


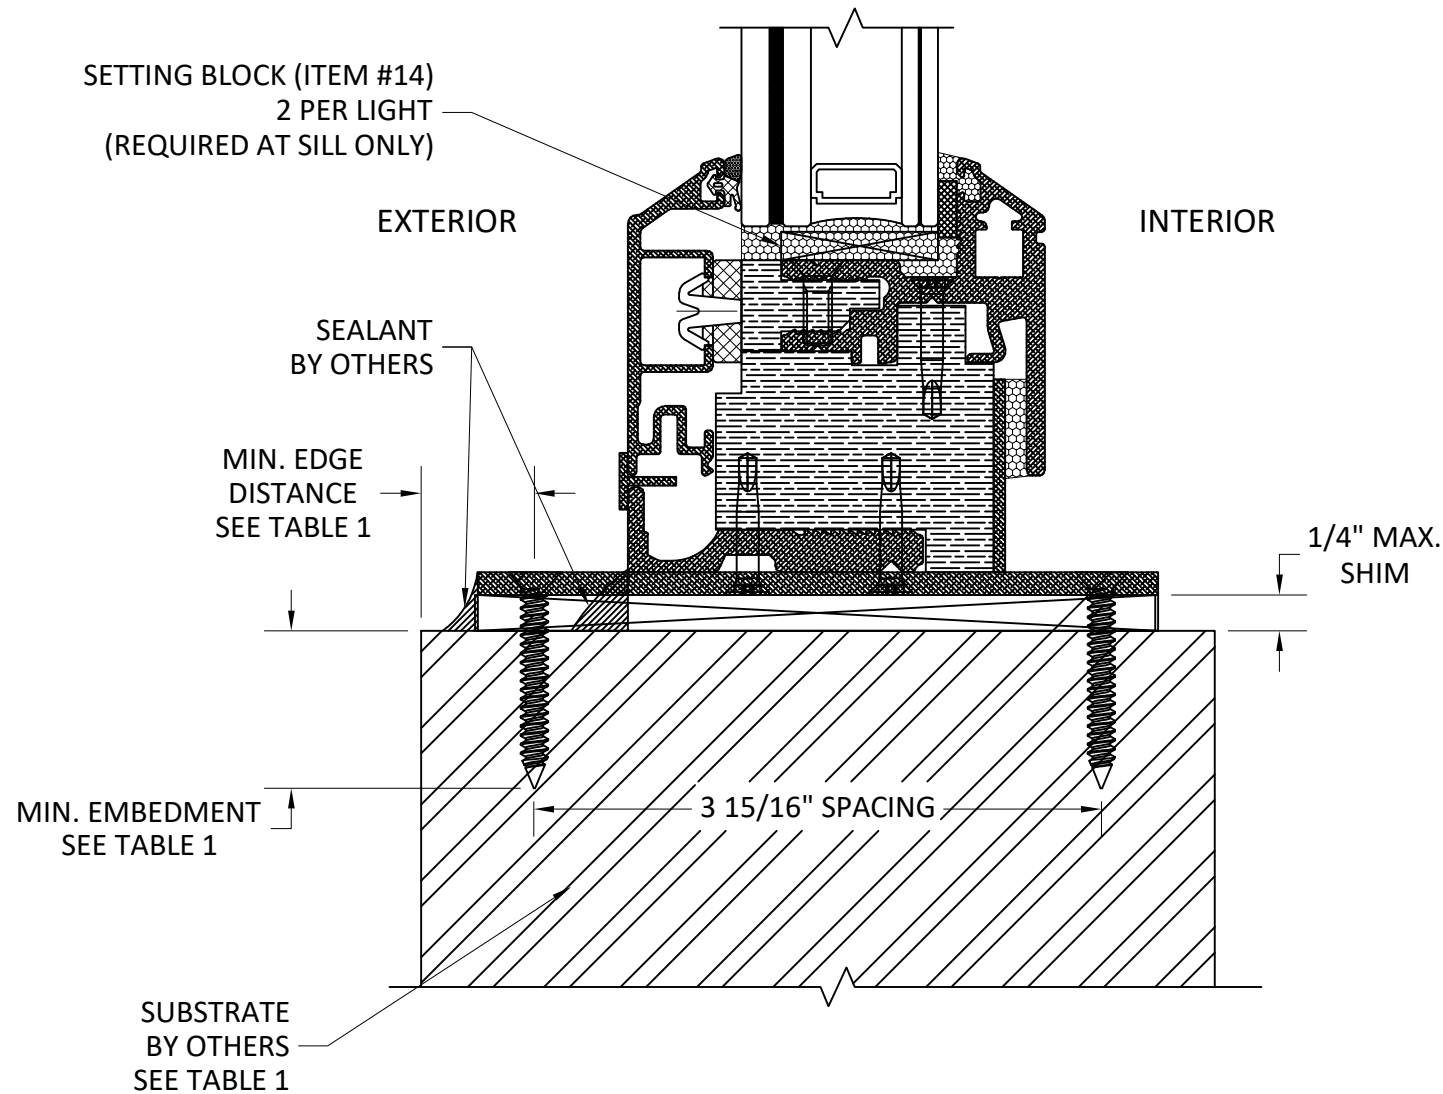

TYPICAL INSTALLATION (SILL/HEAD/JAMB)

TABLE 1. INSTALLATION ANCHORS

SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED	MIN. EDGE DISTANCE
3 KSI MIN. CONCRETE	3/16" DEWALT ULTRACON+	1-3/8"	1"
HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" DEWALT ULTRACON+	1-1/4"	1"
2X MIN. P.T. SOUTHERN PINE (SG=0.55 MIN)	#10 SMS (STEEL OR 18-8 S.S.)	1-3/8"	13/16"
2X MIN. P.T. SOUTHERN PINE (SG=0.55 MIN)	3/16" DEWALT ULTRACON+	1-3/8"	1"
16 GAUGE (0.0566") MIN. STEEL STUD (33 KSI YIELD MIN.)	#10 SMS (STEEL OR 18-8 S.S.)	0.0566"	3/8"

GENERAL ANCHOR NOTES:

- 1.) INSTALL TWO ANCHORS AT EACH LOCATION WITH SPACING SHOWN
- 2.) SHIMS SHALL BE LOAD-BEARING PLASTIC OR METALLIC AND CAPABLE OF TRANSFERRING LOADS TO SUBSTRATE.
- 3.) MINIMUM OF 3 THREADS BEYOND THE METAL SUBSTRATE.
- 4.) SPECIFIED ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND STUCCO OR OTHER WALL FINISH.



COLD MOUNTAIN CUSTOM
Window & Door Distributors LLC

COLD MOUNTAIN CUSTOM
WINDOW AND DOOR
DISTRIBUTORS LLC
266 PEEKSKILL HOLLOW ROAD
PUTNAM VALLEY, NY 10579



8/22/25
ALAN G. KINNE, P.E.
PE#89089

MIX LEGNO GROUP
ALUMINUM FIXED
WINDOW - LMI

PREPARED BY:
KINNE ENGINEERING LLC
523 S MOON DR
VENICE, FL 34292
ALAN@KINNEEC.COM

FLORIDA PRODUCT APPROVAL #

FL# 47725


REV	DATE	DRAWN BY	DESCRIPTION
0	8/22/25	AGK	ORIGINAL ISSUE

DRAWING: CM-PW-FPA-001


SCALE: NTS

DATE: 8/22/25

SHEET: 2 OF 3

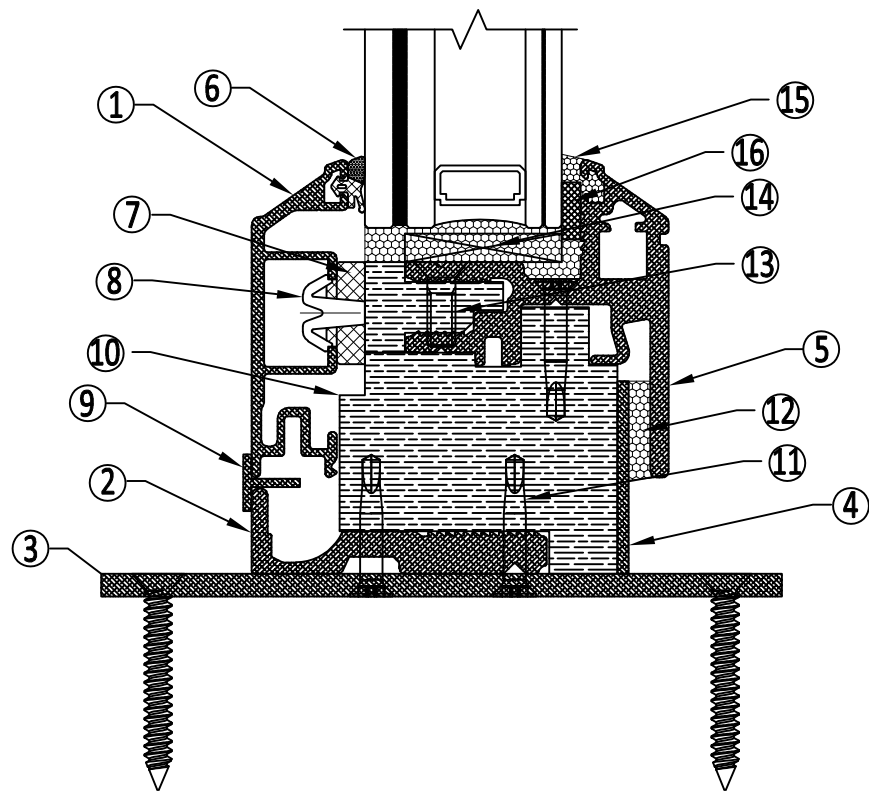


BILL OF MATERIALS			
ITEM #	PART #	DESCRIPTION	MATERIAL
1	11417	BEAD CAP	6060-T5
2	11434	BASE FRAME	6060-T5
3		FIXING PLATE	6060-T5
4		BACKING PLATE	6060-T5
5	11418	SEAT FRAME	6060-T5
6	DE-34-AN	CAP GASKET	EPDM 80 SHA
7		FOAM TAPE	POLYURETHANE
8		CLIP	
9		SNAP CLIP	
10		CARPLYRA	BIRCH/RESIN
11		#8 X 1" FH SCREW	18-8 SS
12		FOAM TAPE	POLYURETHANE
13		5MM X 15MM FH SCREW	18-8 SS
14		70-90 SHORE A DUROMETER SETTING BLOCK	EPDM/NEOPRENE
15		GLAZING SEALANT	TENABOND 124M
16		SEAT FOAM TAPE	EPDM

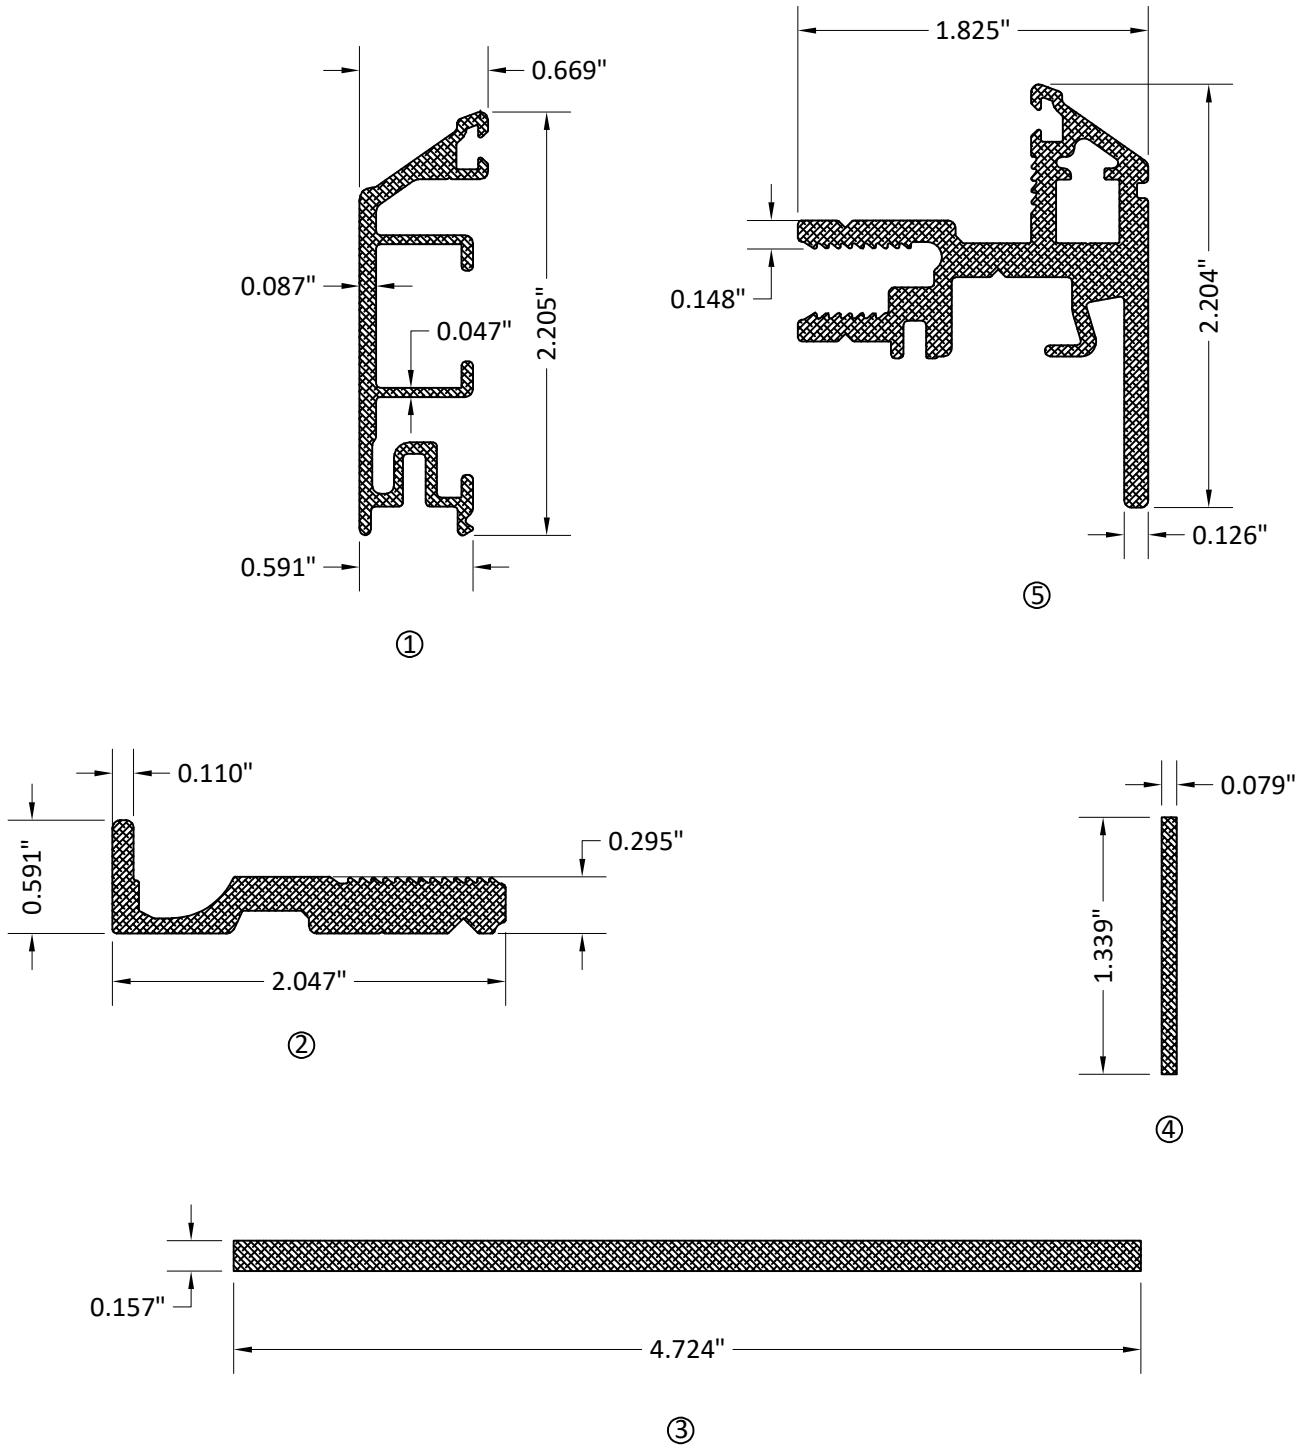



COLD MOUNTAIN CUSTOM
Window & Door Distributors LLC
COLD MOUNTAIN CUSTOM
WINDOW AND DOOR
DISTRIBUTORS LLC
266 PEEKSKILL HOLLOW ROAD
PUTNAM VALLEY, NY 10579

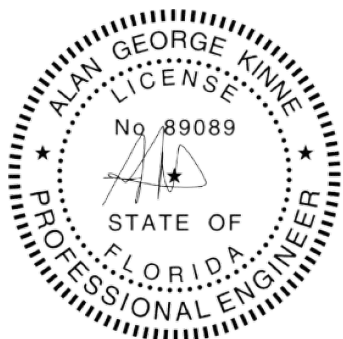

8/22/25
ALAN G. KINNE, P.E.
PE#89089

MIX LEGNO GROUP
ALUMINUM FIXED
WINDOW - LMI

PREPARED BY:
KINNE ENGINEERING LLC
523 S MOON DR
VENICE, FL 34292
ALAN@KINNEEC.COM

FLORIDA PRODUCT APPROVAL #
FL# 47725

REV	DATE	DRAWN BY	DESCRIPTION
0	8/22/25	AGK	ORIGINAL ISSUE

DRAWING: CM-PW-FPA-001

SCALE: NTS

DATE: 8/22/25

SHEET: 3 OF 3