


LEAL GLASS INC.

FX15000 FIXED WINDOW

(HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- AAMA/WDMA/CSA 101/I.S.2/A440-22
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - ASTM E1886-19
 - ASTM E1996-20
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. WINDOW FRAME MATERIAL: ALUMINUM 6060-T66
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

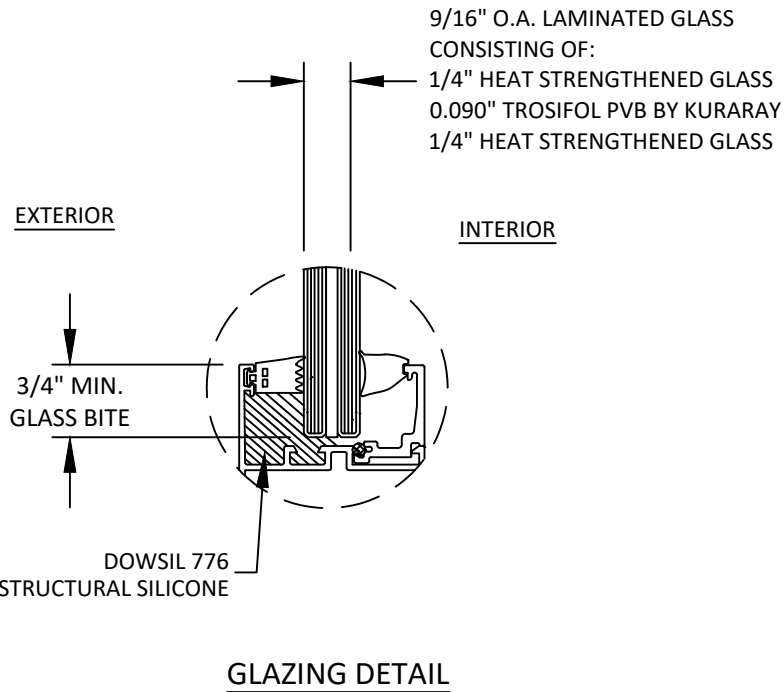

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION AND DESIGN PRESSURE TABLES
3	ANCHOR LAYOUT
4	VERTICAL SECTION
5	HORIZONTAL SECTION
6	ANCHOR DETAILS AND INSTALLATION NOTES
7	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
O	SEE TABLE ON SHEET 2			LARGE & SMALL MISSILE IMPACT



LEAL GLASS INC.
1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305

FX15000
FIXED WINDOW
(HVHZ) (IMPACT)
GENERAL NOTES &
GLAZING DETAIL

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.15 12:22:44 -0400

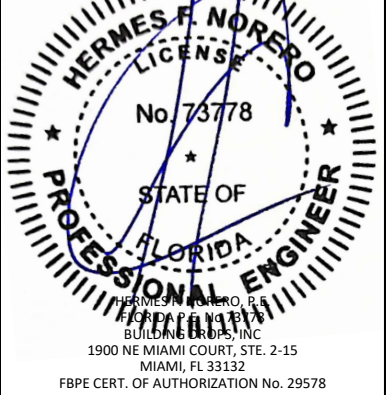

FL #:

FL47737

DATE:

11.22.24

DWG. BY:

DB

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

LLG001

SHEET:

1


REV.

A

OF

7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\leal glass\cc-26-6104 - 2026 code change\dwgs\lf47737\llg001.dwg 7/28/2026 10:51 AM

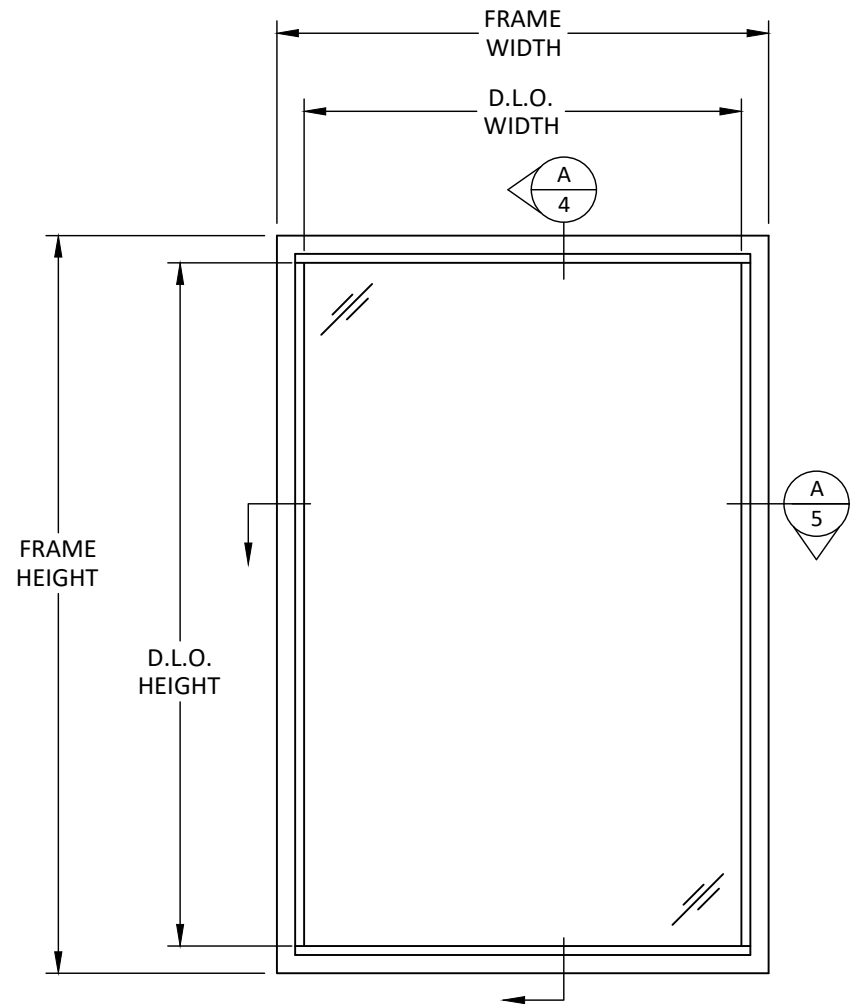


ELEVATION

D.L.O. HEIGHT = FRAME HEIGHT - 4.5625"
D.L.O. WIDTH = FRAME WIDTH - 4.5625"

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		POS. (+)	NEG. (-)
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)		
36	36	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
138		60.0	60.0
144		60.0	60.0
150		60.0	60.0
36	42	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
36	48	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		POS. (+)	NEG. (-)
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)		
36	54	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
36	60	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
36	66	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
72		54.5	54.5
78		54.5	54.5
84		54.5	54.5
90		60.0	60.0
36	72	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		54.5	54.5
72		50.0	50.0

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		POS. (+)	NEG. (-)
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)		
36	78	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		54.5	54.5
36	84	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	90	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	96	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	102	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	108	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	114	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	120	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	126	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	132	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	138	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	144	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0
36	150	60.0	60.0
42		60.0	60.0
48		60.0	60.0
54		60.0	60.0
60		60.0	60.0
66		60.0	60.0

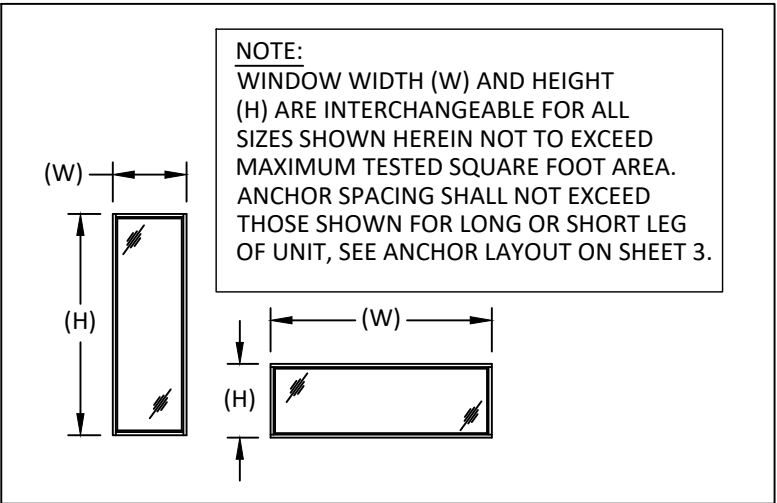

1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305

TITLE:
FX15000
FIXED WINDOW
(H-VHZ) (IMPACT)
ELEVATION & DESIGN
PRESSURE TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47737
DATE:	11.22.24
DWG. BY:	DB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	LLG001
SHEET:	2
REV.	A
OF 7	

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\leal glass\cc-26-6104 - 2026 code change\dwgs\lf47737\llg001.dwg 7/28/2026 10:51 AM

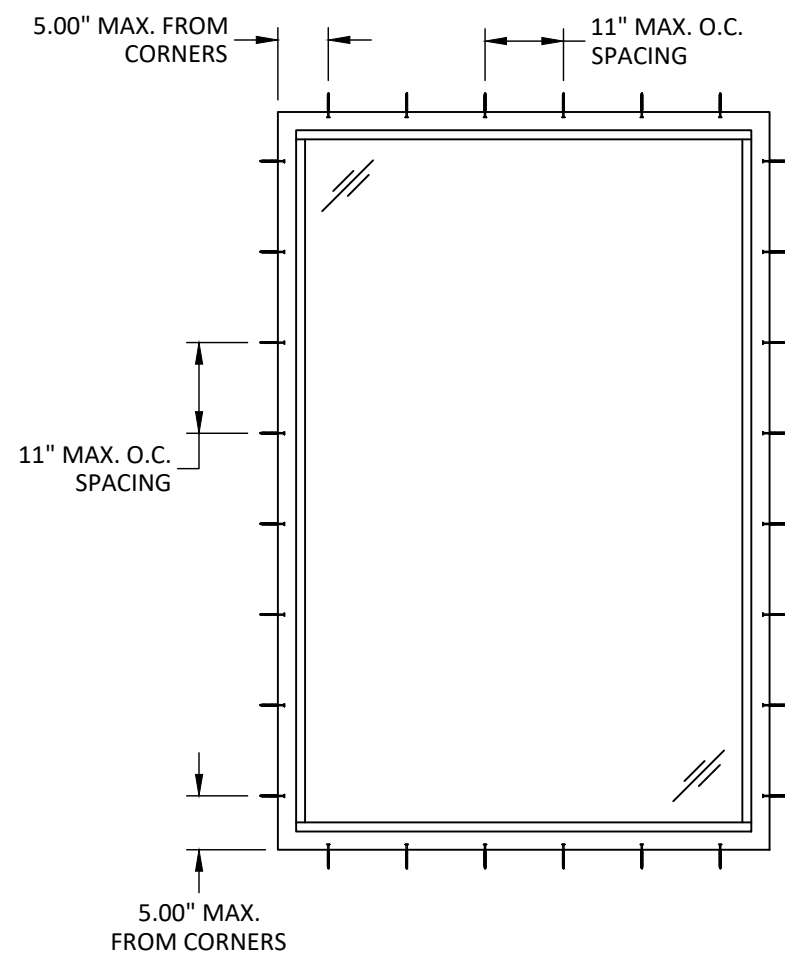

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION



LEAL GLASS INC.
1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305

TITLE:

FX15000
FIXED WINDOW
(H-VHZ) (IMPACT)

ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

**BUILDING DROPS**

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

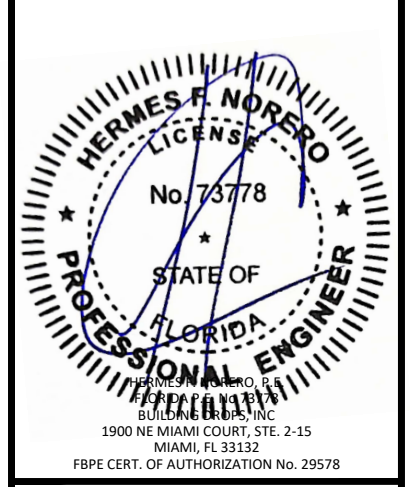

FL #:
FL47737

DATE: **11.22.24**

DWG. BY:
DB

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **LLG001**



SHEET:
3

REV.
A

OF 7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\leal glass\cc-26-6104 - 2026 code change\dwgs\lf47737\lg001.dwg

7/28/2026 10:51 AM

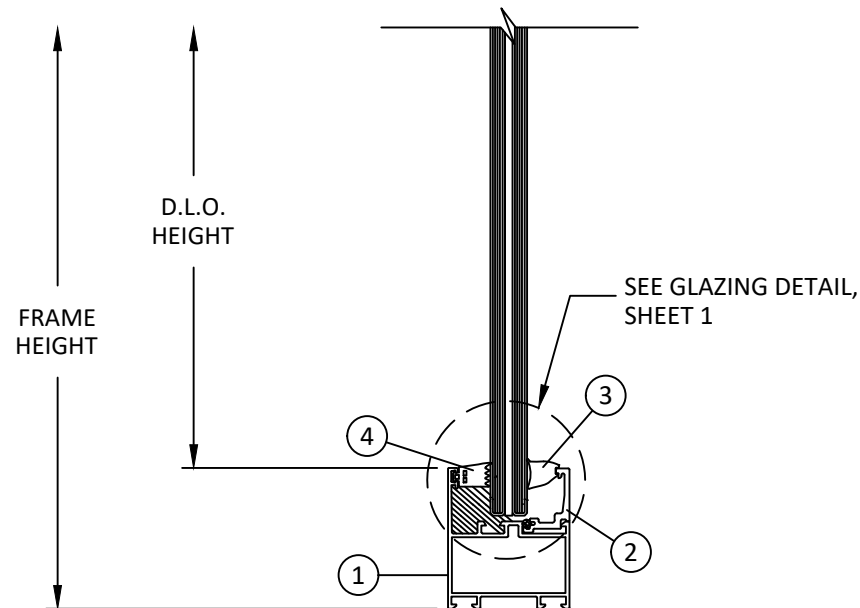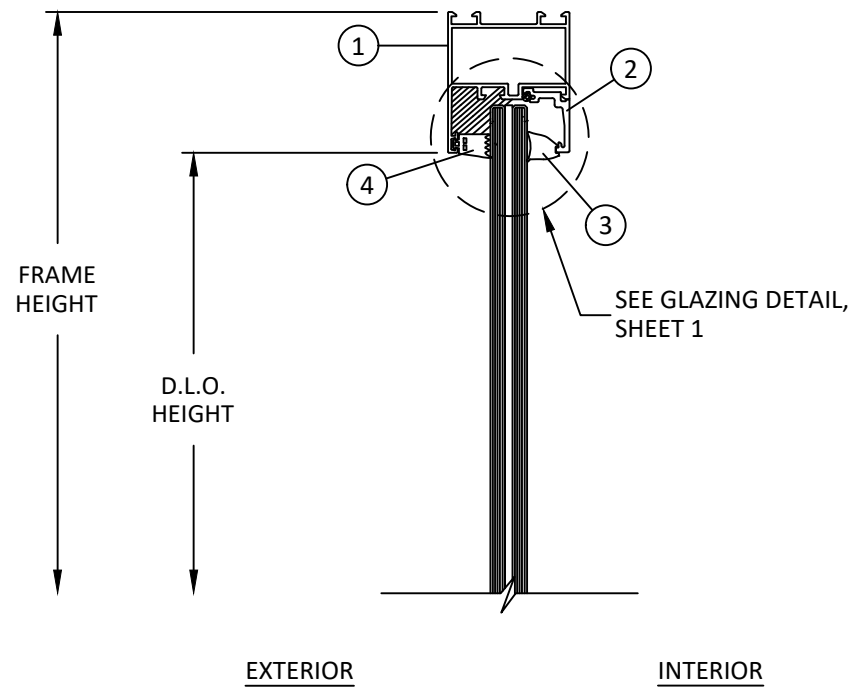

A
4 VERTICAL SECTION



LEAL GLASS INC.
1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305


FX15000
FIXED WINDOW
(H-VHZ) (IMPACT)
VERTICAL SECTION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

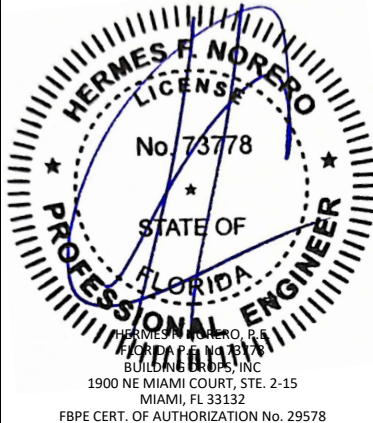

FL #:
FL47737

DATE: **11.22.24**

DWG. BY: DB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **LLG001**

SHEET:	REV.
4	A



1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305

HORIZONTAL SECTION

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

WEB: www.buildingdrops.com



DATE _____

7/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL47737


CHK. BY:
HFN

REV.

A

OF 7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\leal glass\cc-26-6104 - 2026 code change\dwgs\lf47737\llg001.dwg 7/28/2026 10:51 AM

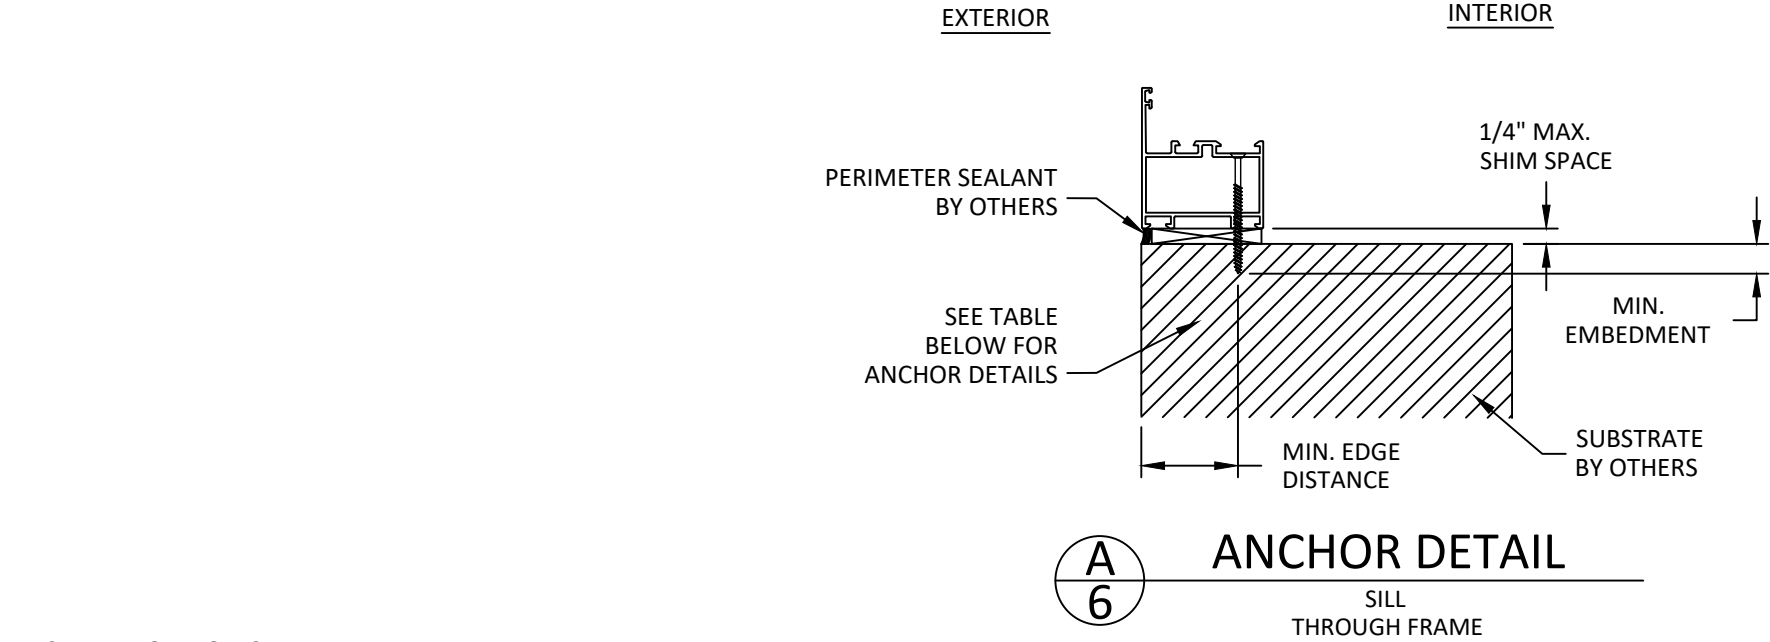

NOTE: JAMB & HEAD SIMILAR

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON	1.00"	2.25"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI			4.00"



LEAL GLASS INC.
1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305


TITLE:
FX15000
FIXED WINDOW
(H-VHZ) (IMPACT)
ANCHOR DETAILS &
INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

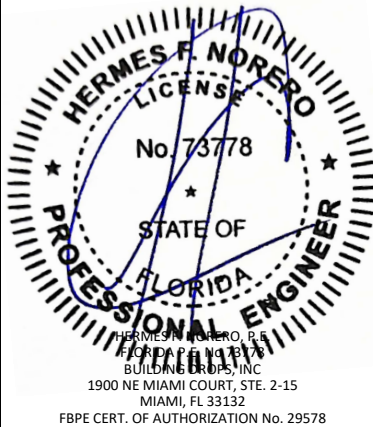

FL #:
FL47737

DATE: 11.22.24

DWG. BY: DB
CHK. BY: HFN

SCALE: NTS





DWG. #: LLG001

SHEET: 6
REV. A

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\leal glass\cc-26-6104 - 2026 code change.dwg(f47737)\lg001.dwg

7/28/2026 10:51 AM

BILL OF MATERIALS			
ITEM	PART NO.	DESCRIPTION	MATERIAL
1	M15010	FRAME	6060-T66
2	M19689	GLAZING BEAD	6060-T66
3	-	GASKET	EPDM
4	200-06-865-03	GASKET	EPDM

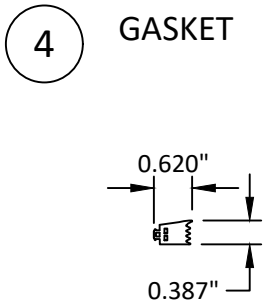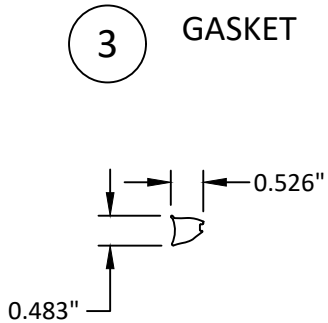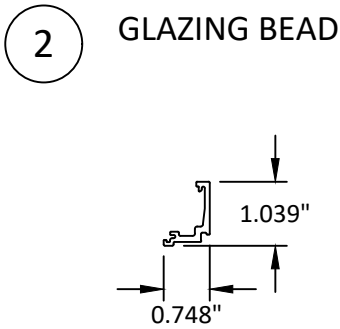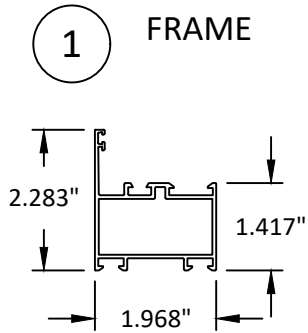



LEAL GLASS INC.
1530 SWEETBAY WAY,
HOLLYWOOD, FL 33019
PH: +1 (305) 842-0305

TITLE:
FX15000
FIXED WINDOW
(H-VHZ) (IMPACT)
BILL OF MATERIALS
& COMPONENTS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

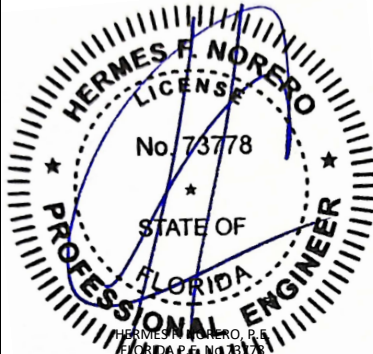

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47737

DATE: **11.22.24**

DWG. BY:
DB

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **LLG001**

SHEET:
7

REV.
A

OF 7