


REYNAERS ALUMINIUM

MASTERLINE 8 AWNING WINDOW

(WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - TAS 201-94
 - TAS 203-94
 - ASTM E1886-13a
 - ASTM E1996-14a
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS.
7. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 4.
8. WINDOW FRAME MATERIAL: ALUMINUM 6060-T66
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

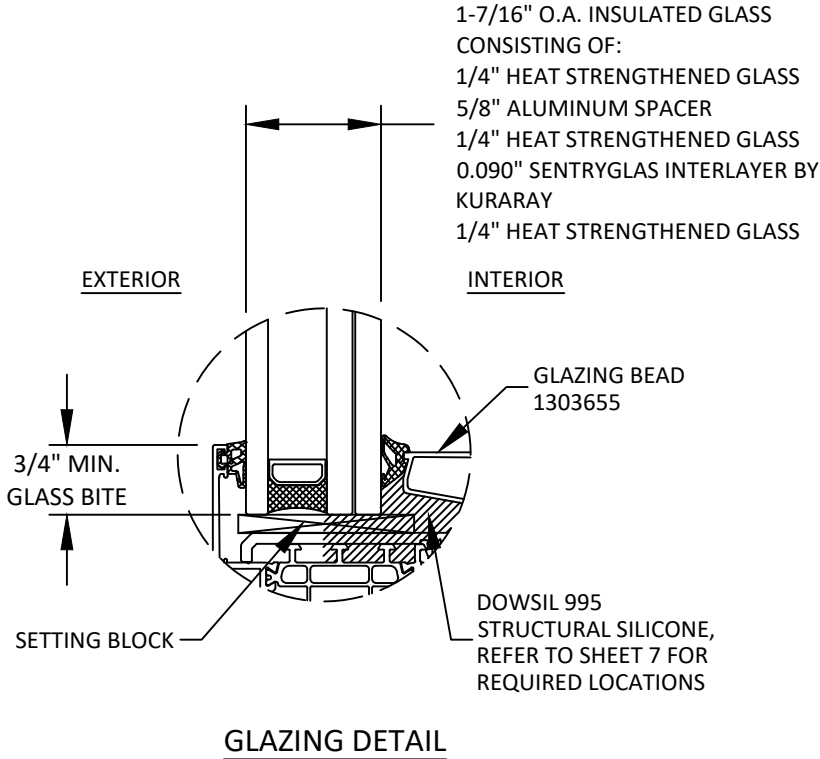

- GLAZING NOTES:
1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36\"/>
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

- HARDWARE NOTE:
- USE SOBINCO CHRONO RC2 WITH FRICTION HINGES AND 060.6362 KEEPER MATCHING MUSHROOM LOCK POINTS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATION & DESIGN PRESSURE TABLE
3	ANCHOR LAYOUTS
4	VERTICAL SECTION
5	HORIZONTAL SECTION
6	STANDALONE MULLION SECTION
7	STRUCTURAL SILICONE LOCATIONS
8	INSTALLATION NOTES & ANCHOR DETAILS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
X	SEE TABLE ON SHEET 2			LARGE & SMALL MISSILE IMPACT



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)

GENERAL NOTES &
GLAZING DETAIL

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.10.13 08:52:42 -04'00'



HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47835

DATE:

08.05.25

DWG. BY:

DB

CHK. BY:

HFN

SCALE:

NTS

DWG. #:


REY004

SHEET:

1

OF 8

c:\users\danielbutrago\building drops, inc.\building drops landing - common\projects\reynaers aluminium\lbc-2-5-0260 - fbc submittal - masterline 8 products - wz3\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

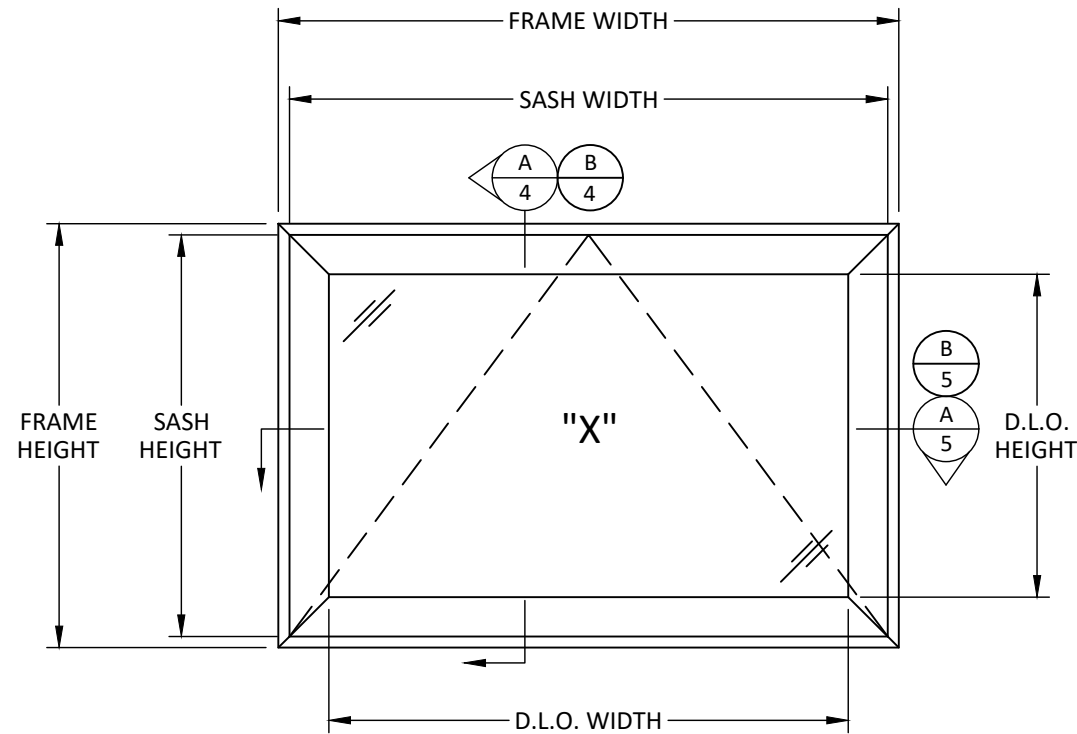

ELEVATION
AWNING WINDOW

SASH 408.0041:

SASH HEIGHT = FRAME HEIGHT - 2.125"
SASH WIDTH = FRAME WIDTH - 2.125"
D.L.O. HEIGHT = FRAME HEIGHT - 9.625"
D.L.O. WIDTH = FRAME WIDTH - 9.625"

SASH 408.1051:

SASH HEIGHT = FRAME HEIGHT - 2.125"
SASH WIDTH = FRAME WIDTH - 2.125"
D.L.O. HEIGHT = FRAME HEIGHT - 11.375"
D.L.O. WIDTH = FRAME WIDTH - 11.375"

DESIGN PRESSURE TABLE (PSF)					
NOMINAL DIMS.		SASH 408.0041		SASH 408.1051	
FRAME HEIGHT (IN.)	FRAME WIDTH (IN.)	POS. (+)	NEG. (-)	POS. (+)	NEG. (-)
18	36	65.0	65.0	65.0	65.0
24		65.0	65.0	65.0	65.0
30		65.0	65.0	65.0	65.0
36		65.0	65.0	65.0	65.0
42		65.0	65.0	65.0	65.0
48		65.0	65.0	65.0	65.0
54	42	-	-	65.0	65.0
18		65.0	65.0	65.0	65.0
24		65.0	65.0	65.0	65.0
30		65.0	65.0	65.0	65.0
36		65.0	65.0	65.0	65.0
42		65.0	65.0	65.0	65.0
48	48	-	-	65.0	65.0
18		65.0	65.0	65.0	65.0
24		65.0	65.0	65.0	65.0
30		65.0	65.0	65.0	65.0
36		65.0	65.0	65.0	65.0
42		-	-	65.0	65.0
18	54	65.0	65.0	65.0	65.0
24		65.0	65.0	65.0	65.0
30		65.0	65.0	65.0	65.0
36		-	-	65.0	65.0
18	60	65.0	65.0	65.0	65.0
24		65.0	65.0	65.0	65.0
30		61.1	61.1	65.0	65.0
18	66	65.0	65.0	65.0	65.0
24		58.0	58.0	65.0	65.0
30		-	-	55.0	55.0
18	72	61.0	61.0	65.0	65.0
24		44.3	44.3	53.6	53.6
18	78	47.6	47.6	57.6	57.6
24		34.6	34.6	41.8	41.8
18	84	37.9	37.9	45.9	45.9
24		-	-	33.3	33.3
18	90	30.7	30.7	37.1	37.1
18	96	25.2	25.2	30.4	30.4
18	102	20.9	20.9	25.3	25.3
18	108	17.5	17.5	21.2	21.2
18	114	-	-	18.0	18.0
18	120	-	-	15.4	15.4



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)
ELEVATION & DESIGN
PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL47835

DATE: **08.05.25**


DWG. BY: **DB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **REY004**

SHEET:
2
OF 8

c:\users\danielbutrago\building drops, inc.\building drops landing - common\projects\reynaers aluminium\lbc-25-0260 - fbc submittal - masterline 8 products - w23\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

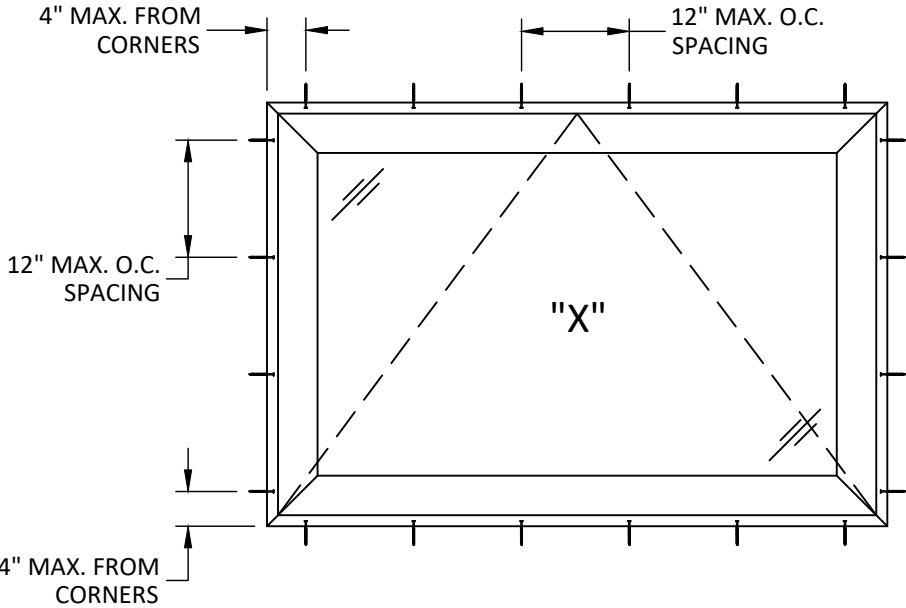

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

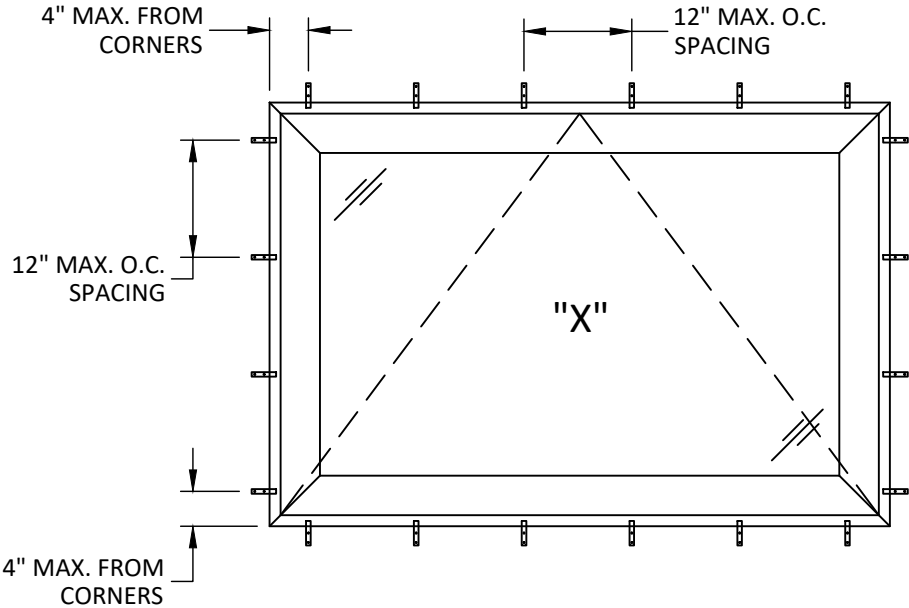

ANCHOR LAYOUT
STRAP INSTALLATION



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM


MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)
ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

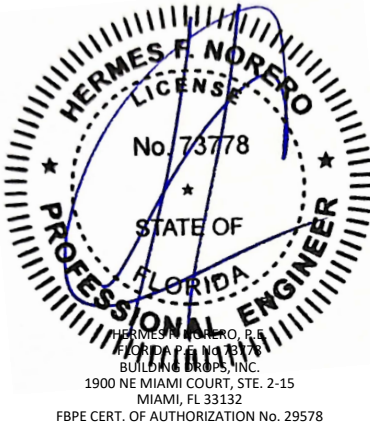

FL #: **FL47835**

DATE: **08.05.25**

DWG. BY: DB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**



DWG. #: **REY004**

SHEET:

3

OF 8

c:\users\danielbutrago\building drops, inc.\building drops landing - common\projects\reynaeers aluminium\lbc-2-5-0260 - fbc submittal - masterline 8 products - wz3\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

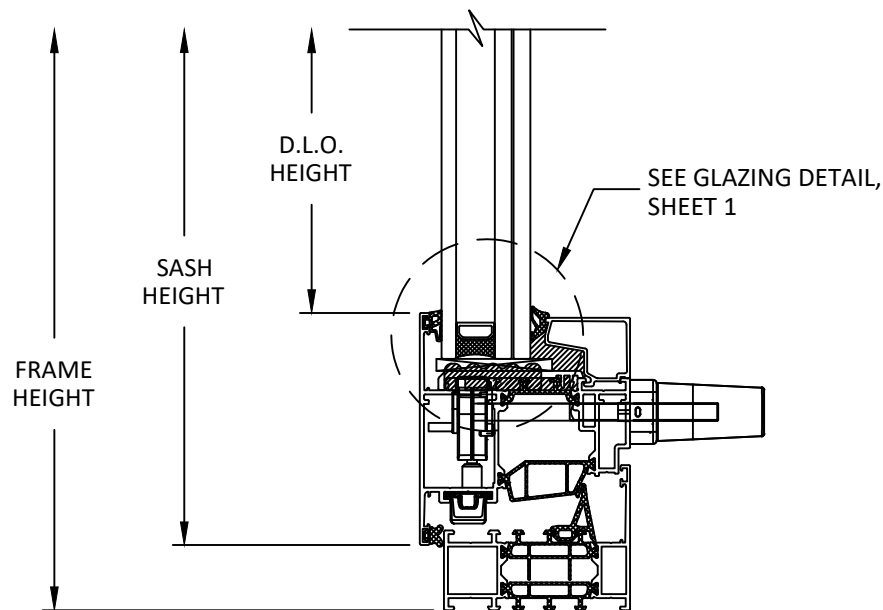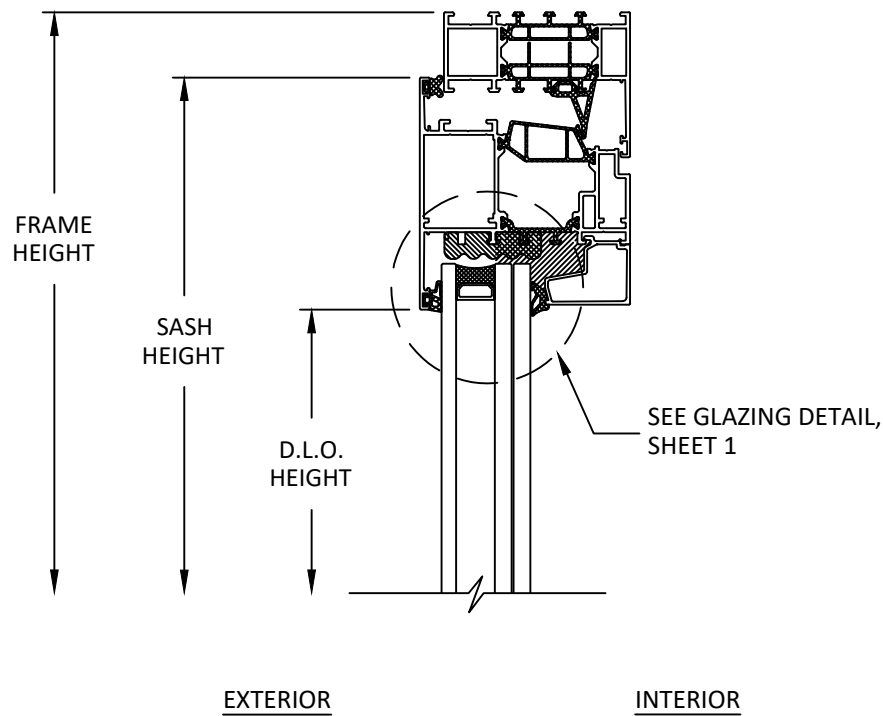

A
4

VERTICAL SECTION

SASH 408.0041

B
4

VERTICAL SECTION

SASH 408.1051



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)

VERTICAL SECTION

TITLE:


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

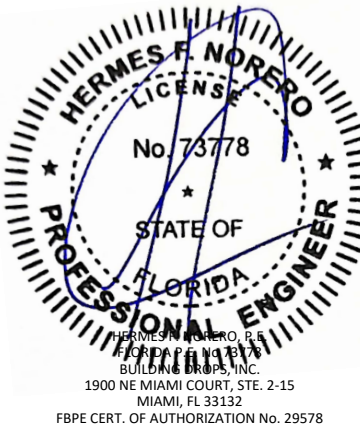


FL #:	FL47835
DATE:	08.05.25
DWG. BY:	CHK. BY:
DB	HFN
SCALE:	NTS
DWG. #:	REY004
SHEET:	

4


OF 8

c:\users\danielbutrago\building drops, inc\building drops landing - common\projects\reynaers aluminium\lbc-2-5-0260 - fbc submittal - masterline 8 products - wz3\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

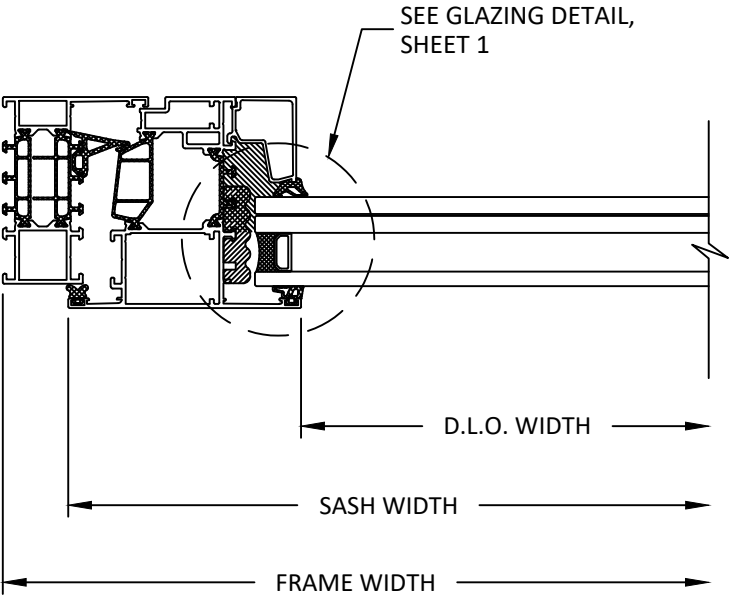


INTERIOR

EXTERIOR

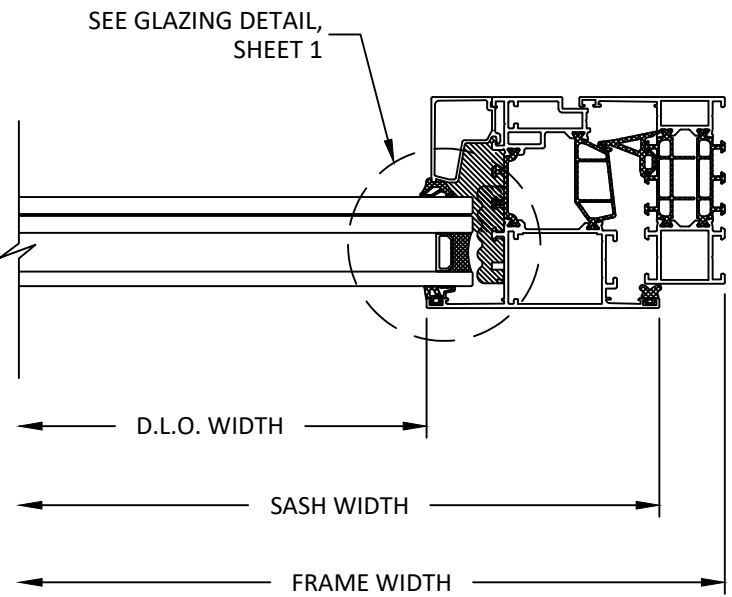


A
5 HORIZONTAL SECTION
SASH 408.0041

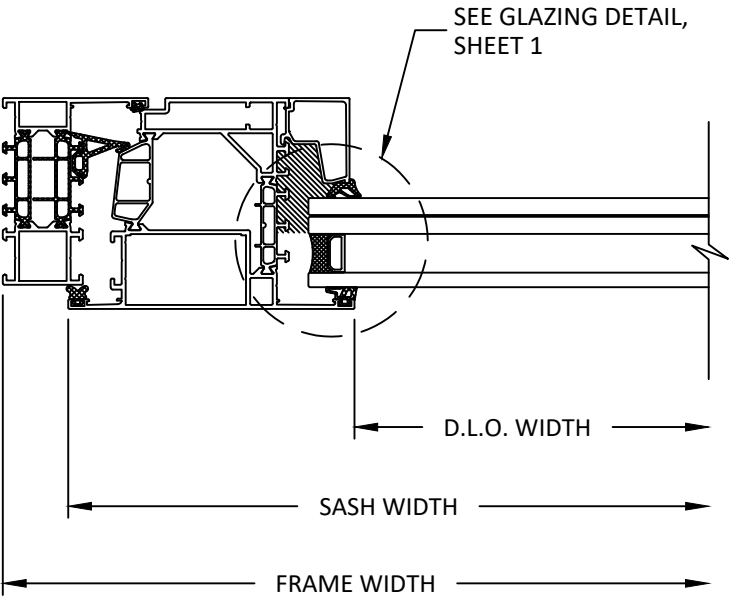

INTERIOR

EXTERIOR

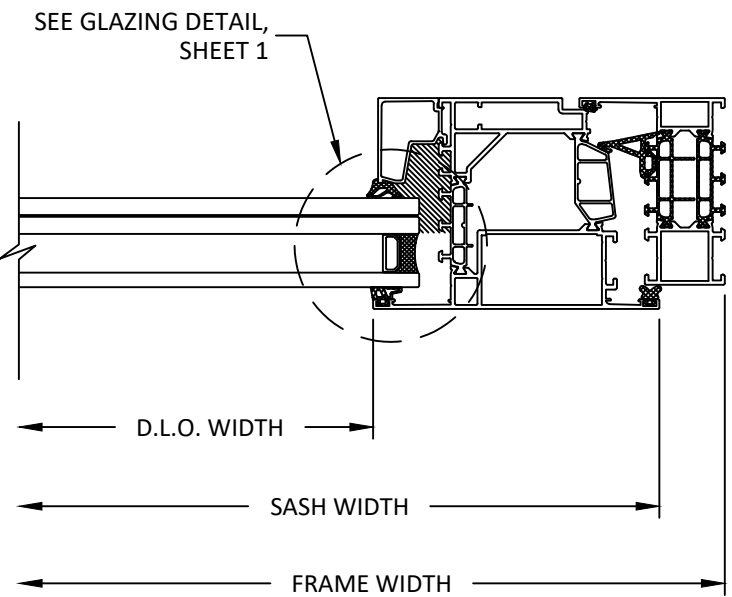

B
5 HORIZONTAL SECTION
SASH 408.1051



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)

HORIZONTAL SECTION

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL47835**

DATE: **08.05.25**

DWG. BY: DB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **REY004**

SHEET:

5

OF 8

c:\users\danielbutrago\building drops, inc\building drops landing - common\projects\reynaeers aluminium\lbc-2-5-0260 - fbc submittal - masterline 8 products - wz3\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

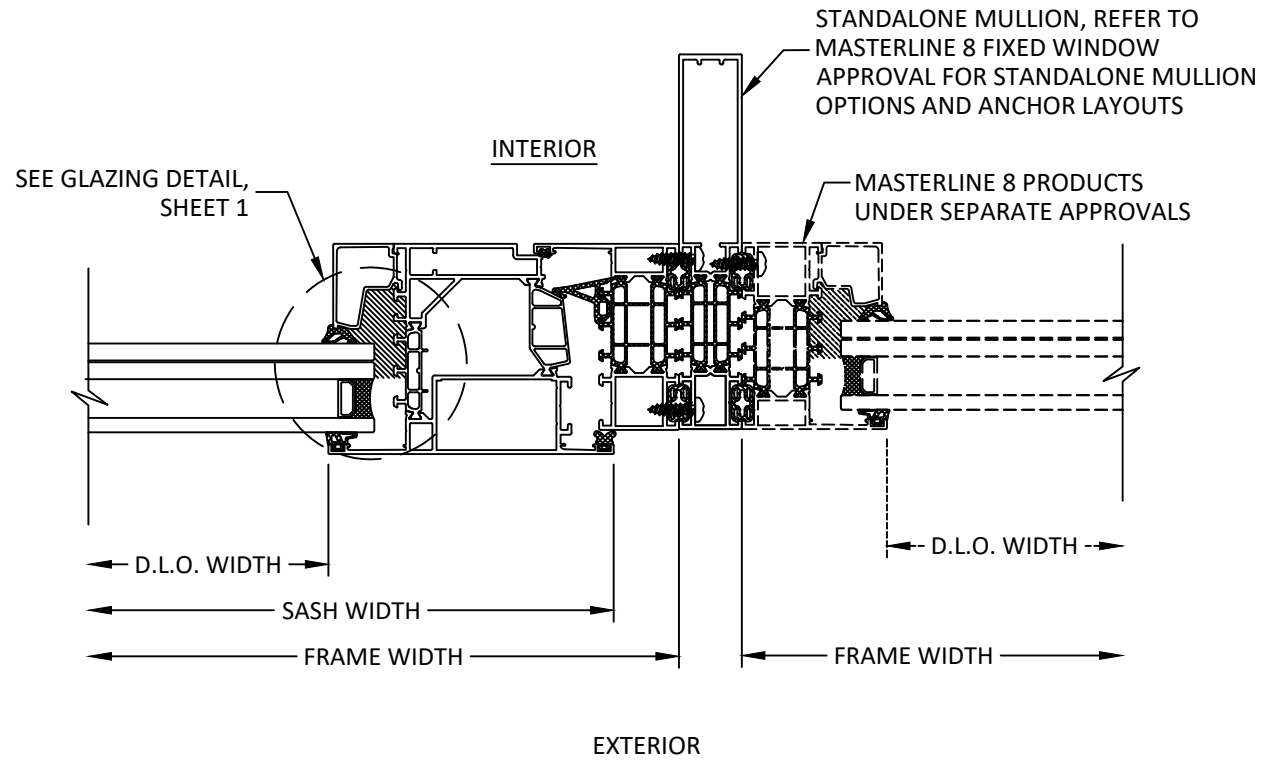

A
6 **HORIZONTAL SECTION**
STANDALONE MULLION

NOTE: THE STANDALONE MULLIONS MENTIONED IN THE MASTERLINE 8 FIXED WINDOW APPROVAL ARE ONLY APPLICABLE TO THE FOLLOWING MASTERLINE 8 PRODUCTS:

- FIXED
- TILT & TURN AND TURN & TILT
- CASEMENT
- AWNING
- TERRACE SIDE HINGED DOOR
- ENTRANCE SIDE HINGED DOOR

THESE PRODUCTS CAN BE COMBINED AND PLACED IN ANY CONFIGURATION. THE MASTERLINE 8 PRODUCTS CAN BE FOUND UNDER SEPARATE APPROVALS. UNITS LIMITED BY TABLES SHOWN ON FIXED WINDOW APPROVAL AND BY TABLES SHOWN ON THEIR RESPECTIVE APPROVALS.



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)

STANDALONE MULLION SECTION

TITLE:

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

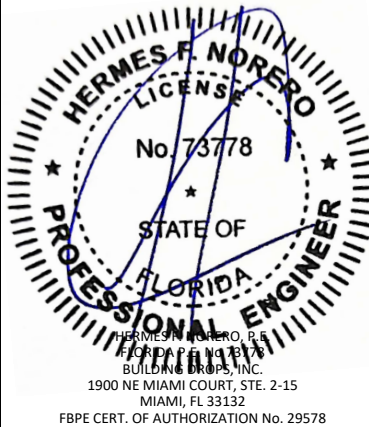

FL #:
FL47835

DATE: **08.05.25**

DWG. BY: **DB** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **REY004**


SHEET:

6

OF 8

c:\users\danielbutrago\building drops, inc\building drops landing - common\projects\reynaers aluminium\lbc-2-5-0260 - fbc submittal - masterline 8 products - wz3\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

STRUCTURAL SILICONE LOCATIONS FOR MASTERLINE 8 PRODUCTS

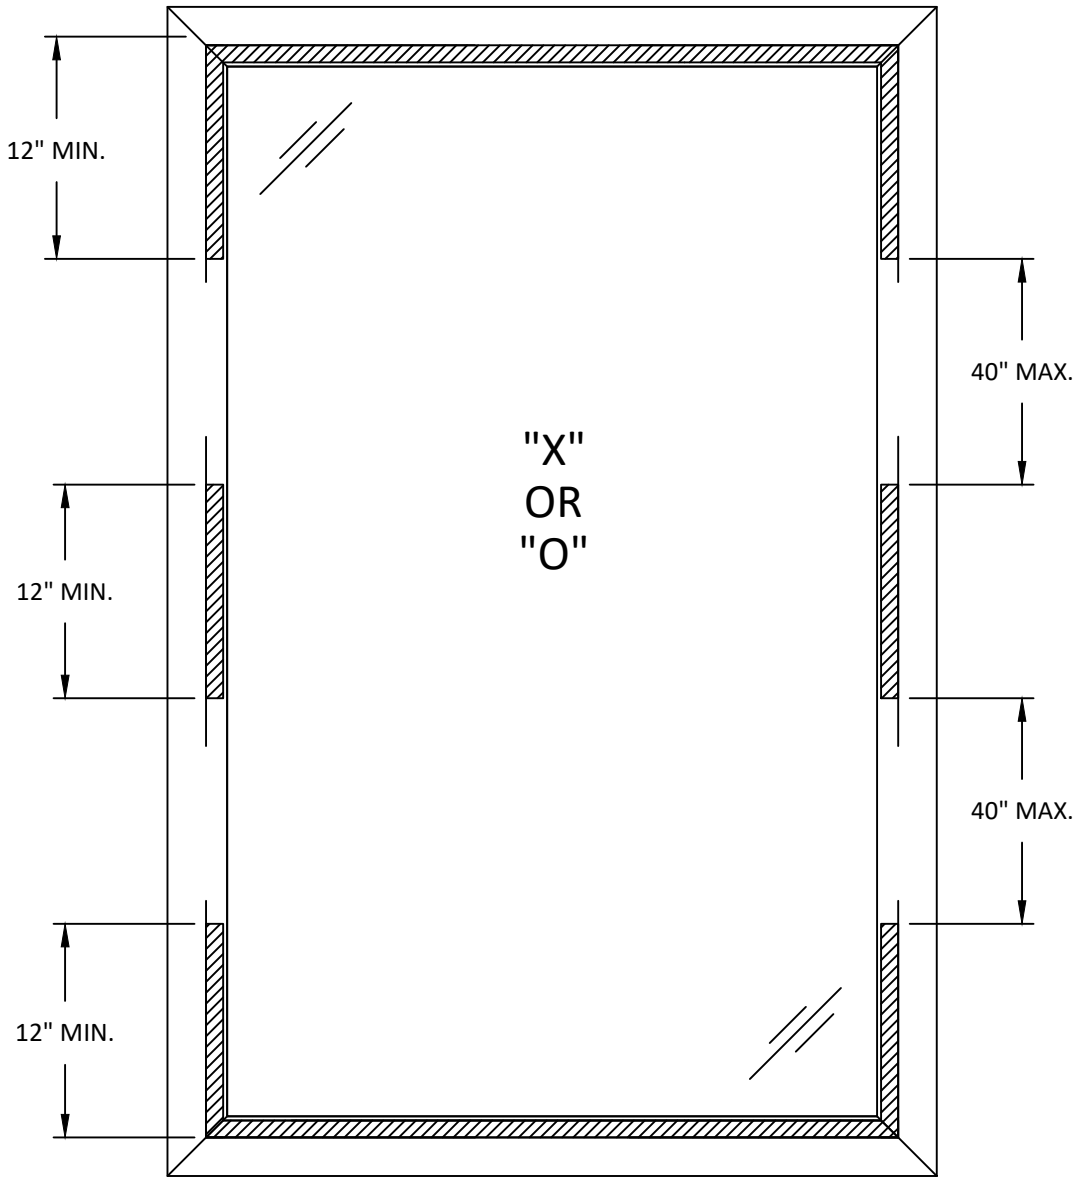

 = DOWSIL 995 STRUCTURAL SILICONE APPLICATION



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

TITLE:

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)

STRUCTURAL SILICONE LOCATIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

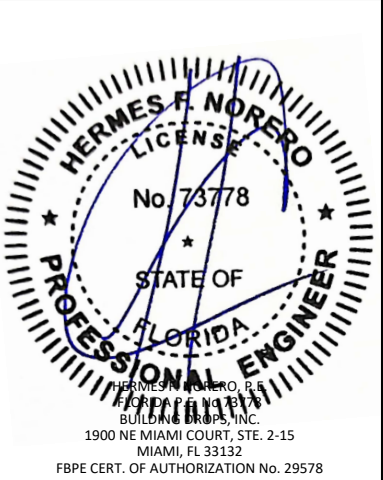

FL #:
FL47835

DATE: **08.05.25**


DWG. BY: **DB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **REY004**

SHEET:

c:\users\danielbutrago\building drops, inc.\building drops landing - common\projects\reynaeers aluminium\lbc-2-5-0260 - fbc submittal - masterline 8 products - wz3\dwgs\awning\rey004.dwg 10/14/2025 5:53 PM

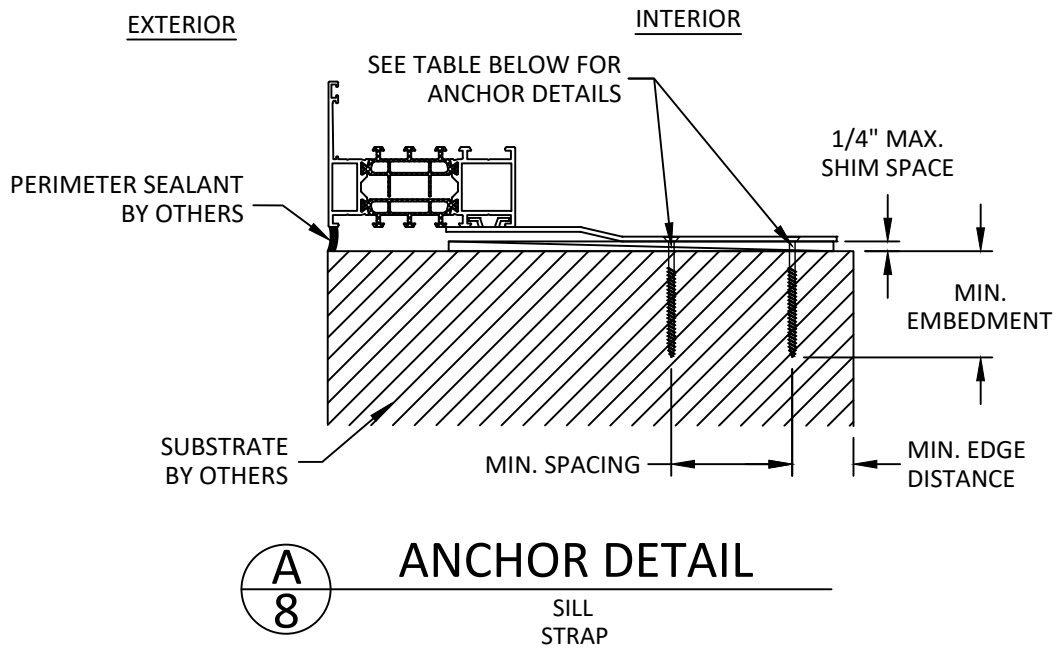

NOTE: JAMB & HEAD SIMILAR

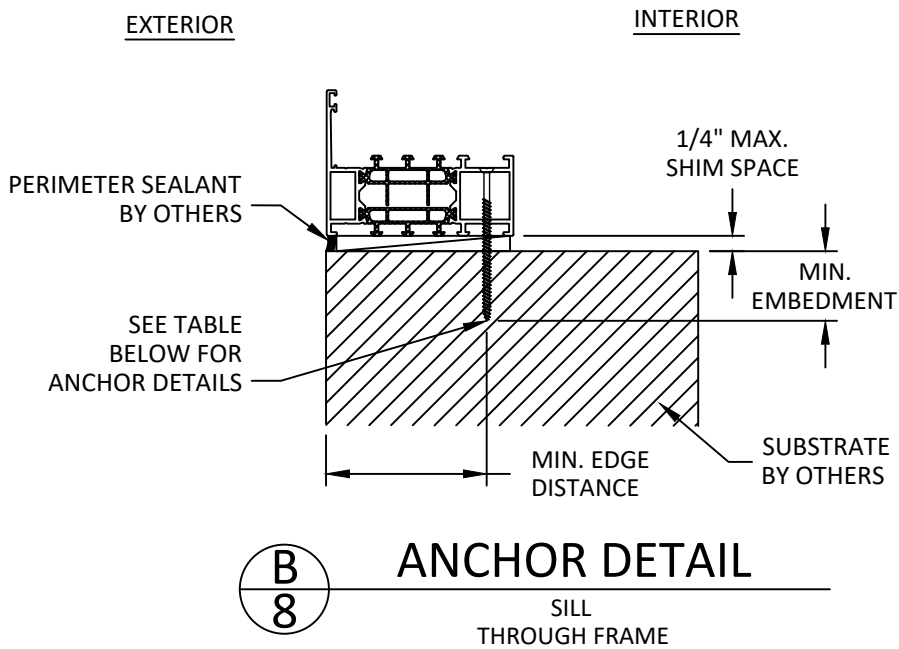

NOTE: JAMB & HEAD SIMILAR

INSTALLATION NOTES:

- FOR STRAP INSTALLATION, TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN. FOR THROUGH FRAME INSTALLATION, ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE	MIN. SPACING
STRAP AND THROUGH FRAME	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE WALL	0.50"	0.75"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON	1.00"	3.00"	1.75"
	MASONRY: CMU PER ASTM C90 MIN. 2000 PSI				



2115 REXFORD ROAD, SUITE 215
CHARLOTTE, NC 28211
EMAIL: INFO.N-A@REYNAERS.COM

MASTERLINE 8
AWNING WINDOW
(WZ3) (IMPACT)

INSTALLATION NOTES
& ANCHOR DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL47835**

DATE: **08.05.25**

DWG. BY: **DB**

CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **REY004**

SHEET:

8

OF 8