

WEILAND SLIDING DOORS AND WINDOWS, INC.

ALS LIFT AND SLIDE DOOR (HVHZ)(IMPACT)

GENERAL NOTES:

1.

THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - ASTM E1886-13a
 - ASTM E1996-14a
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2.

ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3.

1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4.

INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6.

APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7.

DOOR FRAME MATERIAL: ALUMINUM
8.

GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 2 FOR GLAZING DETAIL.
9.

DESIGNATIONS "X", "O", "P" & "W" STAND FOR THE FOLLOWING:

X:

OPERABLE PANEL

O:

FIXED PANEL

P:

POCKET ("P"s MAY BE REPLACED BY INTERIOR WALLS)

W:

WALL
10.

APPROVED CONFIGURATIONS INCLUDE:

1 TRACK

- PX-XP, PX, XP, O

2 TRACK

- PXX-XXP, OX-XXP, PXX-XO, PXX, XXP, OX-XO, OX, XO, OXO, XO-O-OX, O-O-O

3 TRACK

- PXXX, XXXP, XXO, XOX, OXX, PXXX-XXXP, OXX-XXO, PXXX-XXO, OXX-XXXP

4 TRACK

- PXXXX, XXXXP, OXXX, XXO, PXXXX-XXXXP, OXXX-XXXO, PXXXX-XXXO, OXXX-XXXXP

5 TRACK

- XXXXXP, PXXXXX, OXXXX, XXXXO, PXXXXX-XXXXXP, OXXXX-XXXXO, PXXXXX-XXXO, OXXXX-XXXXXP

- ANY NUMBER OF "O" PANELS TO NOT EXCEED THE OVERALL MAX. SYSTEM WIDTHS.

- UNLIMITED NUMBER OF TRACKS OR PANELS MAY BE USED SUCH THAT MAXIMUM OVERALL WIDTHS AS SPECIFIED ON SHEETS 3 - 6 ARE NOT EXCEEDED.

- "X" PANELS IN THE ABOVE CONFIGURATIONS MAY BE REPLACED BY "O" PANELS EXCEPT WHEN NEXT TO A "P".

- POCKETS (P) MAY BE REPLACED BY INTERIOR WALLS (W).

- "O" PANELS MAY BE REPLACED BY "X" PANELS.

- CONFIGURATIONS USING 90 DEGREE CORNER MAY UTILIZE ABOVE TRACK CONFIGURATION OPTIONS SUCH THAT MAXIMUM SIZE LISTED ON SHEET 6 IS NOT EXCEEDED.

- CUSTOM CONFIGURATIONS AVAILABLE UPON REQUEST.


- ANY INTERLOCK CONDITION CAN BE REPLACED BY A MEETING STILE CONDITION.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	GLAZING DETAILS
3	ELEVATION
4	ELEVATION
5	ELEVATIONS
6	DESIGN PRESSURE TABLE
7	ANCHOR LAYOUT
8	ANCHOR LAYOUT
9	ANCHOR LAYOUTS
10	VERTICAL SECTIONS
11	VERTICAL SECTIONS
12	HORIZONTAL SECTIONS
13	HORIZONTAL SECTIONS & VERTICAL SECTION
14	HORIZONTAL SECTIONS
15	ANCHOR DETAILS & INSTALLATION NOTES
16	ANCHOR DETAILS
17	ANCHOR DETAILS
18	ANCHOR DETAILS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
SEE SHEETS 3 - 6				LARGE & SMALL MISSILE IMPACT

- NOTE:
1.

FOR "XXX" UNITS, OPERABLE PANELS (X) ON EXTERIOR EXPOSED TRACK, OR EXTERIOR STACKING CONFIGURATIONS, UNITS SHALL BE INSTALLED WHERE LOCATION OVERHANG (OH) IS EQUAL TO OR MORE THAN 1. OVERHANG (OH) RATIO = OH LENGTH ÷ OH HEIGHT IS ≥1.0,



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.


1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.07.30 19:17:34 -0400

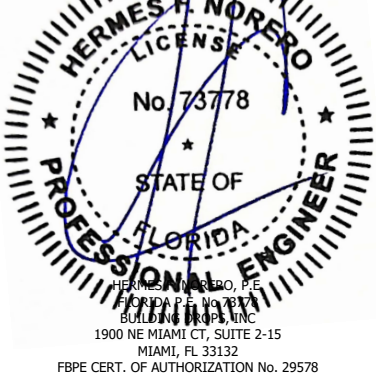

FL #:

FL47871

DATE:

07.30.25

DWG. BY:

HJ

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

WSD015

SHEET:

1

OF 18

ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

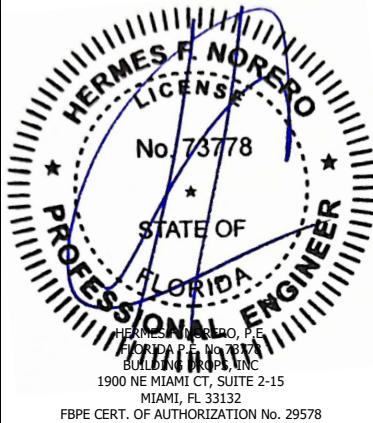

FL #:

FL47871

DATE: 07.30.25

DWG. BY:
HJ

CHK. BY:
HFN




SCALE: NTS

DWG. #: WSD015

SHEET:

2

OF 18

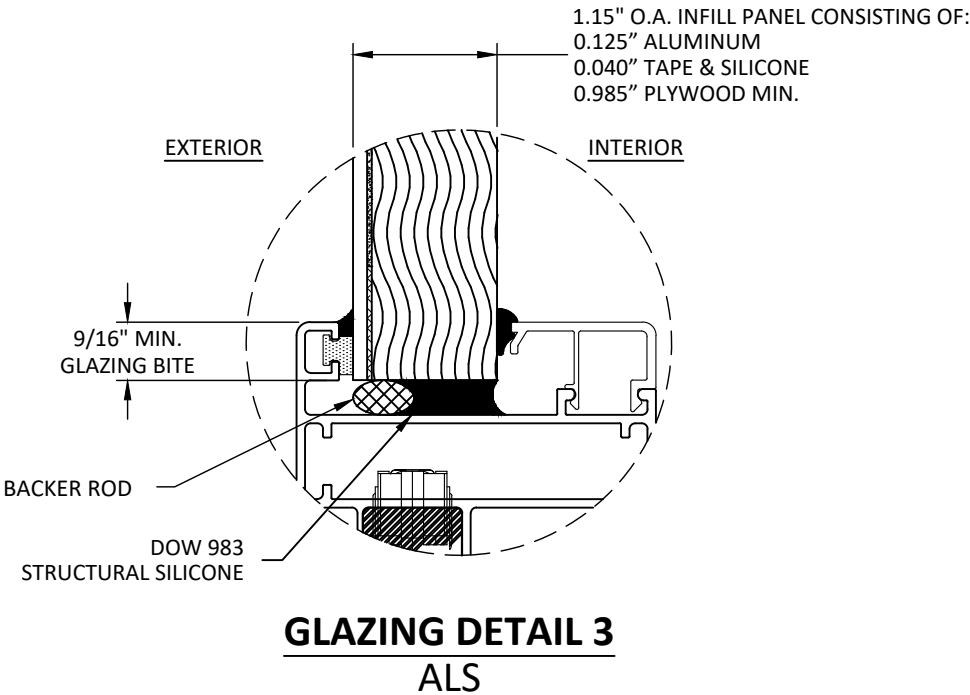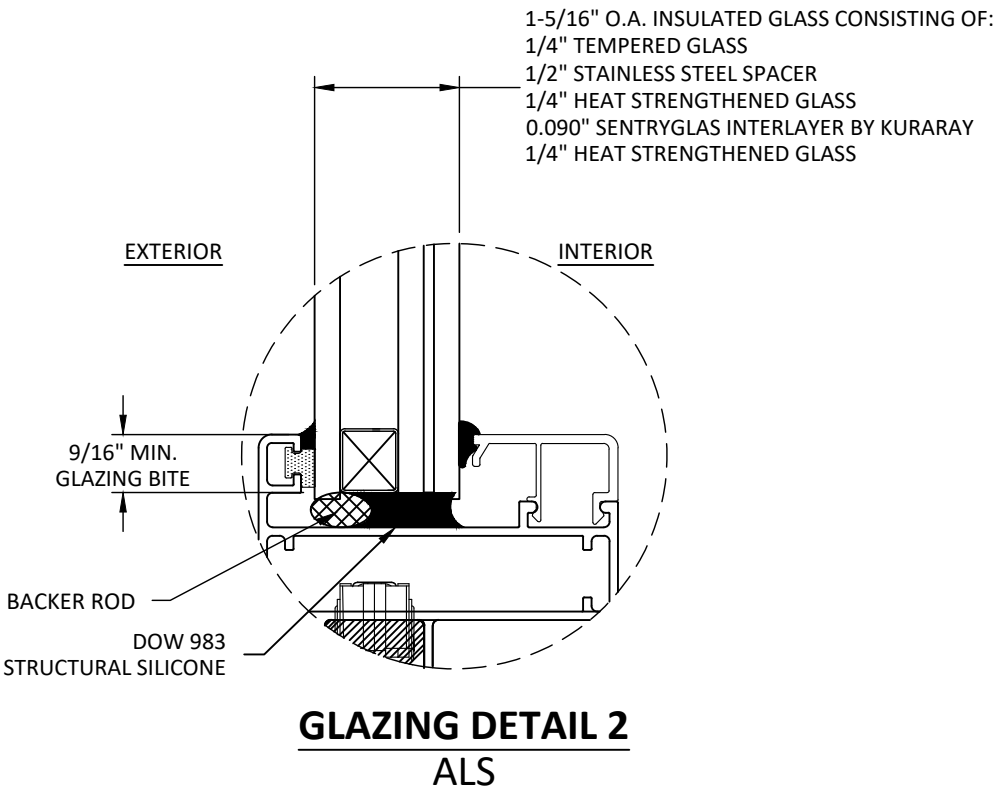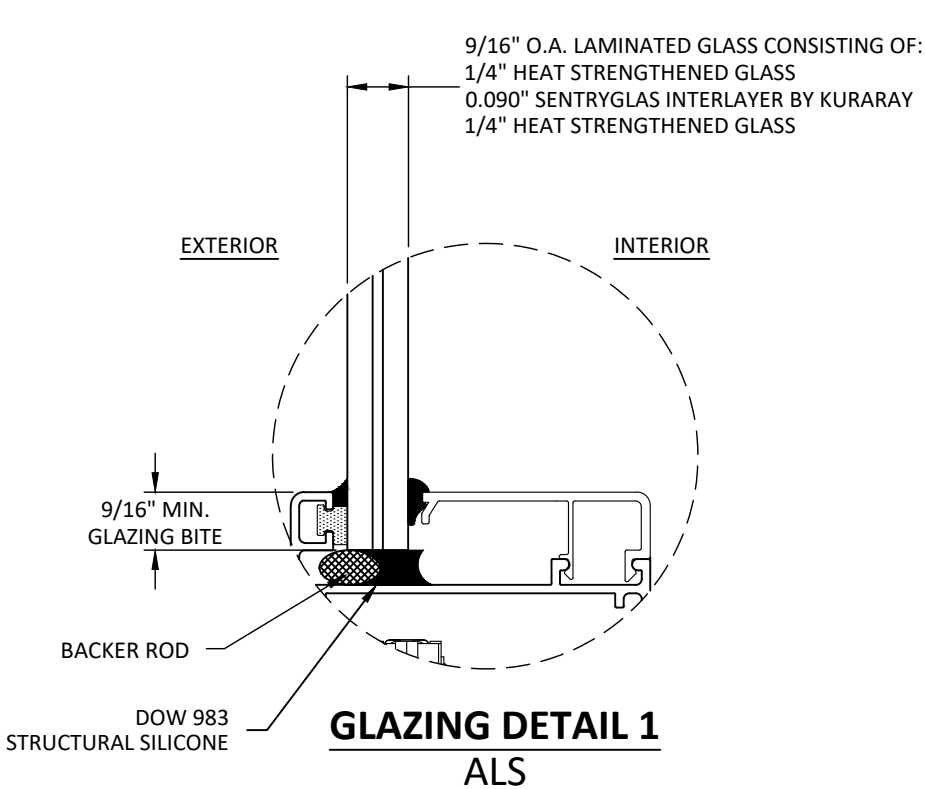

GLAZING NOTES:

- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.I.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.
- DOW 983 AND DOW 995 APPROVED AS SEALANTS TO BE USED FOR GLAZING (FILLET BEAD).

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

ELEVATION


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

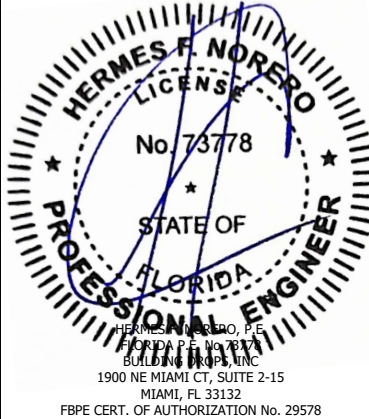

FL #:

FL47871

DATE: **07.30.25**

DWG. BY:
HJ

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **WSD015**

SHEET:

4


OF 18

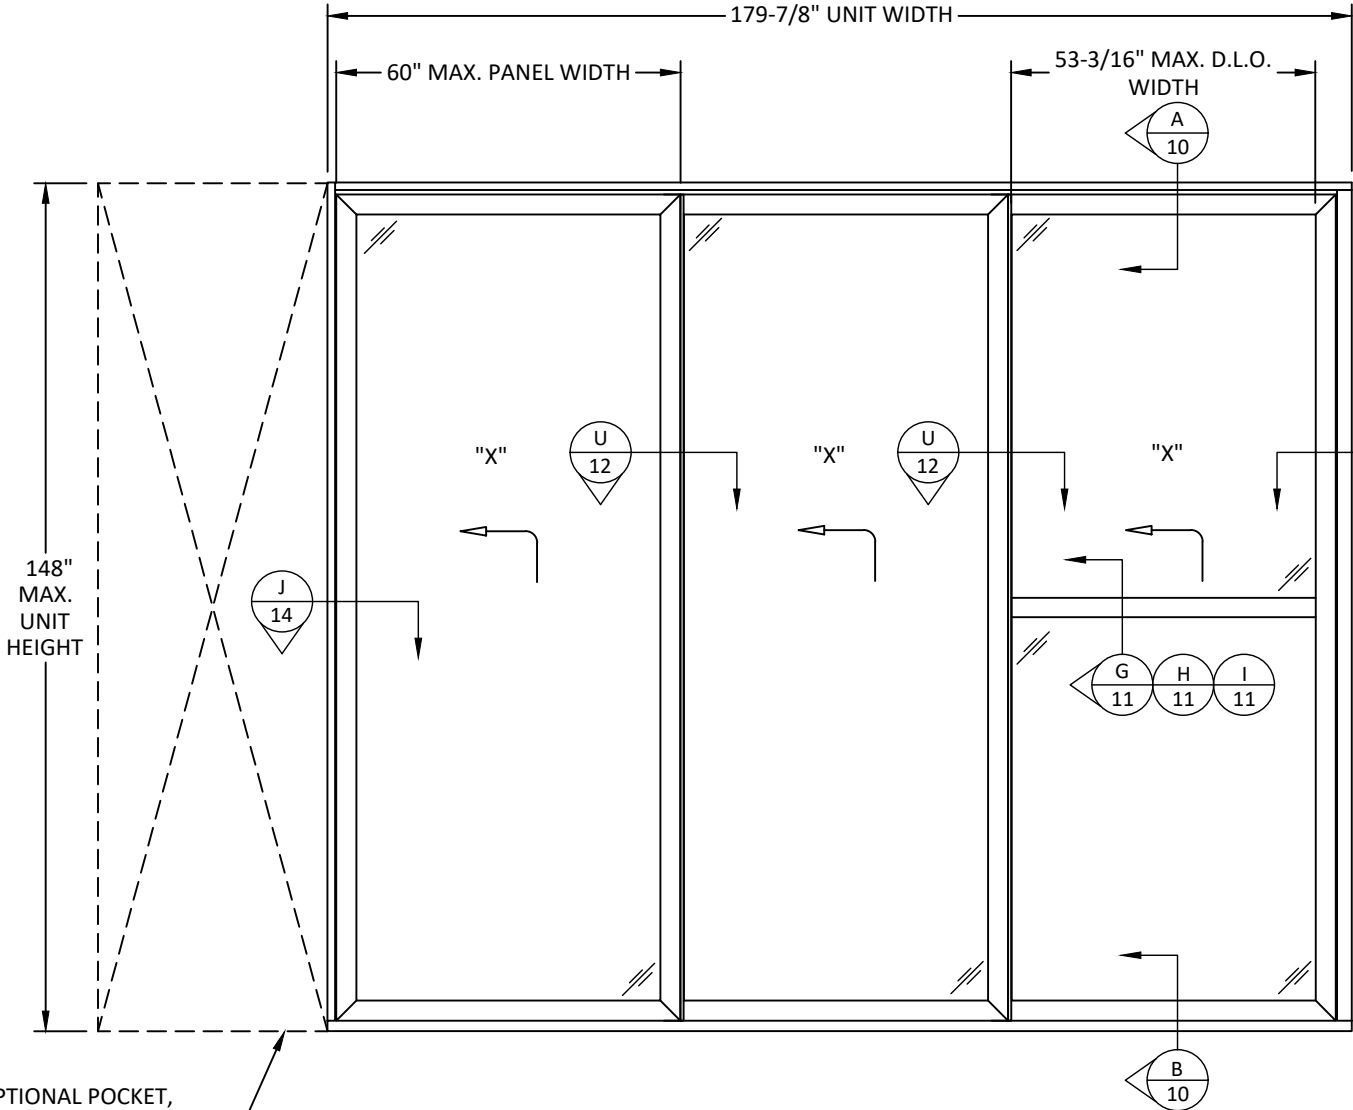

ELEVATION

90° CORNER
PXXX-XO

90°

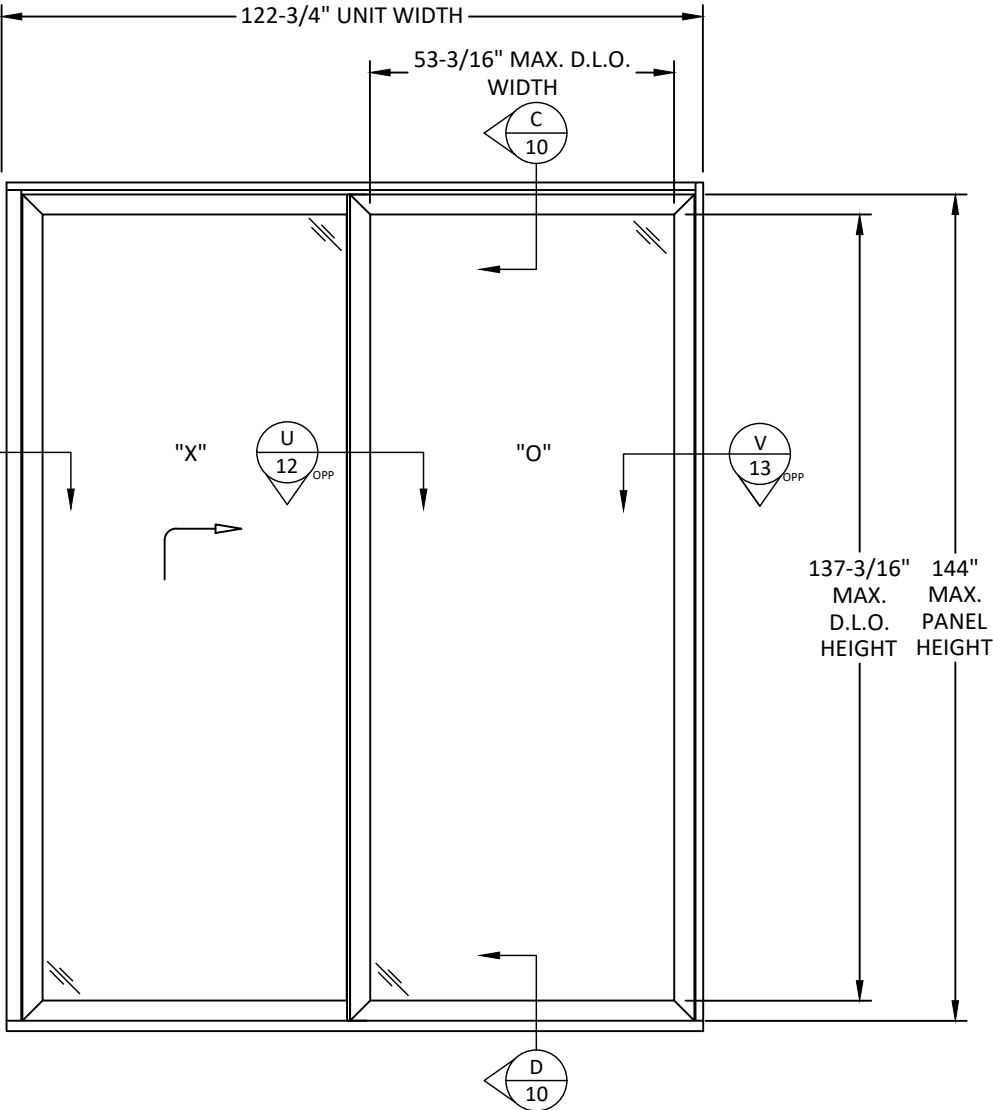

NOTES:

- 1) MAX. O.A. UNIT WIDTH = 528.47" (TESTED WIDTH x 1.5) SUCH THAT MAXIMUM PANEL DIMENSIONS SHOWN ON SHEET 6 IS NOT EXCEEDED.
- 2) DOOR SHALL USE SHOOT BOLT LOCKING HARDWARE BY WEILAND AT INTERLOCK STILES, MEETING STILES, AND CORNER STILES INTO THE HEAD AND SILL.
- 3) DOOR SHALL USE LIFT AND SLIDE HARDWARE BY GU.
- 4) SEE SHEET 6 FOR DESIGN PRESSURES BASED ON PANEL SIZE.
- 5) POCKET (P) OR WALL (W) CONDITIONS MAY BE USED AT EITHER SIDE OR BOTH SIDES OF 90 DEGREE CORNER DOOR ASSEMBLY.

ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

ELEVATIONS

PREPARED BY: BUILDING DROPS, INC.

PH: (954) 399-8478
FAX: (954) 744.4738
WEB: www.buildingdrops.com




TITLE:

REMARKS
DP TABLE 1

Y	DATE
H	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

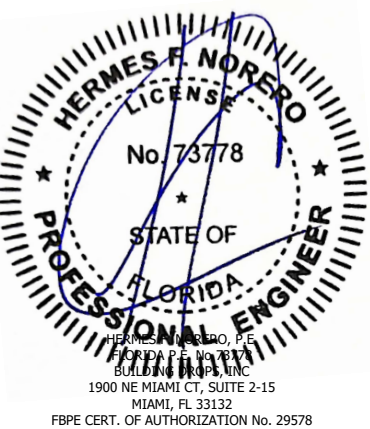

FL #: **FL47871**

DATE: 07.30.25

DWG. BY: HJ	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: WSD015

SHEET:

5

OF 18

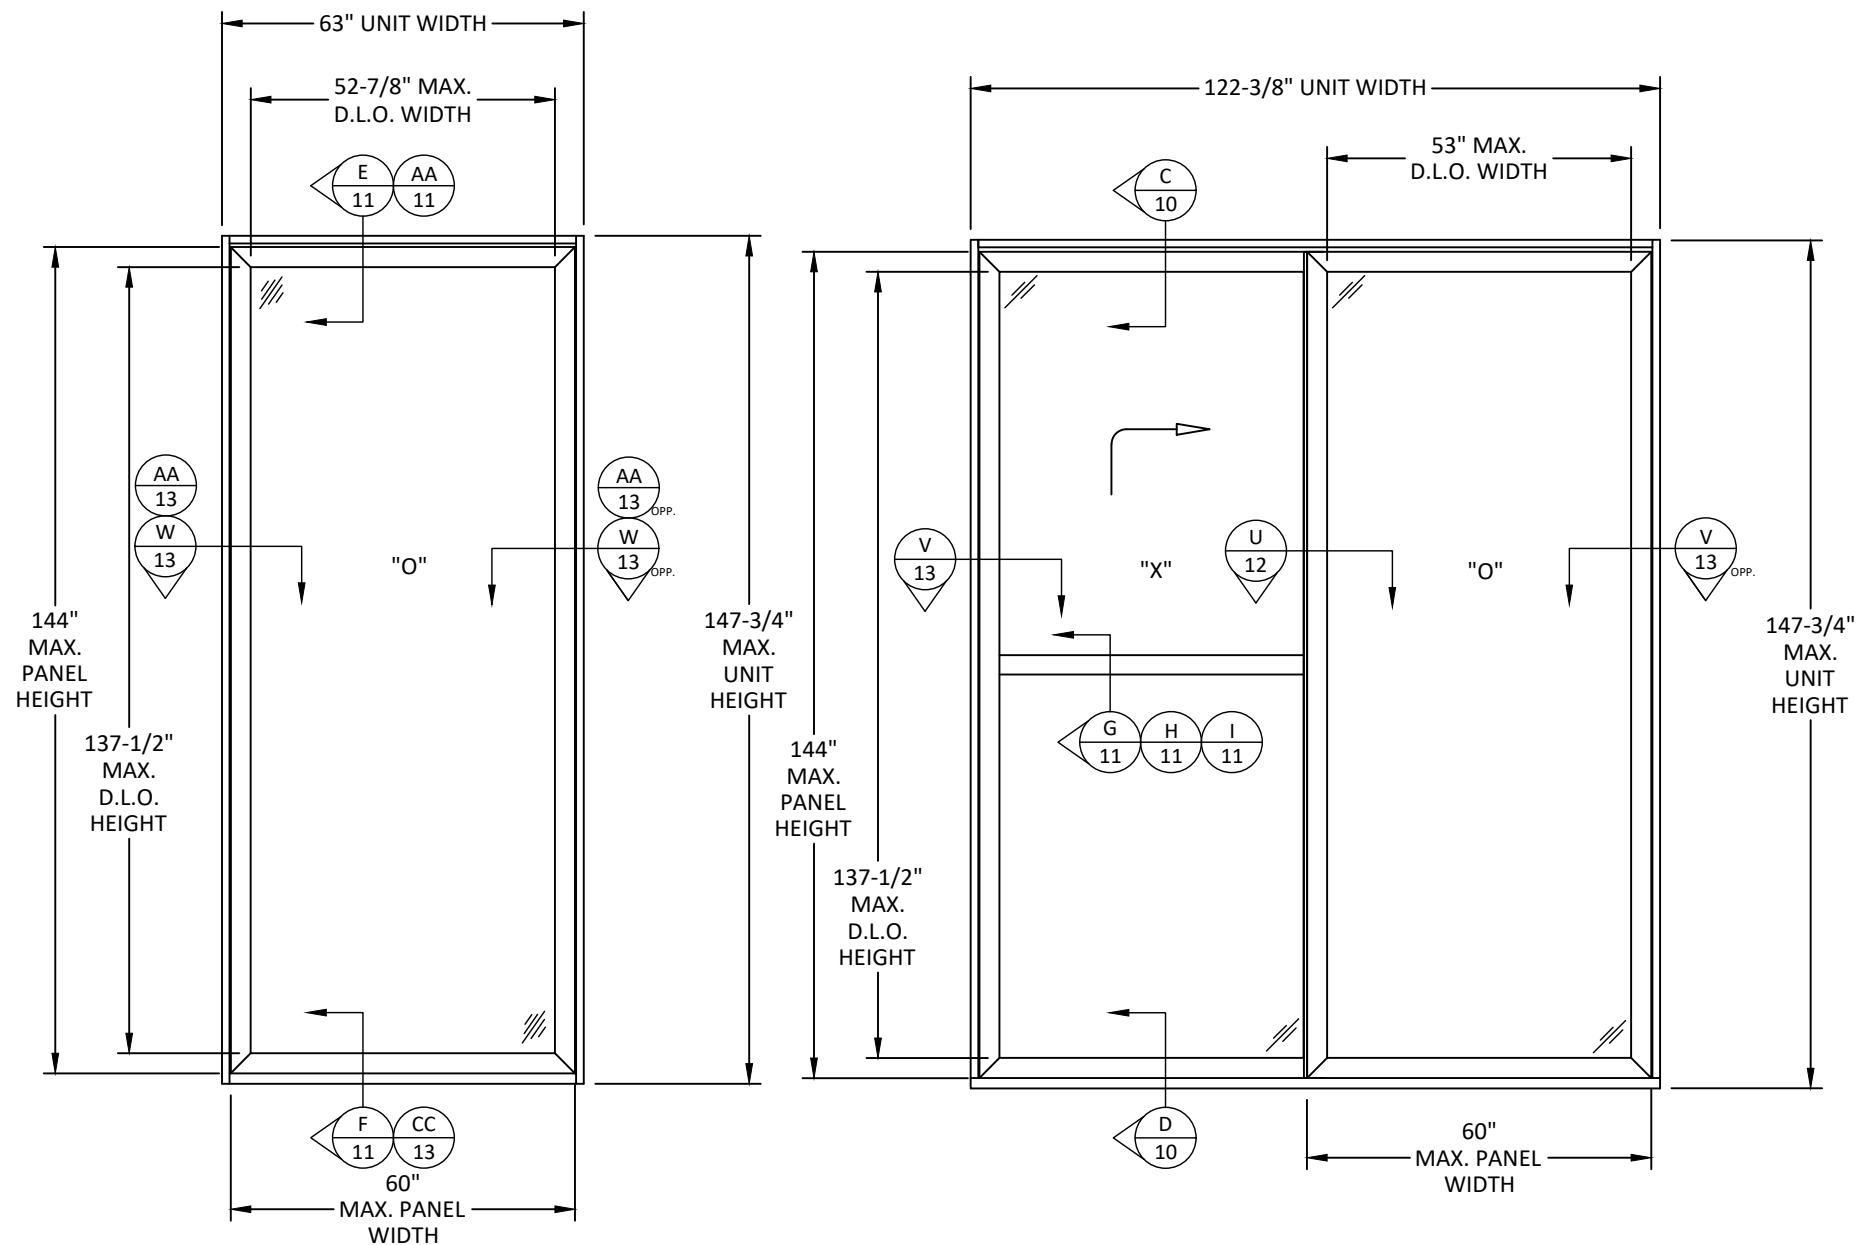

ELEVATION


1-TRACK
0

ELEVATION


2-TRACK
XO

NOTE:

1. SINGLE TRACK, NON-POCKET, SYSTEMS ARE RETAINED BY H-TRACK FOR SIDE AND HEAD JAMB AND EITHER H-TRACK OR DRAINAGE TRACK FOR THE BOTTOM TRACK. TWO TRACK SYSTEMS USE LOCKING PIN HARDWARE TO ATTACH PANELS TO JAMBS.
2. TESTED MEETING STILE HARDWARE SHALL BE USED ON DOUBLE FIXED DOORS.
3. ONE (1) SHOOT BOLT PER MEETING CONDITION, NONE REQUIRED AT JAMB CONDITION.

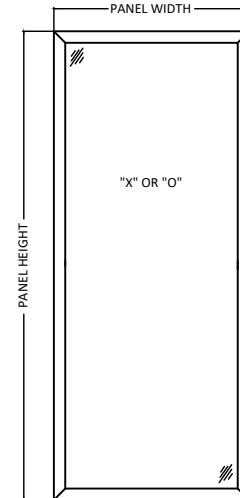

ALLOWED LOCKRAIL CONFIGURATIONS:

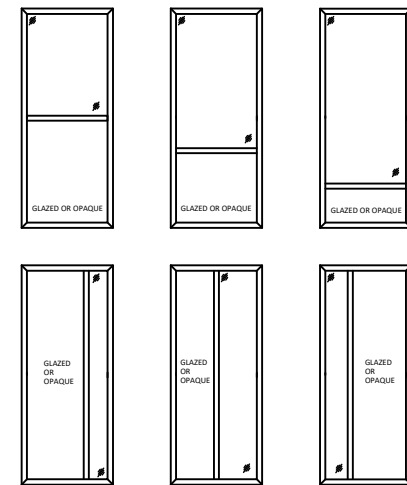

LOCKRAIL NOTES:

1. LOCKRAILS ARE LIMITED TO A MAXIMUM DESIGN PRESSURE OF +/- 80 PSF.
2. LOCKRAIL MAY BE USED AT ANY LOCATION ON THE PANEL SUCH THAT THE TESTED SQUARE FOOTAGE OF THE INFILL PANEL IS NOT EXCEEDED.
 - 2.1. INFILL PANEL MAX D.L.O SIZE
 $53\text{-}3/16'' \times 66\text{-}7/8'' = 24.70 \text{ SQ. FT}$
3. MULTIPLE LOCK RAILS CAN BE USED, BUT YOU CANNOT HAVE A LOCK RAIL MEETING A LOCK RAIL.
4. LOCK RAILS SHALL BE LIMITED TO TESTED MAX. SPAN OF 89" D.L.O.
5. LOCK RAILS GREATER THAN 66" D.L.O. HAVE STAINLESS STEEL REINFORCEMENT BAR.

c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland-sliding doors\1x4-9-6024\4.2\070204_als-c & als-c-2 - revisions\dwgs\wscd015.dwg 4/9/2026 12:04 PM

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS. PANEL WIDTH (IN.)	PANEL HEIGHT (IN.)	SINGLE TRACK WITH SHOOTBOLTS	MULTI-TRACK WITH SHOOTBOLTS
36	78	35.0	80.0
42		35.0	80.0
48		35.0	80.0
54		35.0	80.0
60		35.0	80.0
66		35.0	80.0
72		35.0	80.0
78		35.0	80.0
84		35.0	80.0
90		35.0	80.0
96		35.0	80.0
102		35.0	80.0
108	84	35.0	80.0
110		35.0	80.0
36		35.0	80.0
42		35.0	80.0
48		35.0	80.0
54		35.0	80.0
60		35.0	80.0
66		35.0	80.0
72		35.0	80.0
78		35.0	80.0
84		35.0	80.0
90		35.0	80.0
96		35.0	80.0
102		35.0	80.0
36	90	35.0	80.0
42		35.0	80.0
48		35.0	80.0
54		35.0	80.0
60		35.0	80.0
66		35.0	80.0
72		35.0	79.2
78		35.0	77.4
84		35.0	76.3
90		35.0	76.0
96		35.0	76.0
36	96	35.0	80.0
42		35.0	80.0
48		35.0	80.0
54		35.0	80.0
60		35.0	80.0
66		35.0	74.0
72		35.0	71.3
78		35.0	69.2
84		35.0	67.9
90		35.0	67.1
36	102	35.0	80.0
42		35.0	80.0
48		35.0	80.0
54		35.0	76.0
60		35.0	71.3
66		35.0	67.6
72		35.0	64.8
78		35.0	62.6
84		35.0	61.1

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS. PANEL WIDTH (IN.)	PANEL HEIGHT (IN.)	SINGLE TRACK WITH SHOOTBOLTS	MULTI-TRACK WITH SHOOTBOLTS
36	108	35.0	80.0
42		35.0	80.0
48		35.0	76.3
54		35.0	70.4
60		35.0	65.8
66		35.0	62.2
72		35.0	59.4
78		35.0	57.2
80		35.0	56.6
36	114	35.0	80.0
42		35.0	78.8
48		35.0	71.3
54		35.0	65.5
60		35.0	61.1
66		35.0	57.6
72		35.0	54.8
75		35.0	53.6
36	120	35.0	80.0
42		35.0	74.0
48		35.0	66.8
54		35.0	61.3
60		35.0	57.0
66		35.0	53.6
72		35.0	50.9
36	126	35.0	79.2
42		35.0	69.8
48		35.0	62.9
54		35.0	57.6
60		35.0	53.4
66		35.0	50.1
68		35.0	49.2
36	132	35.0	75.0
42		35.0	66.0
48		35.0	59.4
54		35.0	54.3
60		35.0	50.3
65		35.0	47.6
36	138	35.0	71.3
42		35.0	62.6
48		35.0	56.3
54		35.0	51.4
60		35.0	47.5
62		35.0	46.4
36	144	35.0	67.9
42		35.0	59.6
48		35.0	53.4
54		35.0	48.7
60		35.0	45.0

- NOTE:
- CORNER CONSTRUCTIONS ARE CONSIDERED "MULTI-TRACK" EVEN IF THEY STAGGER DOWN TO A SINGLE TRACK.
 - MULTI-TRACK IS A TRACK THAT STAGGERS DOWN TO AT LEAST TWO TRACKS.
 - FULL HEAD/CONTIUOUS TRACK IS ALSO CONSIDERED A MULTI-TRACK.
 - PX OR PX-XP UNITS WITH SINGLE HEAD TRACK GET THE SINGLE TRACK RATING, PX OR PX-XP UNITS CAN BE MADE WITH TWO HEAD JAMBS/TRACKS TO GET MULTI-TRACK RATING.
 - O & O-O OR STATIONARY ONLY PANELS THAT USE THE H-TRACK GET THE MULTI-TRACK RATING, EVEN IF IT ONLY USES A SINGLE HEAD TRACK



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

DESIGN PRESSURE TABLE

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132


PH: (954) 399-9478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

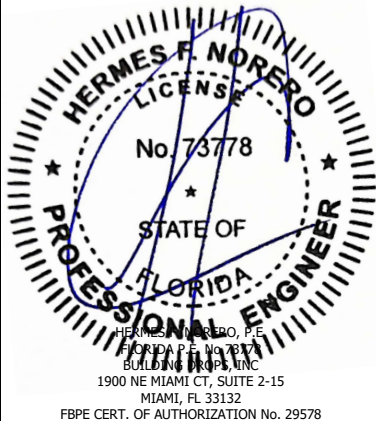

FL #:
FL47871

DATE: **07.30.25**

DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WSD015**

SHEET:
6



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.



1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL47871

DATE: 07.30.25

DWG. BY: HJ

CHK. BY: HFN


SCALE: NTS

DWG. #: WSD015

SHEET:

7

OF 18

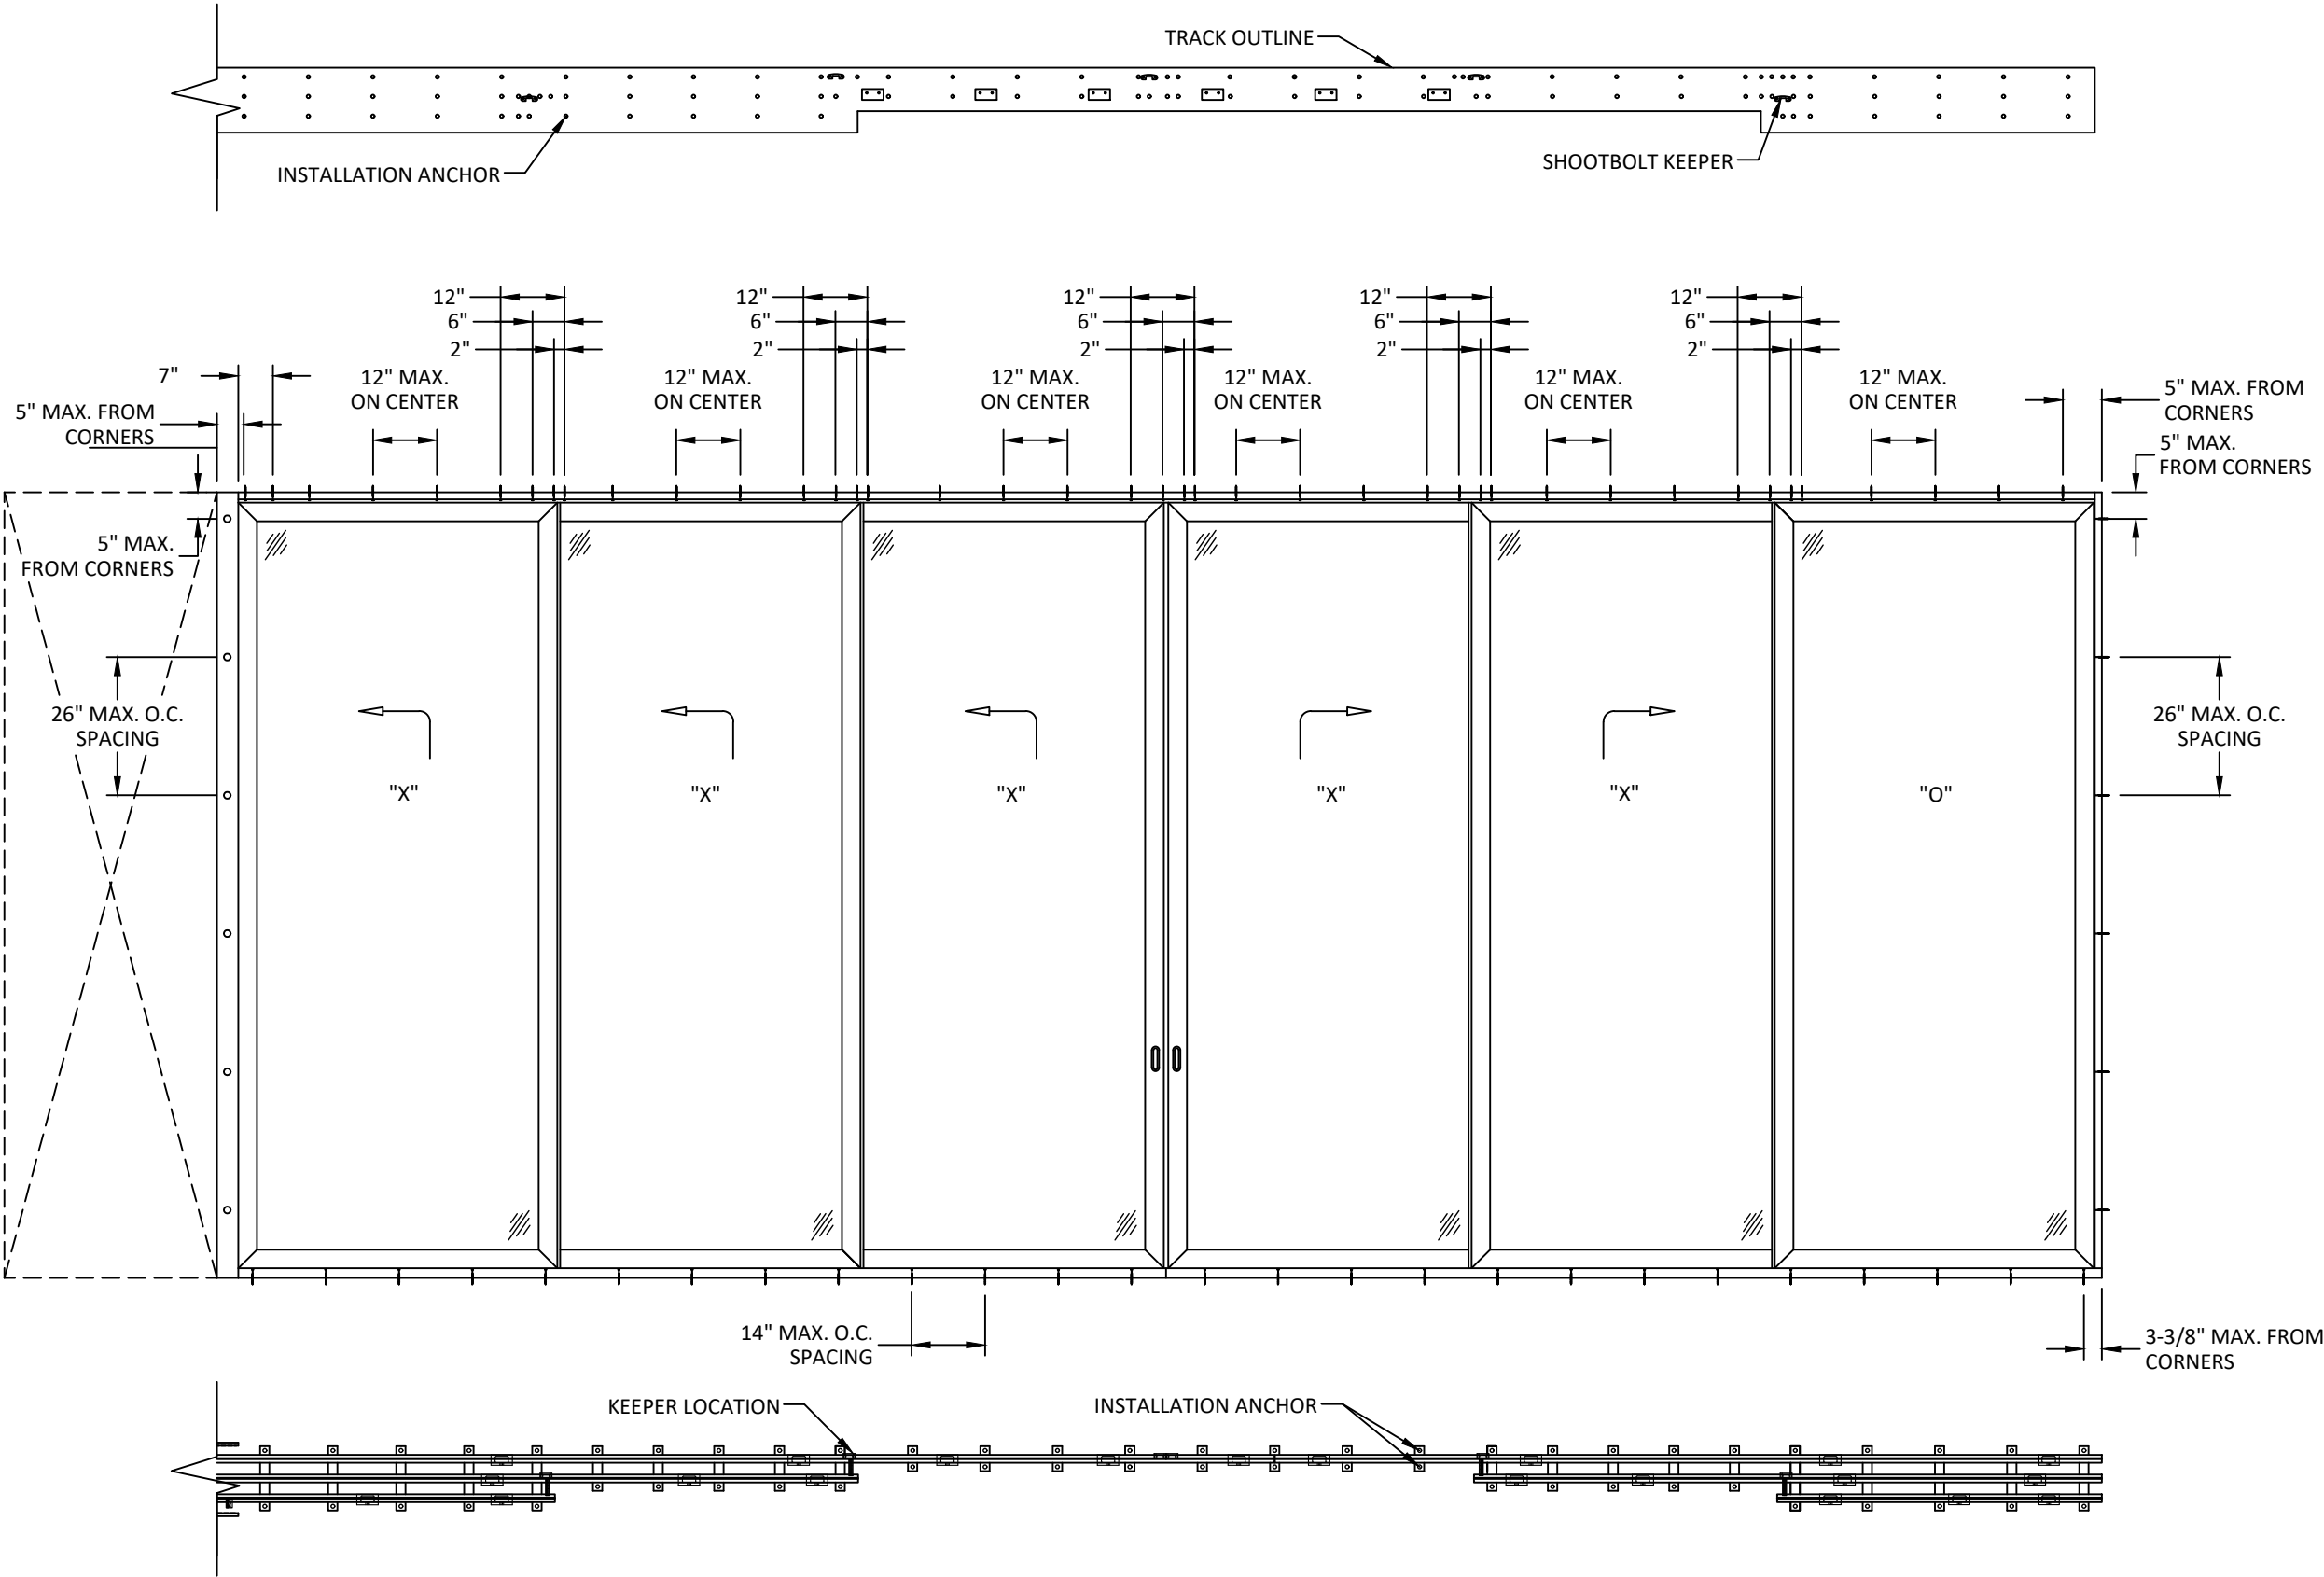


NOTE:
1) IF SYSTEM EXCEEDS 288", SPLITS WILL BE PRESENT
IN THE TOP/BOTTOM TRACKS.

ANCHOR LAYOUT

NOTE:
1) SEE SHEET 10 FOR ANCHOR LAYOUT FOR SINGLE AND DOUBLE
FIXED PANELS.

c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland sliding doors\alcs-2-revisions\dwgs\wscd015.dwg 4/8/2026 12:04 PM

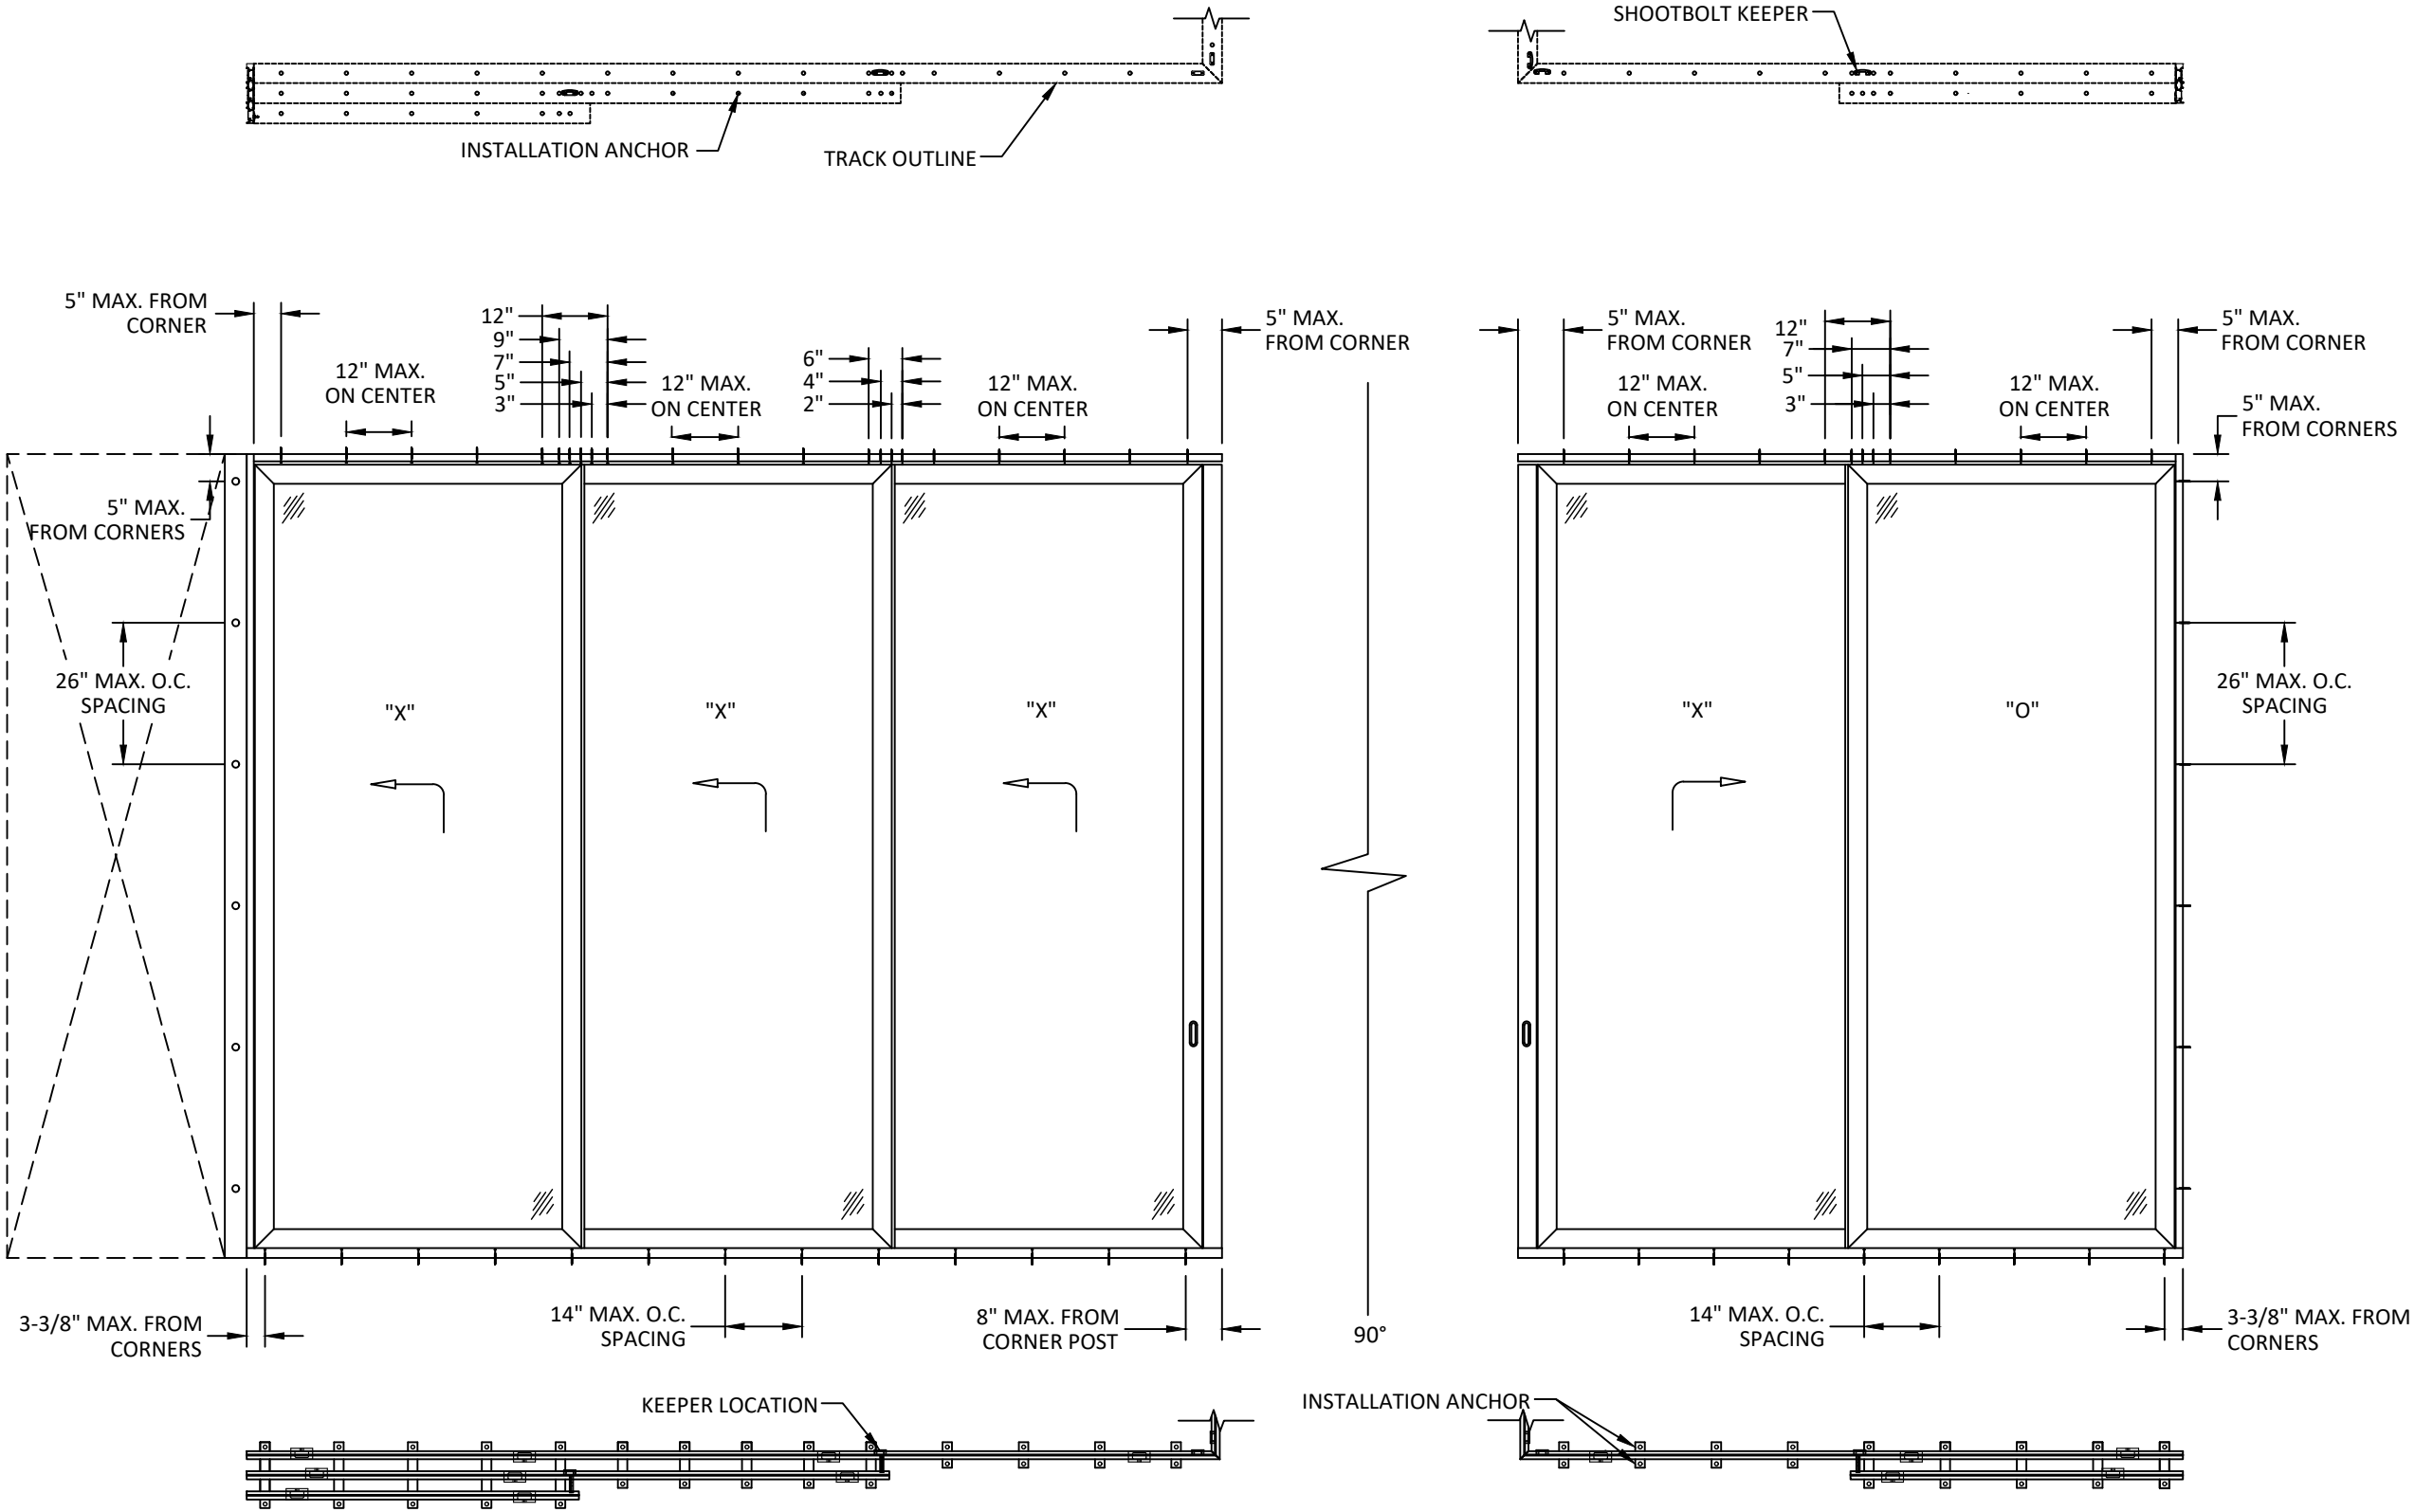

NOTE:
1) ANCHOR LOCATIONS AT THE HEAD MARKED WITH AN ASTERISK (*) ARE NOT REQUIRED WHEN INSTALLING TO WOOD SUBSTRATE.

ANCHOR LAYOUT

NOTE:
1) SEE SHEET 10 FOR ANCHOR LAYOUT FOR SINGLE AND DOUBLE FIXED PANELS.



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

ANCHOR LAYOUT


PREPARED BY: BUILDING DROPS, INC.



1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

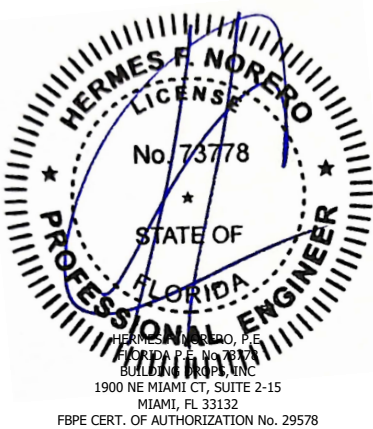

FL #:	FL47871
DATE:	07.30.25
DWG. BY:	HJ
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD015
SHEET:	8

c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland\sliding doors\lsc-26-0244 - fl47871 awls-c & als-c-2 - revisions\dwgs\wscd015.dwg 4/8/2026 12:04 PM

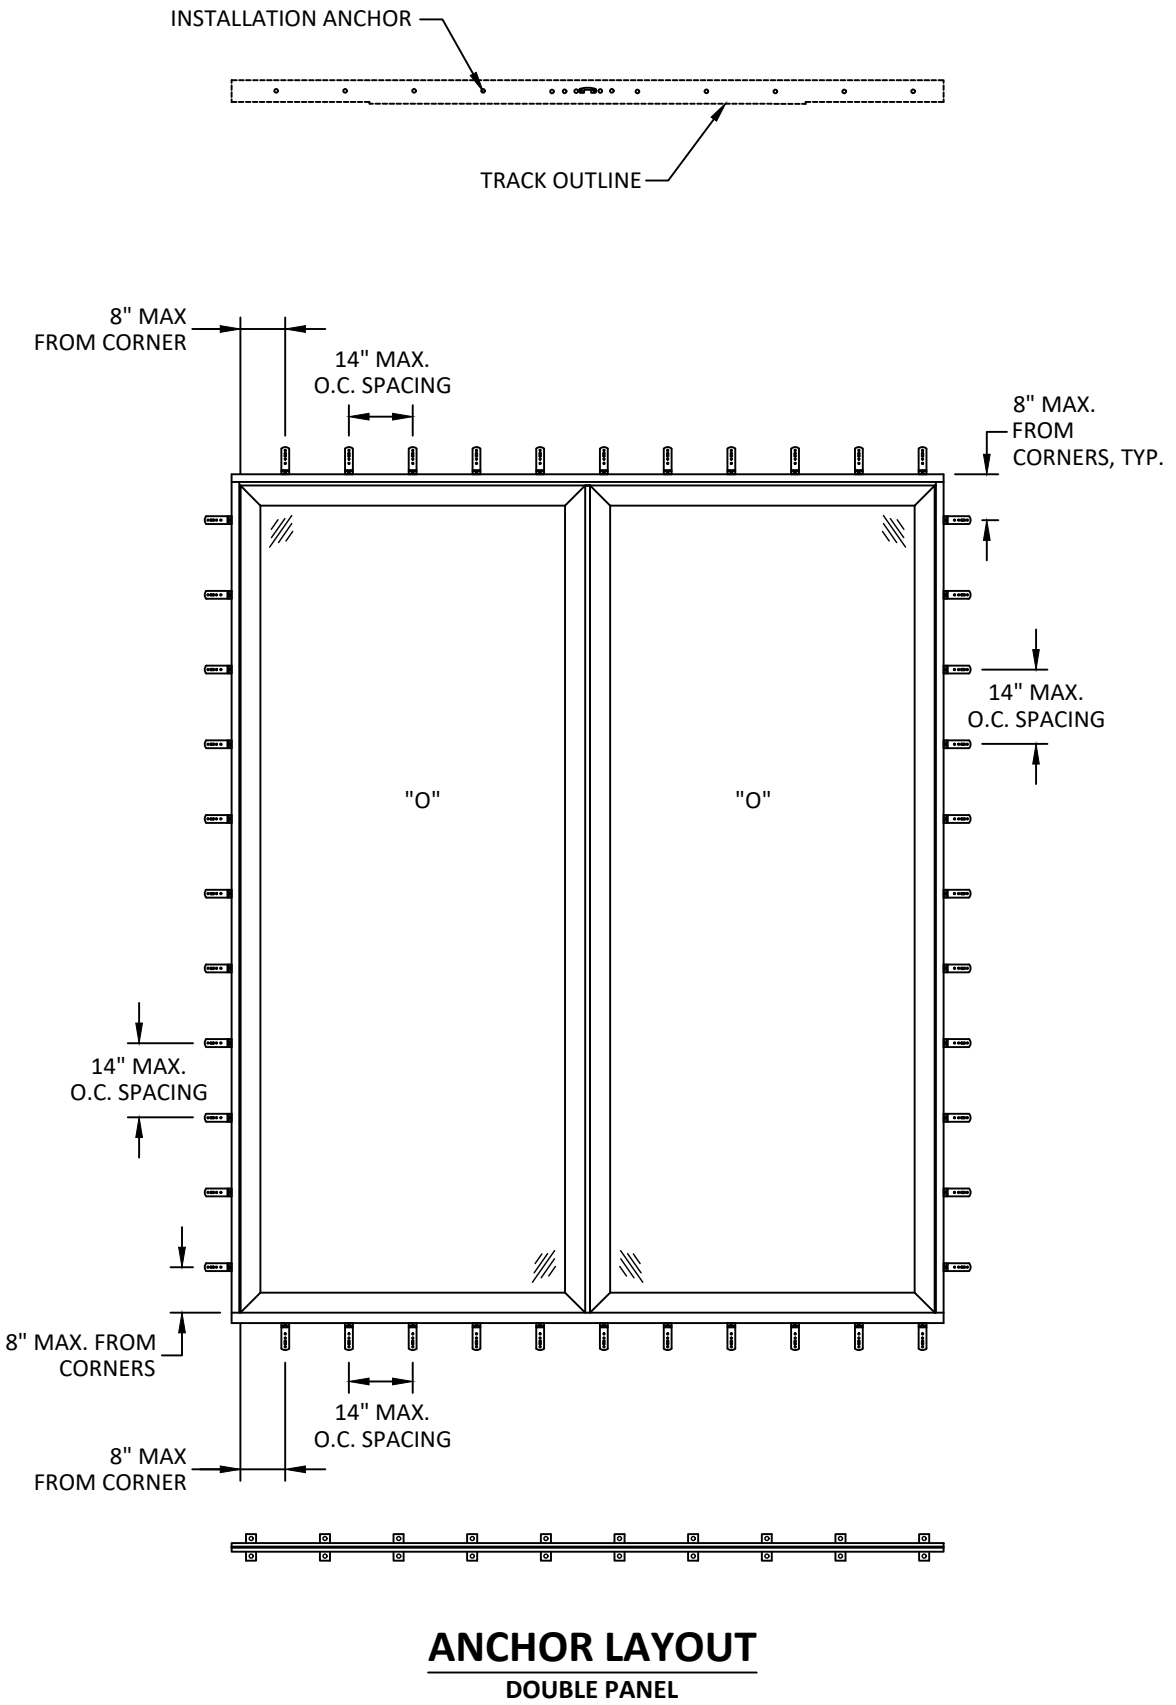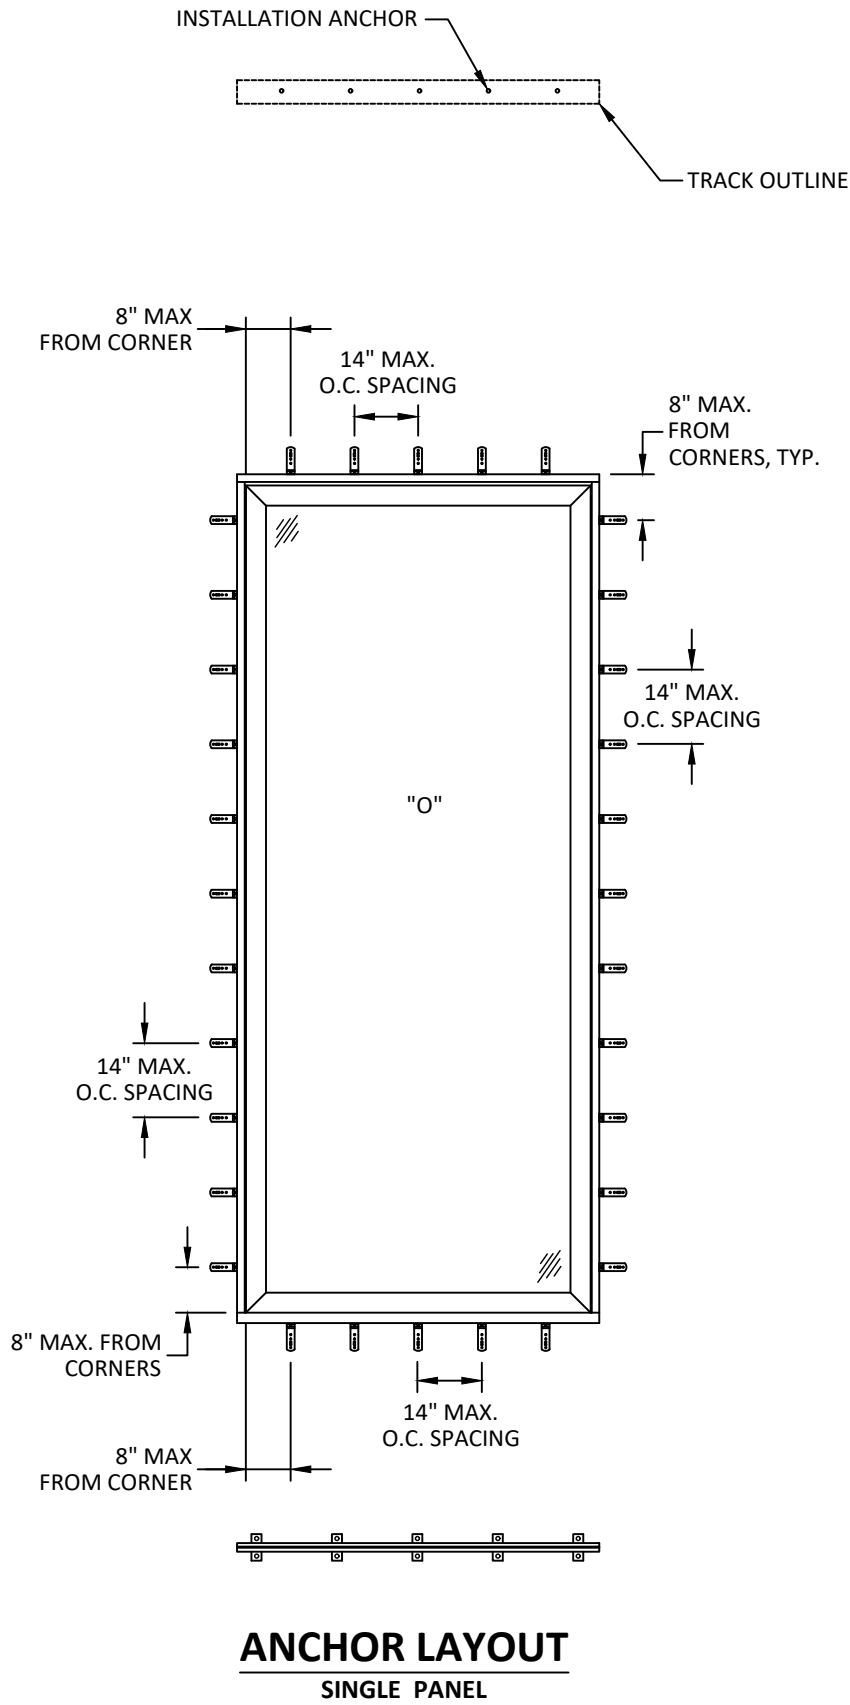



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR (HVHZ)(IMPACT)
ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. NO. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47871**

DATE: **07.30.25**

DWG. BY: HJ	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**

DWG. #: **WSD015**

SHEET: **9**

OF 18

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

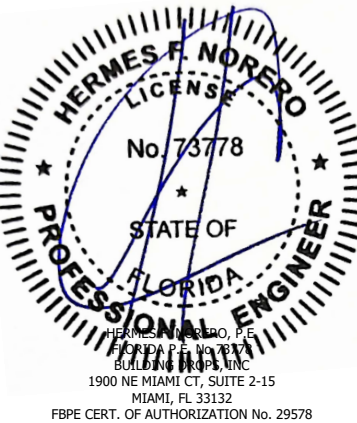

FL #:	FL47871
DATE:	07.30.25
DWG. BY:	HJ
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD015
SHEET:	10

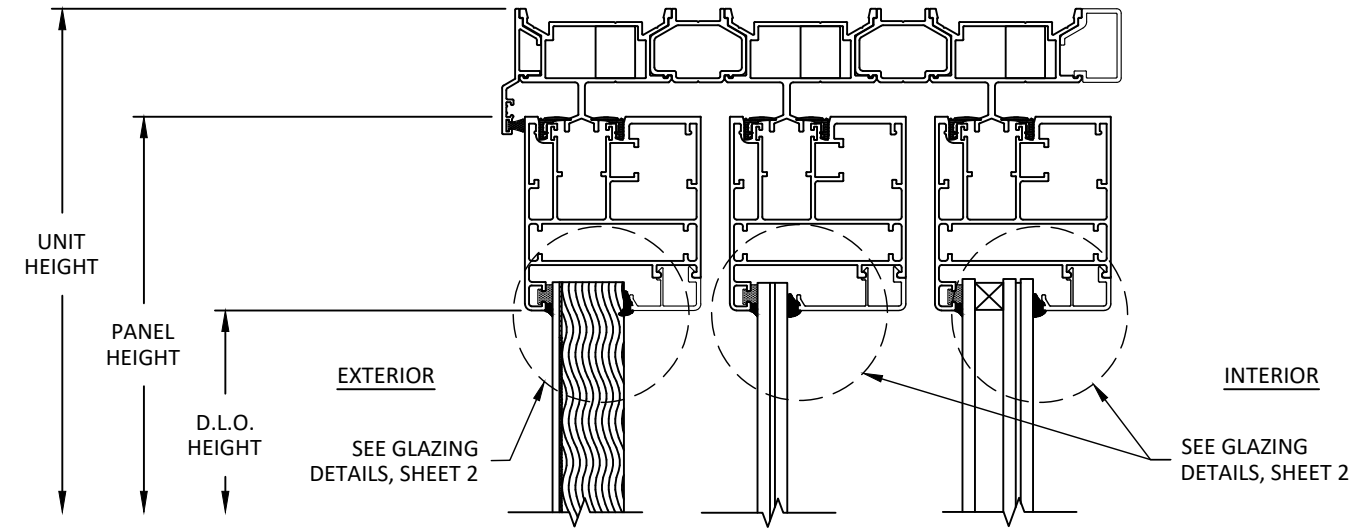


A
10 VERTICAL SECTION
ALS HEAD
3 TRACK

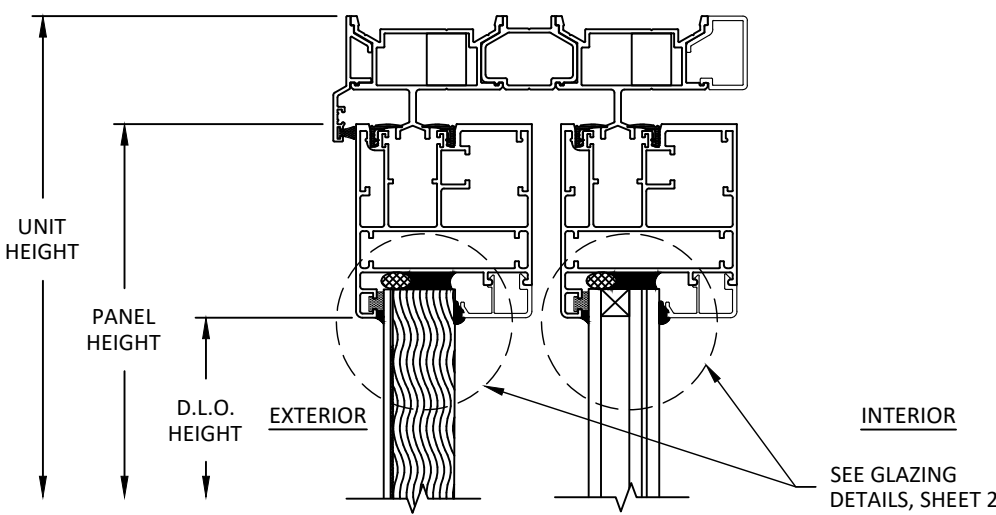


C
10 VERTICAL SECTION
ALS HEAD
2 TRACK

NOTES:
ALL GLAZING OPTIONS MAY BE USED ON
ALL CONFIGURATIONS SHOWN.

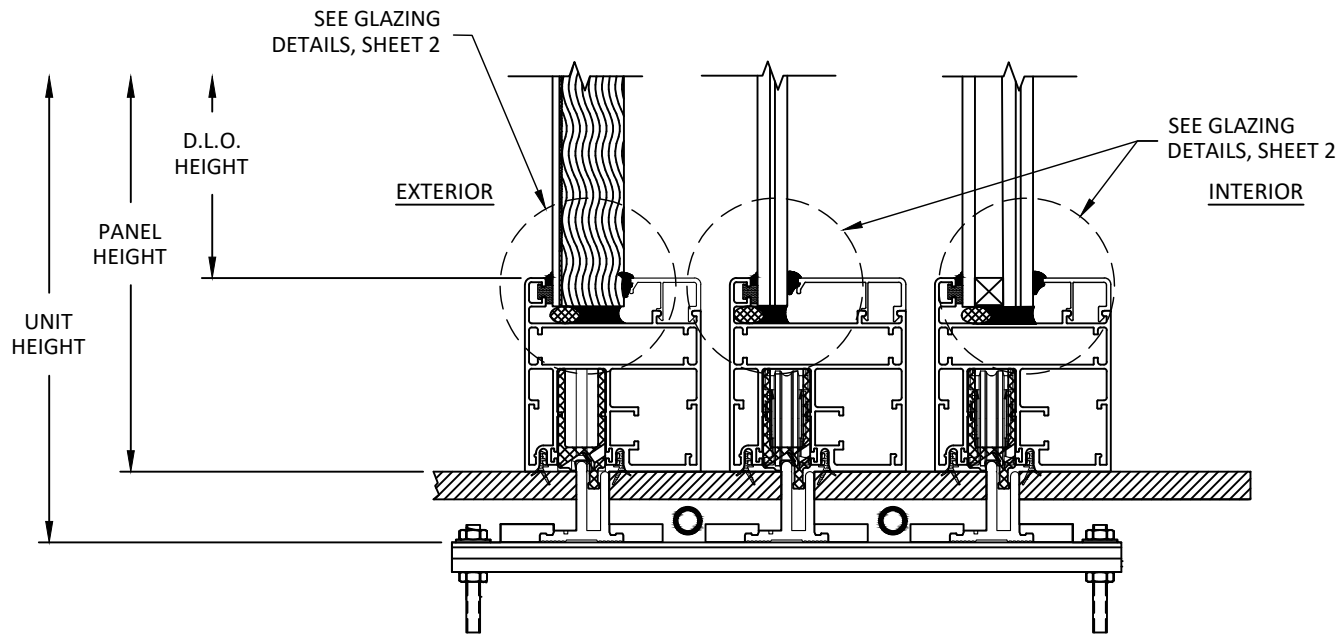


B
10 VERTICAL SECTION
ALS SILL
3 TRACK

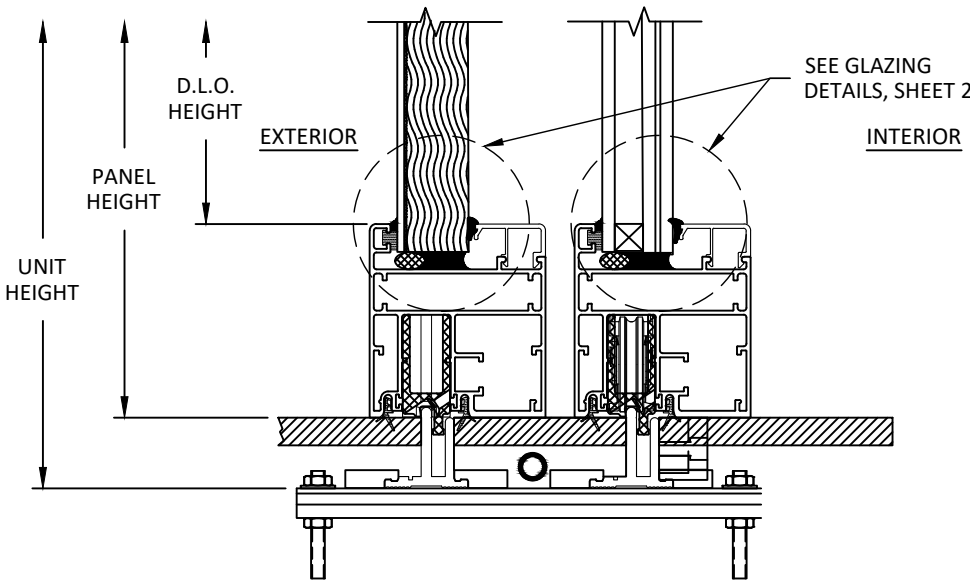


D
10 VERTICAL SECTION
ALS SILL
2 TRACK


c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland - common\projects\weiland - sliding doors\lsc-26-0244 - f147871 awls-c & als-c and als-2 - revisions\dwgs\wscd015.dwg 4/8/2026 12:04 PM

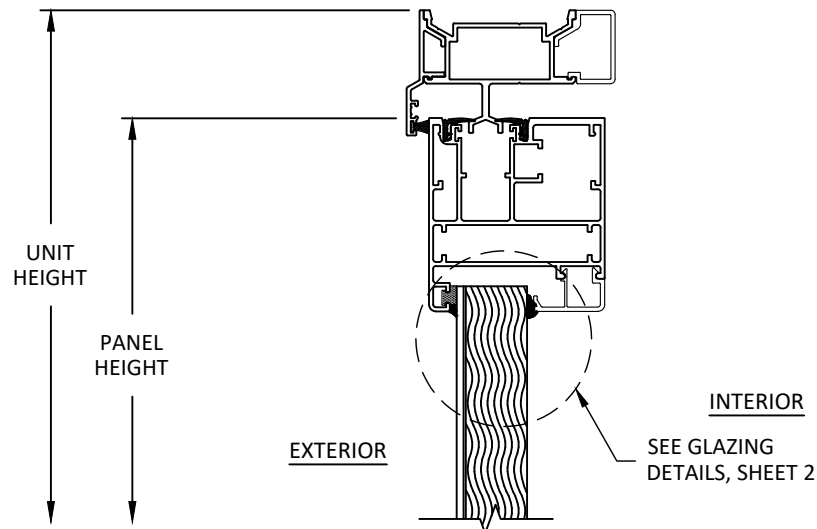

E
11 **VERTICAL SECTION**
ALS HEAD
1 TRACK

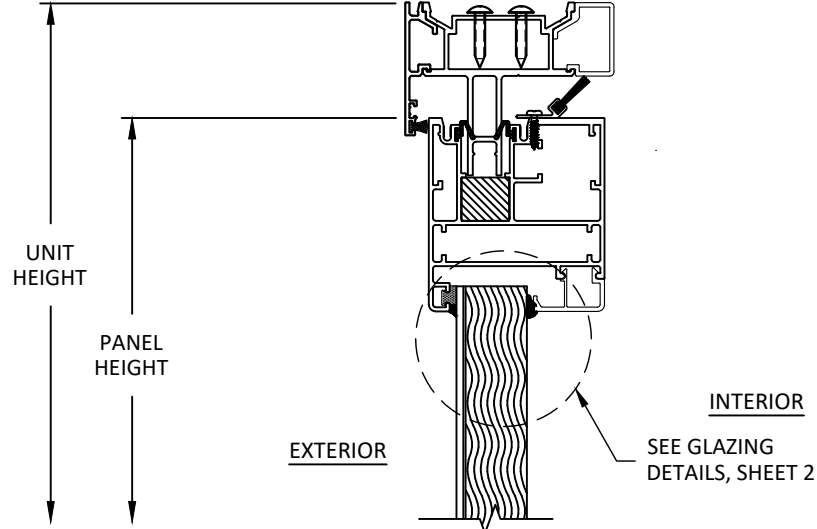


AA
11 **VERTICAL SECTION**
ALS HEAD
H TRACK

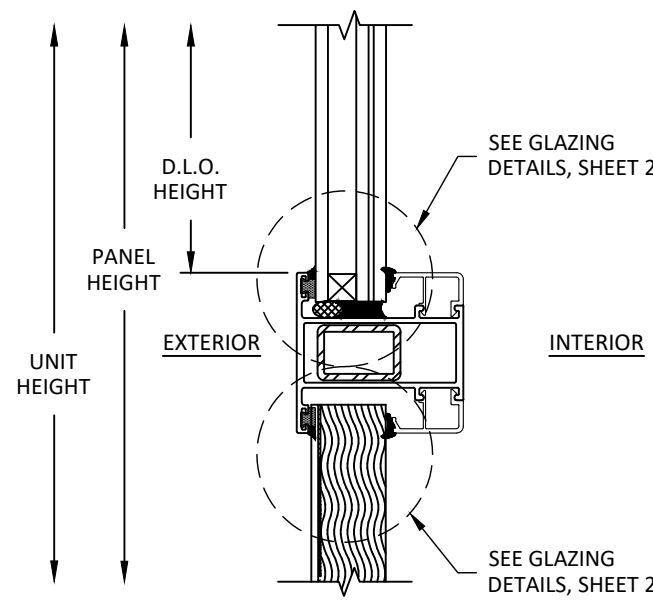


I
11 **VERTICAL SECTION**
ALS MIDRAIL - GLASS OVER INFILL PANEL
REINFORCED


- NOTES:
1. STEEL REINFORCEMENT FOR MID-RAIL ONLY REQUIRED FOR VERTICAL OR HORIZONTAL MID-RAILS EXCEEDING 66".
 2. ALL GLAZING OPTIONS MAY BE USED ON ALL CONFIGURATIONS SHOWN.

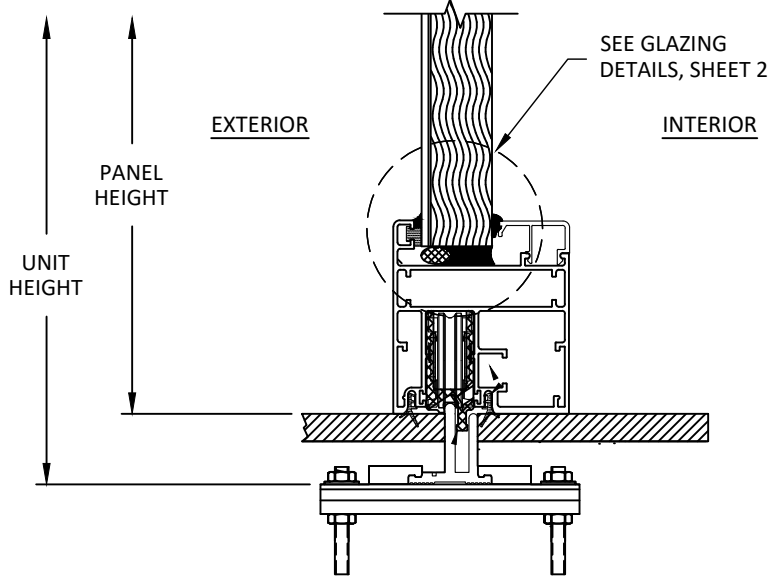

F
11 **VERTICAL SECTION**
ALS SILL
1 TRACK

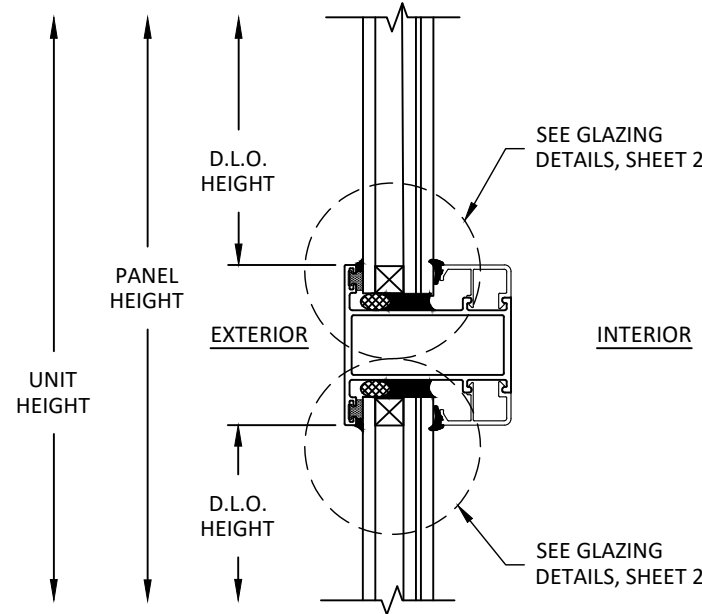

G
11 **VERTICAL SECTION**
ALS MIDRAIL - GLASS OVER GLASS
NON - REINFORCED

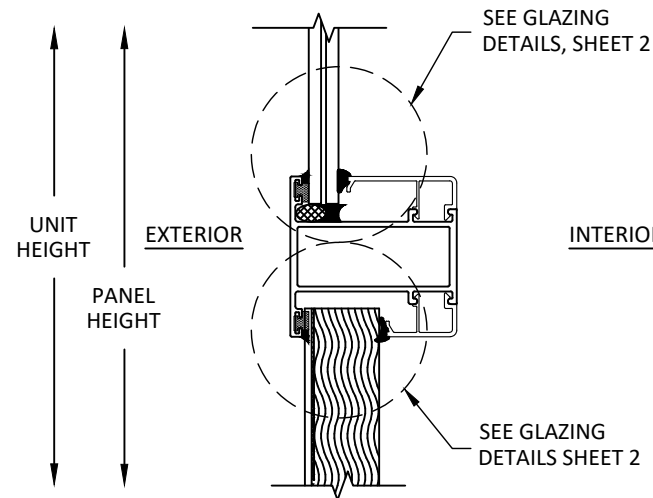

H
11 **VERTICAL SECTION**
ALS MIDRAIL - INFILL OVER INFILL
NON - REINFORCED



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838


TITLE: ALS LIFT AND SLIDE DOOR (HVHZ)(IMPACT) VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.
BUILDING DROPS

REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

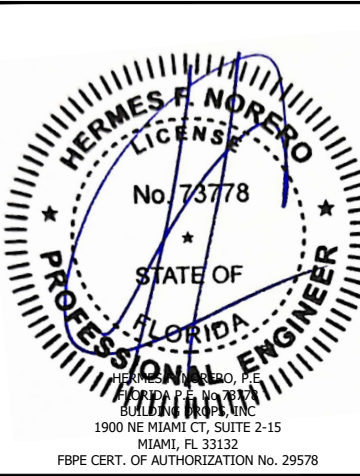

FL #:	FL47871
DATE:	07.30.25
DWG. BY:	HJ
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WSD015
SHEET:	11



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132

PH:

(954) 399-8478

FAX:

(954) 744-4738

WEB:


www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

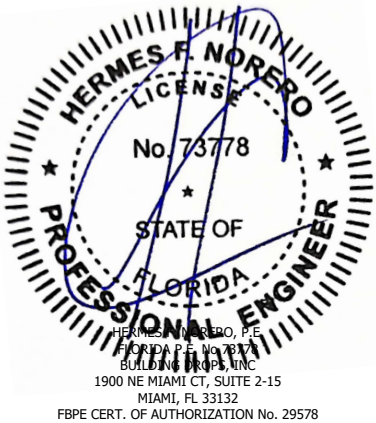

FL #:
FL47871

DATE: **07.30.25**

DWG. BY:
HJ

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **WSD015**

SHEET:

12


OF 18

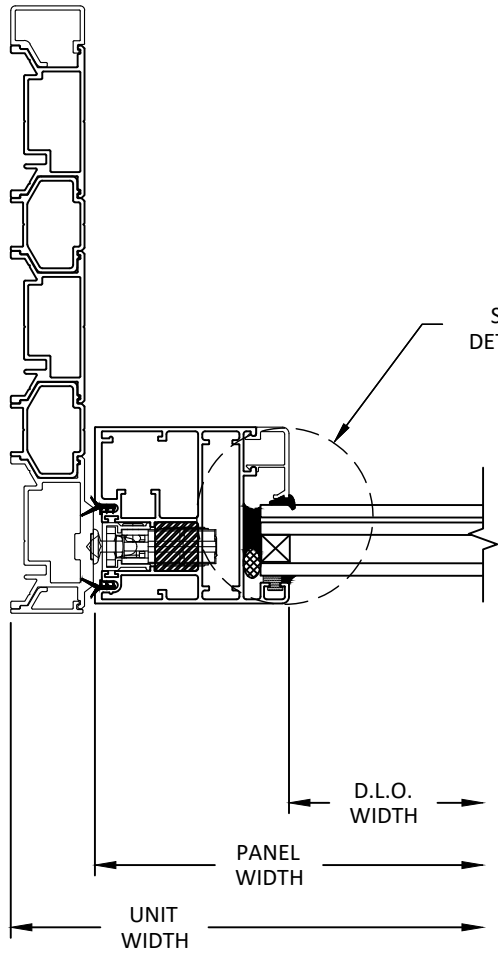

S
12

HORIZONTAL SECTION


ALS JAMB
3 TRACK

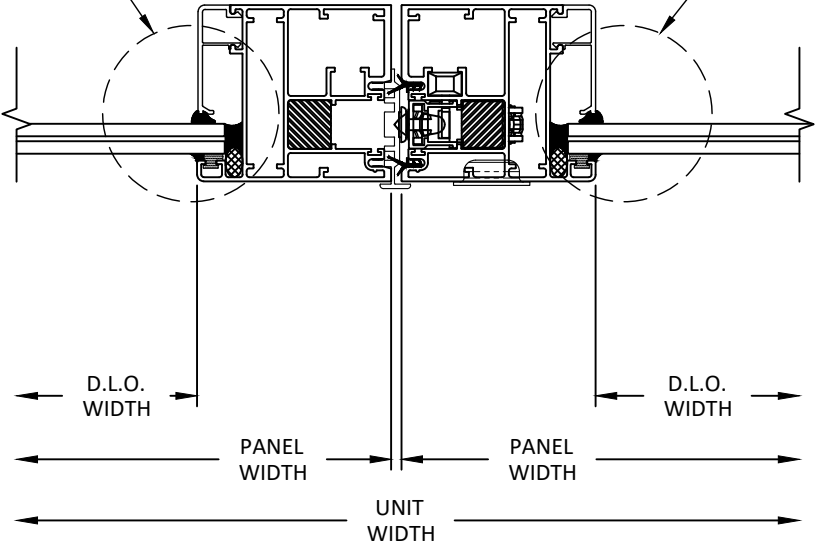

T
12

HORIZONTAL SECTION

ALS MEETING STILE

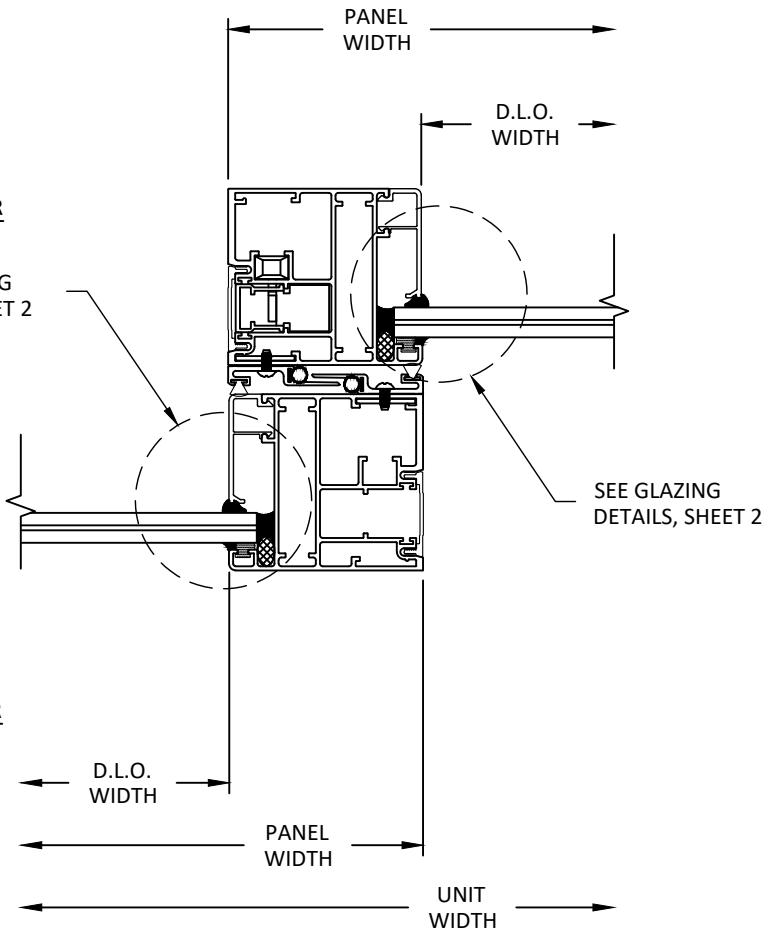

U
12

HORIZONTAL SECTION

ALS INTERLOCK



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838


TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)
HORIZONTAL SECTIONS
& VERTICAL SECTION

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

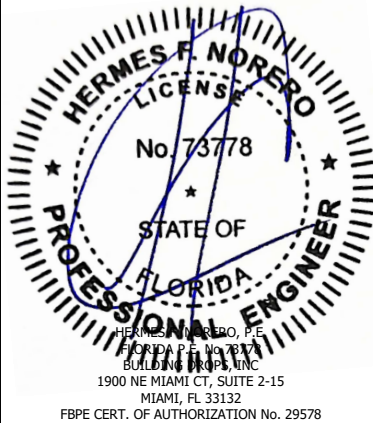

FL #:
FL47871

DATE: **07.30.25**

DWG. BY: **HJ** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WSD015**


SHEET:

13


OF 18

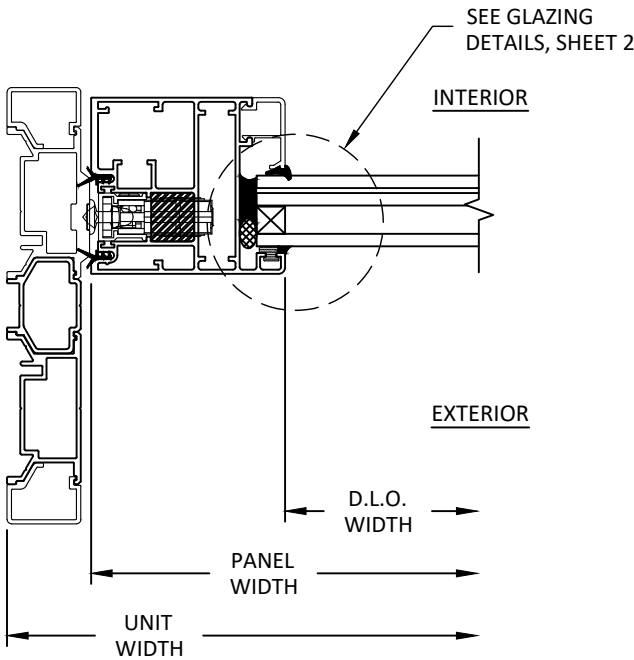


V
13 **HORIZONTAL SECTION**
ALS JAMB
2-TRACK

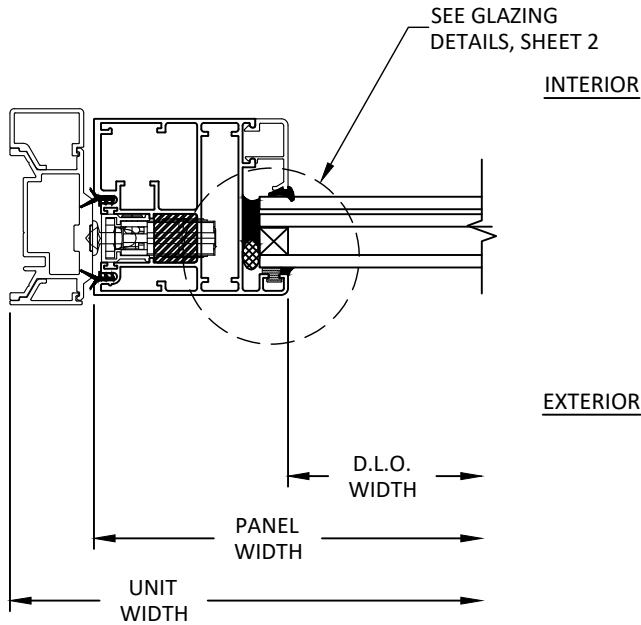

W
13 **HORIZONTAL SECTION**
ALS JAMB
1-TRACK

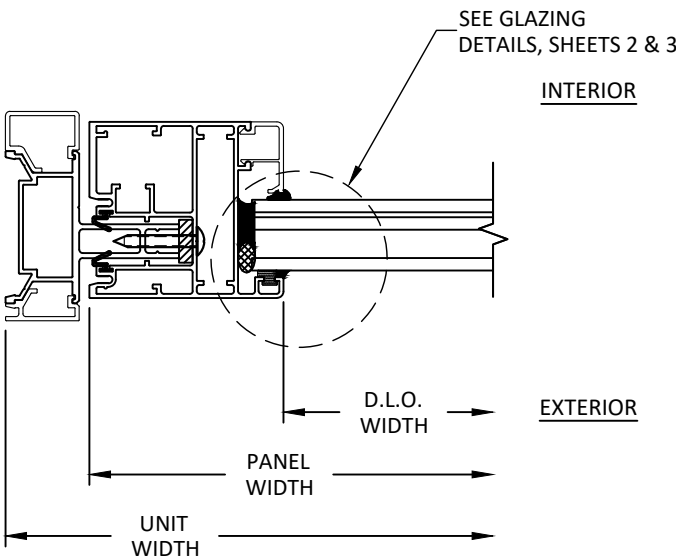


AA
13 **HORIZONTAL SECTION**
ALS JAMB
H-TRACK

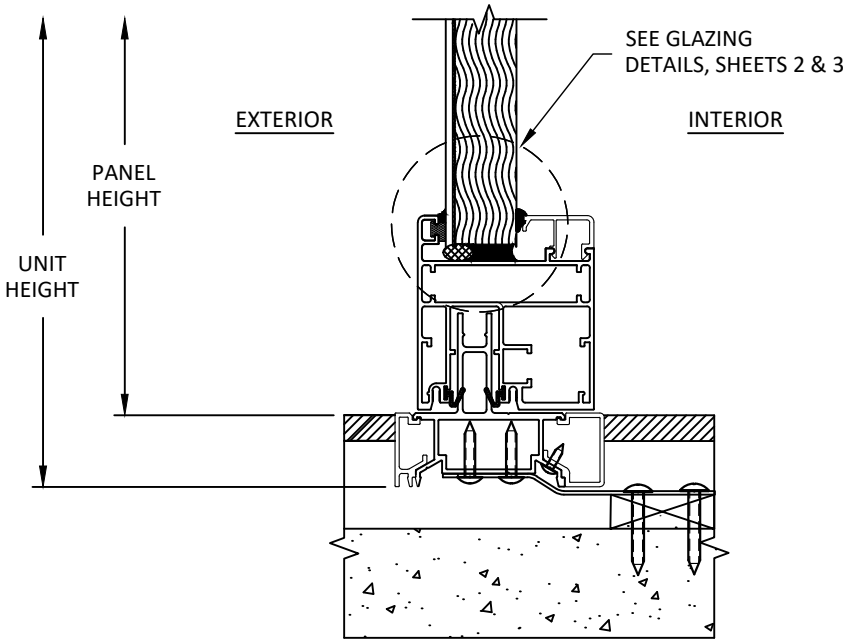


CC
13 **VERTICAL SECTION**
ALS SILL
H TRACK


c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland sliding doors\als-c & als-2 - revisions\dwgs\wscd015.dwg 4/8/2026 12:04 PM

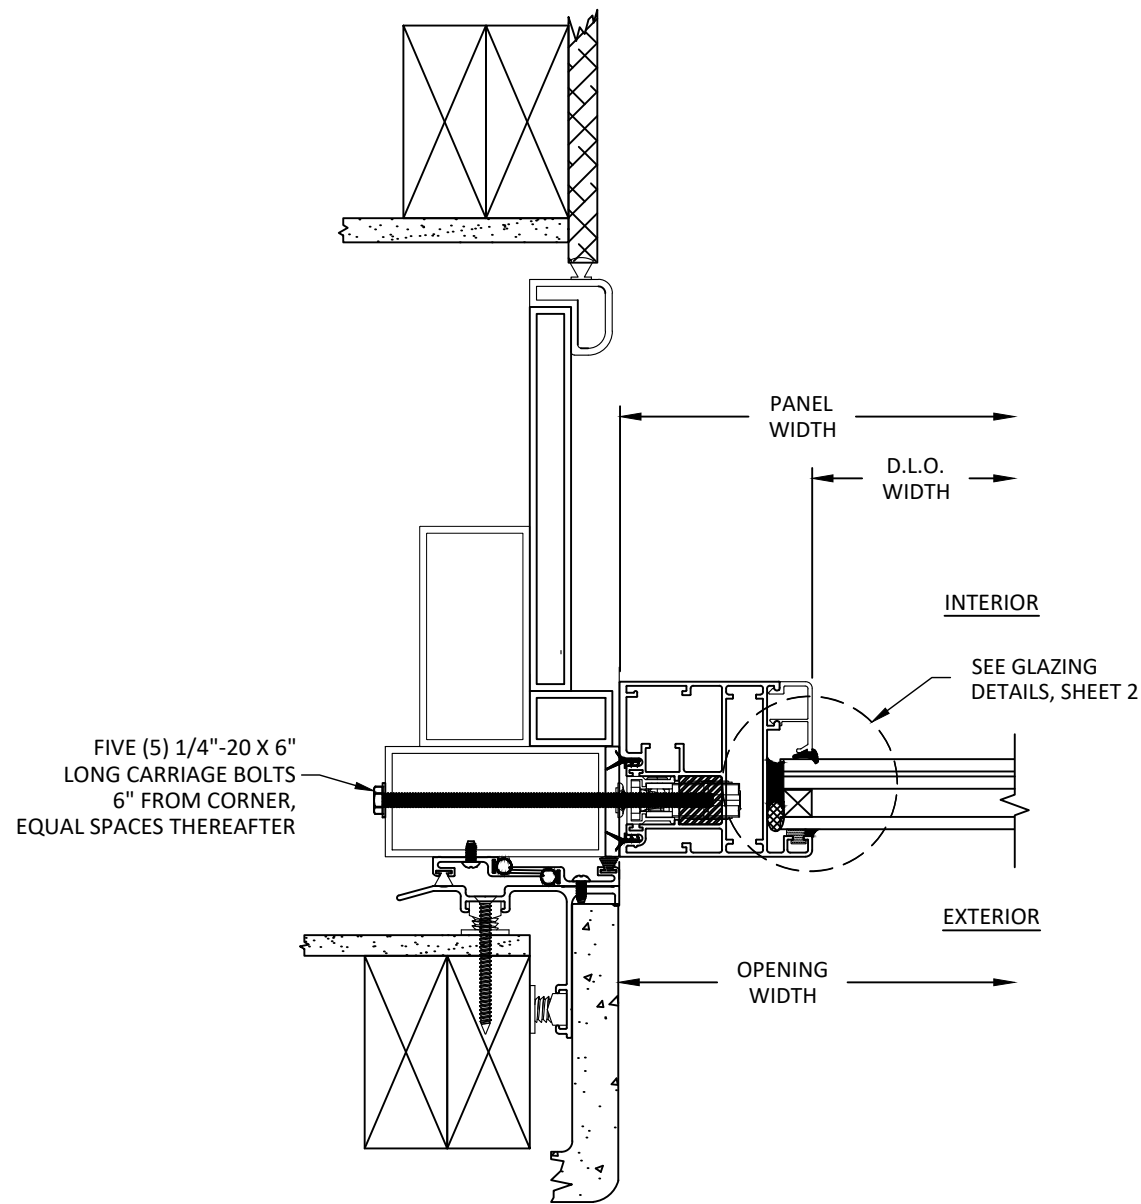

J
14 **HORIZONTAL SECTION**
ALS 3-TRACK POCKET JAMB

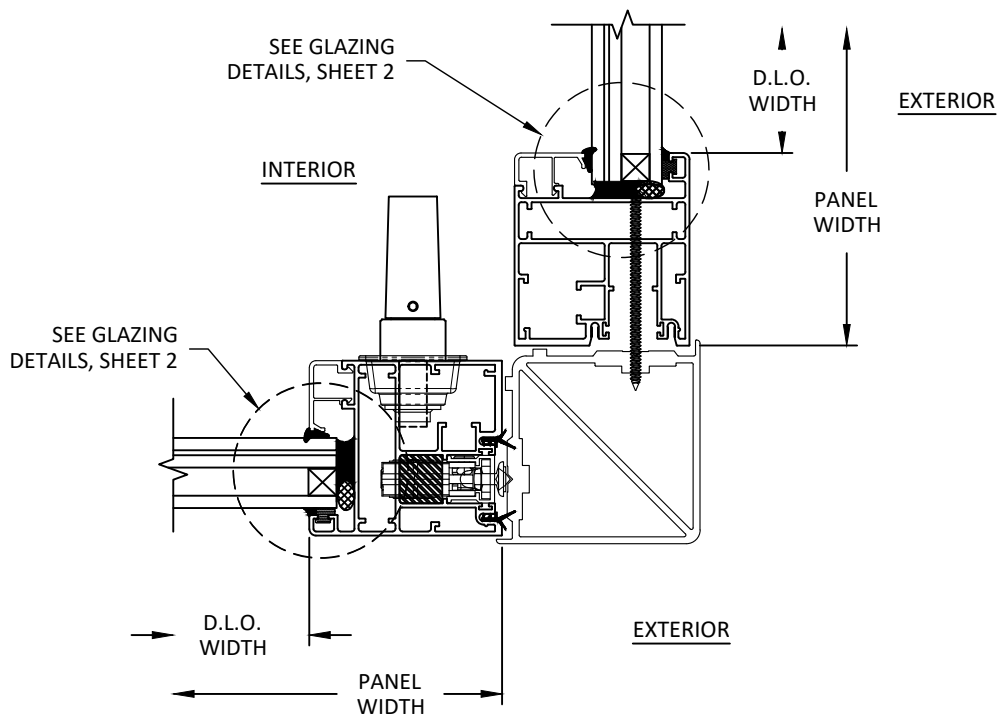

K
14 **HORIZONTAL SECTION**
ALS 90° CORNER POST

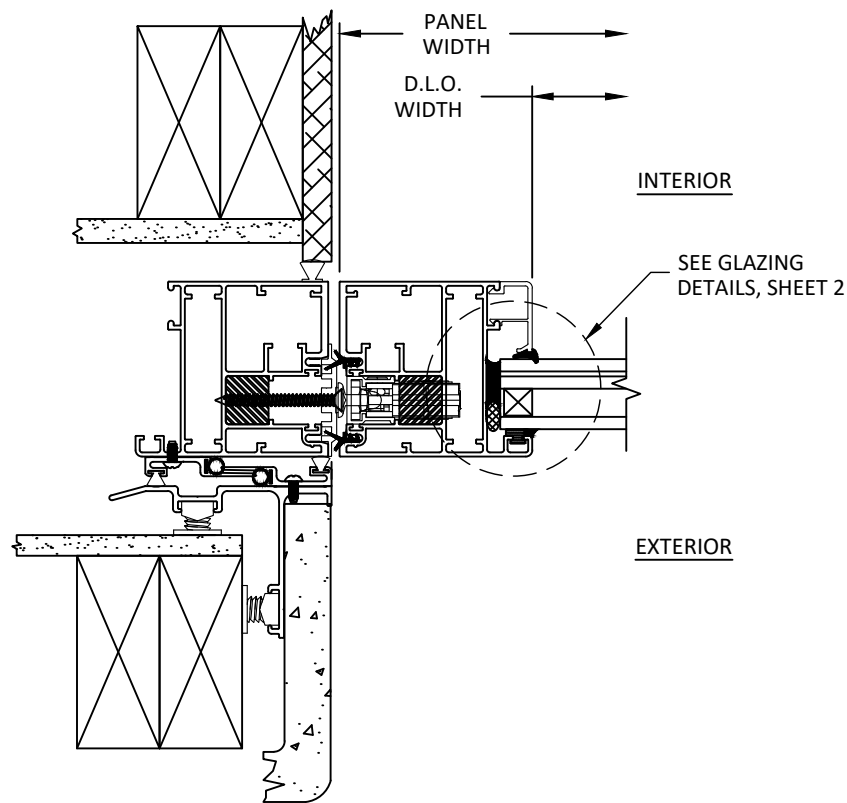

L
14 **HORIZONTAL SECTION**
ALS 1-TRACK POCKET JAMB



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

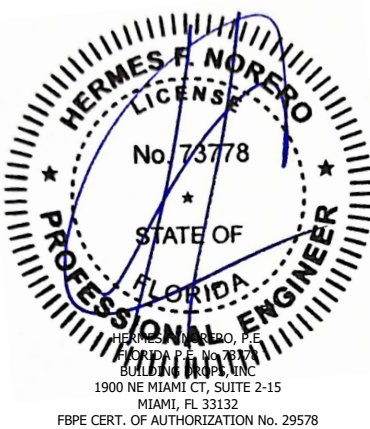

FL #: **FL47871**

DATE: **07.30.25**

DWG. BY: **HJ**

CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WSD015**

SHEET:

14

OF 18

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



SHEET:

OF 18



1. ONE INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEETS 7, 8, & 9.
2. INSTALL INDIVIDUAL INSTALLATION ANCHORS AT ALL JACKING SCREW LOCATIONS WITHIN A TOLERANCE OF $\pm 1/4$ INCH OF THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
3. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
4. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
5. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
6. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
7. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
8. FOR INSTALLATION INTO PRESSURE TREATED WOOD AT SILL USE #14 STAINLESS STEEL WOOD SCREWS OR 1/4" GALVANIZED OR STAINLESS STEEL HANGER BOLT OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2 INCH MINIMUM EMBEDMENT. ANCHORS SHALL MAINTAIN A MIN. EDGE DISTANCE OF 3/4" & 3" MIN. O.C. SPACING. MAXIMUM SHIM SPACE TO BE 1/2".



*QUALIFIED ADHESIVES: HILTI HIT-HY 200, HILTI HIT-HY 150 MAX -SD, POWERS AC100+ GOLD. OR SIMPSON AT-XP



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

ANCHOR DETAILS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL47871

DATE: 07.30.25

DWG. BY: HJ

CHK. BY: HFN


SCALE: NTS

DWG. #: WSD015


SHEET:

16


OF 18

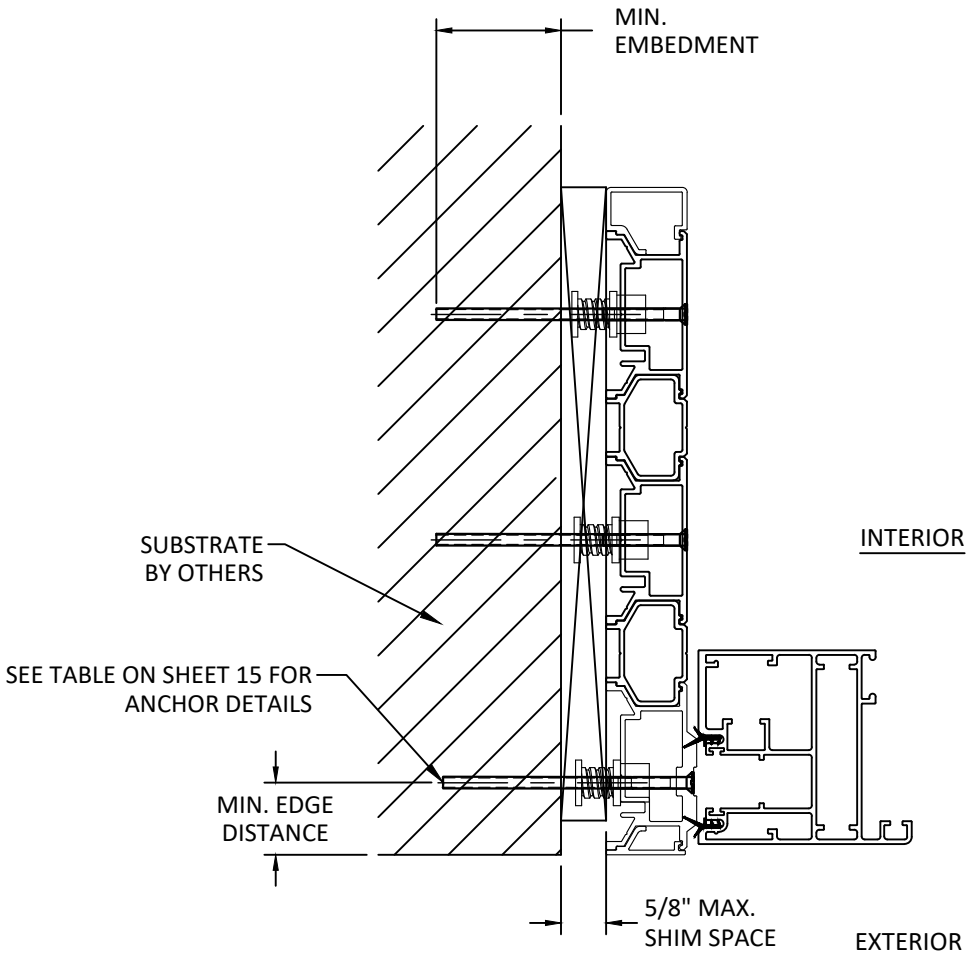


O 16 VERTICAL SECTION
3 TRACK JAMB - THROUGH FRAME

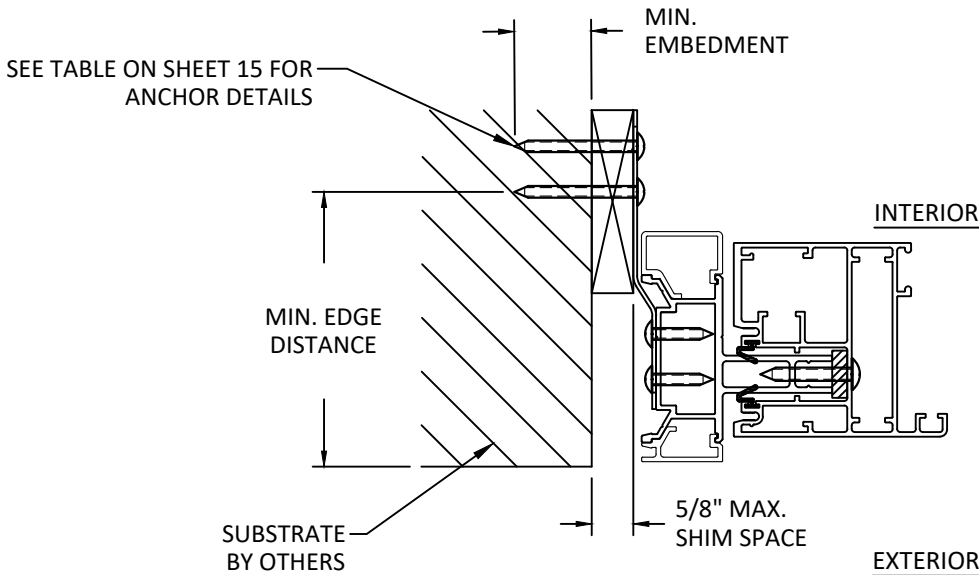

P 16 HORIZONTAL SECTION
1 TRACK JAMB - H TRACK

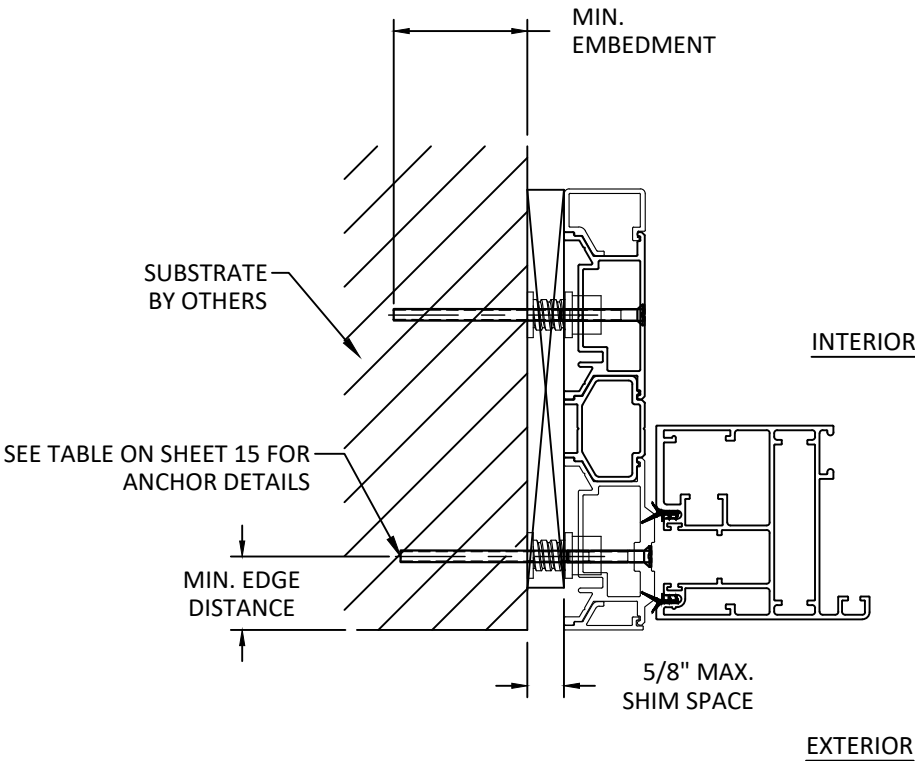


Q 16 VERTICAL SECTION
2 TRACK JAMB - THROUGH FRAME

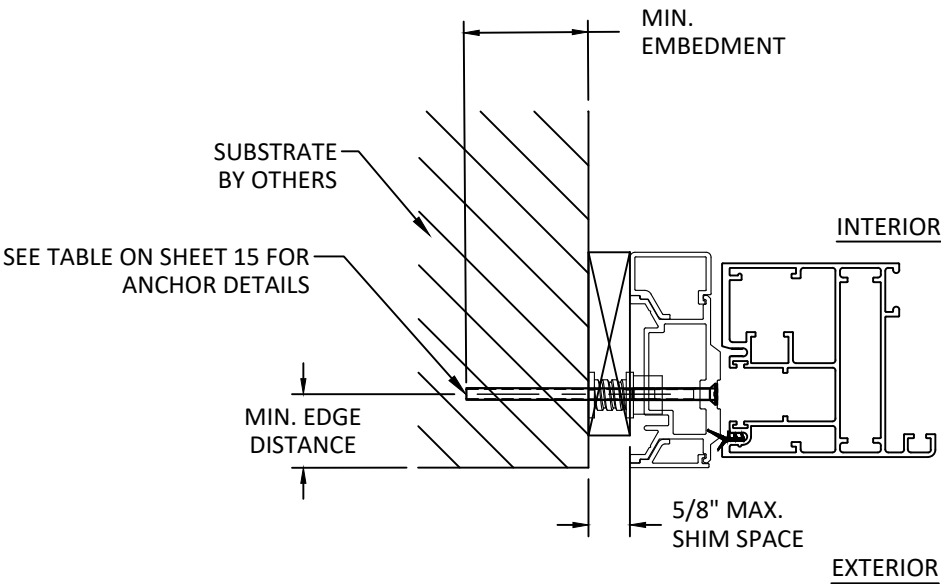


R 16 VERTICAL SECTION
1 TRACK JAMB - THROUGH FRAME


c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland\sliding doors\26-0244 - fl47871 awls-c & als-c 2 - revisions\dwgs\wscd015.dwg 4/8/2026 12:04 PM

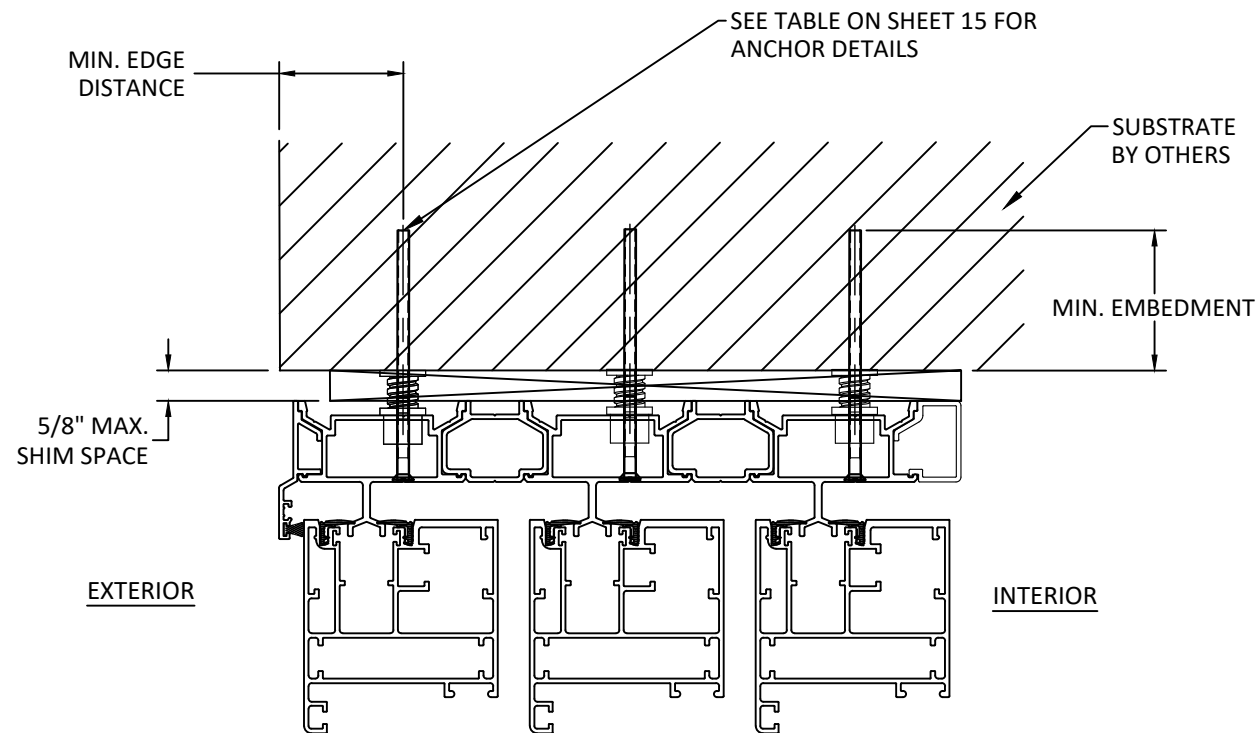


S
17 **VERTICAL SECTION**
3-TRACK HEAD - THROUGH FRAME

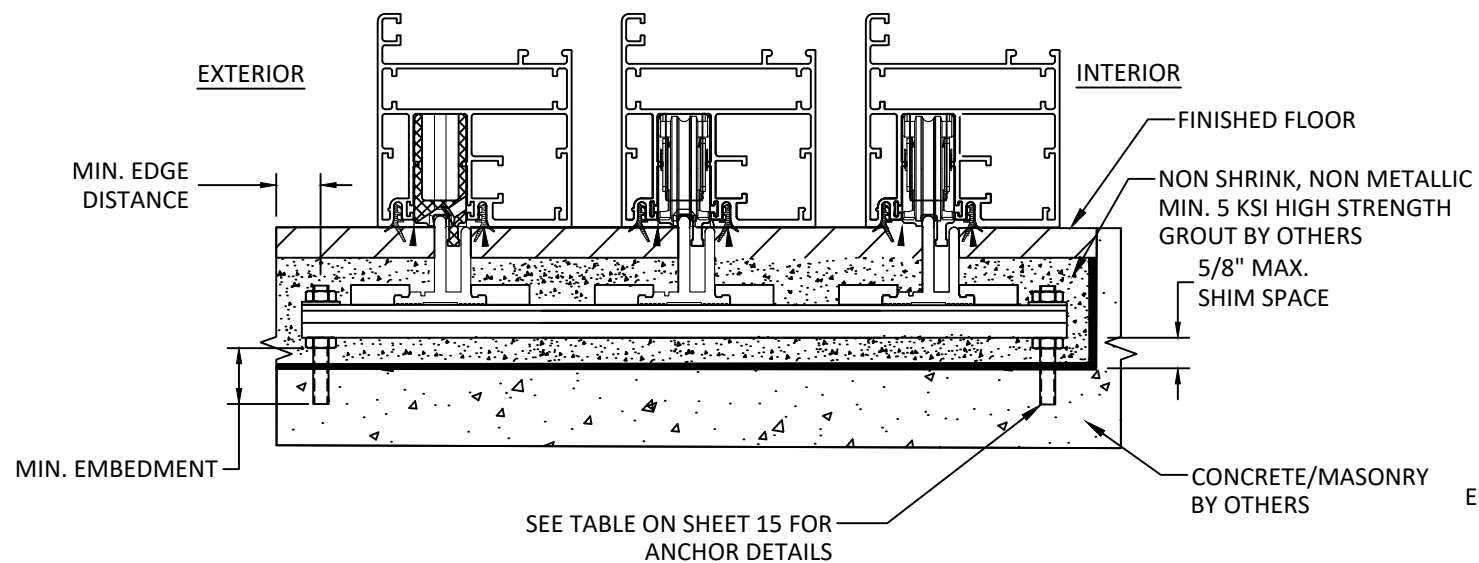

U
17 **VERTICAL SECTION**
3-TRACK SILL - THROUGH FRAME

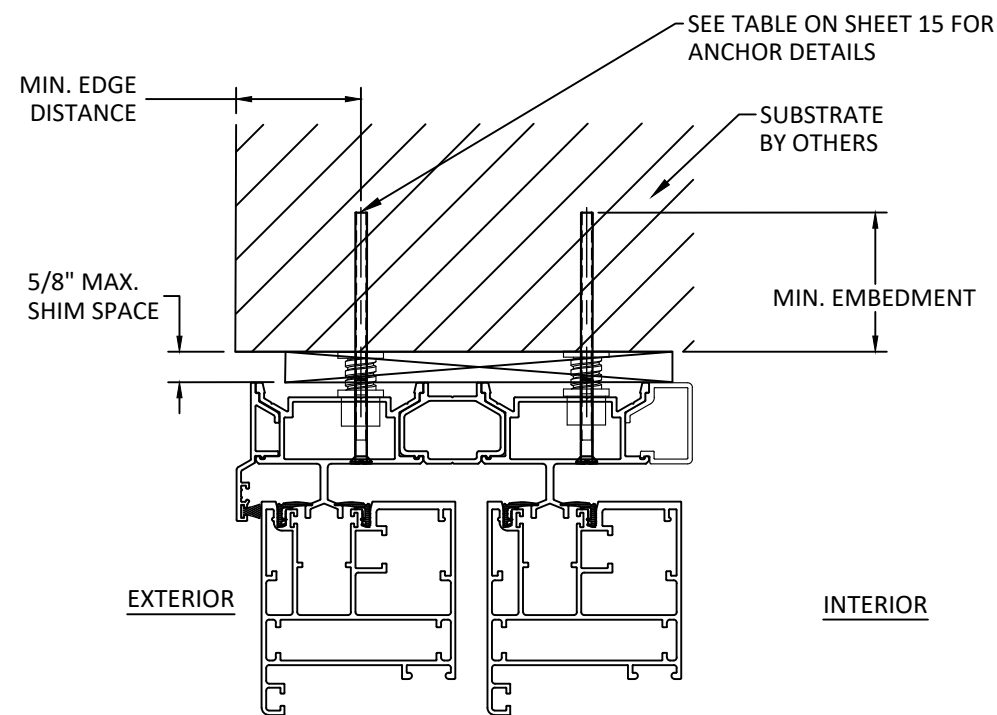

T
17 **VERTICAL SECTION**
2-TRACK HEAD - THROUGH FRAME

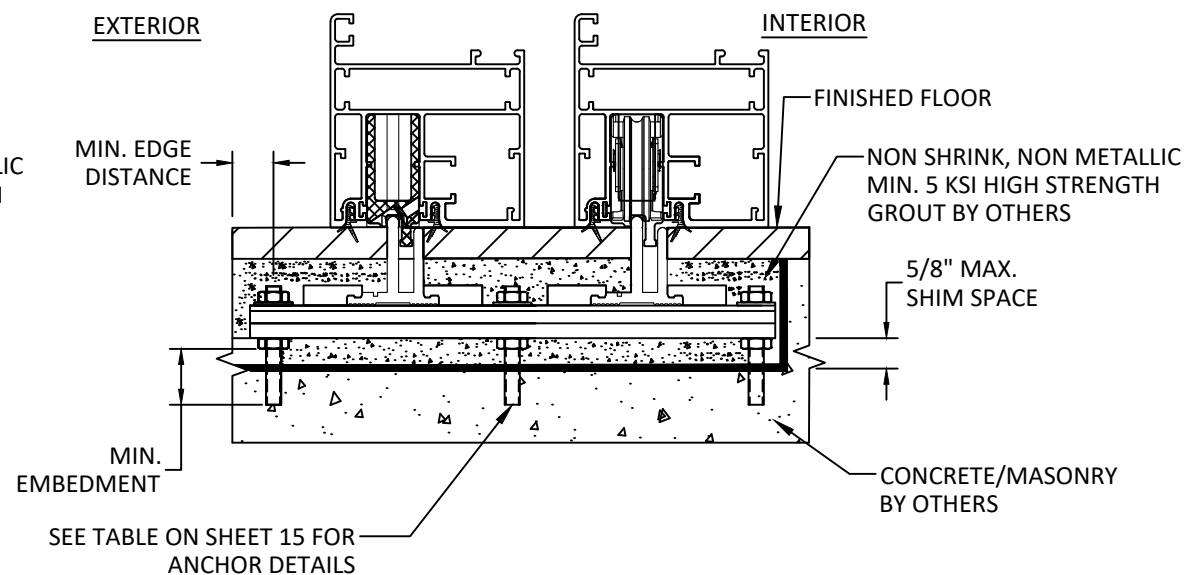

V
17 **VERTICAL SECTION**
2-TRACK SILL - THROUGH FRAME



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)

ANCHOR DETAILS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-9478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

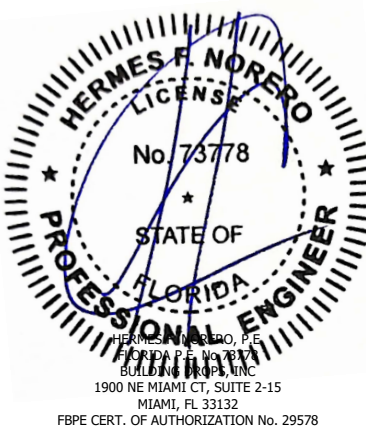

FL #: FL47871

DATE: 07.30.25

DWG. BY: HJ
CHK. BY: HFN

SCALE: NTS


DWG. #: WSD015

SHEET:

17


OF 18

c:\users\harley\jeanty\building drops, inc\building drops, inc\projects\weiland\sliding doors\lbc-26-0244 - fl47871 awls-c & als-c and als-2 - revisions\dwgs\wscd015.dwg 4/8/2026 12:04 PM

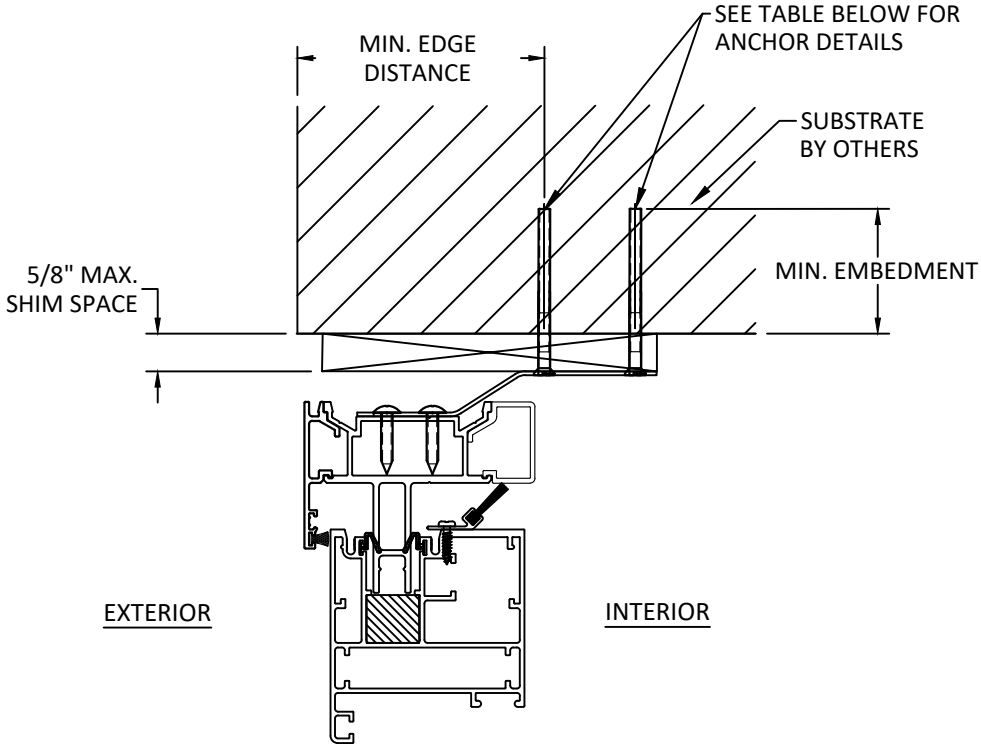

W
18

VERTICAL SECTION
H - TRACK HEAD

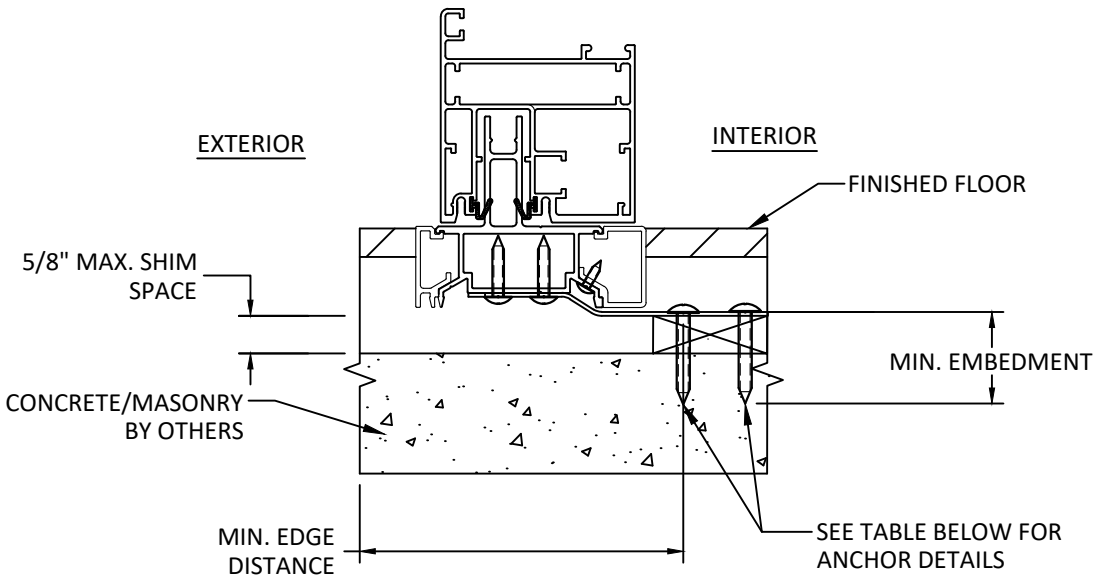

X
18

VERTICAL SECTION
H - TRACK SILL



1319 ROCKY POINT DR #100
OCEANSIDE, CA 92056
PH: (760) 722.8828 FX: (760) 722.8838

TITLE: ALS LIFT AND SLIDE DOOR
(HVHZ)(IMPACT)


ANCHOR DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
DP TABLE REV.	HJ	4/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

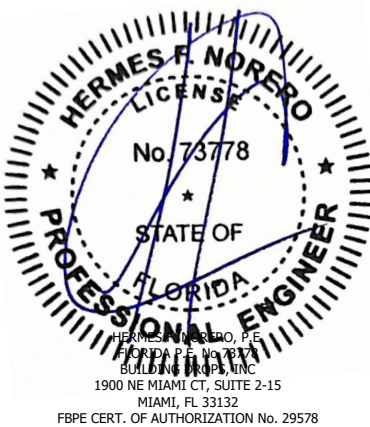

FL #: FL47871

DATE: 07.30.25

DWG. BY: HJ
CHK. BY: HFN

SCALE: NTS

DWG. #: WSD015

SHEET:

18

OF 18