




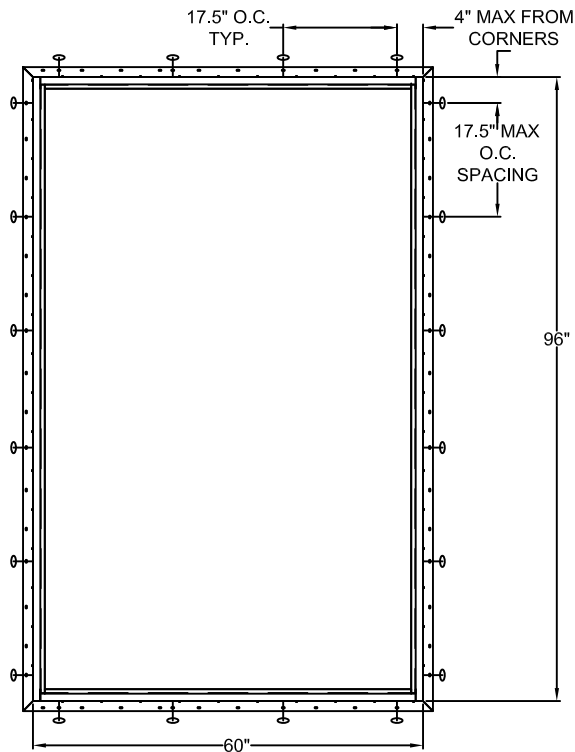

TYPICAL ELEVATION WITH FASTENER SPACING

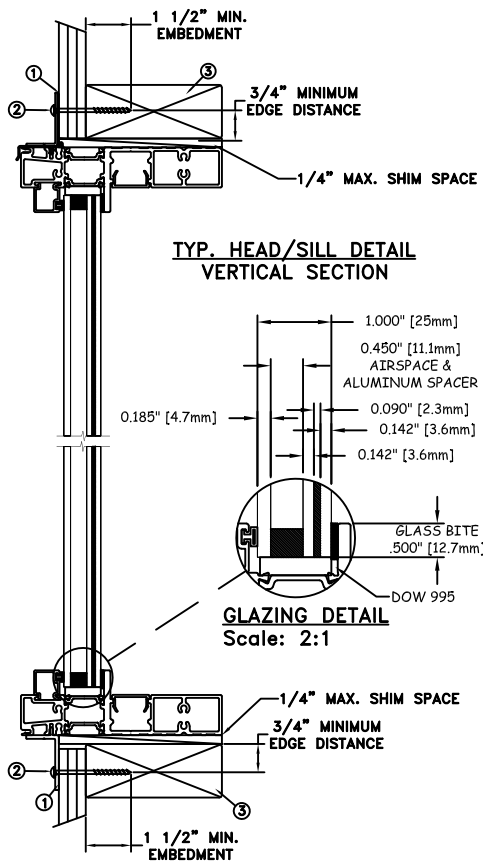

NAILFIN/SCREW-WOOD INSTALLATION

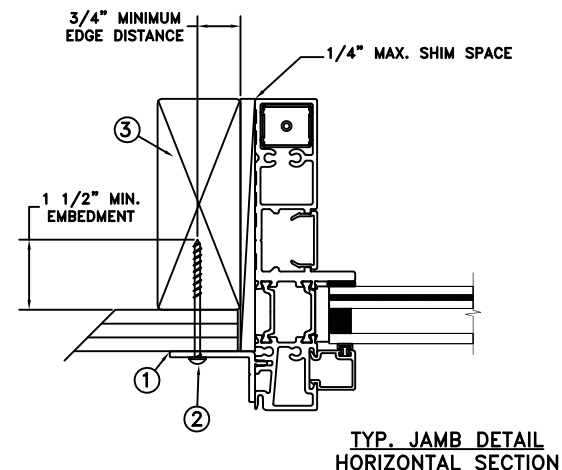

TYP. JAMB DETAIL
HORIZONTAL SECTION

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #8 PH or greater fastener through the nailing flange with sufficient length to penetrate a minimum of 1-1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.55).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 201-94, TAS 202-94, TAS 203-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.12.15 10:22:19 -0500




This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

	DATE: 09/17/2025	 LaCANTINA DOORS		1875 ORD WAY	
DRAWN BY: M.HAM	SCALE: NTS			OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
CHECKED BY: D.VEZO	TITLE: LaCantina V2 Aluminum Direct Set				
APPROVED BY: D.VEZO					
RECORD No.: D1000489					
REPORT No.: CRL 08T04	CAD DWG. No.: —		REV: C	SHEET 1 of 10	




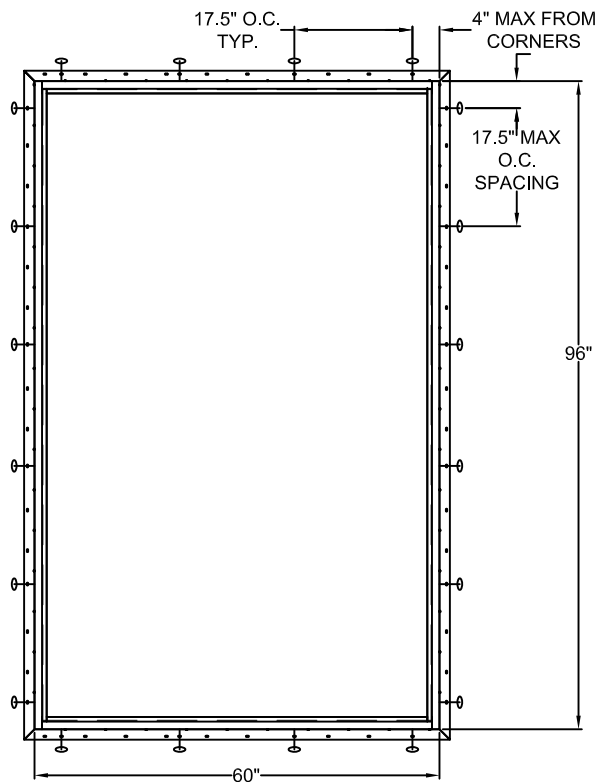

TYPICAL ELEVATION WITH FASTENER SPACING

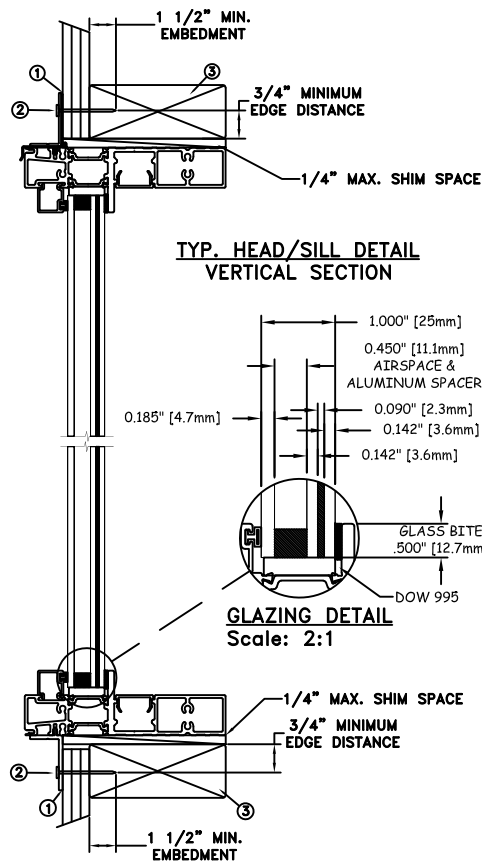

NAILFIN/NAIL-WOOD INSTALLATION

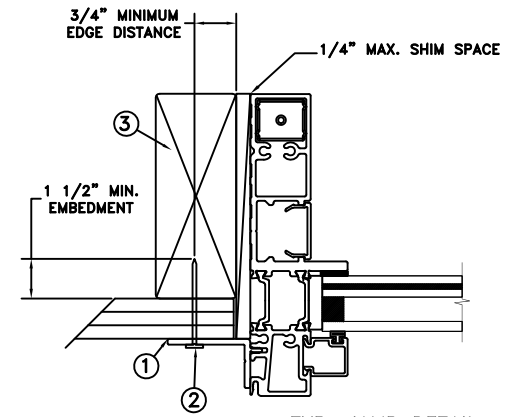

**TYP. JAMB DETAIL
HORIZONTAL SECTION**

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 6d (.113" diameter) x 2" nails through the nailing flange into the wood framing beyond. For 2x wood frame substrate (min. S.G. = 0.55).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 201-94, TAS 202-94, TAS 203-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.


This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

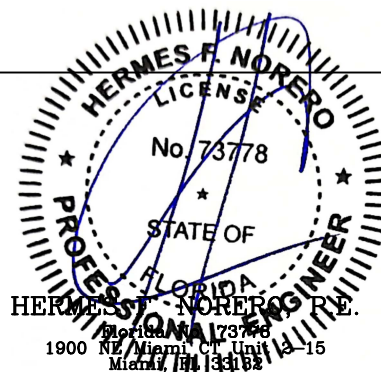

	DATE: 09/17/2025	 LaCANTINA DOORS	1875 ORD WAY	
DRAWN BY: M.HAM	SCALE: NTS		OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
CHECKED BY: D.Vezo	TITLE: LaCantina V2 Aluminum Direct Set			
APPROVED BY: D.Vezo				
RECORD No.: D1000489				
REPORT No.: CRL 08T04		CAD DWG. No.: —	REV: C	SHEET 2 of 10

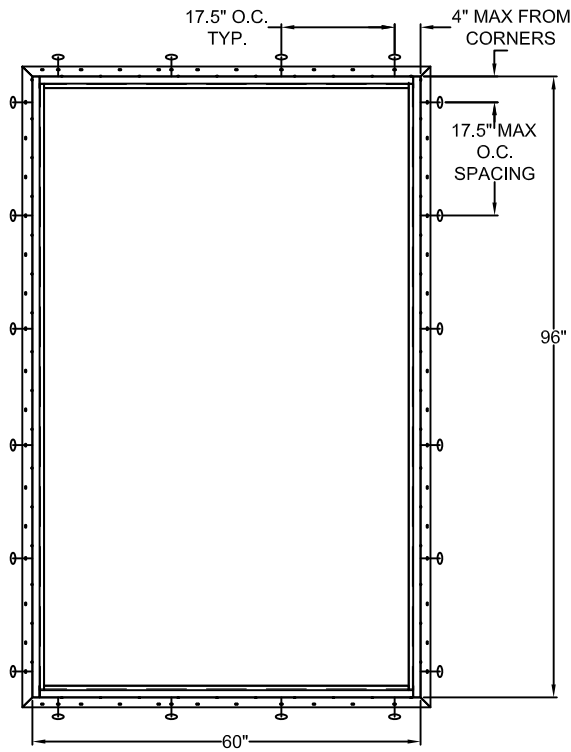


TYPICAL ELEVATION WITH FASTENER SPACING

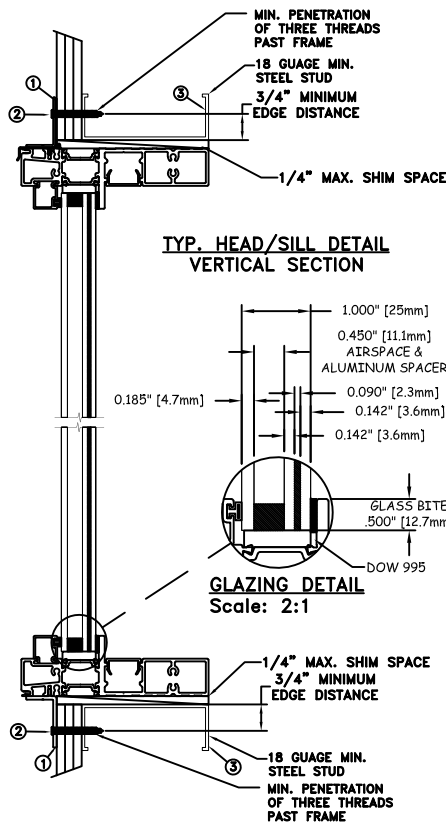

TYP. HEAD/SILL DETAIL
VERTICAL SECTION

GLAZING DETAIL
Scale: 2:1

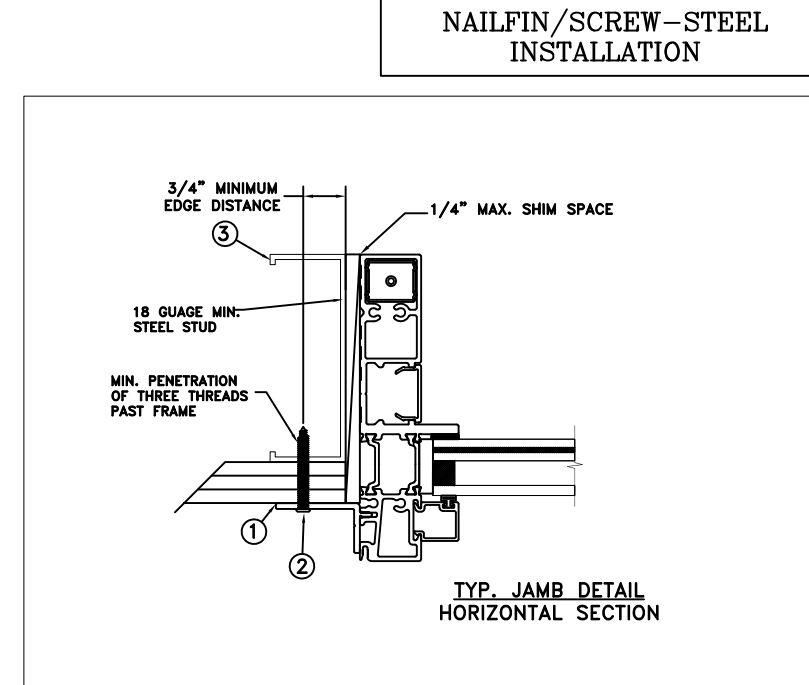

TYP. JAMB DETAIL
HORIZONTAL SECTION

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 TEK screws through the nail flange with sufficient length to achieve a minimum penetration of 3 threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 201-94, TAS 202-94, TAS 203-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

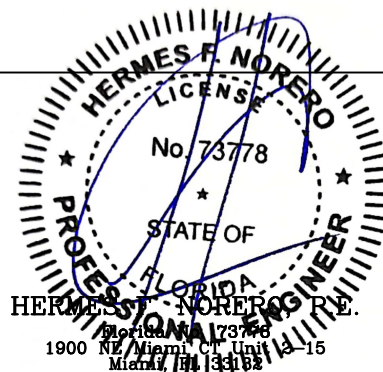


	DATE: 09/17/2025	 LaCANTINA DOORS		1875 ORD WAY	
DRAWN BY: M.HAM	SCALE: NTS			OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
CHECKED BY: D.Vezo	TITLE: LaCantina V2 Aluminum Direct Set				
APPROVED BY: D.Vezo					
RECORD No.: D1000489					
REPORT No.: CRL 08T04		CAD DWG. No.: —		REV: C	SHEET 3 of 10

THROUGH FRAME/SCREW WOOD INSTALLATION

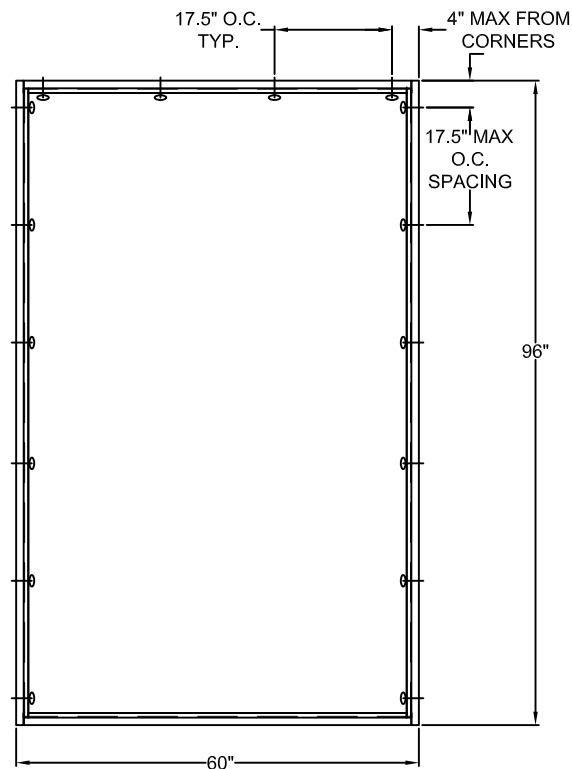


TYPICAL ELEVATION WITH FASTENER SPACING

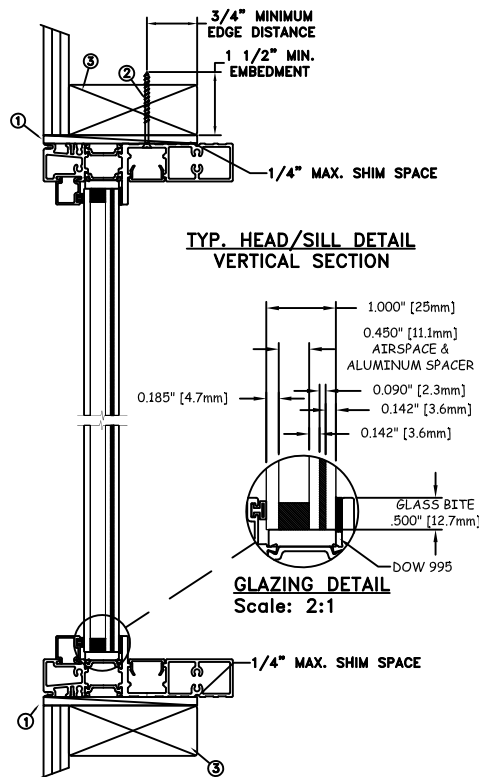

**TYP. HEAD/SILL DETAIL
VERTICAL SECTION**

**GLAZING DETAIL
Scale: 2:1**

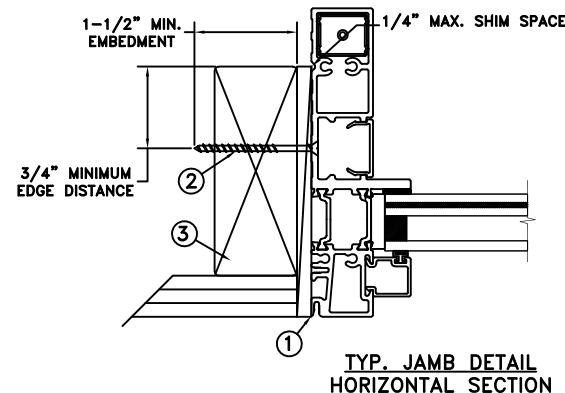

**TYP. JAMB DETAIL
HORIZONTAL SECTION**

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fasteners are used to anchor the sill (typical).
2. Use #8 PH or greater fastener through the head & side jambs with sufficient length to penetrate a minimum of 1-1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.55)
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 201-94, TAS 202-94, TAS 203-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

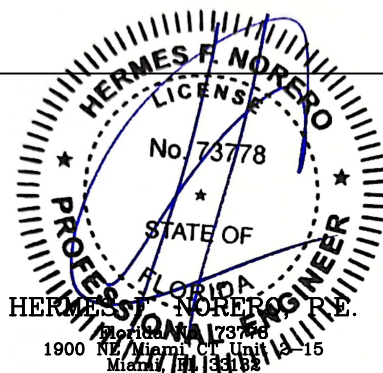


	DATE: 09/17/2025	 LaCANTINA DOORS 1875 ORD WAY OCEANSIDE CA, 92056 PHONE: (800) 535-3936			
DRAWN BY: M.HAM	SCALE: NTS				
CHECKED BY: D.VEZO	TITLE: LaCantina V2 Aluminum Direct Set				
APPROVED BY: D.VEZO					
RECORD No.: D1000489					
REPORT No.: CRL 08T04		CAD DWG. No.: —	REV: C	SHEET 4 of 10	

THROUGH FRAME/SCREW STEEL INSTALLATION

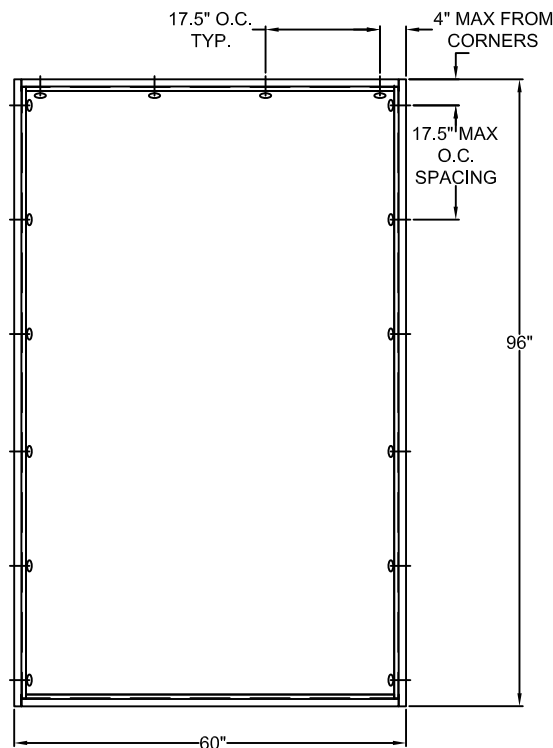


TYPICAL ELEVATION WITH FASTENER SPACING

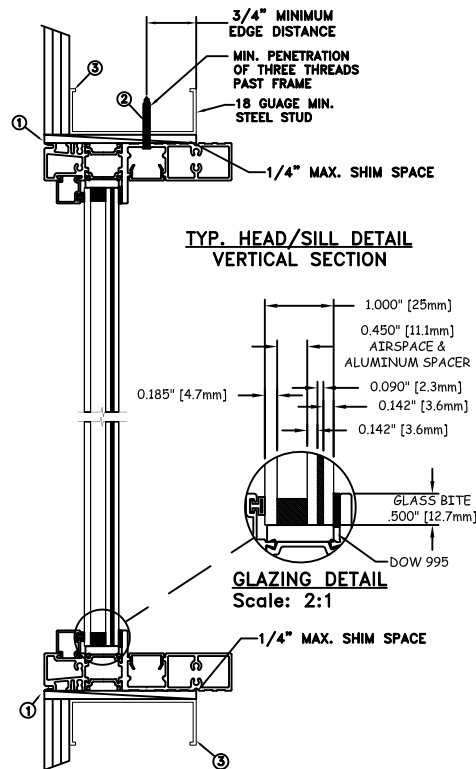

TYP. HEAD/SILL DETAIL
VERTICAL SECTION

GLAZING DETAIL
Scale: 2:1

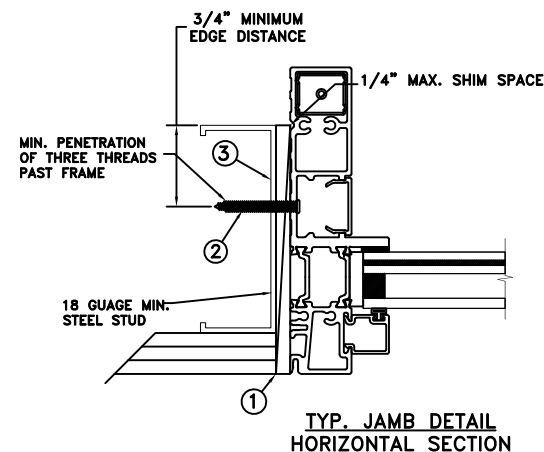

TYP. JAMB DETAIL
HORIZONTAL SECTION

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. For anchoring through head and side jambs into metal framing use #10 TEK Self-Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 201-94, TAS 202-94, TAS 203-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

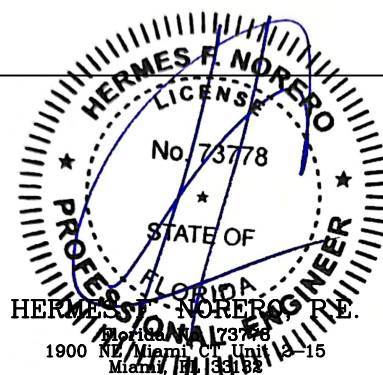


	DATE: 09/17/2025	 LaCANTINA DOORS	1875 ORD WAY	
DRAWN BY: M.HAM	SCALE: NTS		OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
CHECKED BY: D.VEZO	TITLE: LaCantina V2 Aluminum Direct Set			
APPROVED BY: D.VEZO				
RECORD No.: D1000489				
REPORT No.: CRL 08T04	CAD DWG. No.: —	REV: C	SHEET 5 of 10	

THROUGH FRAME/SCREW CONCRETE INSTALLATION

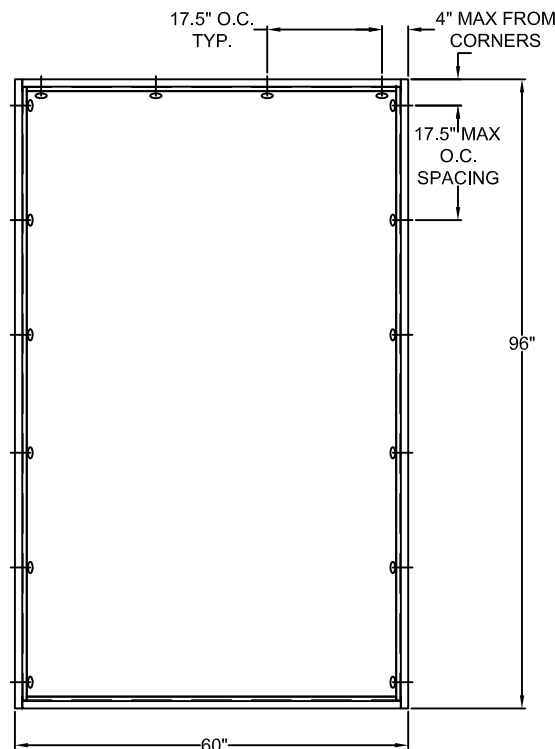


TYPICAL ELEVATION WITH FASTENER SPACING

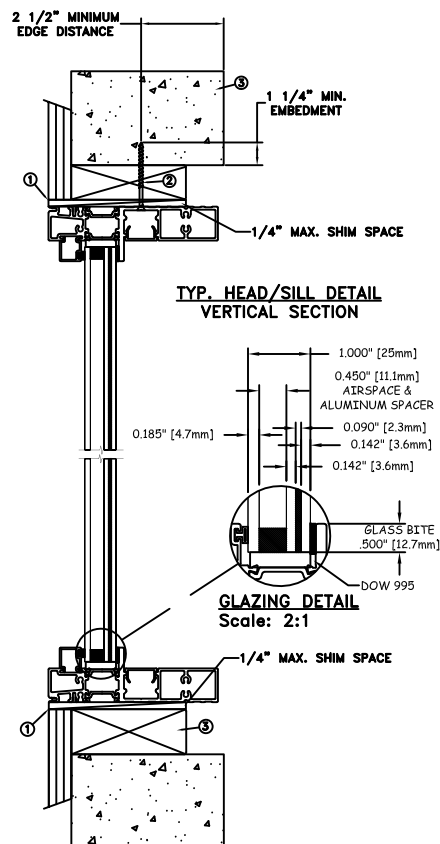

**TYP. HEAD/SILL DETAIL
VERTICAL SECTION**

**GLAZING DETAIL
Scale: 2:1**

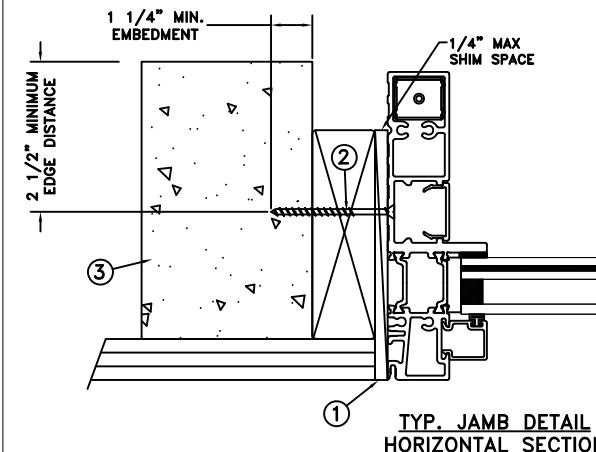

**TYP. JAMB DETAIL
HORIZONTAL SECTION**

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 3/16" Tapcon or equivalent fasteners through the head and side jambs with sufficient length to penetrate a minimum of 1-1/4" into concrete or masonry at each location with a 2-1/2" min. from edge distance. For concrete (min. $f_c = 3000$ psi) or masonry substrate (CMU shall be ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 201-94, TAS 202-94, TAS 203-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


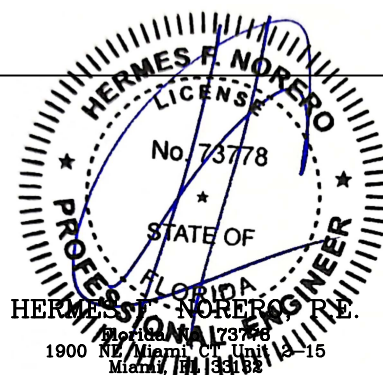


DATE: 09/17/2025	1875 ORD WAY OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS	LaCantina V2 Aluminum Direct Set
CHECKED BY: D.Vezo	TITLE:	
APPROVED BY: D.Vezo	RECORD No.:	
REPORT No.:	CAD DWG. No.:	
CRL 08T04	—	REV: C
		SHEET 6 of 10

MASONRY STRAP WOOD/SCREW INSTALLATION

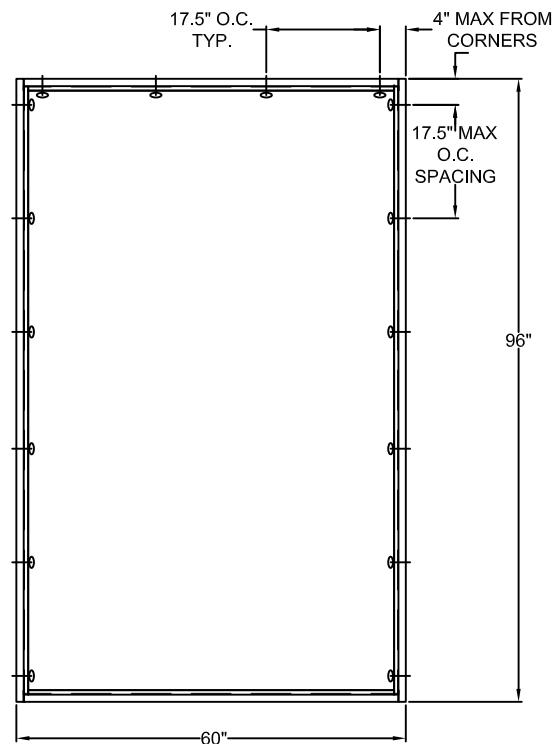

TYPICAL ELEVATION WITH FASTENER SPACING

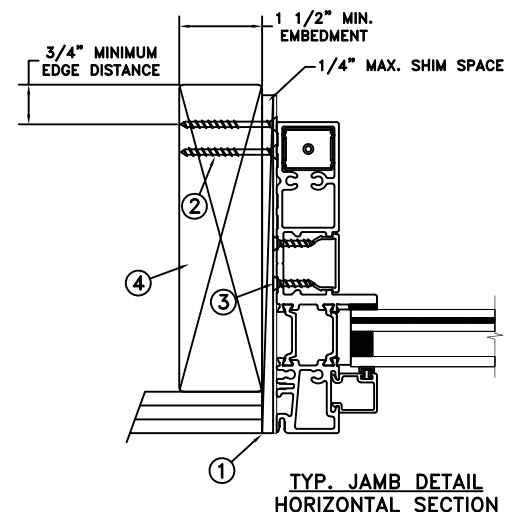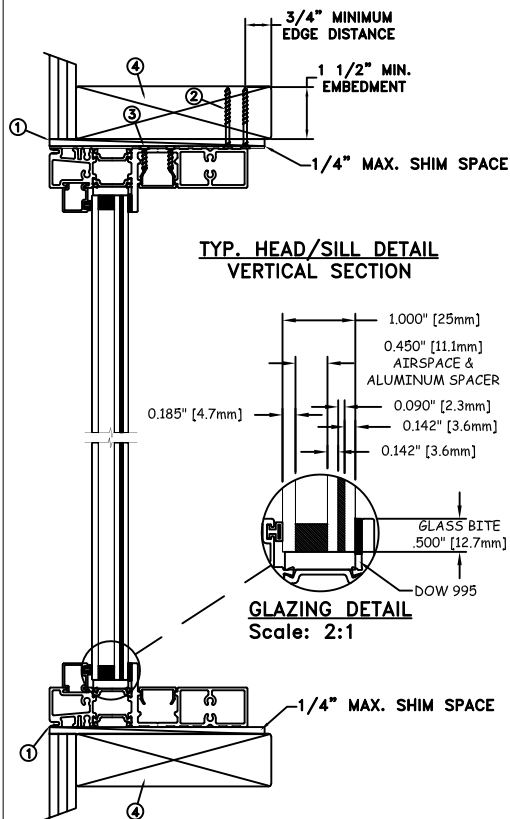

TYP. JAMB DETAIL
HORIZONTAL SECTION

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. For 2x wood frame substrate (min. S.G. = 0.55).
3. Use two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 201-94, TAS 202-94, TAS 203-94
7. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


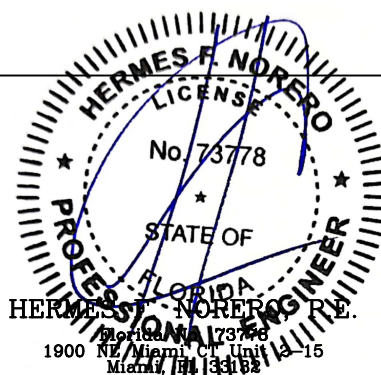


	DATE: 09/17/2025	 LaCANTINA DOORS 1875 ORD WAY OCEANSIDE CA, 92056 PHONE: (800) 535-3936			
DRAWN BY: M.HAM	SCALE: NTS				
CHECKED BY: D.VEZO	TITLE: LaCantina V2 Aluminum Direct Set				
APPROVED BY: D.VEZO					
RECORD No.: D1000489					
REPORT No.: CRL 08T04		CAD DWG. No.: —	REV: C	SHEET 7 of 10	

MASONRY STRAP WOOD/NAIL INSTALLATION

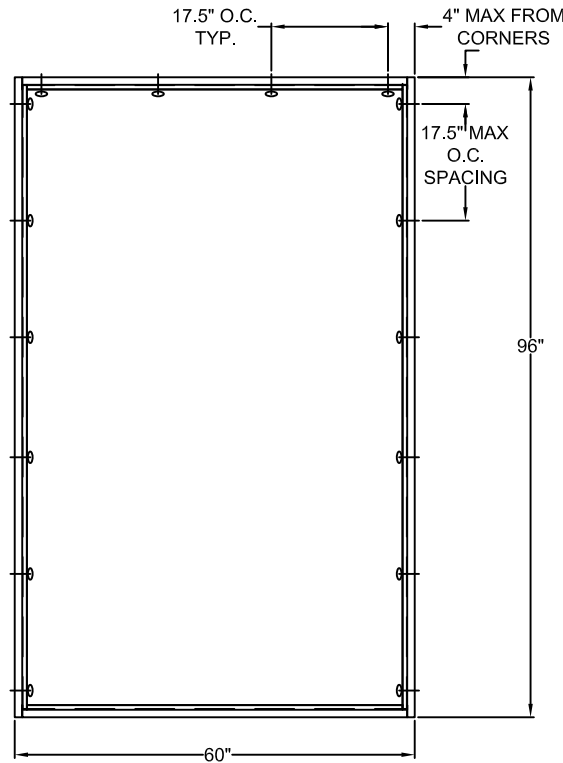

TYPICAL ELEVATION WITH FASTENER SPACING

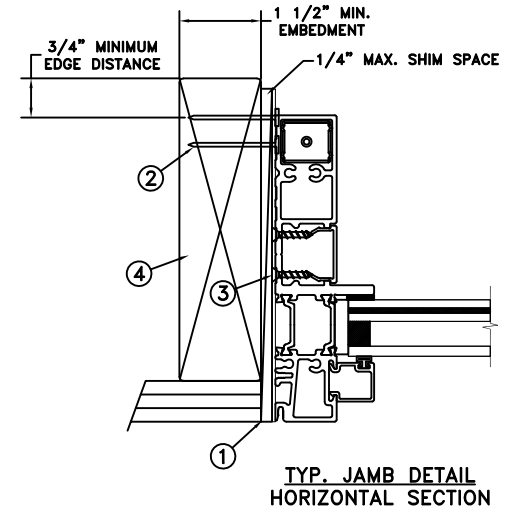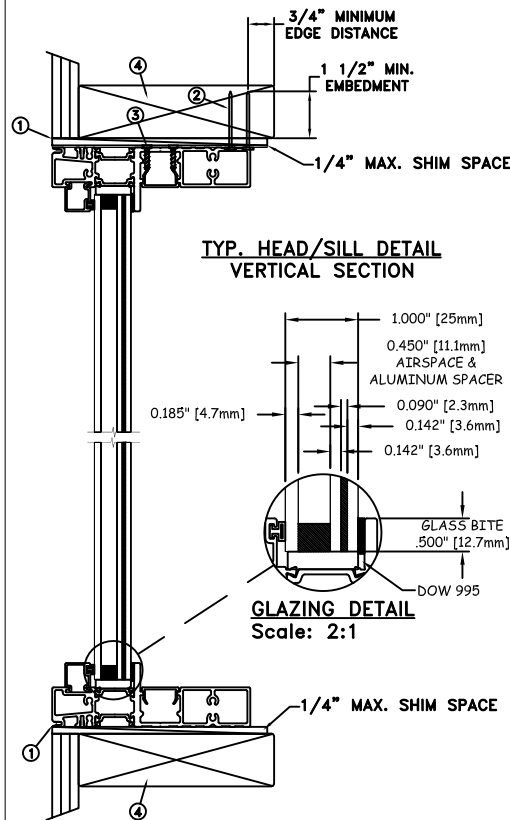

**TYP. JAMB DETAIL
HORIZONTAL SECTION**

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - 6d x 2" fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. For 2x wood frame substrate (min. S.G. = 0.55).
3. Use two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 201-94, TAS 202-94, TAS 203-94
7. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


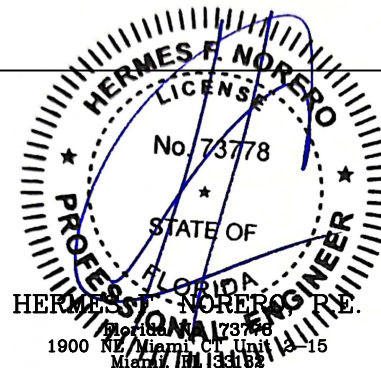


	DATE: 09/17/2025	 LaCANTINA DOORS 1875 ORD WAY OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS		
CHECKED BY: D.Vezo	TITLE: LaCantina V2 Aluminum Direct Set		
APPROVED BY: D.Vezo			
RECORD No.: D1000489			
REPORT No.: CRL 08T04	CAD DWG. No.: —	REV: C	SHEET 8 of 10

MASONRY STRAP STEEL/SCREW INSTALLATION

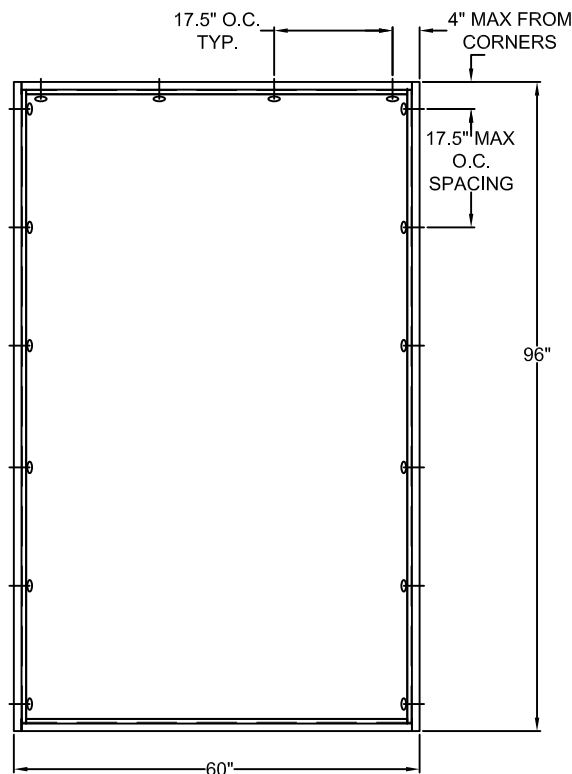

TYPICAL ELEVATION WITH FASTENER SPACING

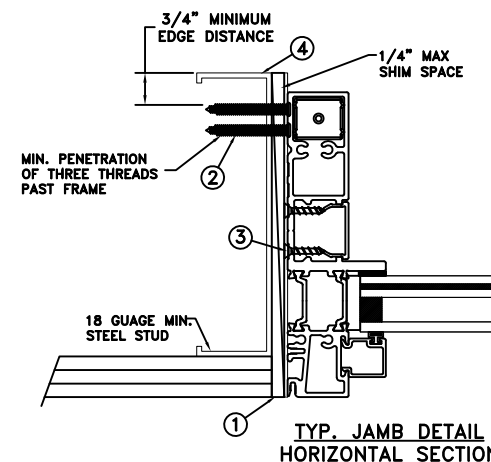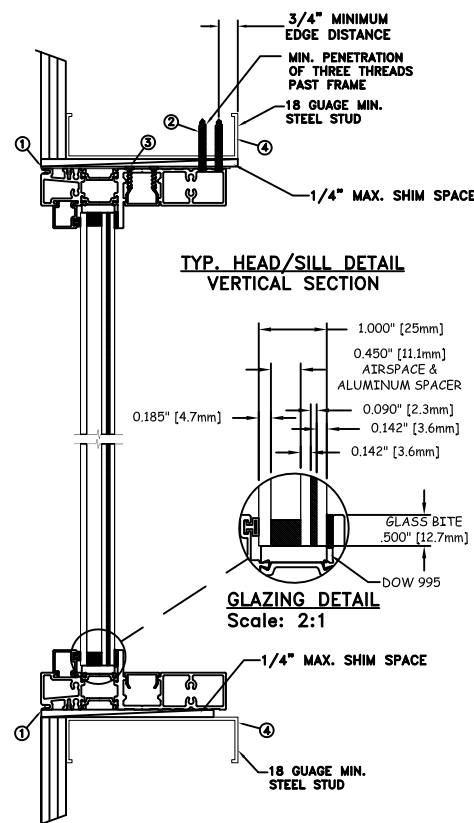

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - #10 TEK Self-Tapping or larger screws through masonry strap with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Use two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 201-94, TAS 202-94, TAS 203-94
7. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


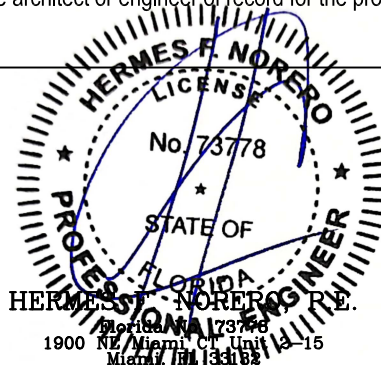


	DATE: 09/17/2025	 LaCANTINA DOORS		1875 ORD WAY	
DRAWN BY: M.HAM	SCALE: NTS			OCEANSIDE CA, 92056 PHONE: (800) 535-3936	
CHECKED BY: D.Vezo	TITLE: LaCantina V2 Aluminum Direct Set				
APPROVED BY: D.Vezo					
RECORD No.: D1000489					
REPORT No.: CRL 08T04		CAD DWG. No.: —	REV: C	SHEET 9 of 10	

MASONRY STRAP CONCRETE
SCREW INSTALLATION

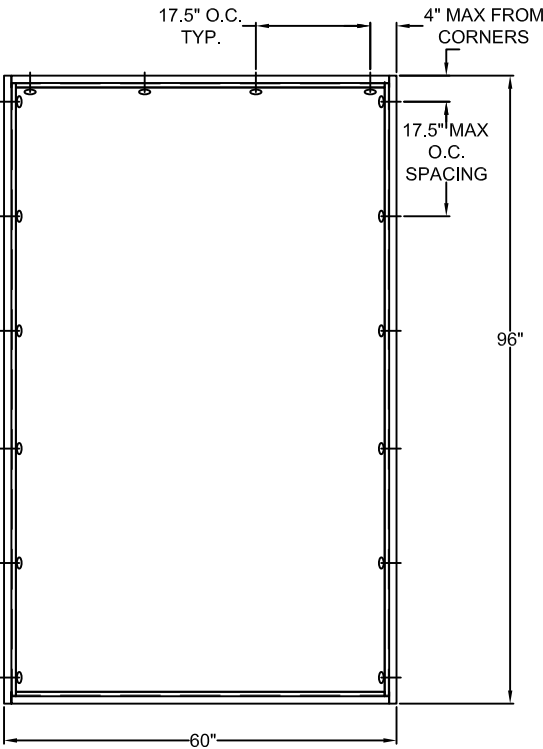

TYPICAL ELEVATION WITH FASTENER SPACING

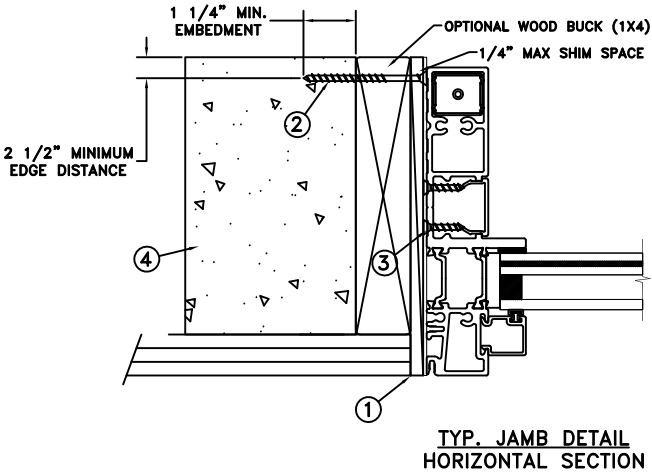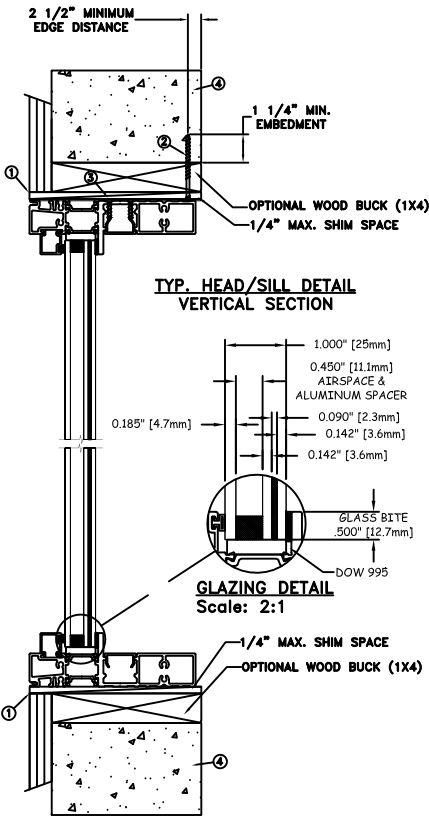

MAXIMUM FRAME	DP	IMPACT
60" x 96"	+65/-70	YES

Installation Notes:


1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use one (1) - 3/16" Tapcon or equivalent fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/4" into the buck or concrete. For 2x wood frame substrate (min. S.G. = 0.55). For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall be ASTM C90).
3. Use two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing conforms to ASTM E1300.
3. Glazing shall be 4.7mm tempered - 11.1mm airspace - 3.6mm annealed - 2.3mm SentryGlas Interlayer by Kuraray - 3.6mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 201-94, TAS 202-94, TAS 203-94
7. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

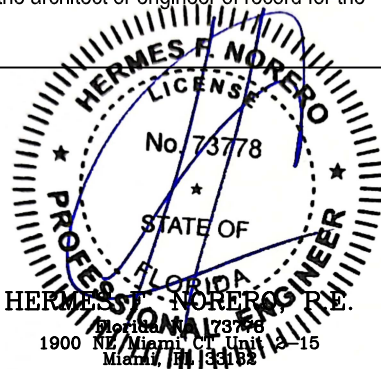

DATE: 09/17/2025	1875 ORD WAY
DRAWN BY: M.HAM	OCEANSIDE CA, 92056
CHECKED BY: D.Vezo	PHONE: (800) 535-3936
APPROVED BY: D.Vezo	
RECORD No.: D1000489	
REPORT No.: CRL 08T04	
CAD DWG. No.: —	REV: C
SHEET 10 of 10	



LaCantina V2 Aluminum Direct Set