

ODL, INC.

INSWING & OUTSWING OPAQUE FIBERGLASS DOOR

(WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- ASTM E1886-19
 - ASTM E1996-20
 - ASTM E330-14
 - ASTM E331-00(23)
 - ASTM E283-04
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS.
7. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 4.
8. DOOR SKIN MATERIAL: FIBERGLASS

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	PRODUCT SPECIFICATIONS TABLE
3	OXXO ELEVATION
4	OXO ELEVATION
5	X & XX ELEVATIONS
6	ADDITIONAL QUALIFIED PANEL DESIGNS
7	ANCHOR LAYOUTS
8	ANCHOR LAYOUTS
9	VERTICAL SECTIONS
10	VERTICAL SECTIONS
11	VERTICAL SECTIONS
12	HORIZONTAL SECTIONS
13	HORIZONTAL SECTIONS
14	HORIZONTAL SECTIONS
15	HORIZONTAL SECTIONS
16	HORIZONTAL SECTIONS
17	HORIZONTAL SECTIONS
18	ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES
19	ANCHOR DETAILS
20	ANCHOR DETAILS
21	ANCHOR DETAILS
22	BILL OF MATERIALS & COMPONENTS
23	COMPONENTS



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

GENERAL NOTES


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.11 17:18:41 -03'00'

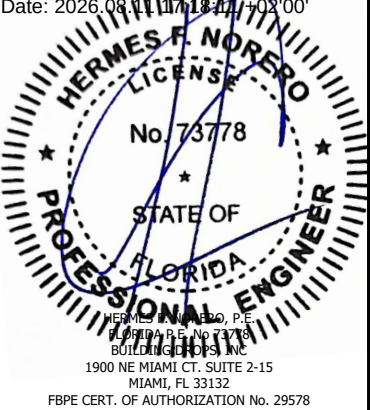

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL47925		
DATE:	12.04.2025		
DWG. BY:	JR	CHK. BY:	HFN
SCALE:	NTS		
DWG. #:	ODL007		
SHEET:	1	REV.	A

OF 23

NOTE: ALL RATINGS ARE WITH NARROW SIDELITES (UP TO 15.50" SIDELITE FRAME WIDTH), EXCEPT CONTINUOUS OXXO CONFIGURATIONS WHICH INCLUDE FULL SIDELITES (UP TO 37.50" SIDELITE FRAME WIDTH).

ELEVATION

OXXO CONFIGURATION



DOOR: PRODUCT DIMENSIONS TABLE				
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)
6'8" OPAQUE	74.50	82.00	35.75	79.25
8'0" OPAQUE	74.50	98.00	35.75	95.25

NOTE: BOXED CONSTRUCTION SHOWN,
CONTINUOUS CONSTRUCTION
QUALIFIED. SEE SHEETS 13-15 FOR
HORIZONTAL SECTION DETAILS FOR
CONTINUOUS CONSTRUCTION.

***NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.**

NOTE: OPAQUE PANELS QUALIFIED FOR USE WITH GLAZED AND FLUSH GLAZED SIDELITES. SEE SEPARATE FLORIDA PRODUCT APPROVAL FOR MORE INFORMATION ON SIDELITES.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

OXXO ELEVATION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

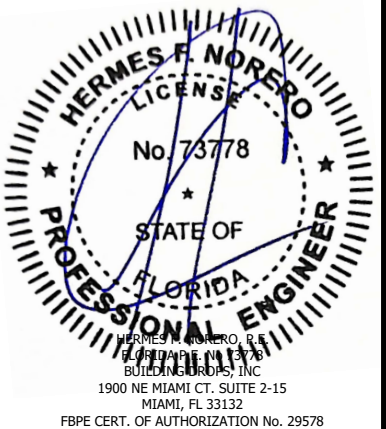

FL #: **FL47925**

DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: ODL007

SHEET:	REV.
2	A

NOTE: 2X NOT REQUIRED BETWEEN
BOXES FOR DOOR PANELS LESS
THAN OR EQUAL TO 79.25" IN HEIGHT.

DOOR: PRODUCT DIMENSIONS TABLE				
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)
6'8" OPAQUE	37.50	82.00	35.75	79.25
8'0" OPAQUE	37.50	98.00	35.75	95.25

NOTE: OPAQUE PANELS QUALIFIED FOR USE WITH GLAZED AND FLUSH GLAZED SIDELITES. SEE SEPARATE FLORIDA PRODUCT APPROVAL FOR MORE INFORMATION ON SIDELITES.



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL47925**

DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: ODL007

SHEET:	REV.
--------	------

4

EV.

DF 23

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
*INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)*

ADDITIONAL QUALIFIED PANEL DESIGNS

PREPARED BY:

BUILDING DROPS, INC.

E MIAMI CT. SUITE 2-15


MIAMI, FL 33132
PH: (305) 300 9478

PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

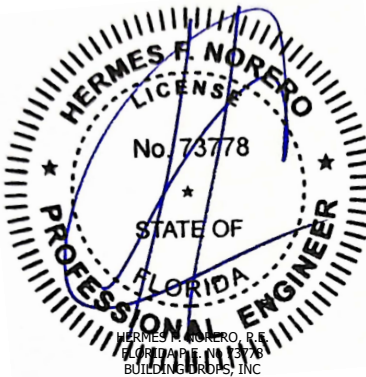

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47925**


DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: ODL007

SHEET:	REV.
6	A

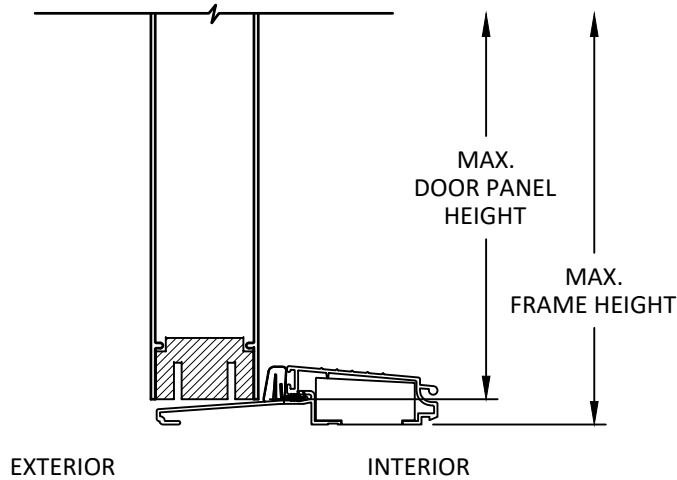

VERTICAL SECTION AFCO A-117 SILL SIDELITE QUALIFIED FOR USE WITH SILL BOX CONSTRUCTION RATED TO MAX. DESIGN PRESSURE +/- 65 PSF

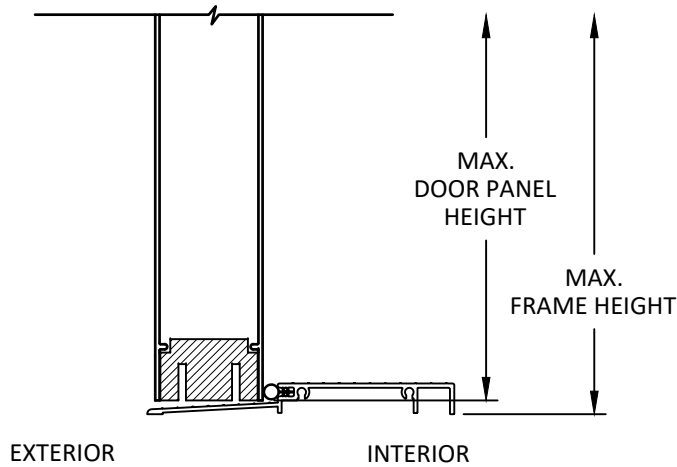


D

11

VERTICAL SECTION


AFCO A-204T SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 65 PSF

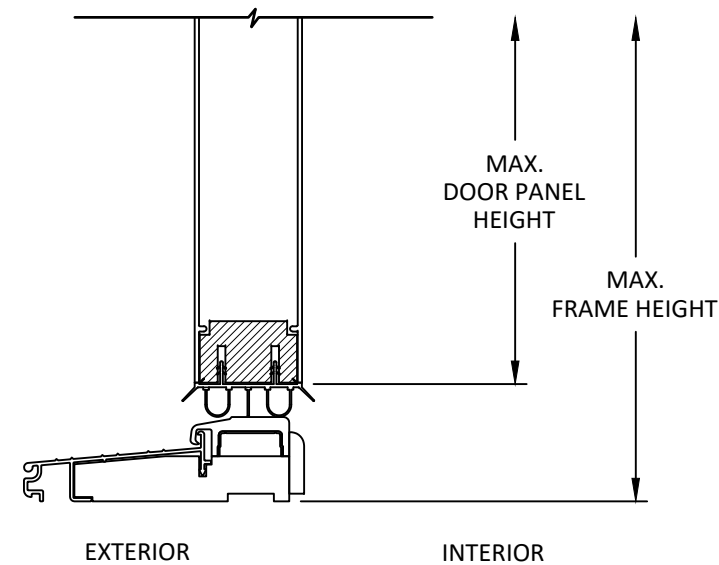



VERTICAL SECTION


AFCO A-276 SILL
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH AFCO SIDELITE BASE
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE + 65 / - 70 PSF

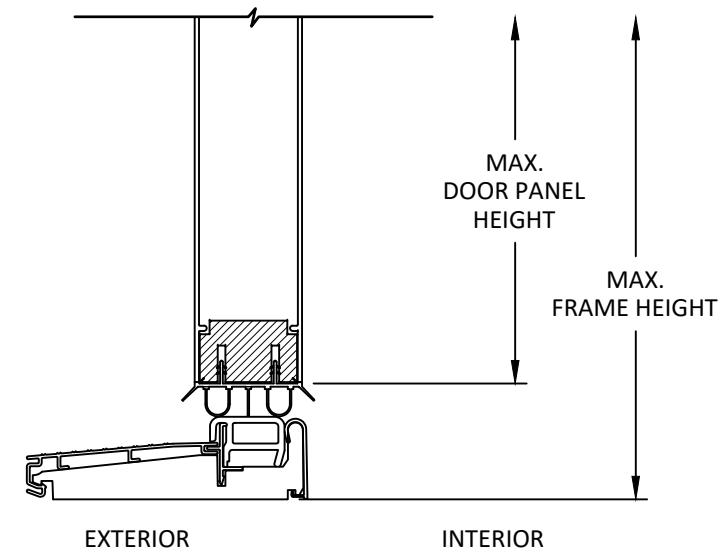




VERTICAL SECTION

ENDURA ZAILAA4565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH ENDURA SIDELITE BASE
CONTINUOUS & BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 65 PSF

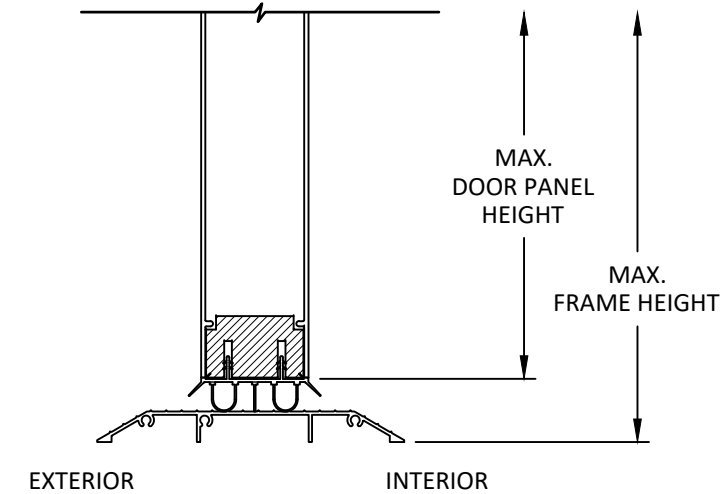

VERTICAL SECTION AFCO A-204 SILL SIDELITE QUALIFIED FOR USE WITH SILL BOX CONSTRUCTION RATED TO MAX. DESIGN PRESSURE +/- 60 PSF

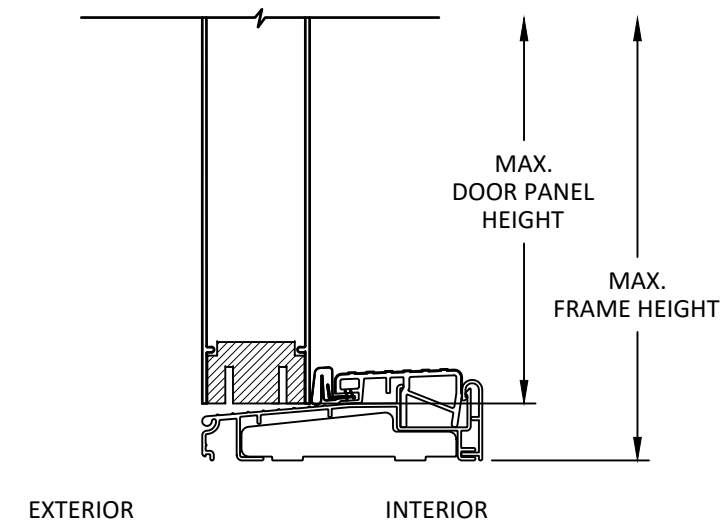

VERTICAL SECTION

ENDURA ZOB14565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
CONTINUOUS & BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 65 PSF



TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

VERTICAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

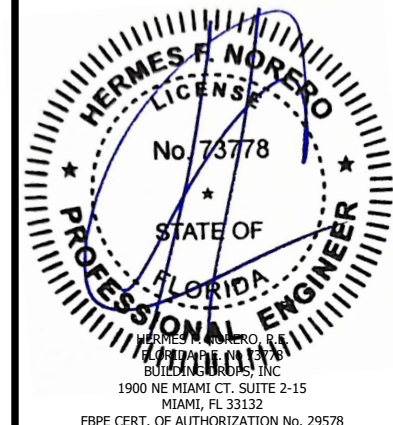

FL #: **FL47925**

DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: ODL007


SHEET:	REV.
11	A

OF 23


FL #:		FL47925	
DATE:		12.04.2025	
DWG. BY:	JR	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		ODL007	
SHEET:		REV.	A
13		OF 23	

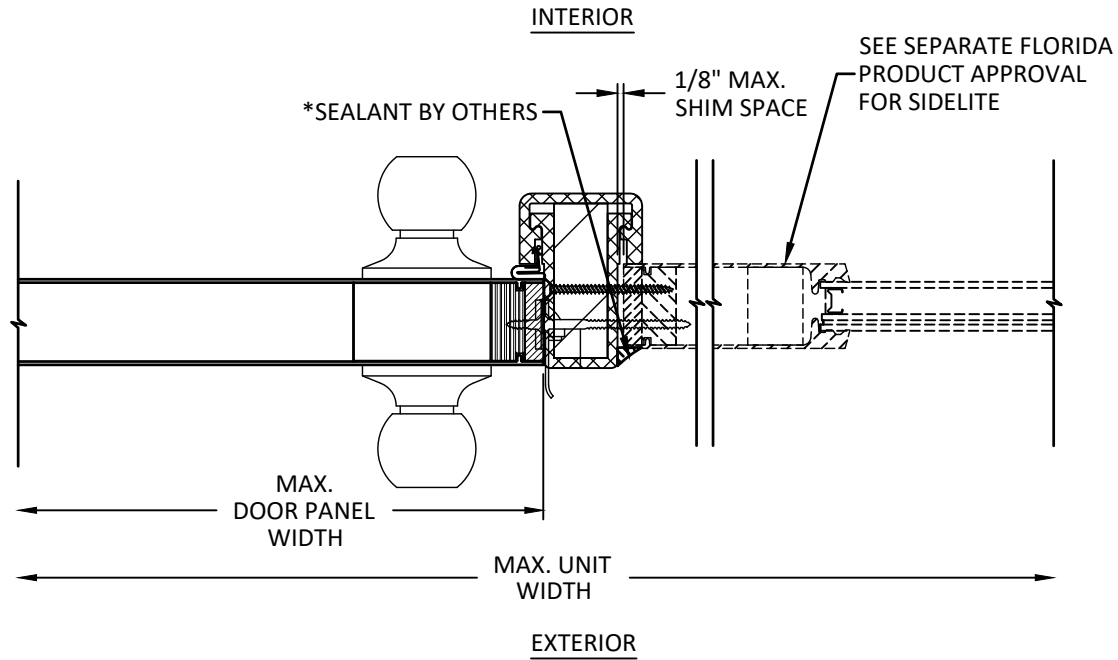

A
14 **HORIZONTAL SECTION**
OUTSWING - PLASTPRO MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

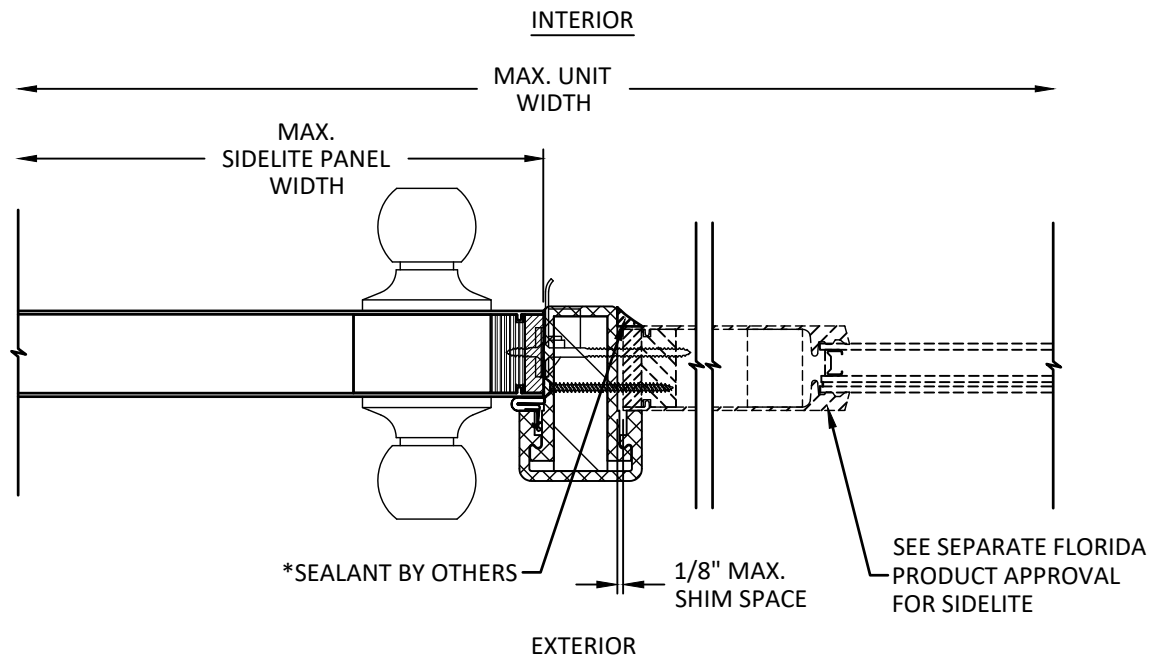


HORIZONTAL SECTION INSWING - PLASTPRO MULLION CONTINUOUS CONSTRUCTION RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

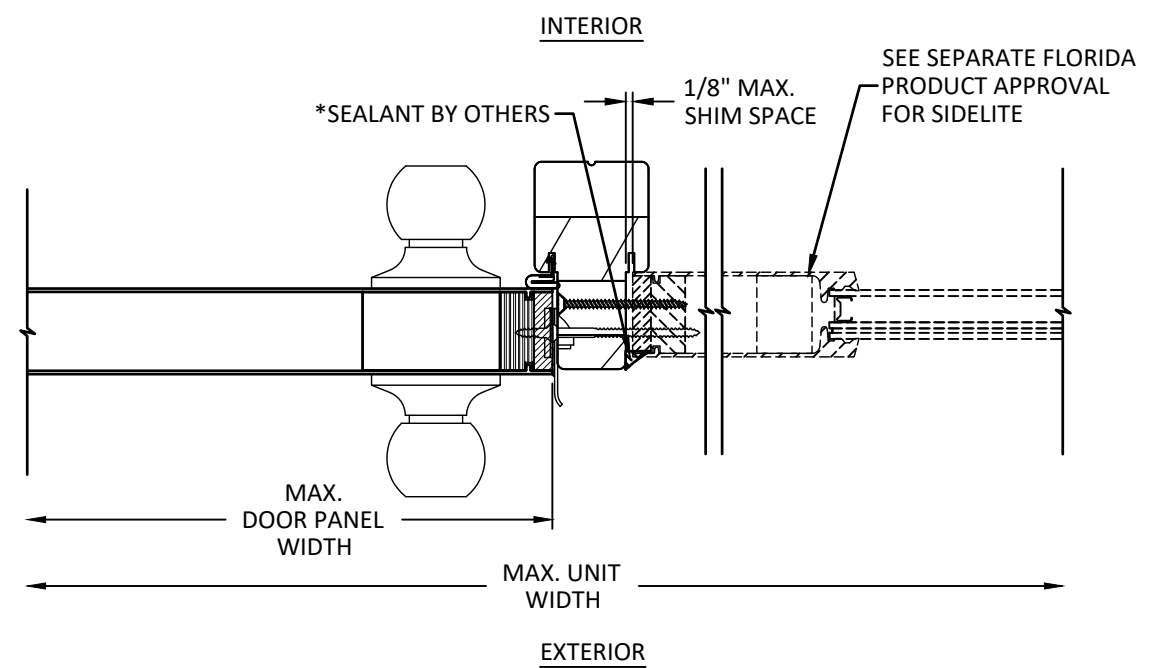

C 14 HORIZONTAL SECTION

OUTSWING - WOOD PINE MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

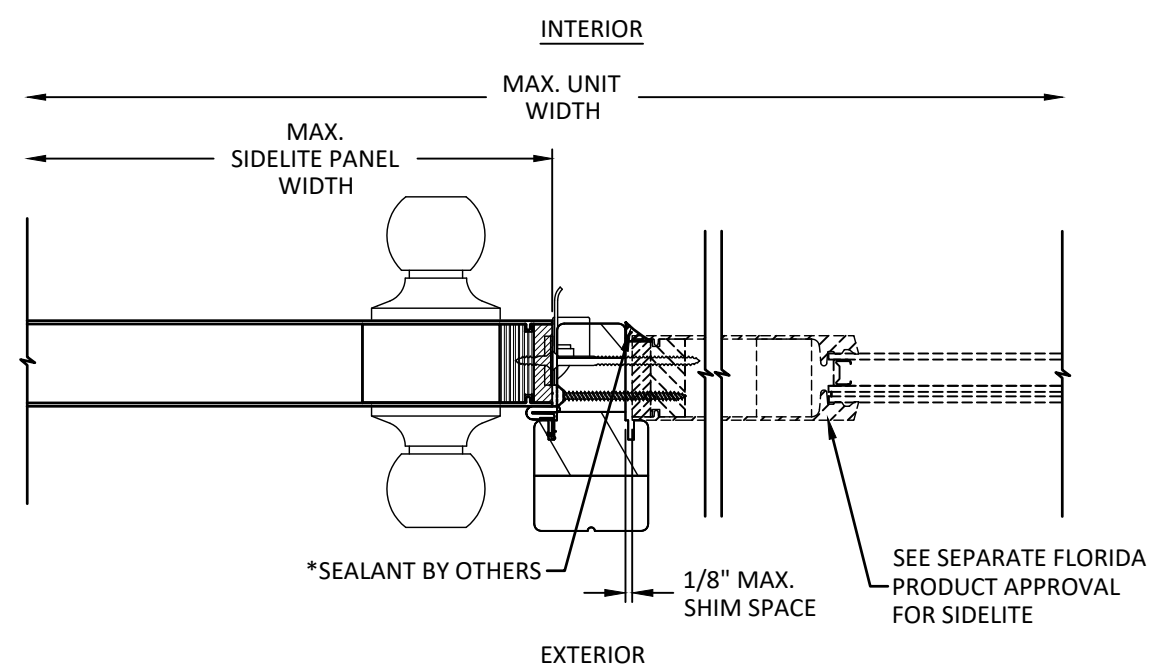

D HORIZONTAL SECTION

INSWING - WOOD PINE MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1000 NE MIAMI CT. SUITE 215


MIAMI, FL 33132
PH: (954)399-8478

FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

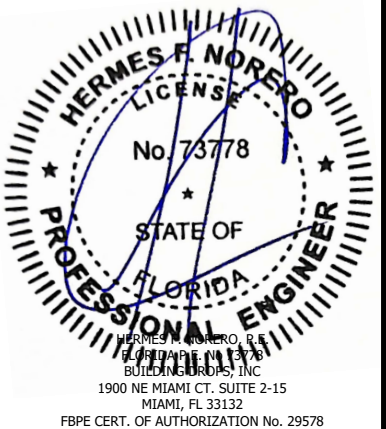

FL #: **FL47925**

DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: ODL007


SHEET:	REV.
--------	------

14

REV. A

OF 23


OUTSWING - ENDURA FRAME
SAVER MULLION
CONTINUOUS CONSTRUCTION
RATED TO A MAX. DP OF +/- 32.7 PSF

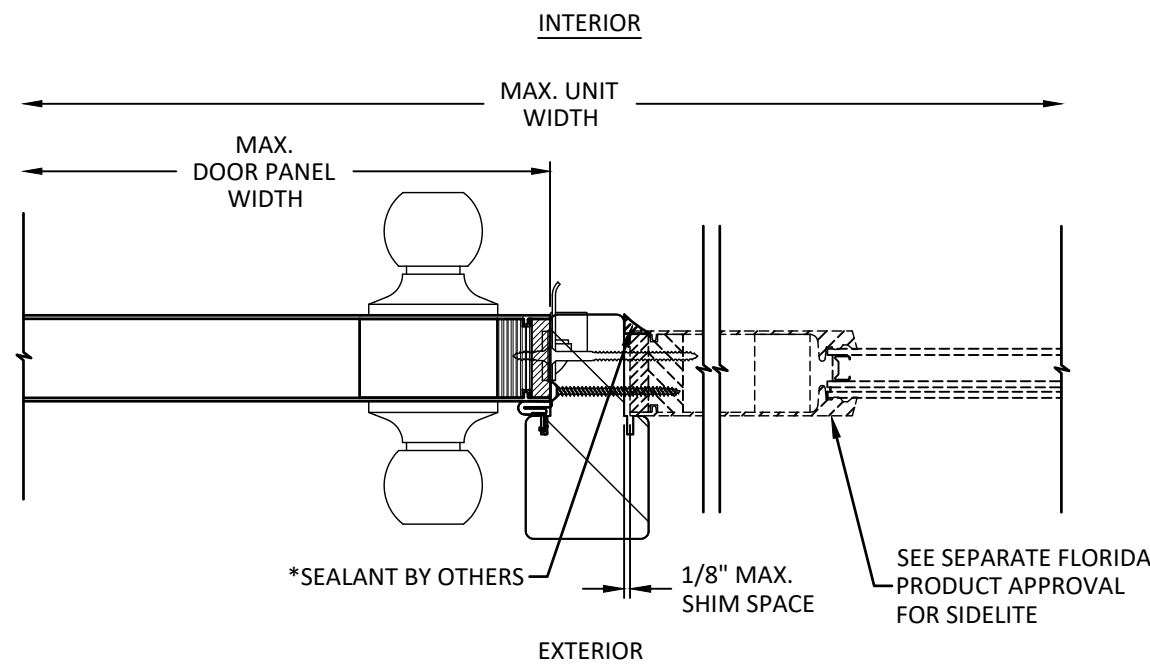


INSWING - ENDURA FRAME
SAVER MULLION
RATED TO A MAX. DP OF +/- 32.7 PSF
CONTINUOUS CONSTRUCTION




c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40-1 - 2026 code change.dwg\147925\odi007 - a.dwg 7/20/2026 5:15 PM

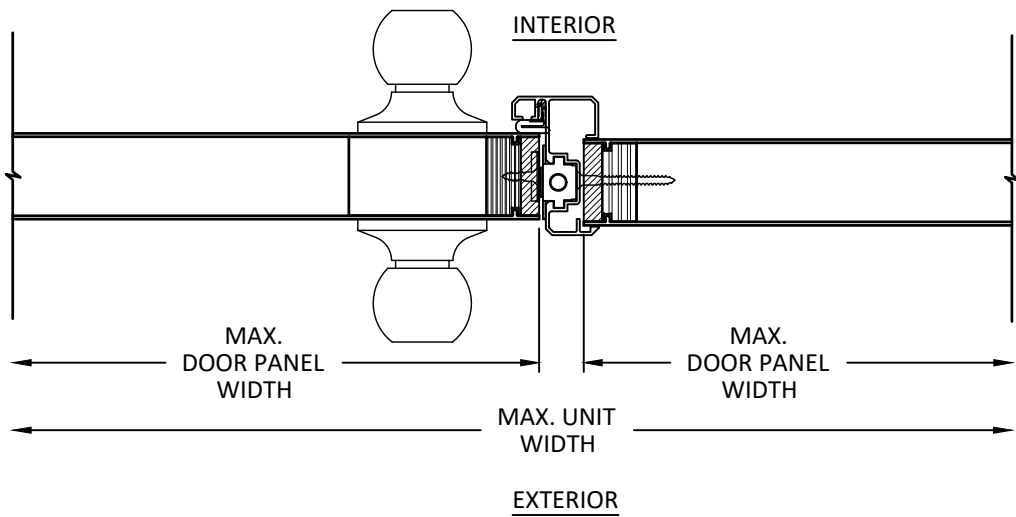


A
16 HORIZONTAL SECTION
OUTSWING - DLP MODERN ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

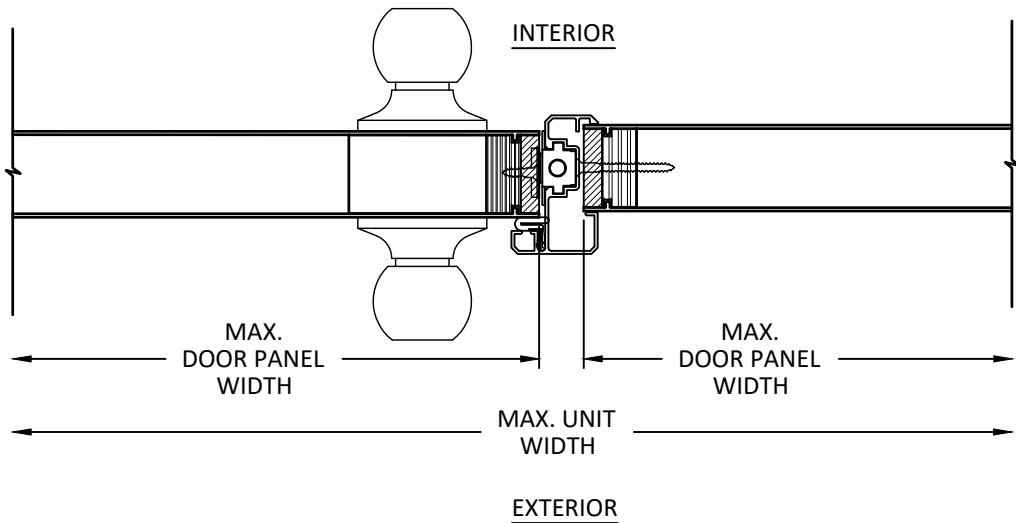

B
16 HORIZONTAL SECTION
INSWING - DLP MODERN ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

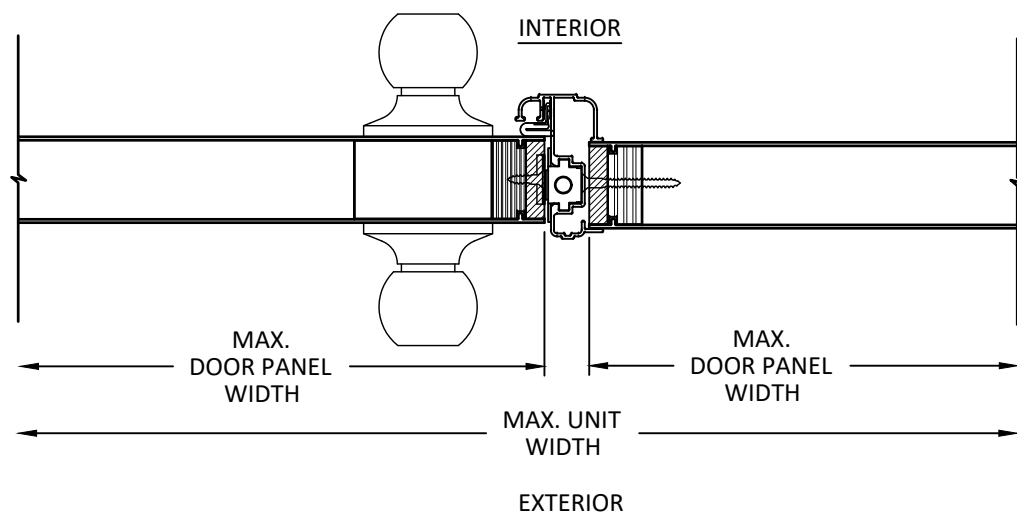

C
16 HORIZONTAL SECTION
OUTSWING - DLP TRADITIONAL ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

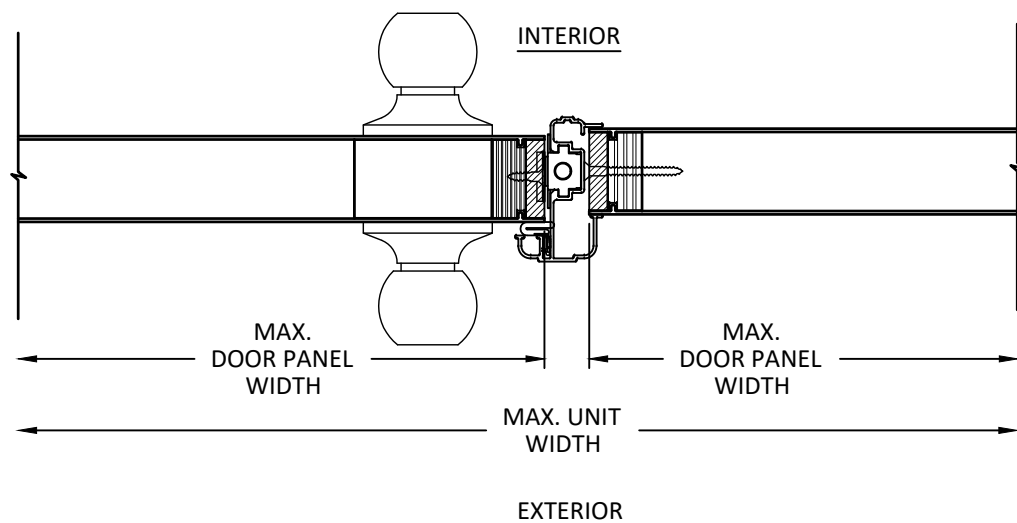

D
16 HORIZONTAL SECTION
INSWING - DLP TRADITIONAL ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

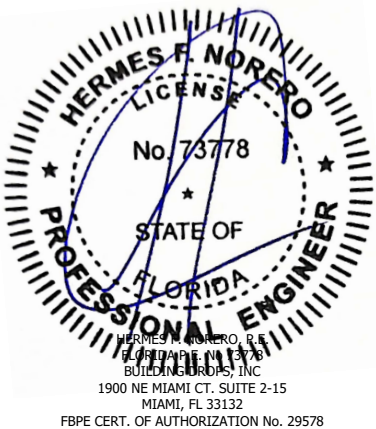

FL #:	FL47925
DATE:	12.04.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL007
SHEET:	16
REV.	A

PH: (800) 253-3900

HORIZONTAL SECTIONS

1900 NE MIAMI CT. SUITE 2-15
MIAMI FL 33132

MIAMI, FL 33132

FAX: (954)744.4738
WEB: www.buildingdrops.com



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.





DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

DWG. #: ODL007


17

A


OF 23

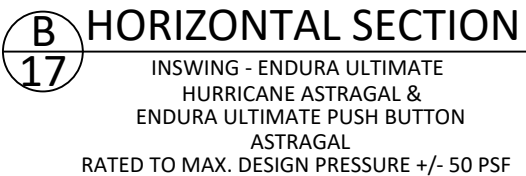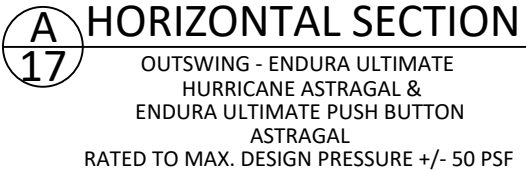


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change.dwg (s147925) (di007 - a.dwg) 7/20/2026 5:15 PM

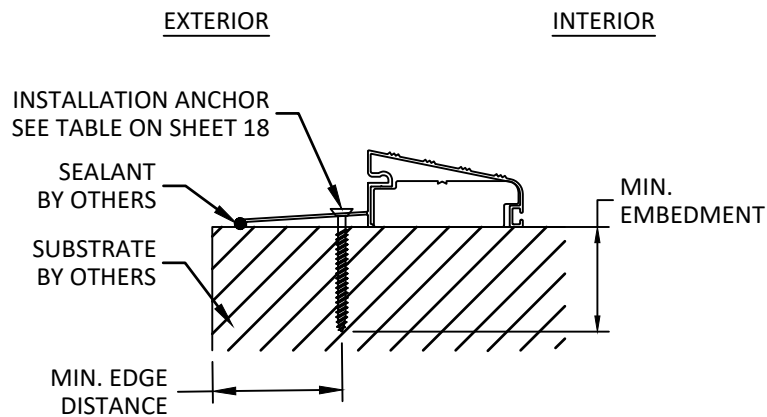


A
19 ANCHOR DETAIL
QOSH SILL

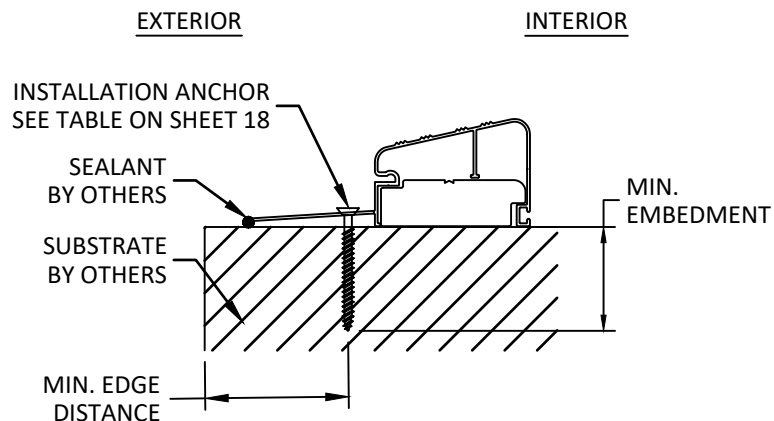


B
19 ANCHOR DETAIL
QOSR SILL

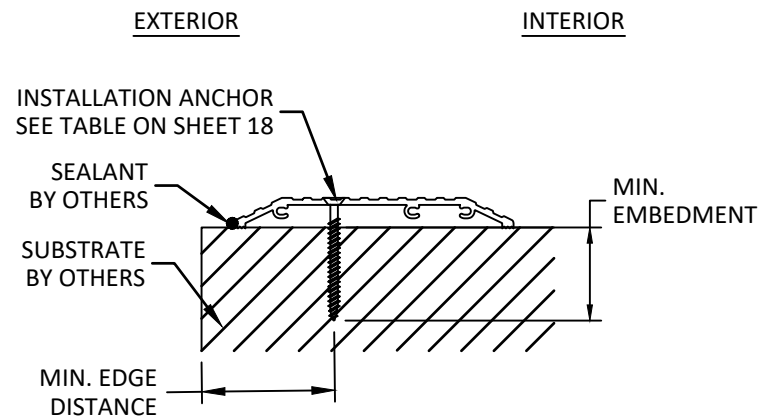


C
19 ANCHOR DETAIL
DLP ADA DB4565DL SILL

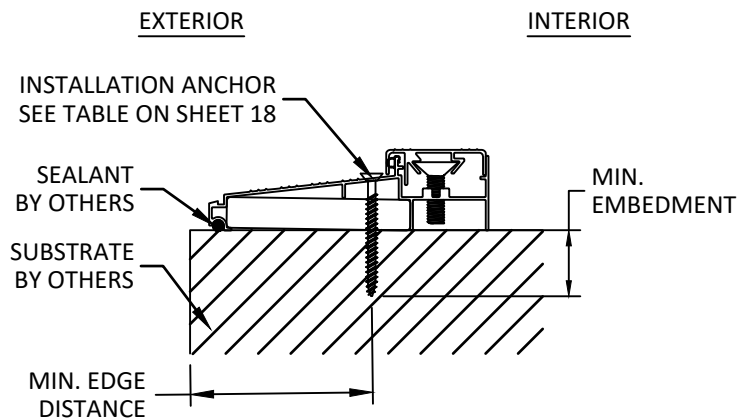

D
19 ANCHOR DETAIL
DLP ISCS SILL

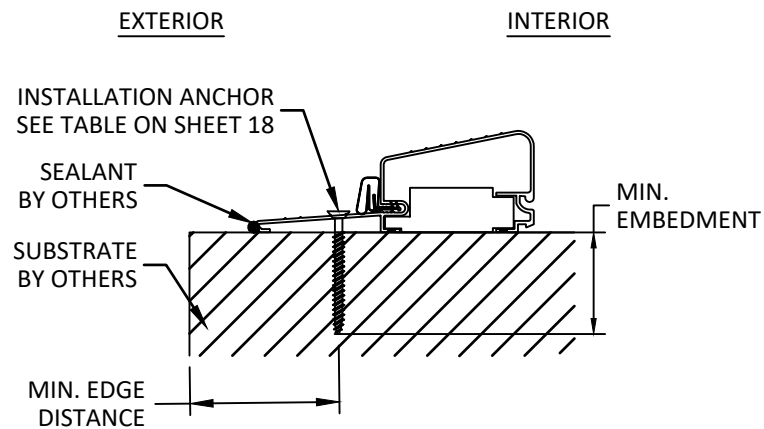

E
19 ANCHOR DETAIL
AFCO H-497 SILL

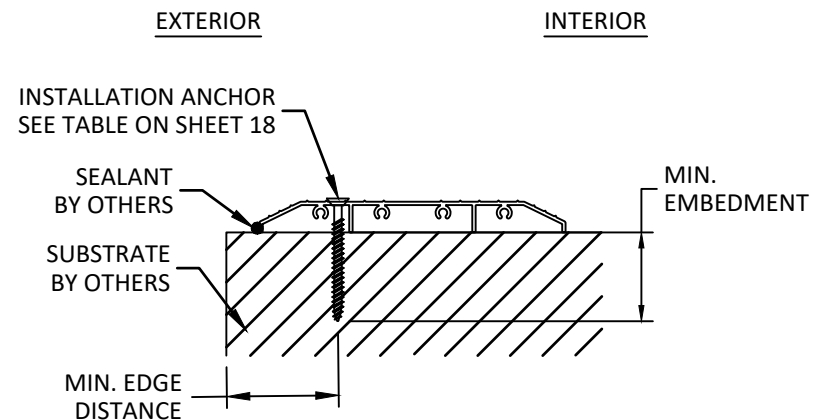

F
19 ANCHOR DETAIL
ENDURA HC15000 ADA SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)


ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

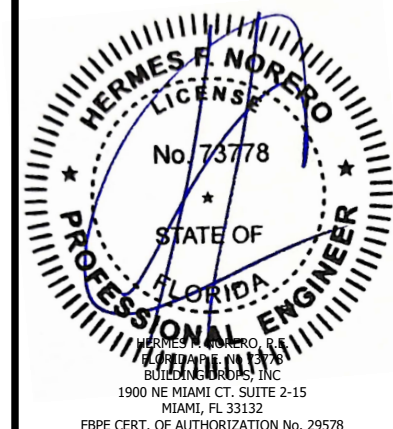

FL #:

FL47925

DATE: 12.04.2025

DWG. BY: JR
CHK. BY: HFN


SCALE: NTS

DWG. #: ODL007

SHEET: 19
REV. A



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

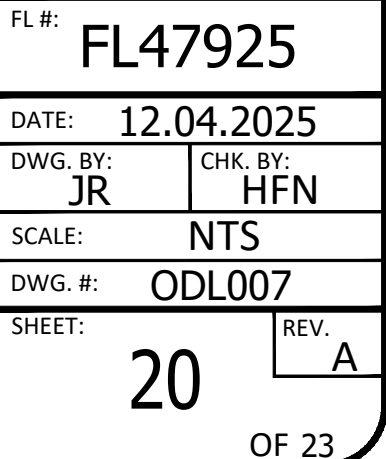




ANCHOR DETAILS

900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

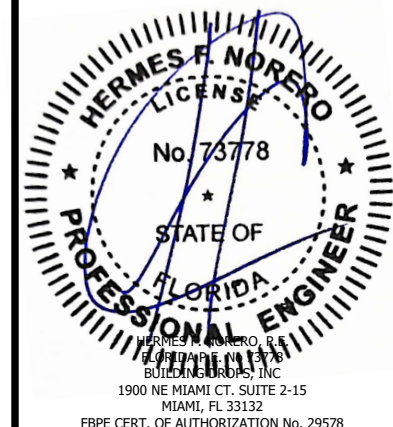

FL #: **FL47925**

DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

















DWG. #: ODL007

SHEET:	REV.
--------	------

21

REV. A

BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
1	JAMB	FINGER JOINT PINE, LVL, OR COMPOSITE
2	ENDURA FUSION MULLION	VARIES
3	BOXED MULLION	FINGER JOINT PINE OR LVL
4	WEATHERSTRIP	FOAM
5	DOOR SWEEP	VINYL
6	HINGE	STEEL
7	LOCK SET	STEEL
8	DEADBOLT	STEEL
9	LATCH STRIKE PLATE	STEEL
10	DEADBOLT STRIKE PLATE	STEEL
11	DOOR PANEL	-
12	SIDELITE PANEL	-
13	FASTENERS	STEEL
14	DLP MODERN ASTRAGAL	ALUMINUM
15	DLP TRADITIONAL ASTRAGAL	ALUMINUM
16	ASTRAGAL STRIKE PLATE	STEEL
17	DLP QOSH SILL	ALUMINUM
18	DLP QOSR SILL	ALUMINUM
19	AFCO H-497 SILL	ALUMINUM
20	DLP ISCS SILL	ALUMINUM
21	DLP ADA ISHC SILL	ALUMINUM
22	DLP DB4565DL SILL	ALUMINUM
23	ENDURA HC15000 ADA SILL	ALUMINUM
24	ENDURA FOB4565 SILL	ALUMINUM
25	ENDURA ZOB4565FN SILL	ALUMINUM
26	AFCO A-117 SILL	ALUMINUM
27	AFCO A-276 SILL	ALUMINUM
28	AFCO A-204 SILL	ALUMINUM
29	AFCO A-204T SILL	ALUMINUM
30	ENDURA ZAILAA4565 SILL	ALUMINUM
31	ENDURA ZOBL4565F SILL	ALUMINUM
32	AFCO SIDELITE BASE	PVC / ALUMINUM
33	ENDURA SIDELITE BASE	PVC / ALUMINUM
34	ENDURA ULTIMATE HURRICANE ASTRAGAL	ALUMINUM
35	ENDURA ULTIMATE PUSH BUTTON ASTRAGAL	ALUMINUM
36	PLASTPRO MULLION	VARIES
37	WOOD PINE MULLION	FINGER JOINT PINE
38	ENDURA FRAME SAVER MULLION	FINGER JOINT PINE

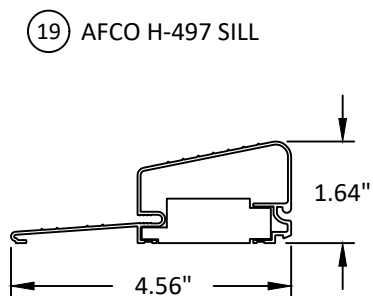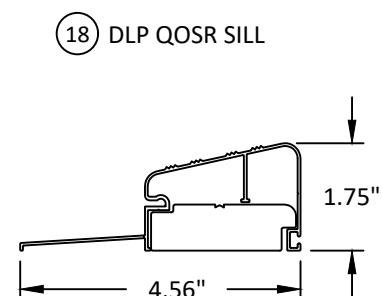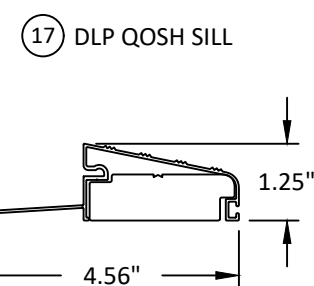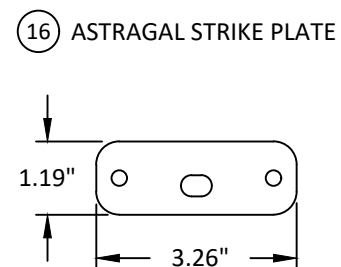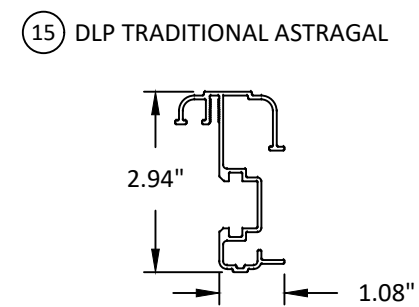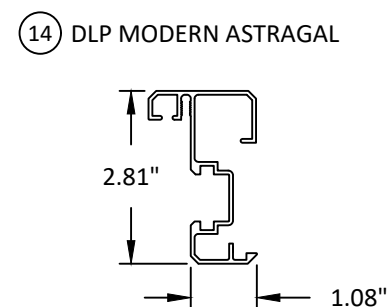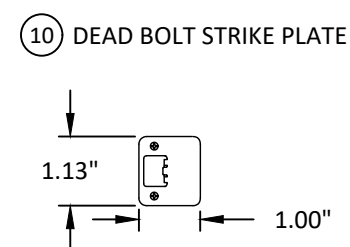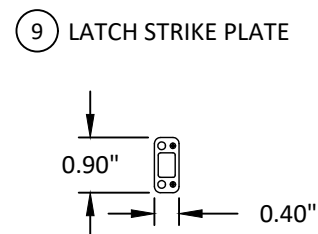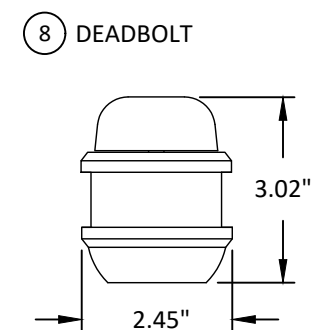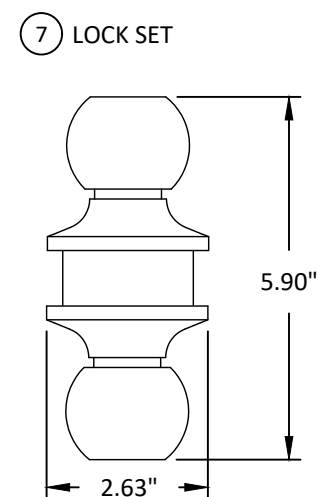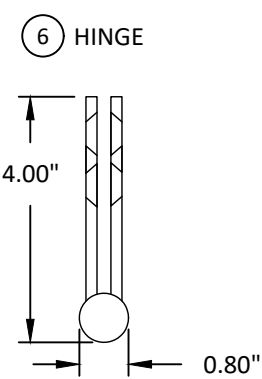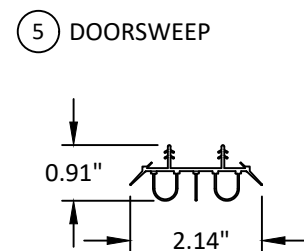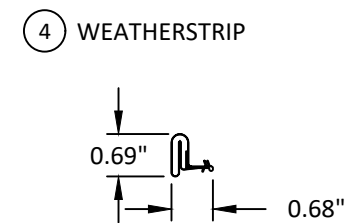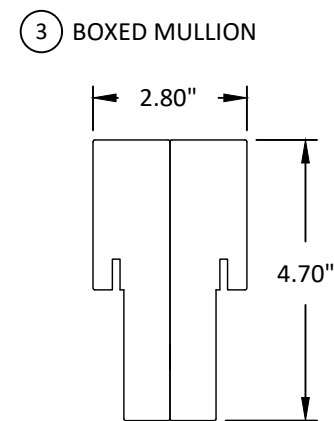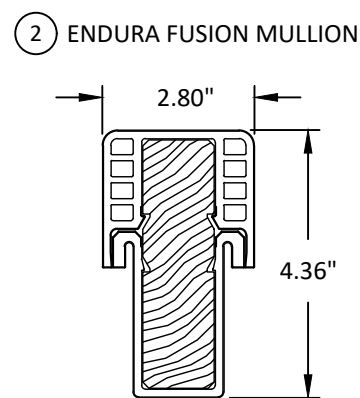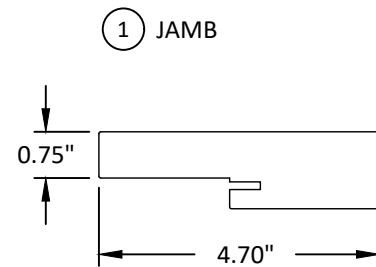

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

BILL OF MATERIALS & COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

MIAMI, FL 33132
PH: (954)399-8478



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

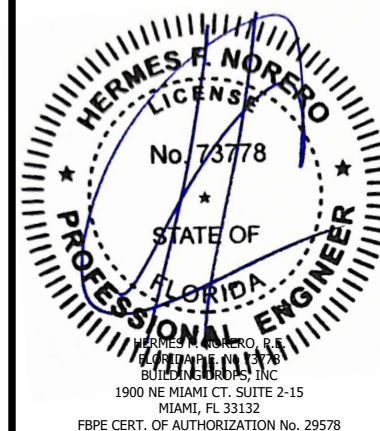

FL #:

FL47925

DATE: 12.04.2025

DWG. BY:
JR

CHK. BY:
HFN

SCALE: NTS

DWG. #: ODL007

SHEET:

22


REV.

A


OF 23

c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change projects\dwgs\147925\odl007 - a.dwg 7/20/2026 5:15 PM


20 DLP ISCS SILL

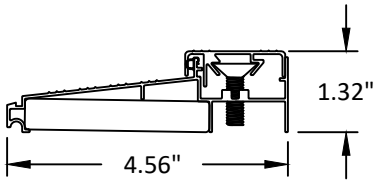


21 DLP ADA ISHC SILL

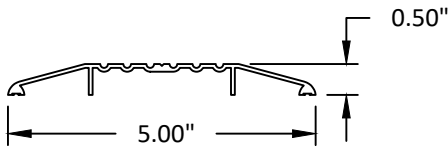


22 DLP DB4565DL SILL

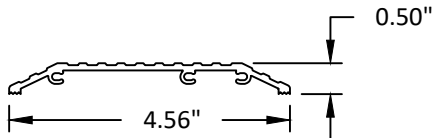


23 ENDURA HC15000 ADA SILL

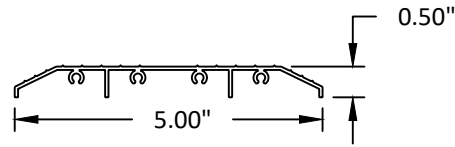


24 ENDURA FOB4565 SILL

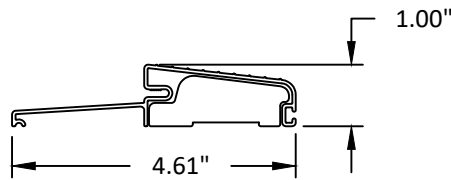


25 ENDURA ZOB4565FN SILL

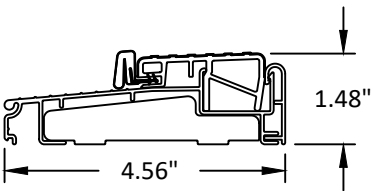


26 AFCO A-117 SILL

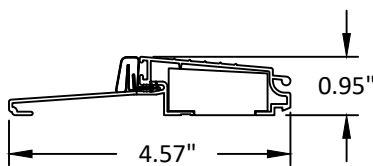


27 AFCO A-276 SILL

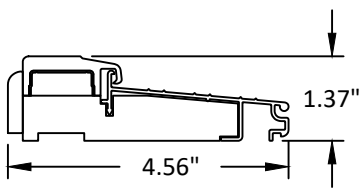


28 AFCO A-204 SILL

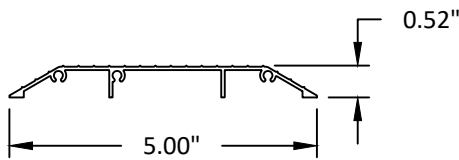


29 AFCO A-204T SILL

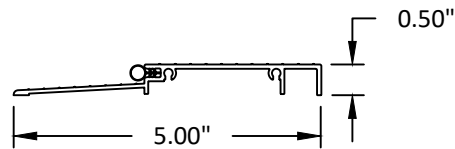


30 ENDURA ZAILAA4565 SILL

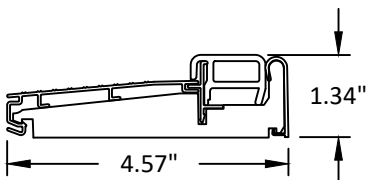


31 ENDURA ZOBL4565 SILL

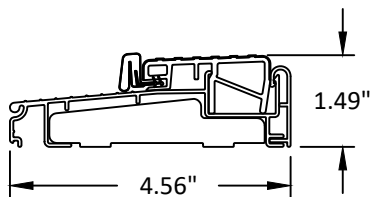


32 AFCO SIDELITE BASE

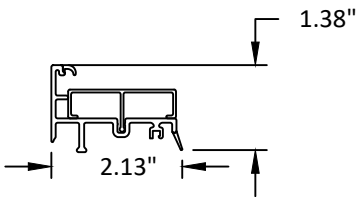


33 ENDURA SIDELITE BASE




34 ENDURA ULTIMATE HURRICANE ASTRAGAL




35 ENDURA ULTIMATE PUSH BUTTON ASTRAGAL




36 PLASTPRO MULLION



37 WOOD PINE MULLION

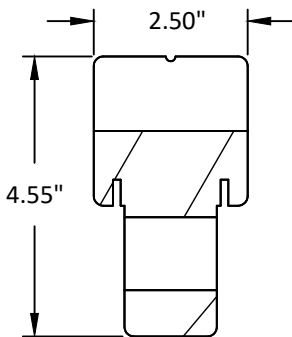

38 ENDURA FRAME SAVER MULLION

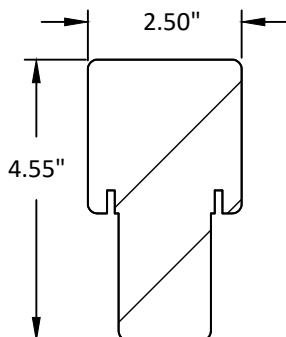

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (WZ3) (IMPACT)

COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

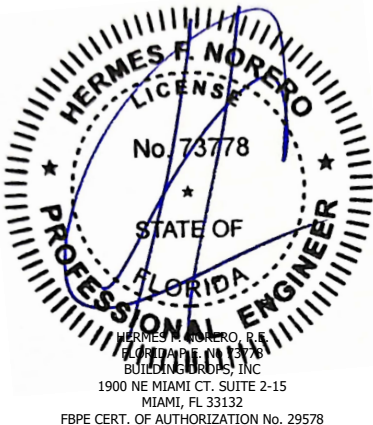

FL #:	FL47925
DATE:	12.04.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL007
SHEET:	23
REV.	A
OF 23	