

8/5/2026 3:02 PM

c:\users\julianarodriguez\building drops, inc\building drops\common\projects\odl, inc\cc-26-0340.1 - 2026 code change\dwgs\147925\odl012 - a.dwg

ODL, INC.

INSWING & OUTSWING GLAZED FIBERGLASS DOOR

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- ASTM E330-14

• ASTM E331-00(23)

• ASTM E283-04
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. DOOR SKIN MATERIAL: FIBERGLASS
8. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	PRODUCT SPECIFICATIONS TABLE
3	GLAZING DETAILS
4	OXO ELEVATION
5	OXO ELEVATION
6	X & XX ELEVATIONS
7	LITE KIT DETAILS
8	ANCHOR LAYOUTS
9	ANCHOR LAYOUTS
10	VERTICAL SECTIONS
11	VERTICAL SECTIONS
12	VERTICAL SECTIONS
13	VERTICAL SECTIONS
14	HORIZONTAL SECTIONS
15	HORIZONTAL SECTIONS
16	HORIZONTAL SECTIONS
17	HORIZONTAL SECTIONS
18	HORIZONTAL SECTIONS
19	HORIZONTAL SECTIONS
20	ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES
21	ANCHOR DETAILS
22	ANCHOR DETAILS
23	ANCHOR DETAILS
24	BILL OF MATERIALS & COMPONENTS
25	COMPONENTS



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)
GENERAL NOTES


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.11 17:21:47 -03'00'

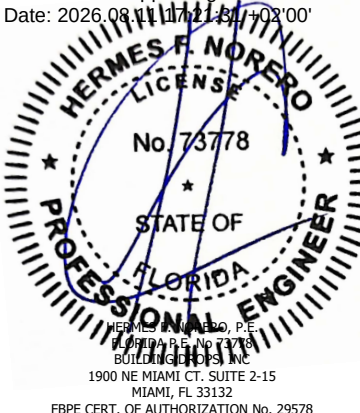

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47925**

DATE: **12.01.2025**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: ODL012	
SHEET: 1	REV. A

OF 25

c:\users\julianarodriguez\building_drops, inc\building_drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40-1 - 2026 code change projects\dwgs\1147925\odi012 - a.dwg 8/5/2026 3:02 PM

PRODUCT SPECIFICATIONS								
JAMB TYPE	DOOR SIZE	OUTSWING (OS) / INSWING (IS)	UNIT CONFIGURATIONS & CORRESPONDING MAX. DESIGN PRESSURES (PSF)					BOXED (BOX) / CONTINUOUS CONSTRUCTION (CHS)
			X	OX	OXO	XX	OXXO	
WOOD	6'8"	IS	+ 45 / - 50	+ 40 / - 45	+ 40 / - 45	+ 45 / - 50	+ 45 / - 50	BOX
		OS	+/- 45	+/- 45	+/- 45	+/- 45	+/- 45	
	8'0"	IS	+ 45 / - 50	+ 45 / - 50	+ 45 / - 50	+ 35 / - 40	+ 35 / - 40	
		OS	+/- 50	+/- 50	+/- 50	+/- 40	+/- 40	
COMPOSITE	6'8"	IS	+ 45 / - 50	+ 45 / - 50	+ 45 / - 50	+ 45 / - 50	+ 45 / - 50	
		OS	+/- 45	+/- 45	+/- 45	+/- 45	+/- 45	
	8'0"	IS	+/- 50	+/- 50	+/- 50	+ 35 / - 40	+ 35 / - 40	
		OS	+/- 50	+/- 50	+/- 50	+/- 40	+/- 40	
WOOD	6'8"	IS	-	+ 45 / - 50	+ 45 / - 50	-	+ 45 / - 50	CHS
		OS		+/- 40	+/- 40		+/- 45	
	8'0"	IS		+ 45 / - 50	+ 45 / - 50		+/- 50	
		OS		+/- 50	+/- 50		+/- 50	
COMPOSITE	6'8"	IS		+ 35 / - 40	+ 35 / - 40		+ 45 / - 50	
		OS		+/- 40	+/- 40		+/- 45	
	8'0"	IS		+/- 50	+/- 50		+/- 50	
		OS		+/- 50	+/- 50		+/- 50	



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)


PRODUCT SPECIFICATIONS
TABLE

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

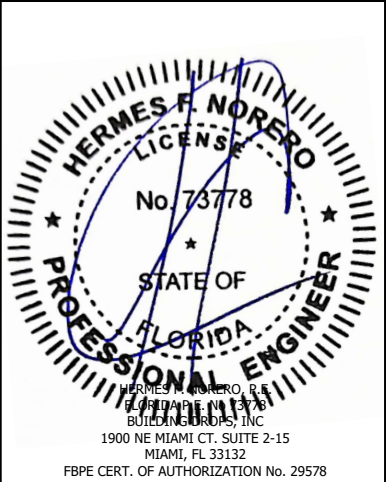

FL #:
FL47925

DATE:
12.01.2025

DWG. BY:
JR

CHK. BY:
HFN

SCALE:
NTS


DWG. #:
ODL012

SHEET:
2


REV.
A

OF 25


NOTE: BOXED CONSTRUCTION SHOWN,
CONTINUOUS CONSTRUCTION
QUALIFIED. SEE SHEETS 15-17 FOR
HORIZONTAL SECTION DETAILS FOR
CONTINUOUS CONSTRUCTION.

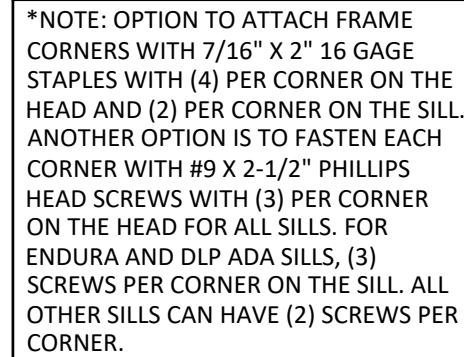

DOOR: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)	MAX. DOOR D.L.O. WIDTH (IN)	MAX. DOOR D.L.O. HEIGHT (IN)
6'8" GLAZED	74.50	82.00	35.75	79.25	20.90	62.90
8'0" GLAZED	74.50	98.00	35.75	95.25	20.90	78.90



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




NOTE: BOXED CONSTRUCTION SHOWN,
CONTINUOUS CONSTRUCTION
QUALIFIED. SEE SHEETS 15-17 FOR
HORIZONTAL SECTION DETAILS FOR
CONTINUOUS CONSTRUCTION.



PH: (800) 253-3900

*NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.

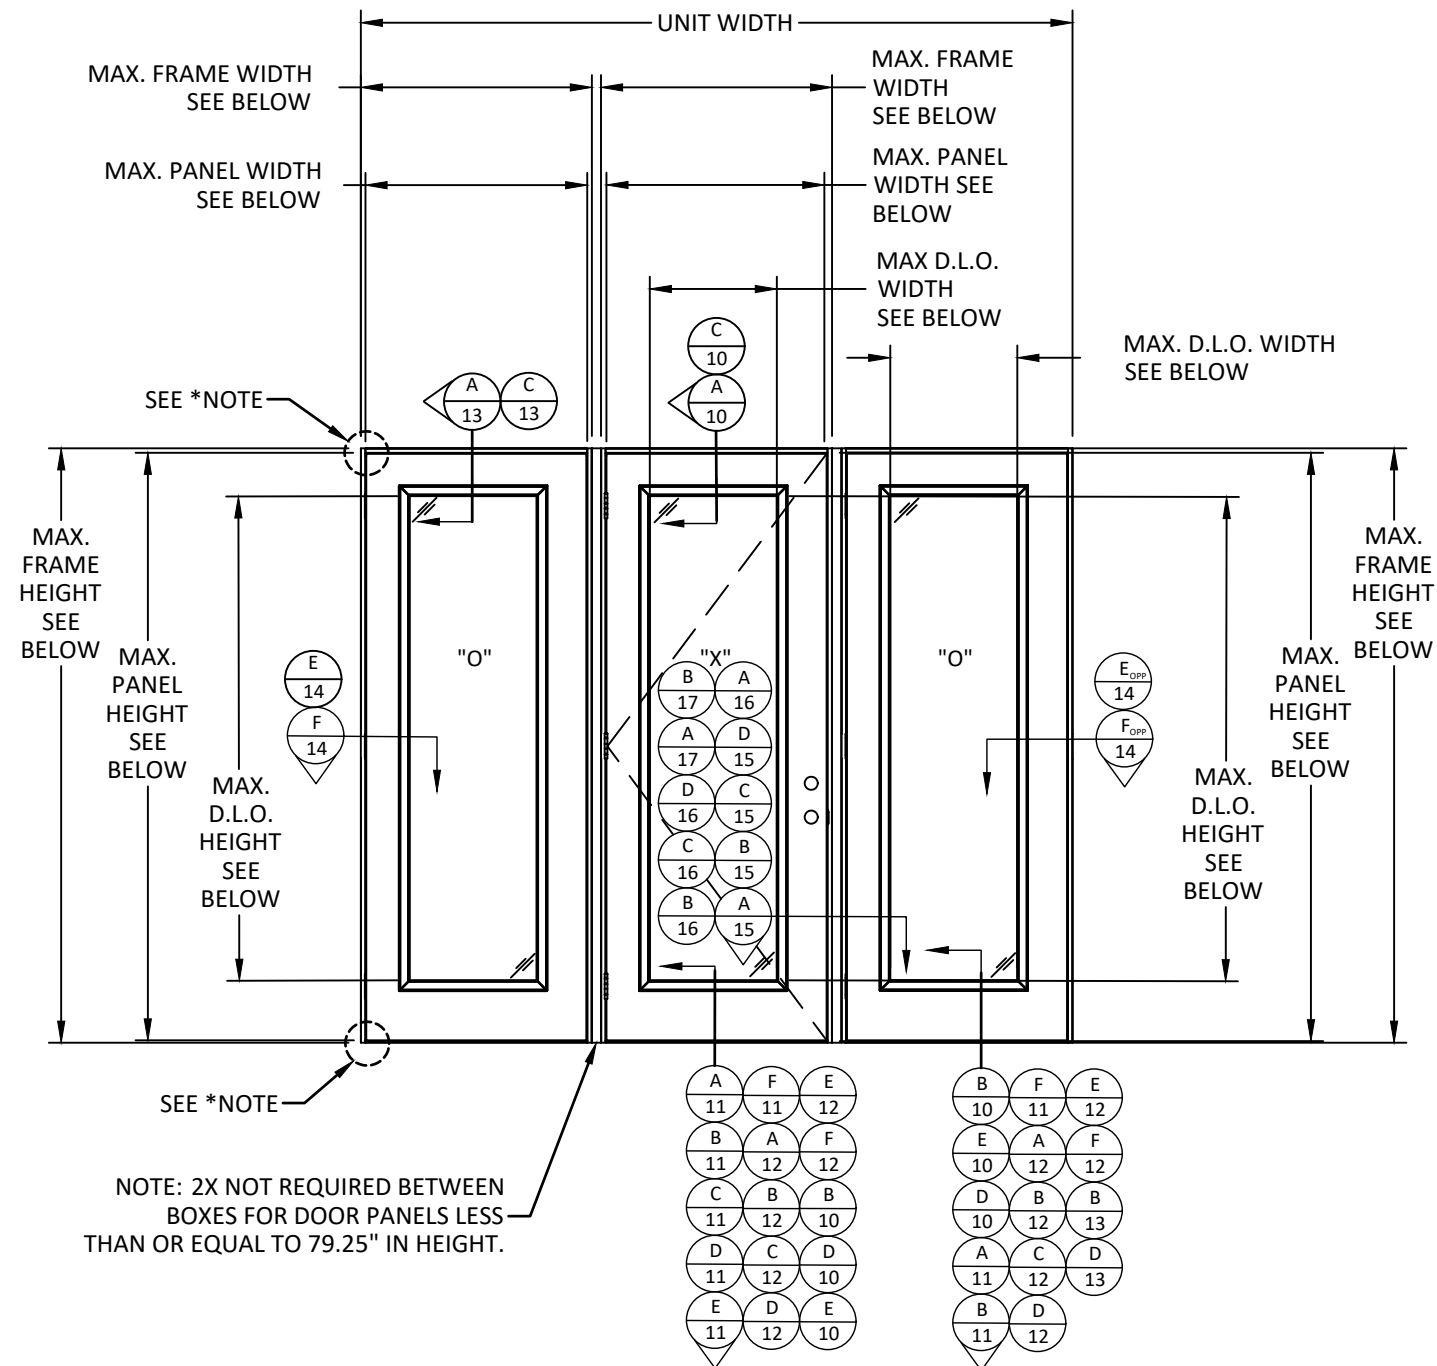

SIDELITE: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. SIDELITE FRAME WIDTH (IN)	MAX. SIDELITE FRAME HEIGHT (IN)	MAX. SIDELITE PANEL WIDTH (IN)	MAX. SIDELITE PANEL HEIGHT (IN)	MAX. SIDELITE D.L.O. WIDTH (IN)	MAX. SIDELITE D.L.O. HEIGHT (IN)
6'8" GLAZED	37.50	82.00	35.75	79.25	20.90	62.90
8'0" GLAZED	37.50	98.00	35.75	95.25	20.90	78.90

DOOR: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)	MAX. DOOR D.L.O. WIDTH (IN)	MAX. DOOR D.L.O. HEIGHT (IN)
6'8" GLAZED	37.50	82.00	35.75	79.25	20.90	62.90
8'0" GLAZED	37.50	98.00	35.75	95.25	20.90	78.90

TITLE: INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

OXO ELEVATION

PREPARED BY: **BUILDING DROPS, INC.**
1000 NE MIAMI CT SUITE 315



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL47925**

DATE: 12.01.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: ODL012

SHEET:	REV.
F	A

DOOR: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)	MAX. DOOR D.L.O. WIDTH (IN)	MAX. DOOR D.L.O. HEIGHT (IN)
6'8" GLAZED	74.50	82.00	35.75	79.25	20.90	62.90
8'0" GLAZED	74.50	98.00	35.75	95.25	20.90	78.90



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)
LITE KIT DETAILS

LITE KIT DETAILS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI FL 33132


PH: (954)399-8478

FAX: (954)744.4738
WEB: www.buildingadrons.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

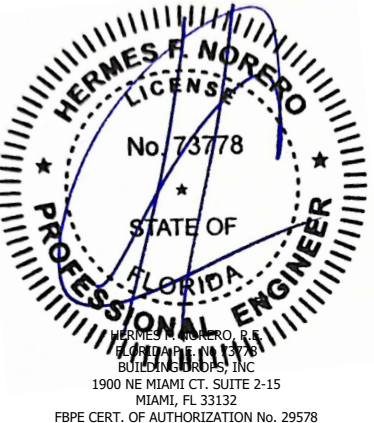

FL #: FL47925


DATE: 12.01.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: ODL012

SHEET:	REV.
7	A




THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

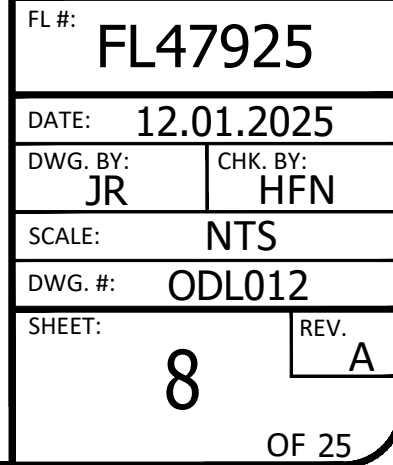

ANCHOR LAYOUTS

FAX: (954)744.4738



DATE _____

07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL47925

CHK. BY:
HFN

ENTS

ODL012

REV

A

OF 25

6.00" MAX.
FROM THE
CORNERS

XX CONFIGURATION


THROUGH FRAME INSTALLATION

6.00" MAX.
FROM THE
CORNERS


X CONFIGURATION

THROUGH FRAME INSTALLATION


c:\users\julianarodriguez\building drops, inc\building drops\projects\2026 code change projects\jodi, inc\cc-26-03-40.1 - 2026 code change\dwgs\147925\01012 - a.dwg 8/5/2026 3:03 PM

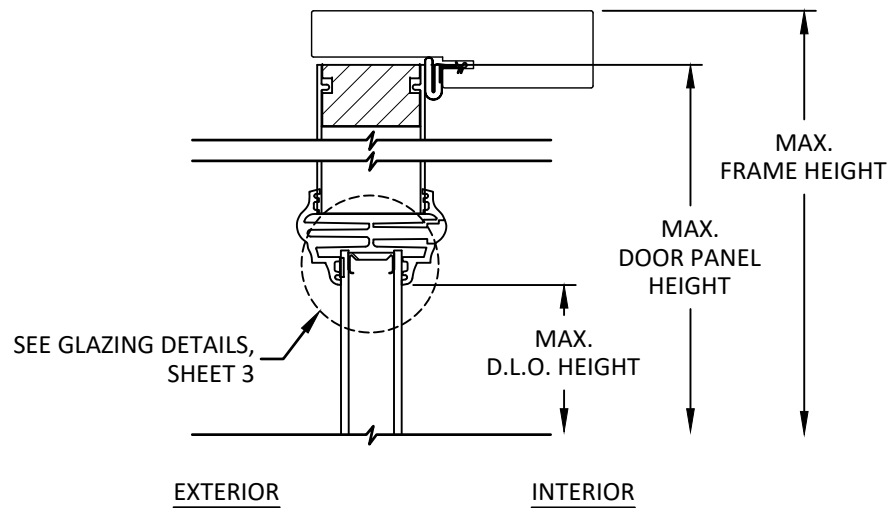


A
10 VERTICAL SECTION
OUTSWING DOOR - HEAD
EVOLVE FRAME

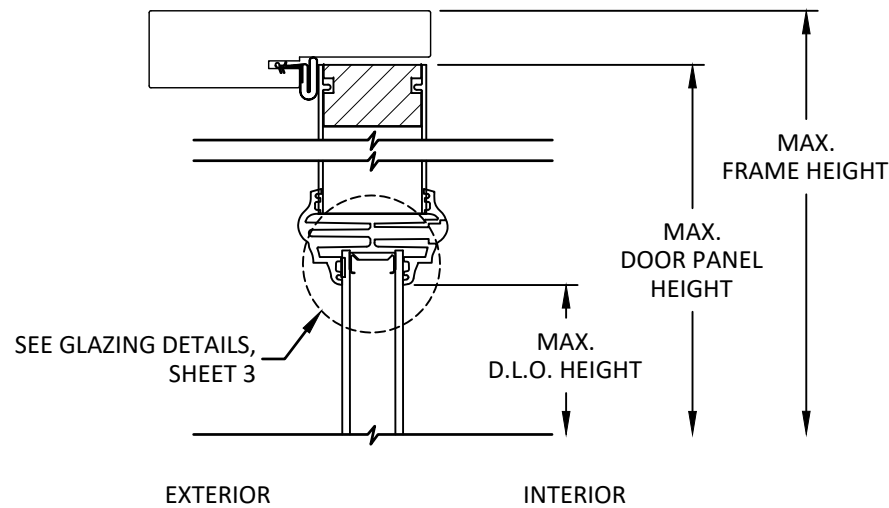


C
10 VERTICAL SECTION
INSWING DOOR - HEAD
EVOLVE FRAME

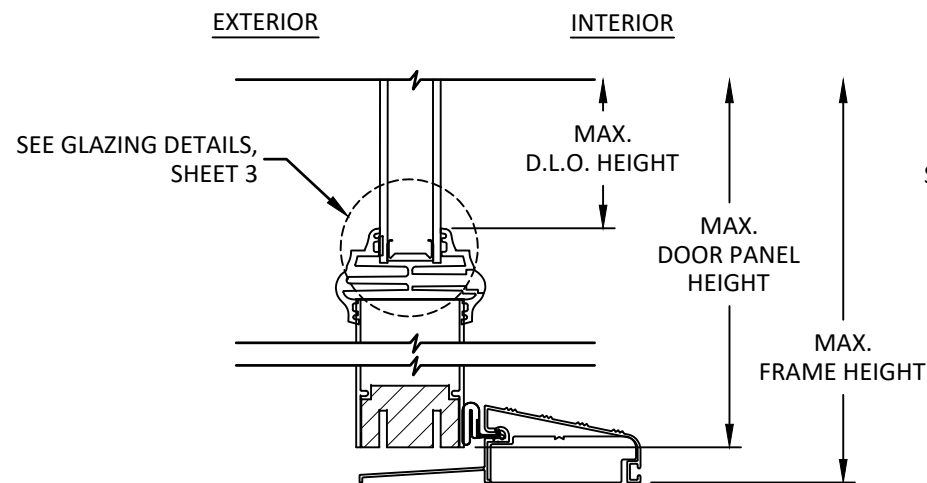

B
10 VERTICAL SECTION
QOSH SILL
EVOLVE FRAME
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

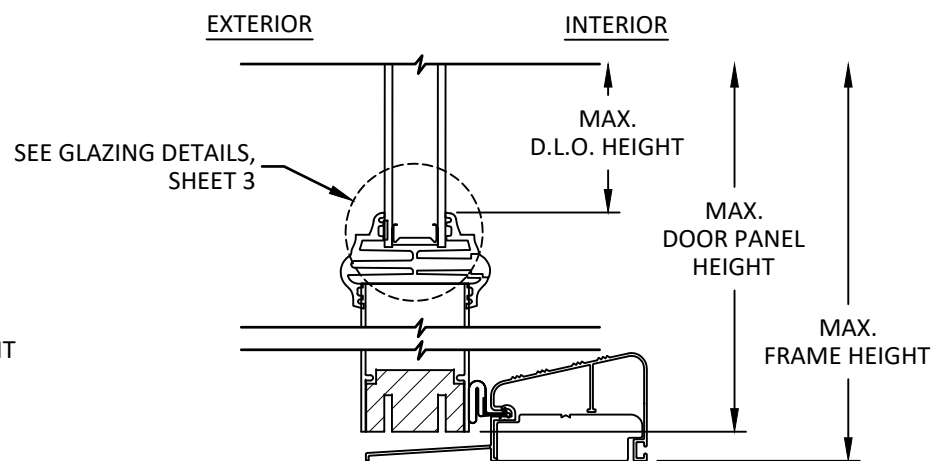

D
10 VERTICAL SECTION
QOSR SILL
EVOLVE FRAME
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

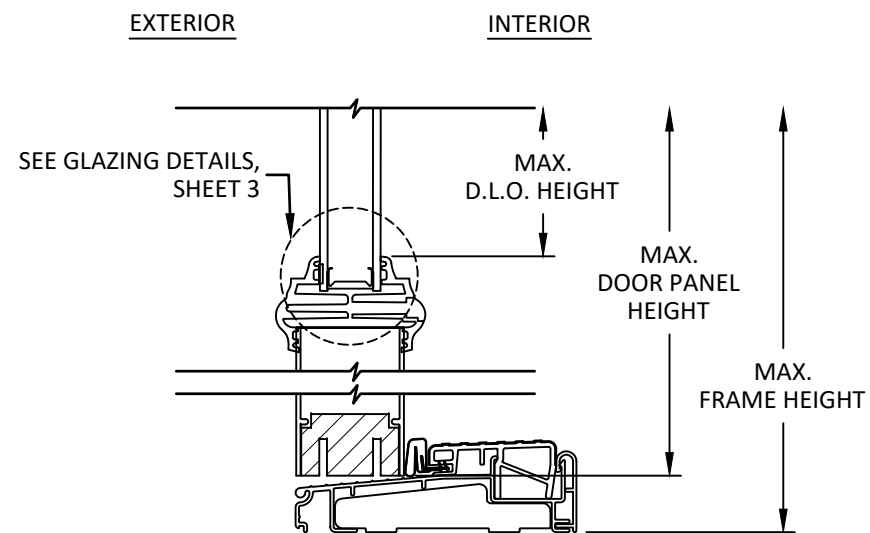

E
10 VERTICAL SECTION
ENDURA ZOB4565FN SILL
EVOLVE FRAME
SIDELITE QUALIFIED FOR USE WITH SILL
CONTINUOUS CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

PH: (954) 599-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

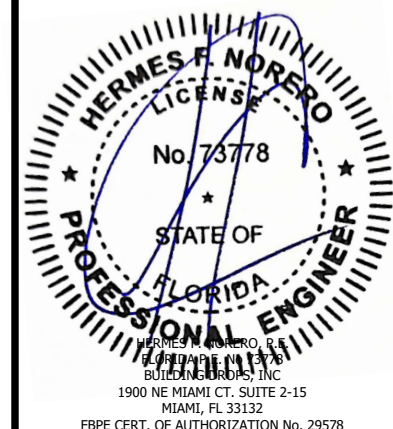

FL #: **FL47925**


DATE: **12.01.2025**

DWG. BY: **JR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **ODL012**

SHEET: **10** REV. **A**

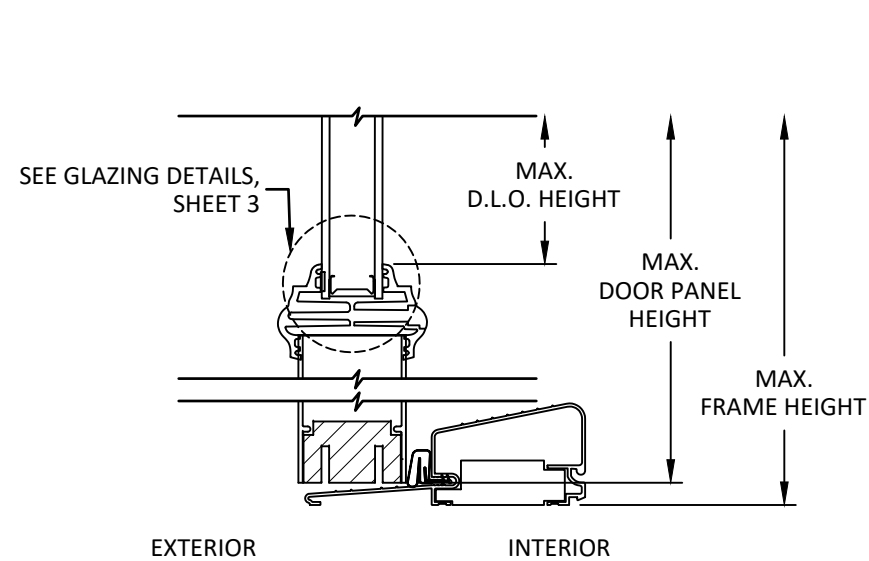


VERTICAL SECTION AFCO H-497 SILL EVOLVE FRAME SIDELITE QUALIFIED FOR USE WITH SILL BOX CONSTRUCTION

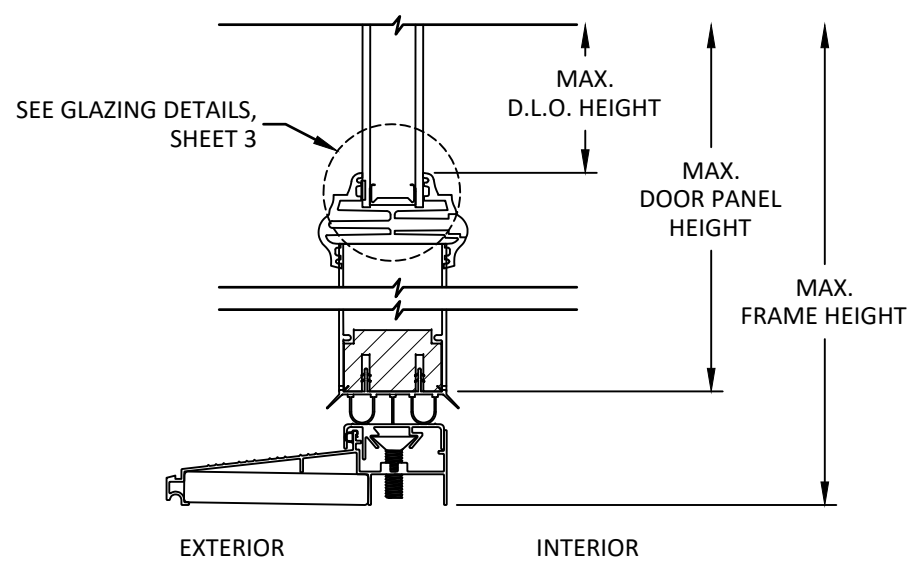


B 11

VERTICAL SECTION


DLP ISCS SILL
EVOLVE FRAME
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH SIDELITE BASE
BOX CONSTRUCTION

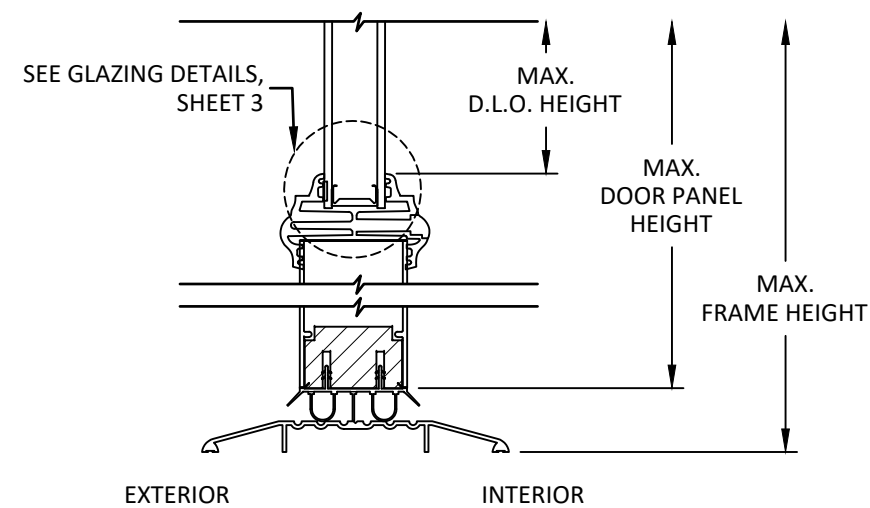


VERTICAL SECTION ADA ISHC SILL EVOLVE FRAME BOX CONSTRUCTION

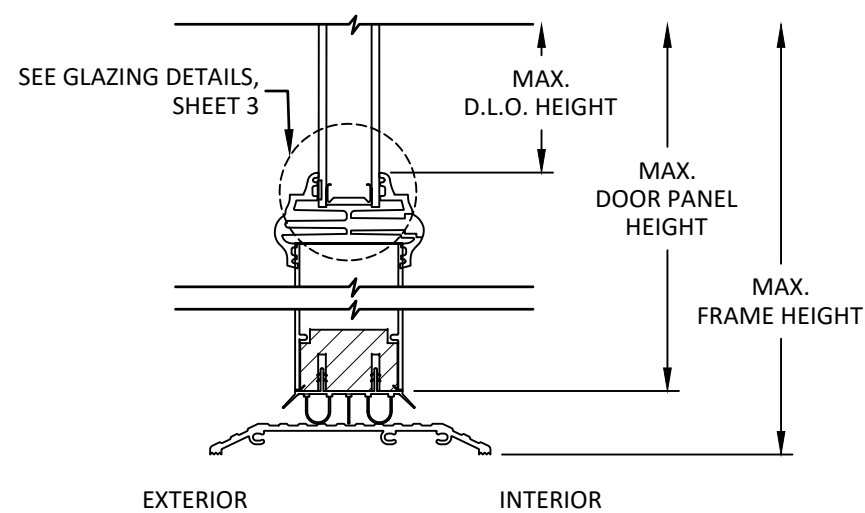

D 11 VERTICAL SECTION DLP ADA DB4565DL SILL EVOLVE FRAME BOX CONSTRUCTION

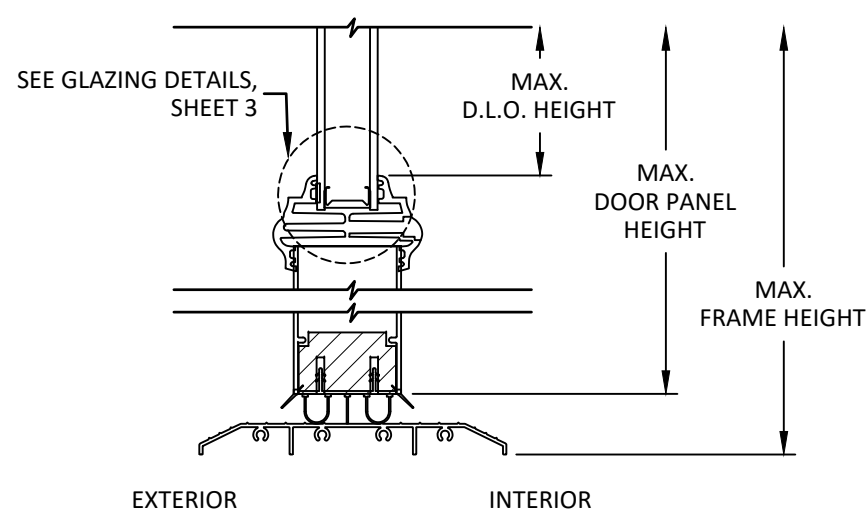

VERTICAL SECTION ENDURA HC15000 ADA SILL EVOLVE FRAME BOX CONSTRUCTION

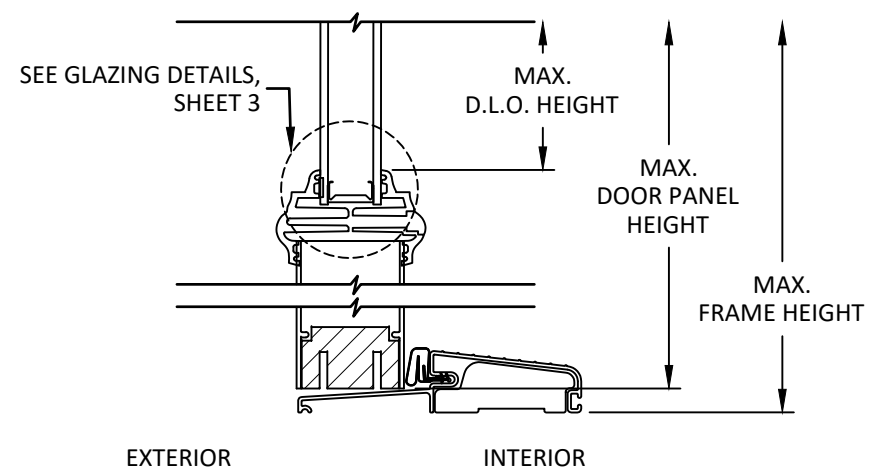

VERTICAL SECTION

TITLE:
**INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)**

VERTICAL SECTIONS


PREPARED BY:

BUILDING DROPS

BUILDING DROPS, INC.
 1900 NE MIAMI CT., SUITE 2-15
 MIAMI, FL 33132
 PH: (954)399-8478
 FAX: (954)744-4738
 WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

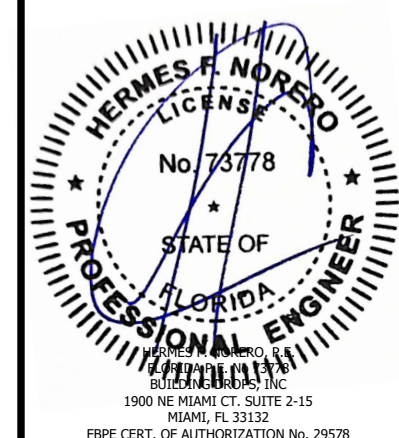

FL #: **FL47925**

DATE: 12.01.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: ODL012

SHEET:	REV.
11	A


PH: (800) 253-3900



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




OF 25





THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

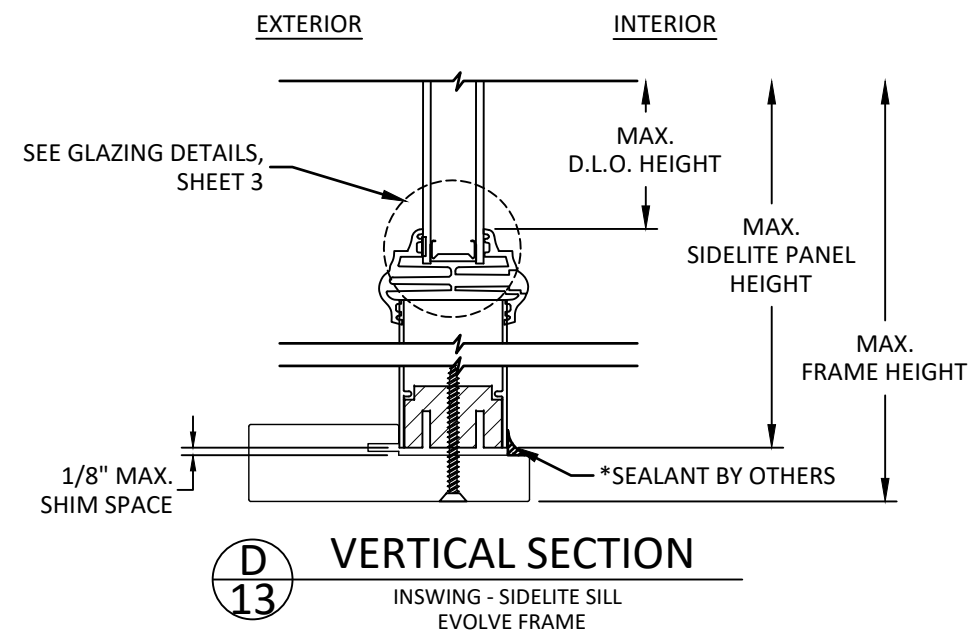



OUTSWING - HINGE JAMB
EVOLVE FRAME




OUTSWING - SIDELITE JAMB
EVOLVE FRAME



INSWING - HINGE JAMB
EVOLVE FRAME



INSWING - SIDELITE JAMB
EVOLVE FRAME



HORIZONTAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

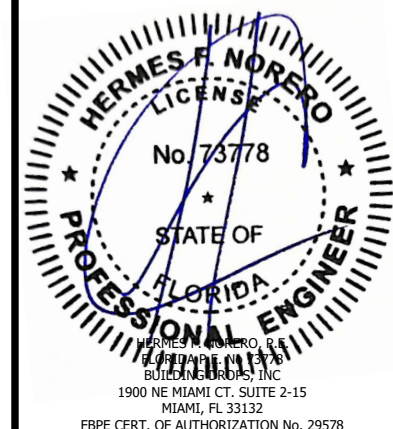

FL #: **FL47925**


DATE: 12.01.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: ODL012

SHEET:	REV.
14	A

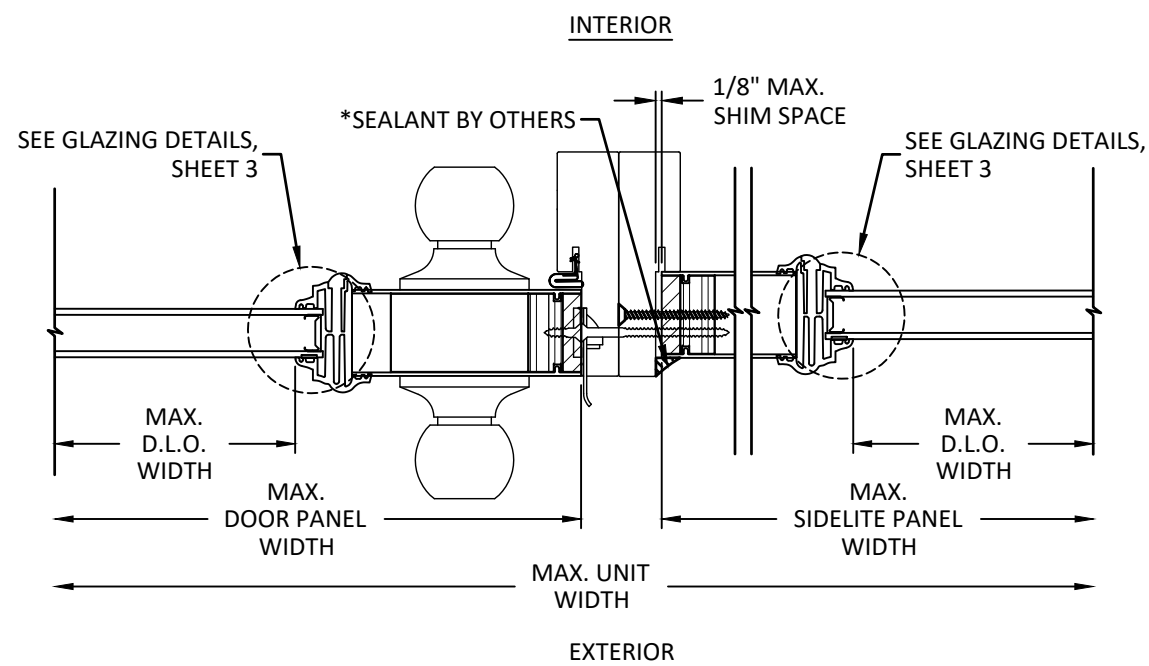


A HORIZONTAL SECTION

OUTSWING - BOXED MULLION
EVOLVE FRAME
BOXED CONSTRUCTION

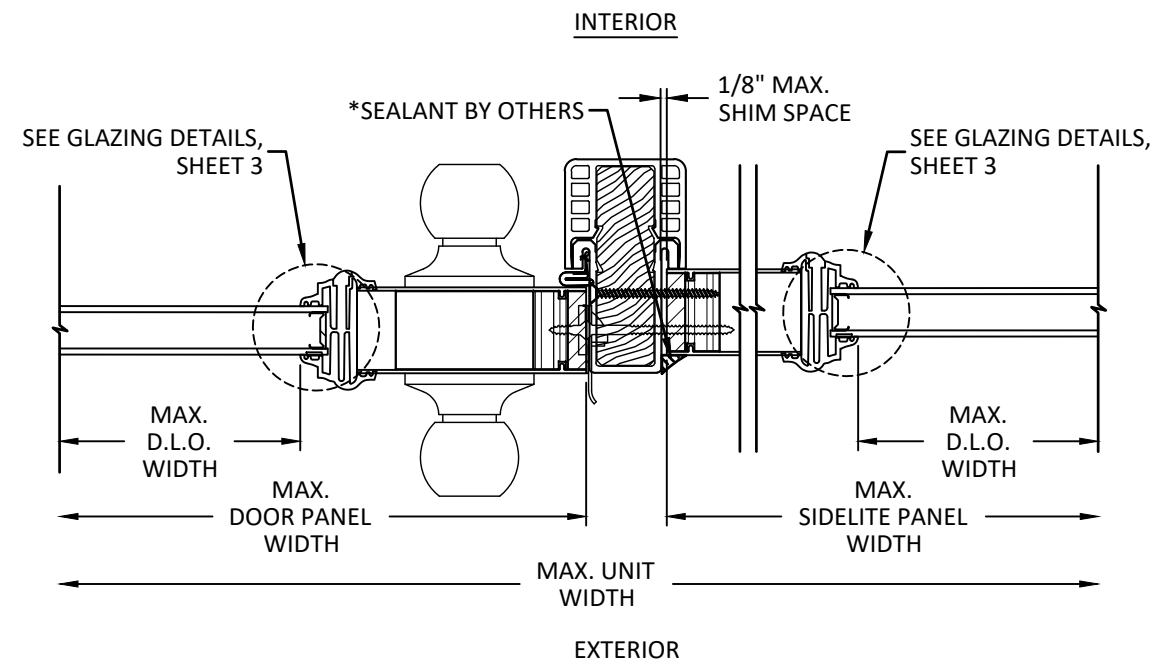


C
15 **HORIZONTAL SECTION**
OUTSWING - ENDURA FUSION MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION

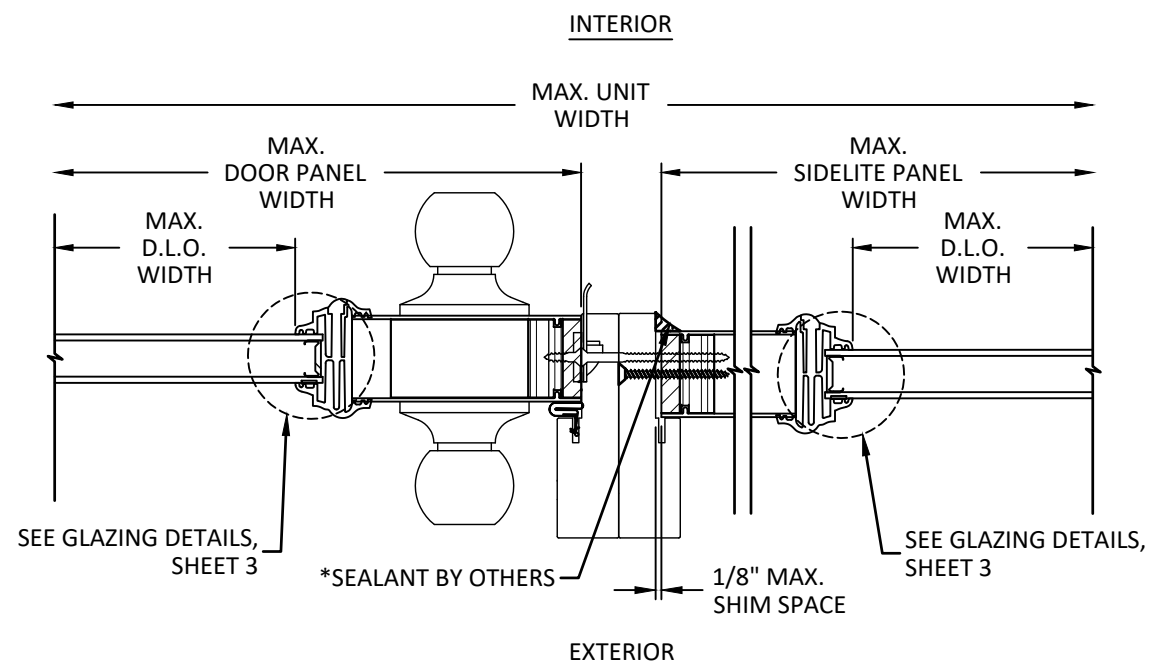

B HORIZONTAL SECTION

INSWING - BOXED MULLION
EVOLVE FRAME
BOXED CONSTRUCTION

NOTE: BOX AND CONTINUOUS CONSTRUCTION QUALIFIED FOR USE WITH EVOLVE FRAME.

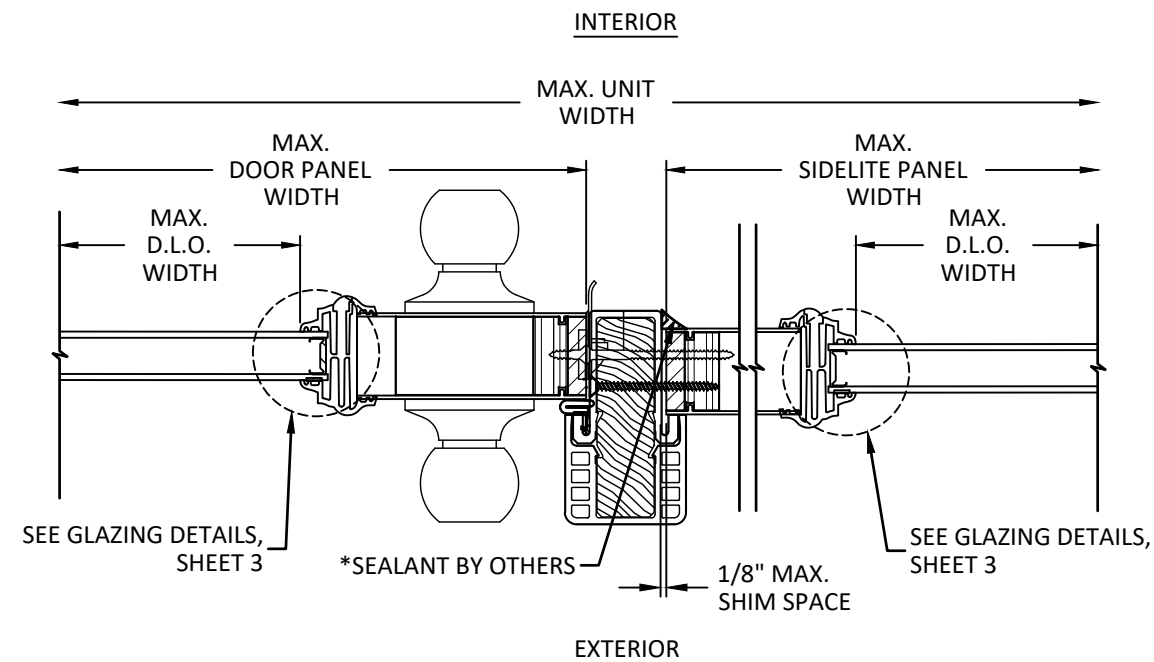

D 15 HORIZONTAL SECTION

INSWING - ENDURA FUSION MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

HORIZONTAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
9000 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

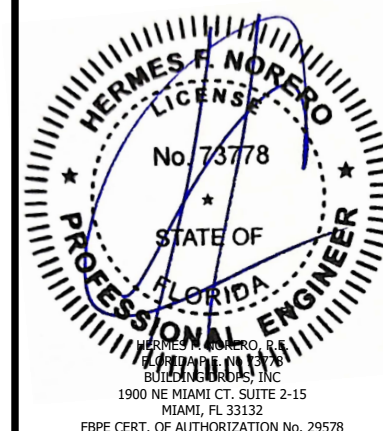

FL #: **FL47925**

DATE: 12.01.2025


DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: ODL012

SHEET:	REV.
15	A


c:\users\julianarodriguez\building_drops, inc\building drops, inc\documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40-1 - 2026 code change.dwg(1/4/25)odl012 - a.dwg 8/5/2026 3:03 PM

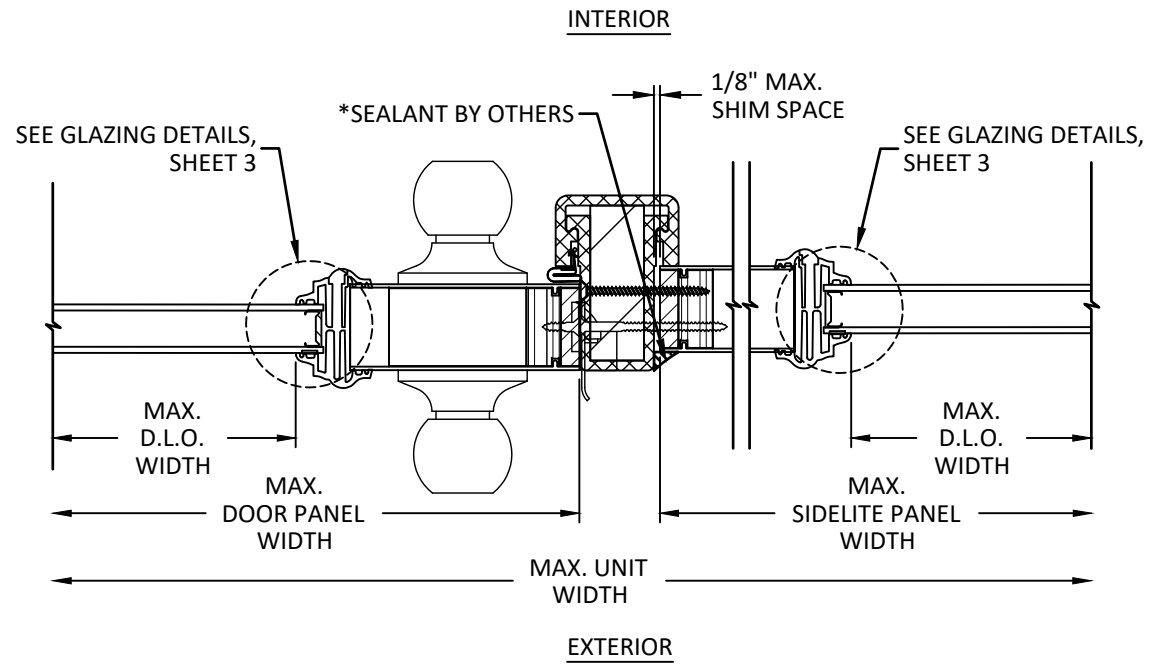


A HORIZONTAL SECTION
16 OUTSWING - PLASTPRO MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION

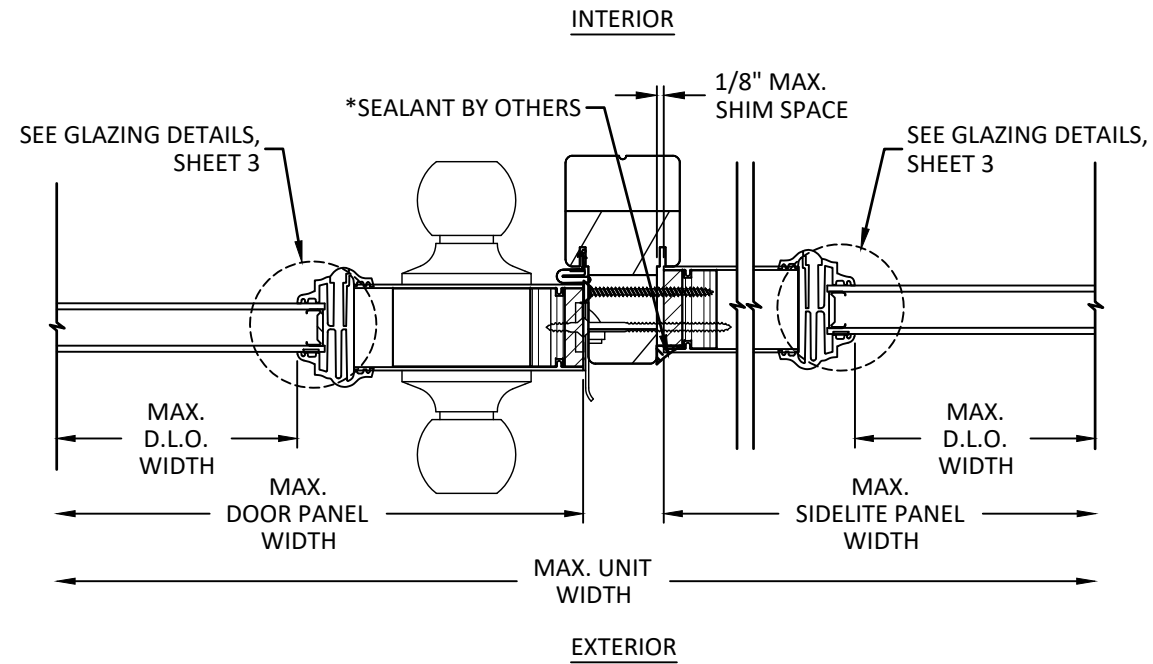

C HORIZONTAL SECTION
16 OUTSWING - WOOD PINE MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION

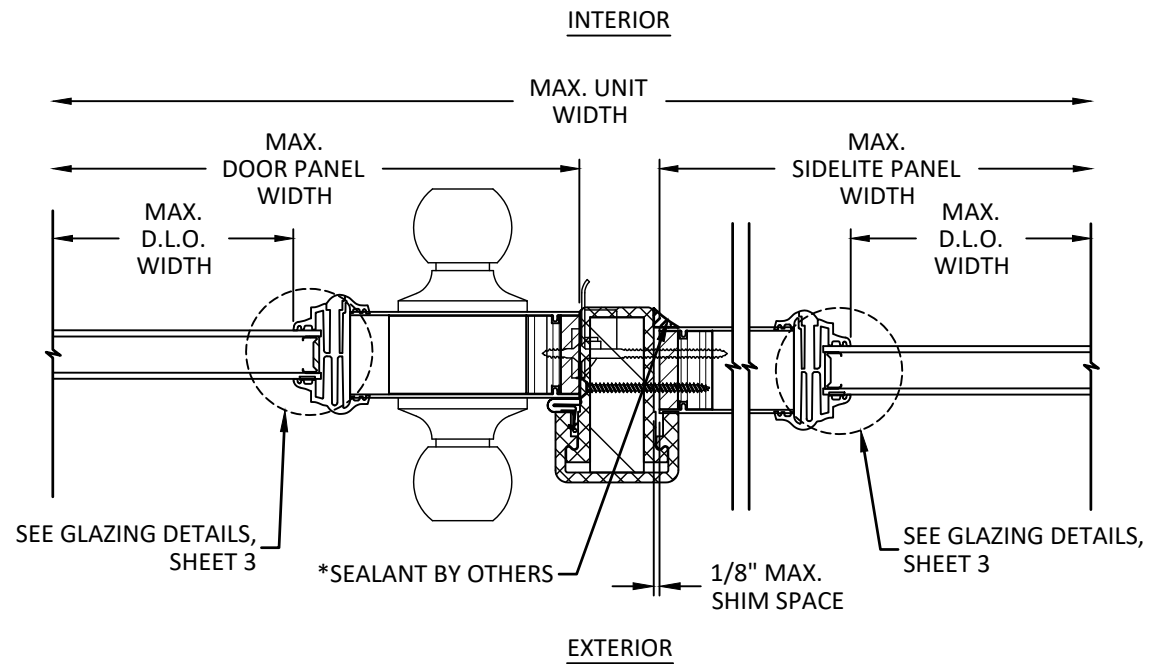

B HORIZONTAL SECTION
16 INSWING - PLASTPRO MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION

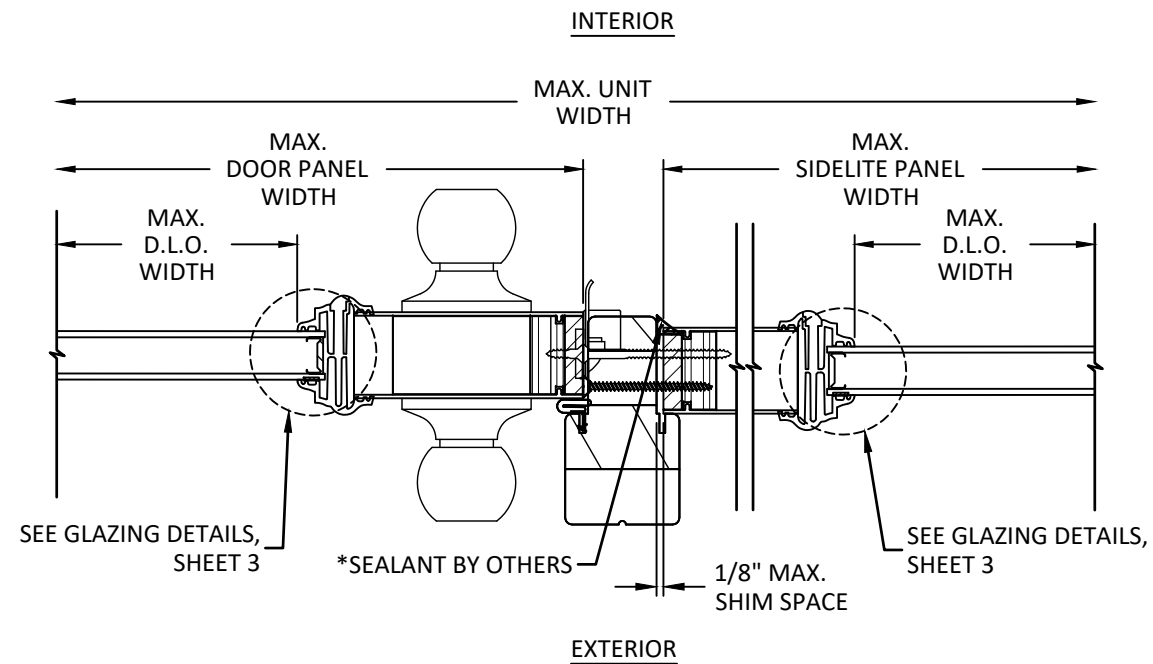

D HORIZONTAL SECTION
16 INSWING - WOOD PINE MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION

NOTE: BOX AND CONTINUOUS
CONSTRUCTION QUALIFIED FOR
USE WITH EVOLVE FRAME.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464
PH: (800) 253-3900


TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954)599-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

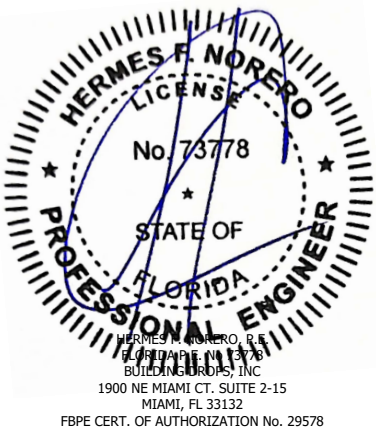


FL #:	FL47925
DATE:	12.01.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL012
SHEET:	16
REV.	A

c:\users\julianarodriguez\building_drops, inc\building_drops\projects\2026 code change projects\odl, inc\cc-26-03-40-1 - 2026 code change.dwg\147925\odl012 - a.dwg 8/5/2026 3:03 PM

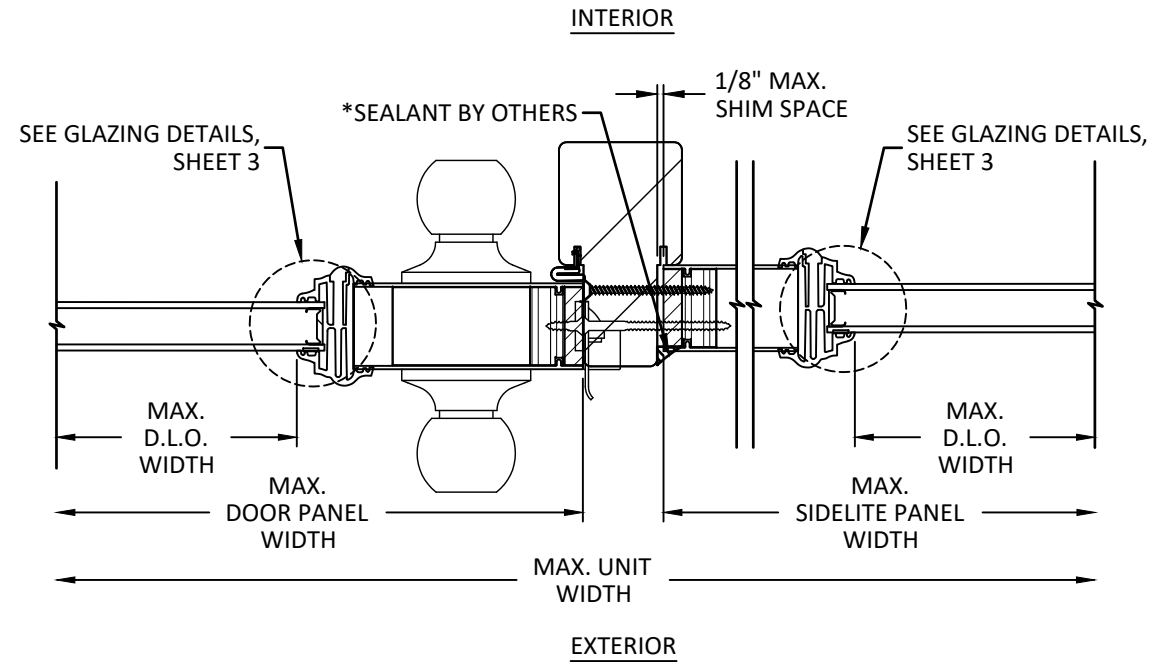

A
17 **HORIZONTAL SECTION**
OUTSWING - ENDURA FRAME
SAVER MULLION
EVOLVE FRAME
CONTINUOUS CONSTRUCTION
RATED TO A MAX. DP OF +/- 32.7 PSF

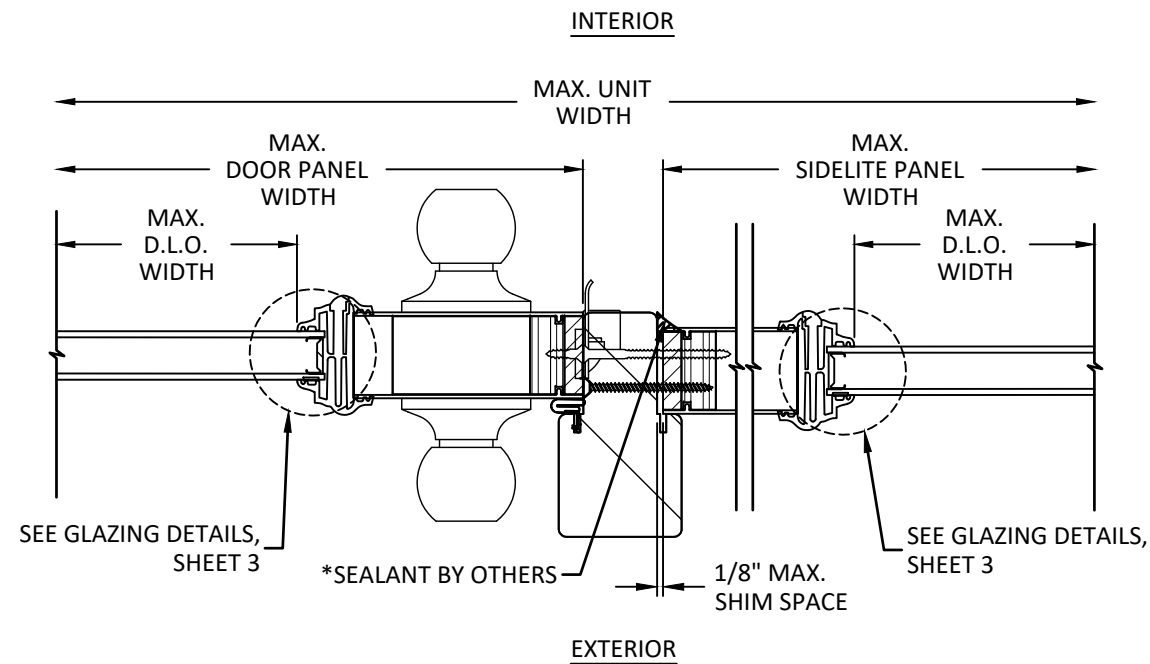

B
17 **HORIZONTAL SECTION**
INSWING - ENDURA FRAME
SAVER MULLION
EVOLVE FRAME
RATED TO A MAX. DP OF +/- 32.7 PSF
CONTINUOUS CONSTRUCTION

NOTE: BOX AND CONTINUOUS
CONSTRUCTION QUALIFIED FOR
USE WITH EVOLVE FRAME.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

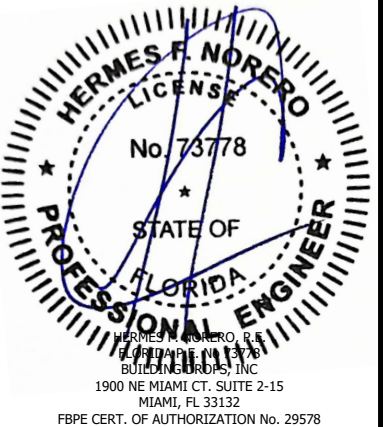

FL #:
FL47925

DATE: **12.01.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL012**

SHEET: **17** REV. **A**



BRIDGING DROPS

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




OF 25






1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR THROUGH FRAME INSTALLATION.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE $1/4$ INCH. SHIM WHERE SPACE OF $1/16$ INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - 7.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - 7.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.


ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. S.G. = 0.55	#10 WOOD SCREW	1.50"	0.75"
	CONCRETE (MIN. f'c = 3000 PSI) OR CMU (PER ASTM C90)	3/16" ITW TAPCON	1.00"	2.50"
	STEEL MIN. 18 GA. (MIN. Fy = 36 KSI) ALUM. MIN. 1/8" THK. (MIN. 6063-T5)	#12 SELF-TAPPING OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"

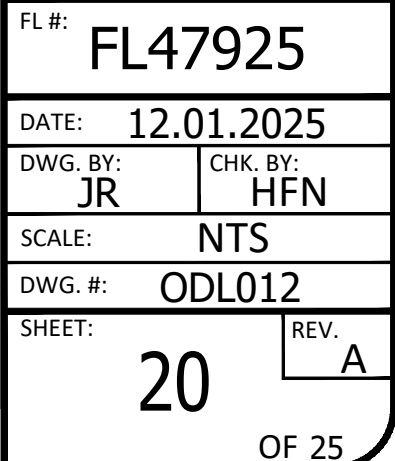


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg(147925)odl012 - a.dwg 8/5/2026 3:03 PM

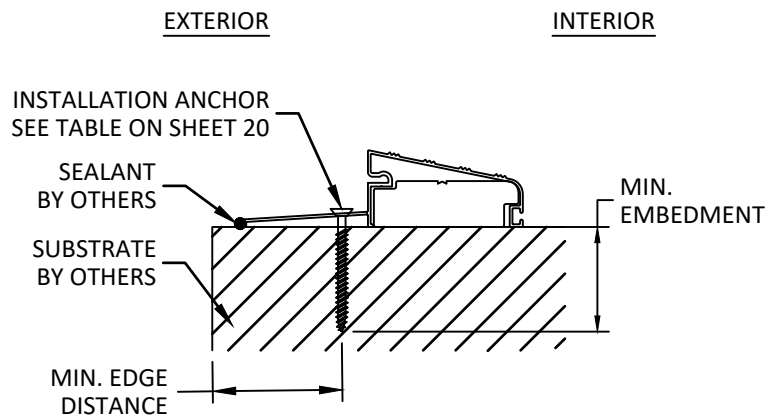


A
21 ANCHOR DETAIL
QOSH SILL

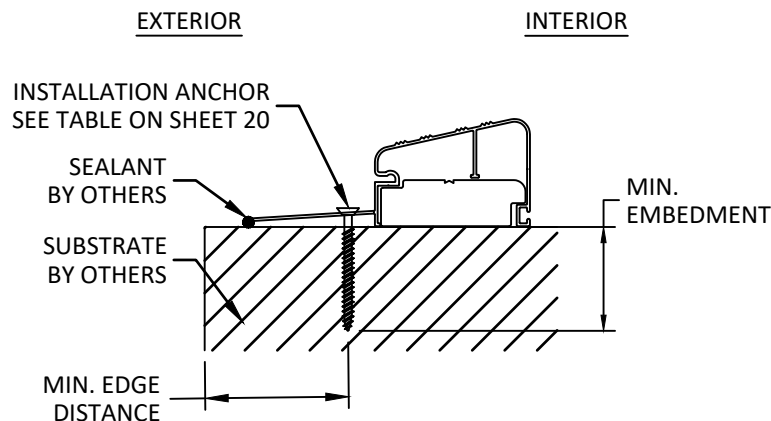


B
21 ANCHOR DETAIL
QOSR SILL

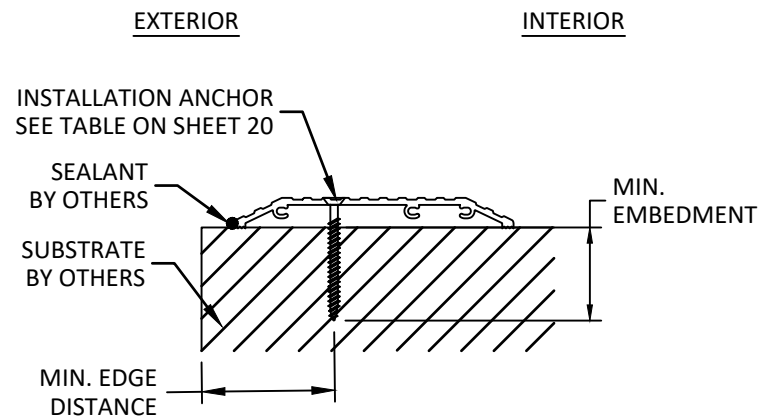


C
21 ANCHOR DETAIL
DLP ADA DB4565DL SILL

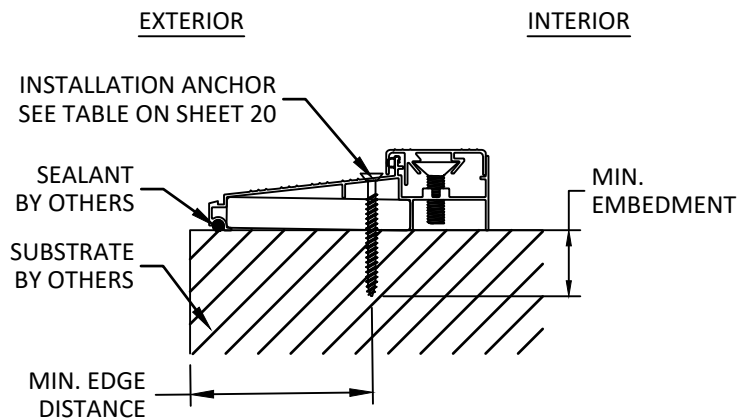

D
21 ANCHOR DETAIL
DLP ISCS SILL

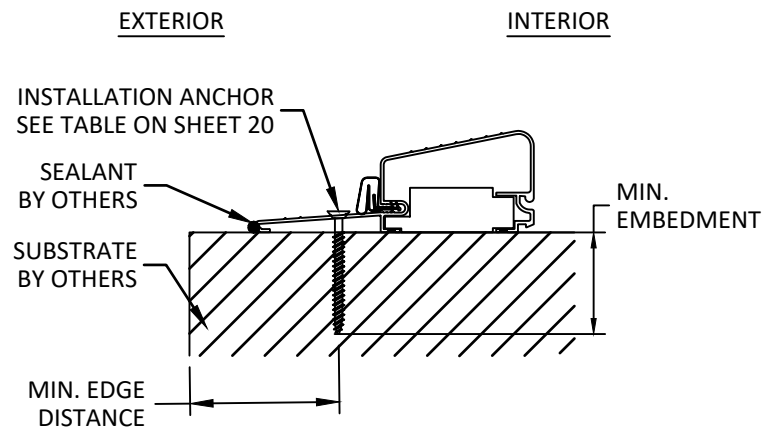

E
21 ANCHOR DETAIL
AFCO H-497 SILL

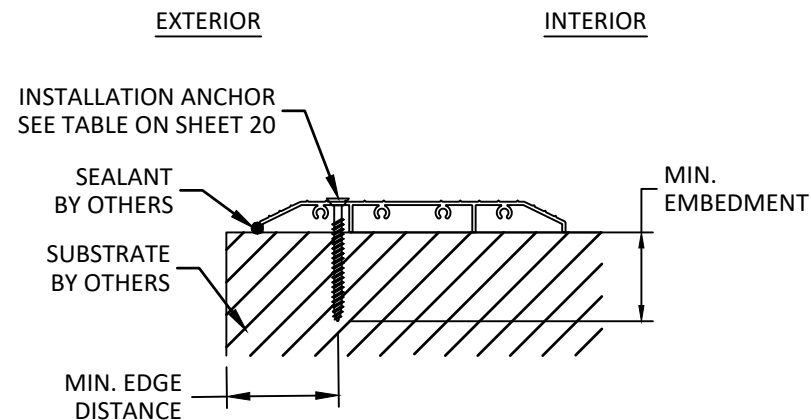

F
21 ANCHOR DETAIL
ENDURA HC15000 ADA SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

ANCHOR DETAILS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

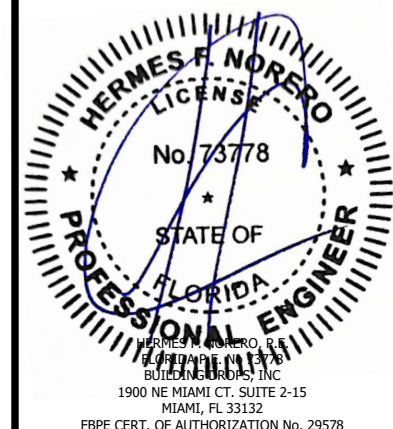

FL #:

FL47925

DATE: 12.01.2025


DWG. BY: JR
CHK. BY: HFN

SCALE: NTS


DWG. #: ODL012

SHEET: 21
REV. A


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg(147925)odl012 - a.dwg 8/5/2026 3:02 PM

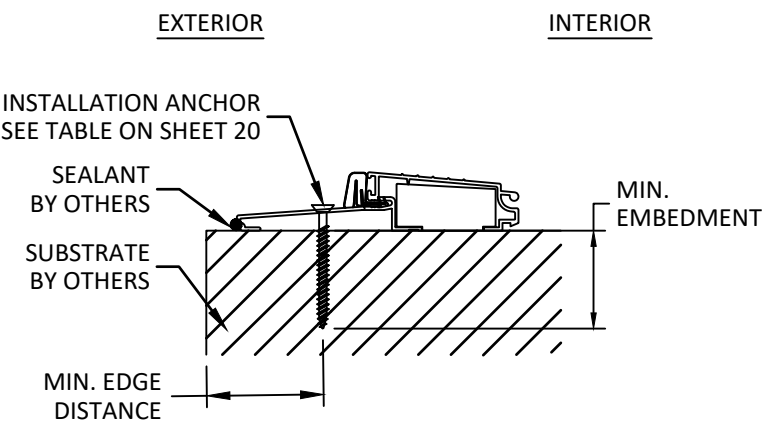


A
22 ANCHOR DETAIL
AFCO A-117 SILL

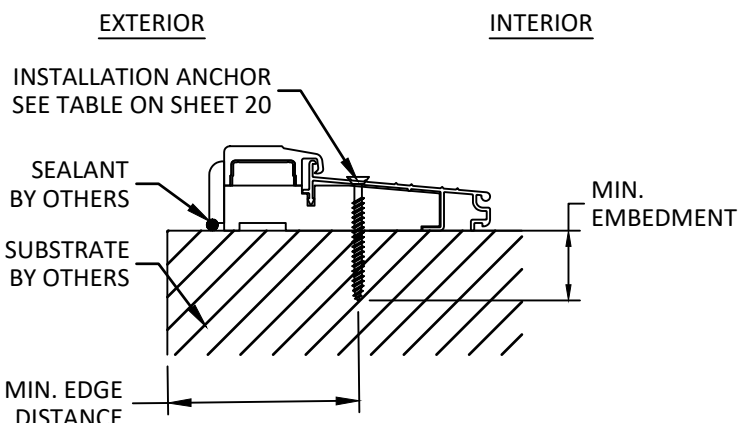


B
22 ANCHOR DETAIL
AFCO A-276 SILL

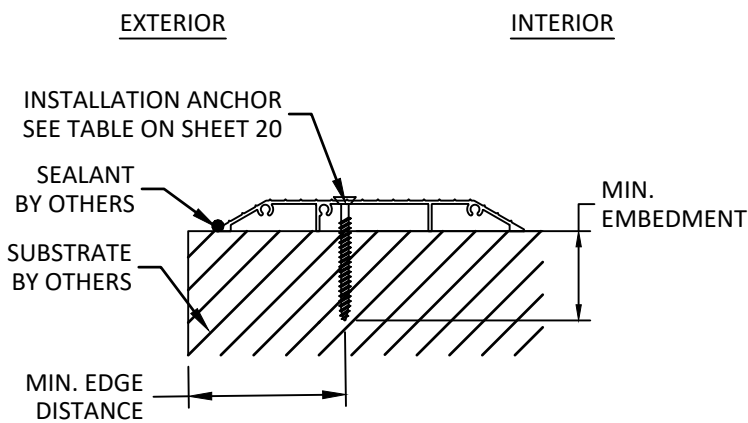


C
22 ANCHOR DETAIL
AFCO A-204 SILL

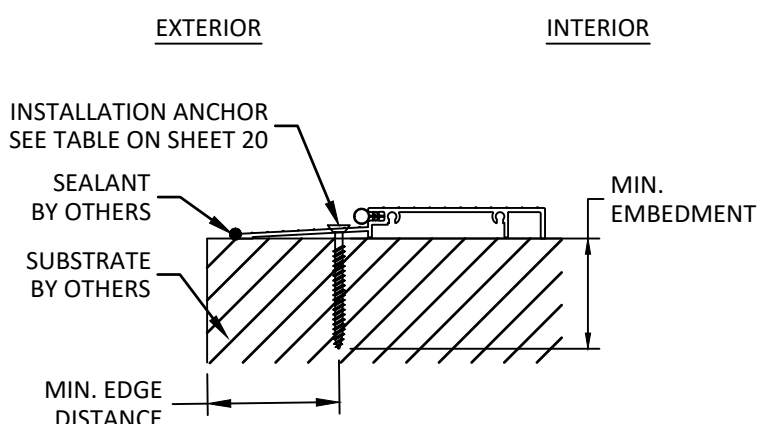

D
22 ANCHOR DETAIL
AFCO A-204T SILL

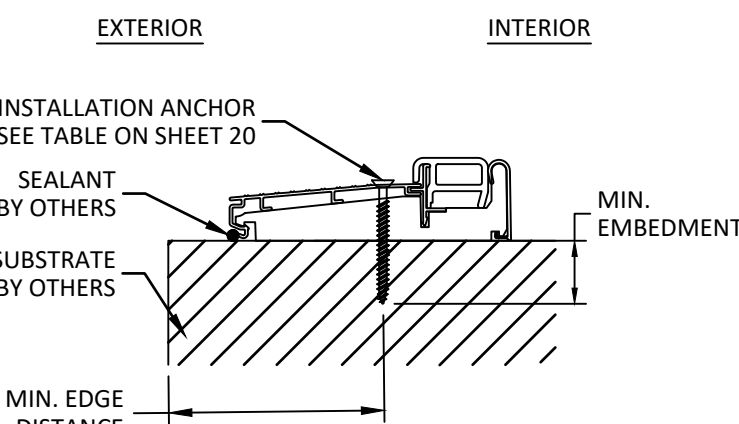

E
22 ANCHOR DETAIL
ENDURA ZAILAA4565 SILL

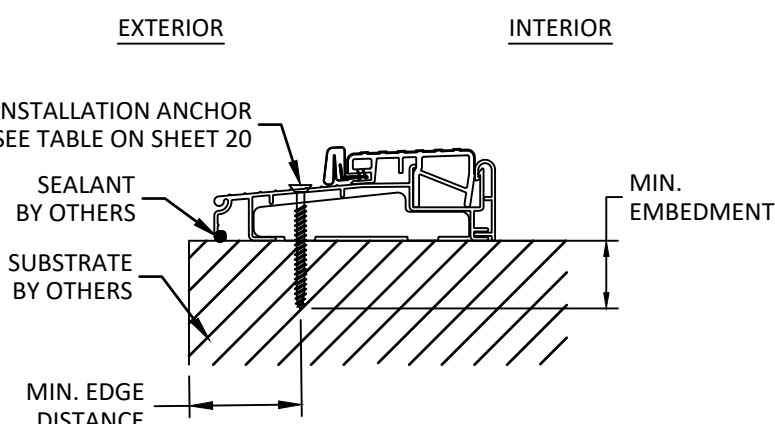

F
22 ANCHOR DETAIL
ENDURA ZOBL4565 SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

ANCHOR DETAILS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

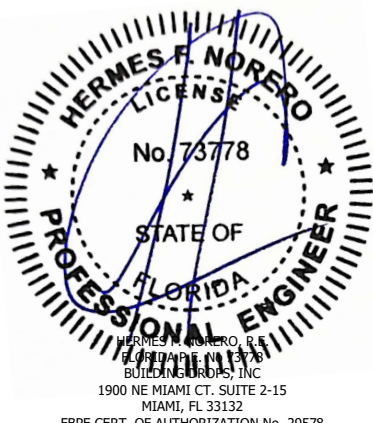

FL #:	FL47925	
DATE:	12.01.2025	
DWG. BY:	JR	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	ODL012	
SHEET:	22	REV. A
OF 25		




THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

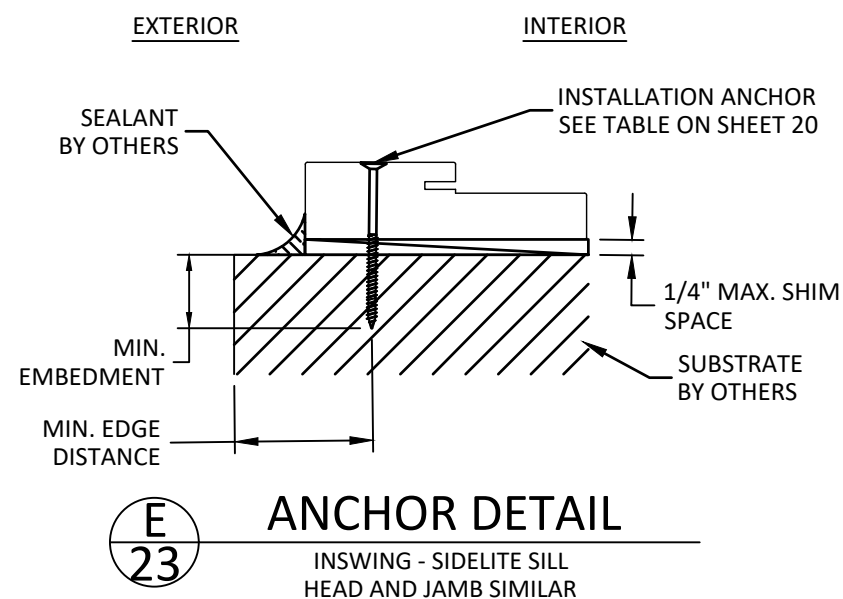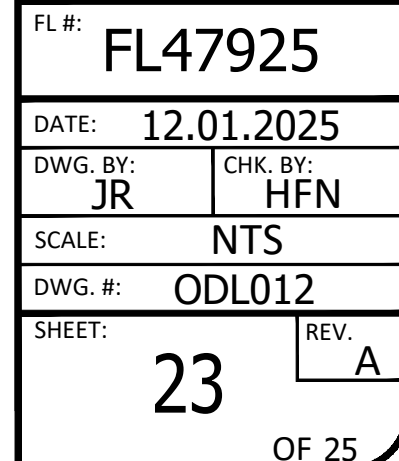


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg\147925\odl012 - a.dwg 8/5/2026 3:02 PM


20 DLP ISCS SILL

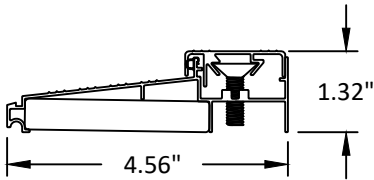


21 DLP ADA ISHC SILL

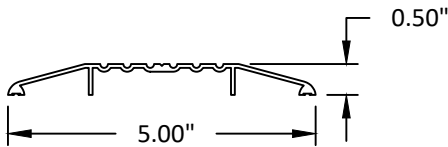


22 DLP DB4565DL SILL

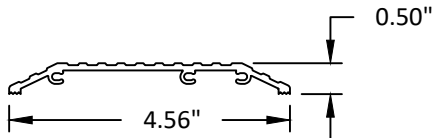


23 ENDURA HC15000 ADA SILL

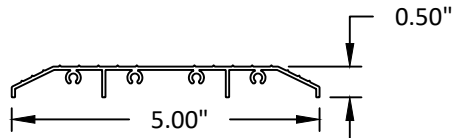


24 ENDURA FOB4565 SILL

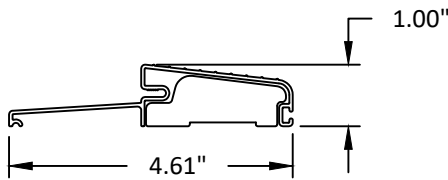


25 ENDURA ZOB4565FN SILL

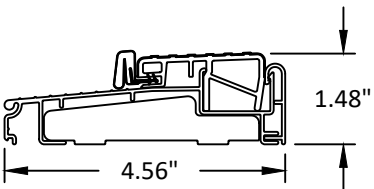


26 AFCO A-117 SILL

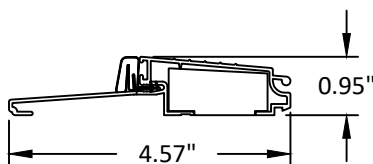


27 AFCO A-276 SILL

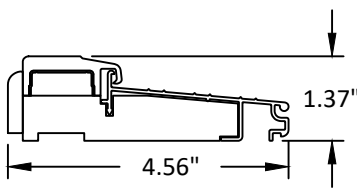


28 AFCO A-204 SILL

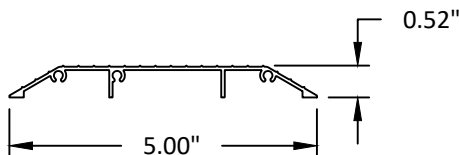


29 AFCO A-204T SILL

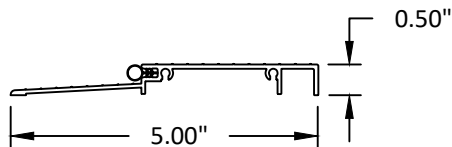


30 ENDURA ZAILAA4565 SILL

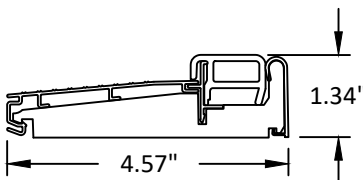


31 ENDURA ZOBL4565 SILL

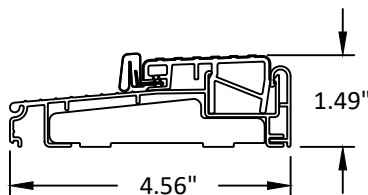


32 AFCO SIDELITE BASE

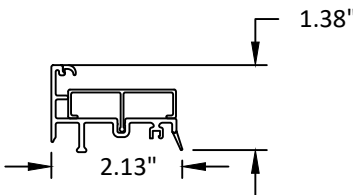


33 ENDURA SIDELITE BASE




34 ENDURA ULTIMATE HURRICANE ASTRAGAL




35 ENDURA ULTIMATE PUSH BUTTON ASTRAGAL




36 PLASTPRO MULLION



37 WOOD PINE MULLION

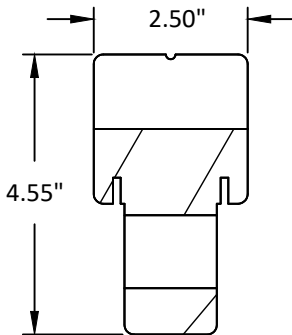

38 ENDURA FRAME SAVER MULLION

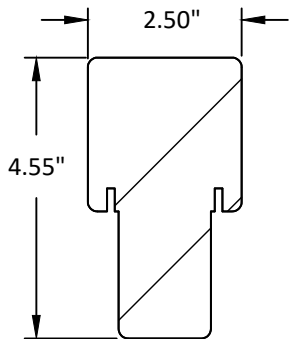

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING GLAZED
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132


PH: (954)399-8478
FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

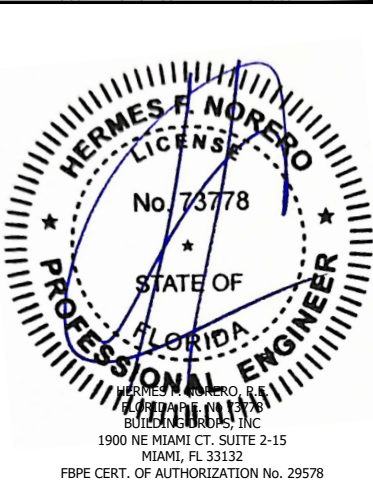

FL #:	FL47925
DATE:	12.01.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL012
SHEET:	25
REV.	A
OF 25	