

8/5/2026 3:12 PM

c:\users\julianarodriguez\building drops, inc\building drops\drops, inc\change projects\2026 code change projects\odl, inc\cc-26-0340.1 - 2026 code change\dwgs\147925\odl013 - a.dwg

ODL, INC.

INSWING & OUTSWING OPAQUE FIBERGLASS DOOR

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- ASTM E330-14

• ASTM E331-00(23)

• ASTM E283-04
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. DOOR SKIN MATERIAL: FIBERGLASS

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	PRODUCT SPECIFICATIONS TABLE
3	OXXO ELEVATION
4	OXO ELEVATION
5	X & XX ELEVATIONS
6	ADDITIONAL QUALIFIED PANEL DESIGNS
7	ANCHOR LAYOUTS
8	ANCHOR LAYOUTS
9	VERTICAL SECTIONS
10	VERTICAL SECTIONS
11	VERTICAL SECTIONS
12	HORIZONTAL SECTIONS
13	HORIZONTAL SECTIONS
14	HORIZONTAL SECTIONS
15	HORIZONTAL SECTIONS
16	HORIZONTAL SECTIONS
17	HORIZONTAL SECTIONS
18	ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES
19	ANCHOR DETAILS
20	ANCHOR DETAILS
21	ANCHOR DETAILS
22	BILL OF MATERIALS & COMPONENTS
23	COMPONENTS



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464


PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

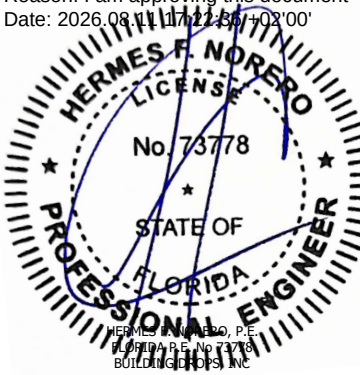

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		
Digitally signed by Hermes F. Norero, P.E. Reason: I am approving this document Date: 2026.08.11 17:22:59 -03'00'		
		
HERMES F. NORERO, P.E. FLORIDA P.E. No. 73778 BUILDING DROPS, INC. 1900 NE MIAMI CT. SUITE 2-15 MIAMI, FL 33132 FBPE CERT. OF AUTHORIZATION No. 29578		
FL #:		
FL47925		
DATE: 12.08.2025		
DWG. BY: JR	CHK. BY: HFN	
SCALE: NTS		
DWG. #: ODL013		
SHEET:	REV.	
1	A	
OF 23		

c:\users\julianarodriguez\building_drops, inc\building_drops\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change projects\odi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 3:12 PM

FOR SIDELITE FRAME
WIDTH UP TO 37.50"

PRODUCT SPECIFICATIONS									
JAMB TYPE	DOOR SIZE	OUTSWING (OS) / INSWING (IS)	UNIT CONFIGURATIONS & CORRESPONDING MAX. DESIGN PRESSURES (PSF)					BOXED (BOX) / CONTINUOUS CONSTRUCTION (CHS)	
			X	OX	OXO	XX	OXXO		
WOOD	6'8"	IS	+ 65 / - 70	+ 50 / - 60	+ 50 / - 60	+ 45 / - 50	+ 45 / - 50	BOX	
		OS	+/- 65	+/- 50	+/- 50	+/- 55	+/- 55		
	8'0"	IS	+/- 60	+/- 50	+/- 50	+ 45 / - 50	+ 45 / - 50		
		OS	+/- 60	+/- 50	+/- 50	+/- 45	+/- 45		
COMPOSITE	6'8"	IS	+ 65 / - 70	+ 55 / - 60	+ 55 / - 60	+ 45 / - 50	+ 45 / - 50		
		OS	+/- 65	+/- 55	+/- 55	+/- 55	+/- 55		
	8'0"	IS	+/- 60	+/- 50	+/- 50	+ 45 / - 50	+ 45 / - 50		
		OS	+/- 60	+/- 50	+/- 50	+/- 45	+/- 45		
WOOD	6'8"	IS	-	+/- 50	+/- 50	-	+/- 50	CHS	
		OS		+/- 50	+/- 50		+/- 50		
	8'0"	IS		+/- 50	+/- 50		+ 45 / - 50		
		OS		+/- 50	+/- 50		+/- 45		
COMPOSITE	6'8"	IS		+/- 50	+/- 50		+/- 50		
		OS		+/- 50	+/- 50		+/- 50		
	8'0"	IS		+/- 50	+/- 50		+ 45 / - 50		
		OS		+/- 50	+/- 50		+/- 45		
WOOD	8'0"	IS		-	-		-		+ 45 / - 50
		OS							+/- 40
COMPOSITE	8'0"	IS							+ 45 / - 50
		OS							+/- 40

NOTE: ALL RATINGS ARE WITH NARROW
SIDELITES (UP TO 15.50" SIDELITE FRAME
WIDTH), EXCEPT WHERE NOTED.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

PRODUCT SPECIFICATIONS
TABLE

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

PH: (954)599-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

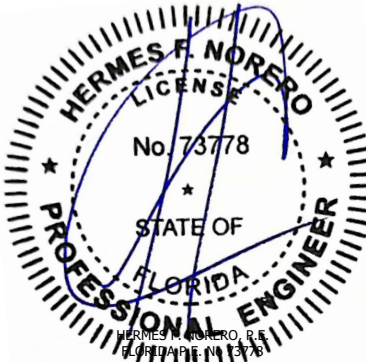

HERMES F. NORERO, P.E.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47925

DATE: 12.08.2025

DWG. BY: JR
CHK. BY: HFN


SCALE: NTS

DWG. #: ODL013

SHEET: 2
REV. A

c:\users\julianarodriguez\building_drops - documents\common\projects\2026 code change projects\odl - 2026 code change dwgs\147925\odl013 - a.dwg 8/5/2026 3:12 PM

ELEVATION
OXXO CONFIGURATION

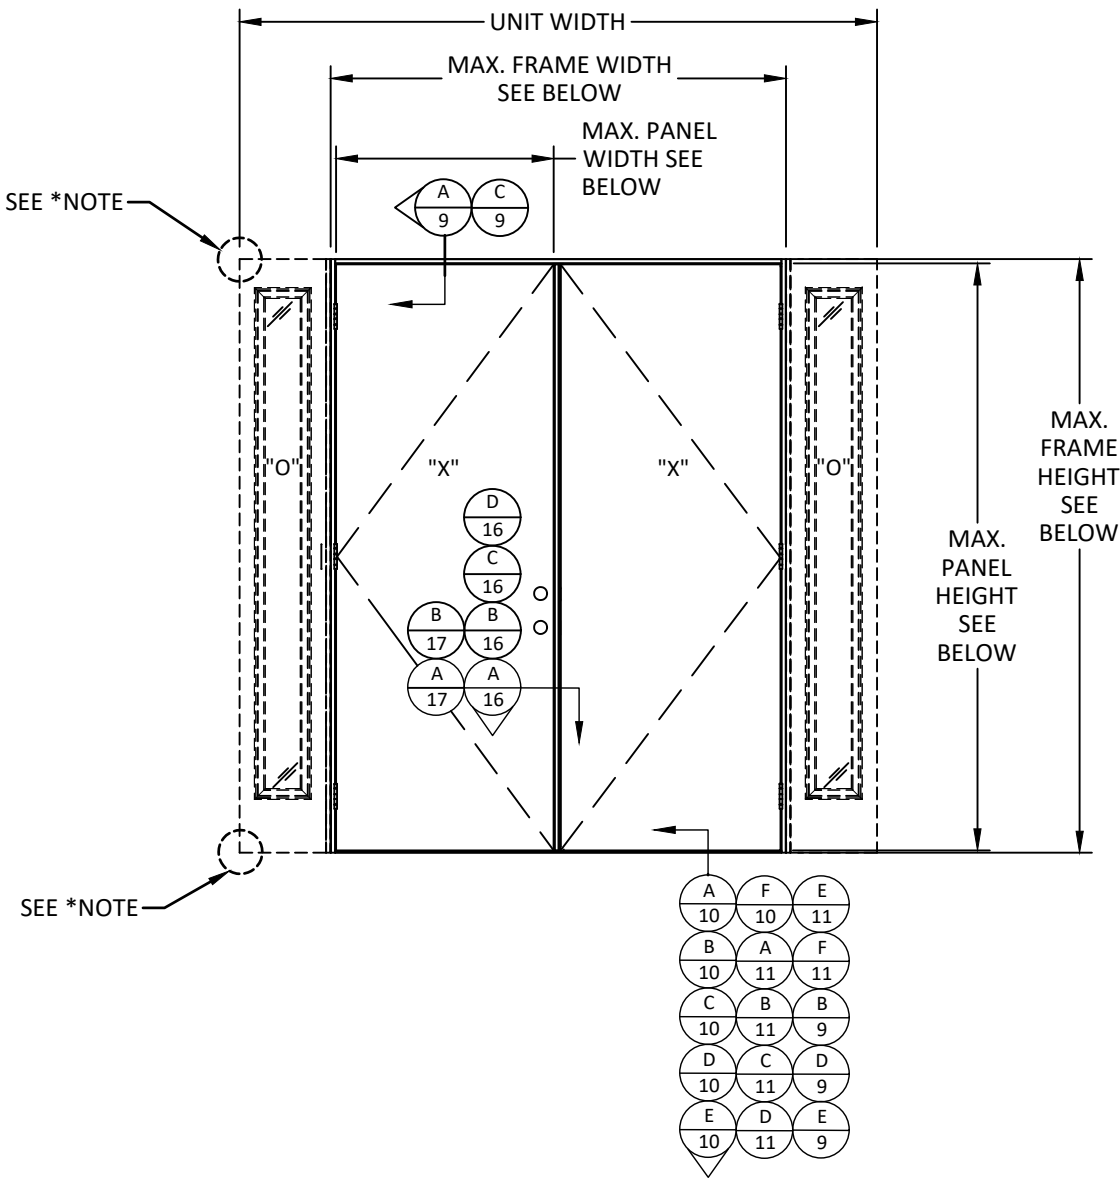

DOOR: PRODUCT DIMENSIONS TABLE				
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)
6'8" OPAQUE	74.50	82.00	35.75	79.25
8'0" OPAQUE	74.50	98.00	35.75	95.25

NOTE: BOXED CONSTRUCTION SHOWN,
CONTINUOUS CONSTRUCTION
QUALIFIED. SEE SHEETS 13-15 FOR
HORIZONTAL SECTION DETAILS FOR
CONTINUOUS CONSTRUCTION.

*NOTE: OPTION TO ATTACH FRAME
CORNERS WITH 7/16" X 2" 16 GAGE
STAPLES WITH (4) PER CORNER ON THE
HEAD AND (2) PER CORNER ON THE SILL.
ANOTHER OPTION IS TO FASTEN EACH
CORNER WITH #9 X 2-1/2" PHILLIPS
HEAD SCREWS WITH (3) PER CORNER
ON THE HEAD FOR ALL SILLS. FOR
ENDURA AND DLP ADA SILLS, (3)
SCREWS PER CORNER ON THE SILL. ALL
OTHER SILLS CAN HAVE (2) SCREWS PER
CORNER.

NOTE: OPAQUE PANELS QUALIFIED FOR
USE WITH GLAZED AND FLUSH GLAZED
SIDELITES. SEE SEPARATE FLORIDA
PRODUCT APPROVAL FOR MORE
INFORMATION ON SIDELITES.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

OXXO ELEVATION

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15

MIAMI, FL 33132

PH: (954)599-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

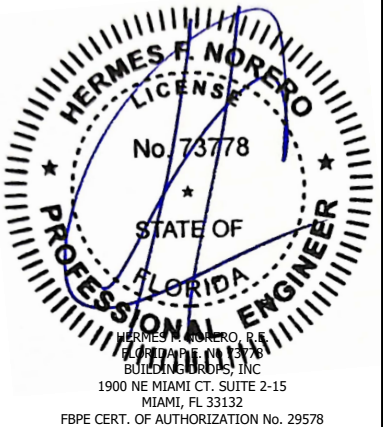

FL #: **FL47925**

DATE: **12.08.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL013**

SHEET: **3** REV. **A**

Diagram illustrating the layout and dimensions of a door panel assembly. The diagram shows a central panel with a grid of boxes (A, B, C, D, E, F) and a central 'X' area. Dimensions are indicated by arrows and text labels.

Dimensions:

- UNIT WIDTH:** Indicated by a horizontal arrow at the top.
- MAX. FRAME WIDTH SEE BELOW:** Indicated by a horizontal arrow on the right side.
- MAX. PANEL WIDTH SEE BELOW:** Indicated by a horizontal arrow on the right side.
- MAX. FRAME HEIGHT SEE BELOW:** Indicated by a vertical arrow on the right side.
- MAX. PANEL HEIGHT SEE BELOW:** Indicated by a vertical arrow on the right side.

Box Layouts:

Top Section:

A	C
9	9

Central Section:

B	A
15	14
A	D
15	13
D	C
14	13
C	B
14	13
B	A
14	13

Bottom Section:

A	F	E
10	10	11
B	A	F
10	11	11
C	B	B
10	11	9
D	C	D
10	11	9
E	D	E
10	11	9

Notes:

- SEE *NOTE:** Points to the top-left corner of the panel.
- SEE *NOTE:** Points to the bottom-left corner of the panel.
- SEE *NOTE:** Points to the bottom-left corner of the panel.
- SEE *NOTE:** Points to the bottom-left corner of the panel.

Labels:

- "O":** Labels for the top-left and top-right corners of the panel.
- "X":** Label for the central area of the panel.

NOTE: 2X REQUIRED BETWEEN BOXES
FOR DOOR PANELS GREATER
THAN 79.25" IN HEIGHT.

DOOR: PRODUCT DIMENSIONS TABLE				
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)
6'8" OPAQUE	37.50	82.00	35.75	79.25
8'0" OPAQUE	37.50	98.00	35.75	95.25

NOTE: BOXED CONSTRUCTION SHOWN,
CONTINUOUS CONSTRUCTION
QUALIFIED. SEE SHEETS 13-15 FOR
HORIZONTAL SECTION DETAILS FOR
CONTINUOUS CONSTRUCTION.

*NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.

NOTE: OPAQUE PANELS QUALIFIED FOR USE WITH GLAZED AND FLUSH GLAZED SIDELITES. SEE SEPARATE FLORIDA PRODUCT APPROVAL FOR MORE INFORMATION ON SIDELITES.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
**INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)**


OXO ELEVATION

PREPARED BY: **BUILDING DROPS, INC.**
1000 NE MIAMI CT. SUITE 315



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

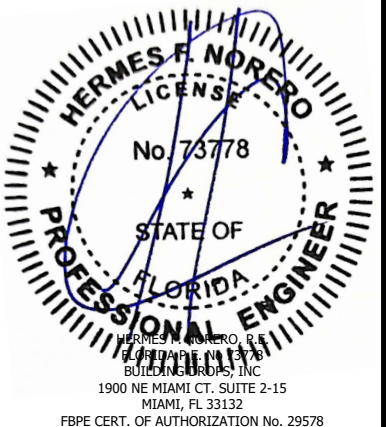

FL #: **FL47925**

DATE: 12.08.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS



DWG. #: ODL013

SHEET:	REV.
--------	------

4

REV.

OF 23

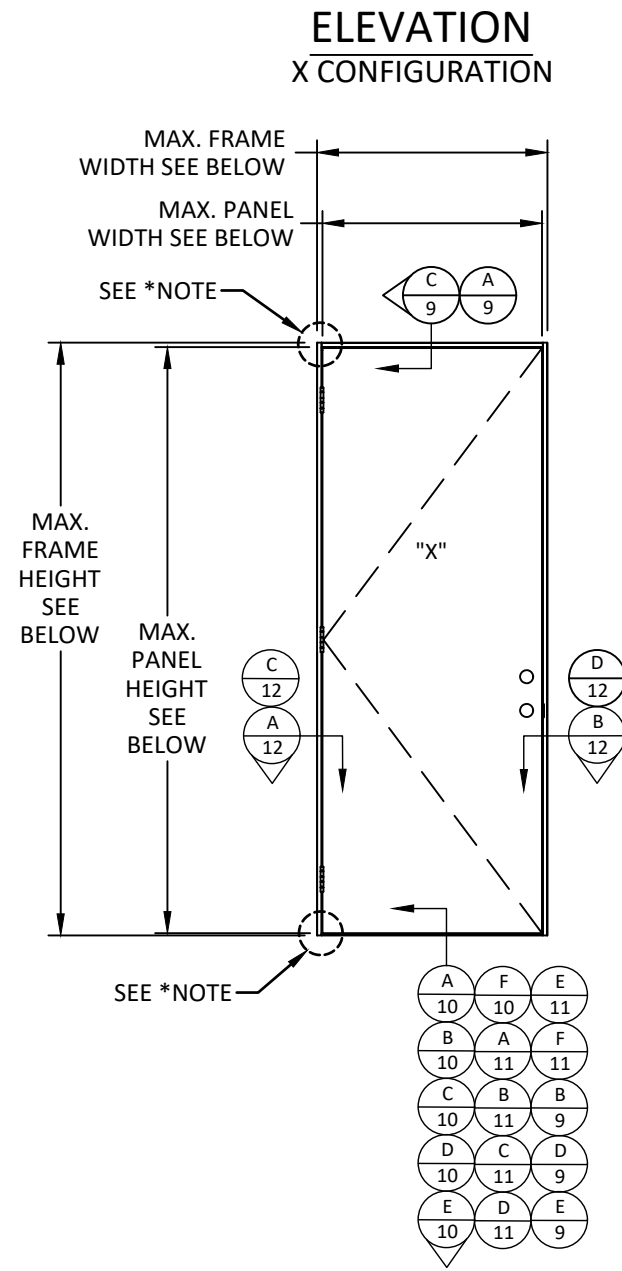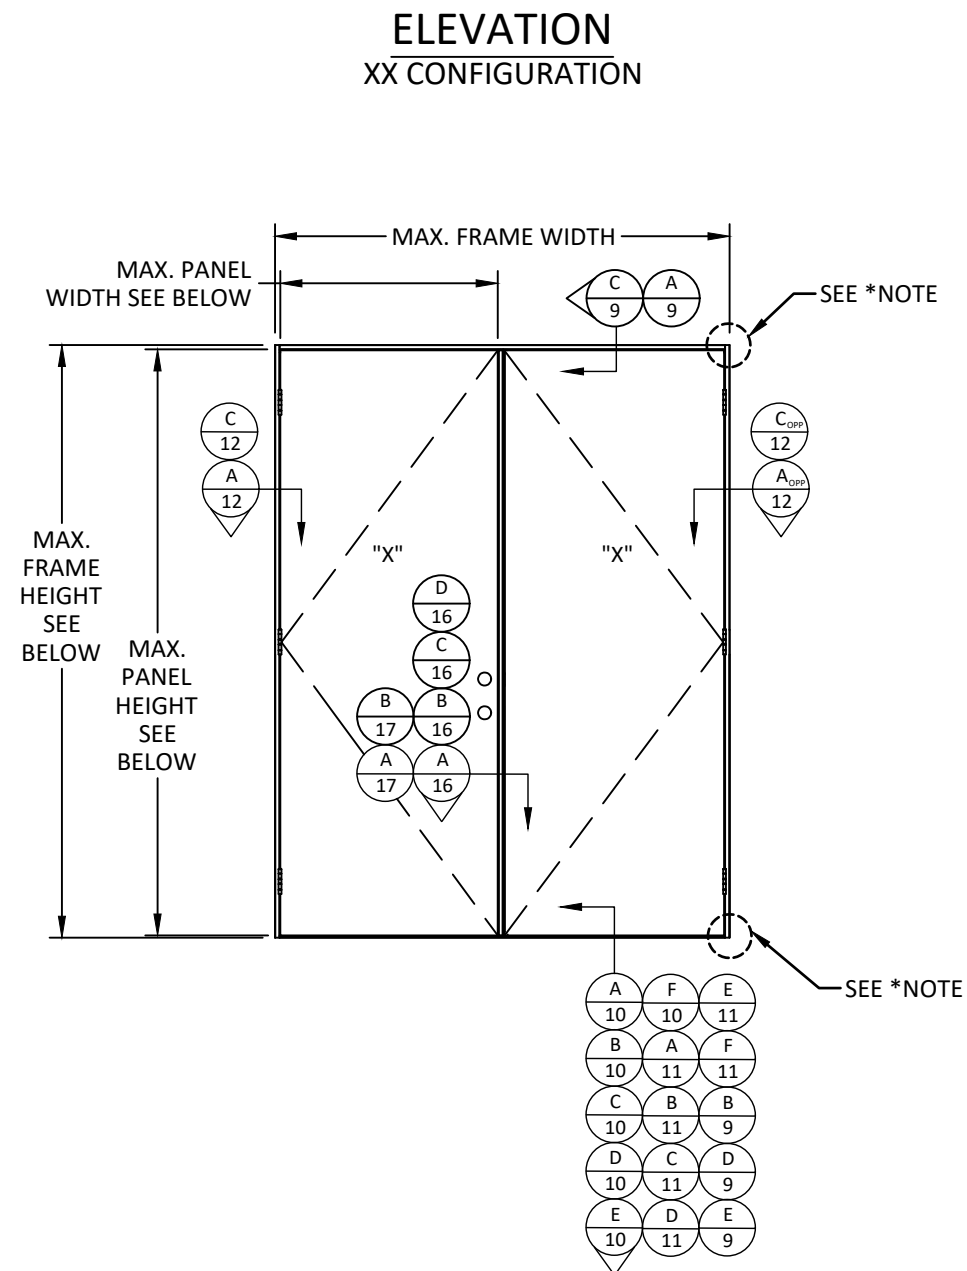

DOOR: PRODUCT DIMENSIONS TABLE				
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)
6'8" OPAQUE	74.50	82.00	35.75	79.25
8'0" OPAQUE	74.50	98.00	35.75	95.25

***NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.**



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

X & XX ELEVATIONS


PREPARED BY:

 **BUILDING DROPS**

BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

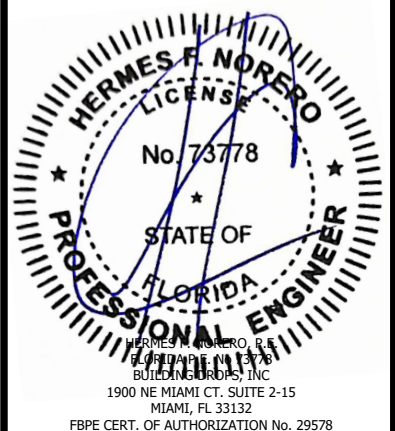

FL #: **FL47925**


DATE: 12.08.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: ODL013

SHEET:	REV.
F	A

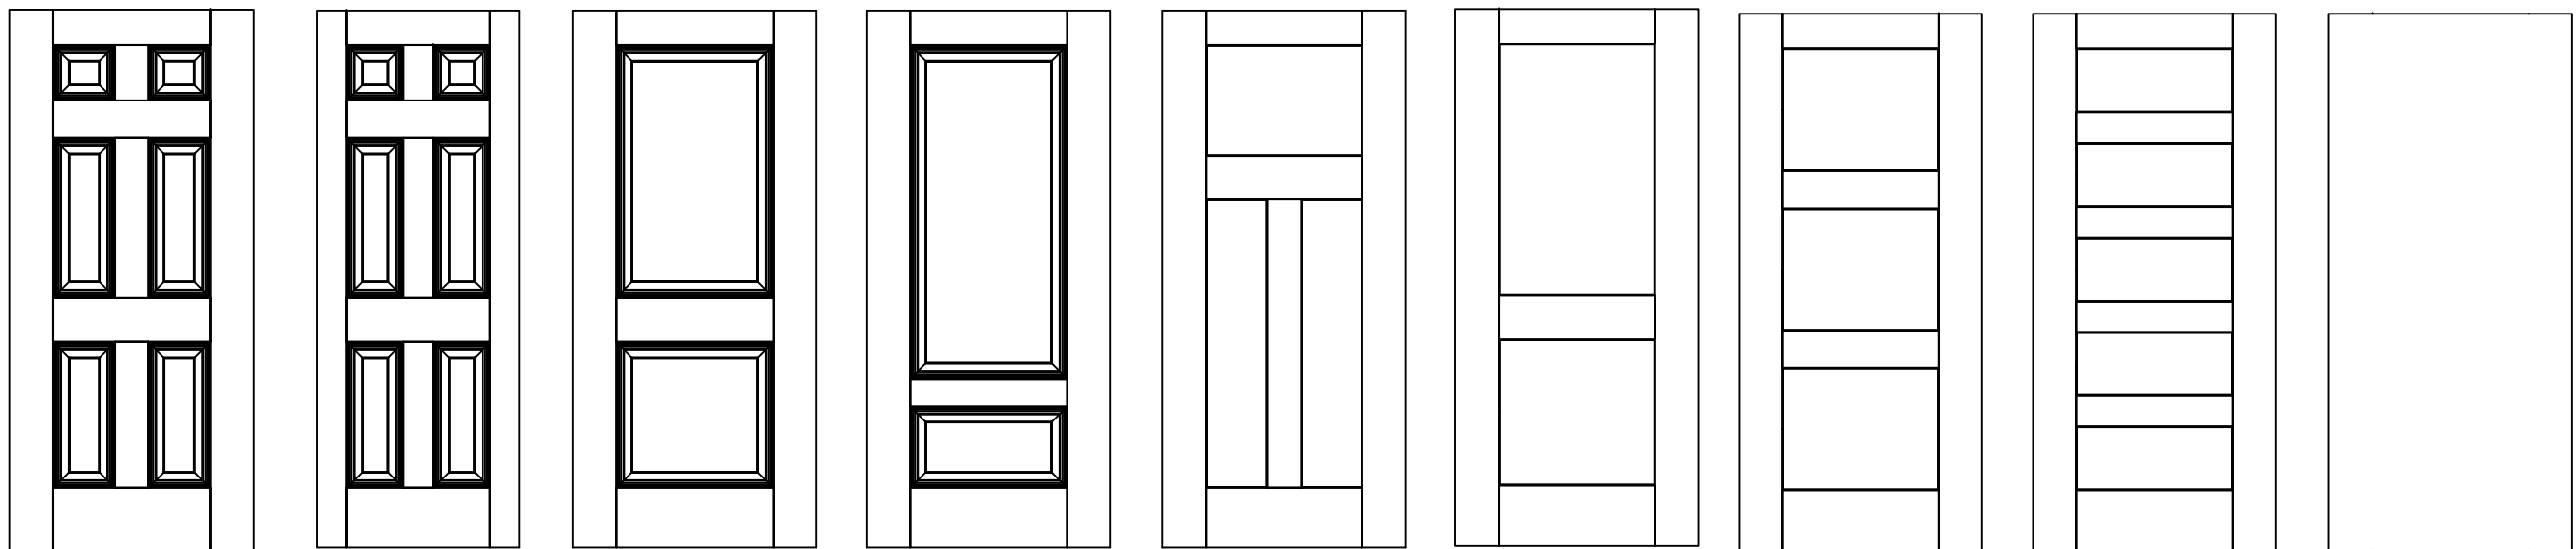


ADDITIONAL QUALIFIED PANEL DESIGNS

FOR BOTH 6'8" AND 8'0" SYSTEMS



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

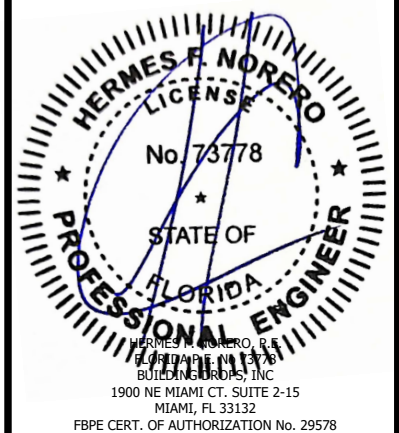

FL #: **FL47925**

DATE: 12.08.2025


DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: ODL013

SHEET:	REV.
6	A

c:\users\julianarodriguez\building_drops - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change\dwgs\147925\odi013 - a.dwg 8/5/2026 3:13 PM

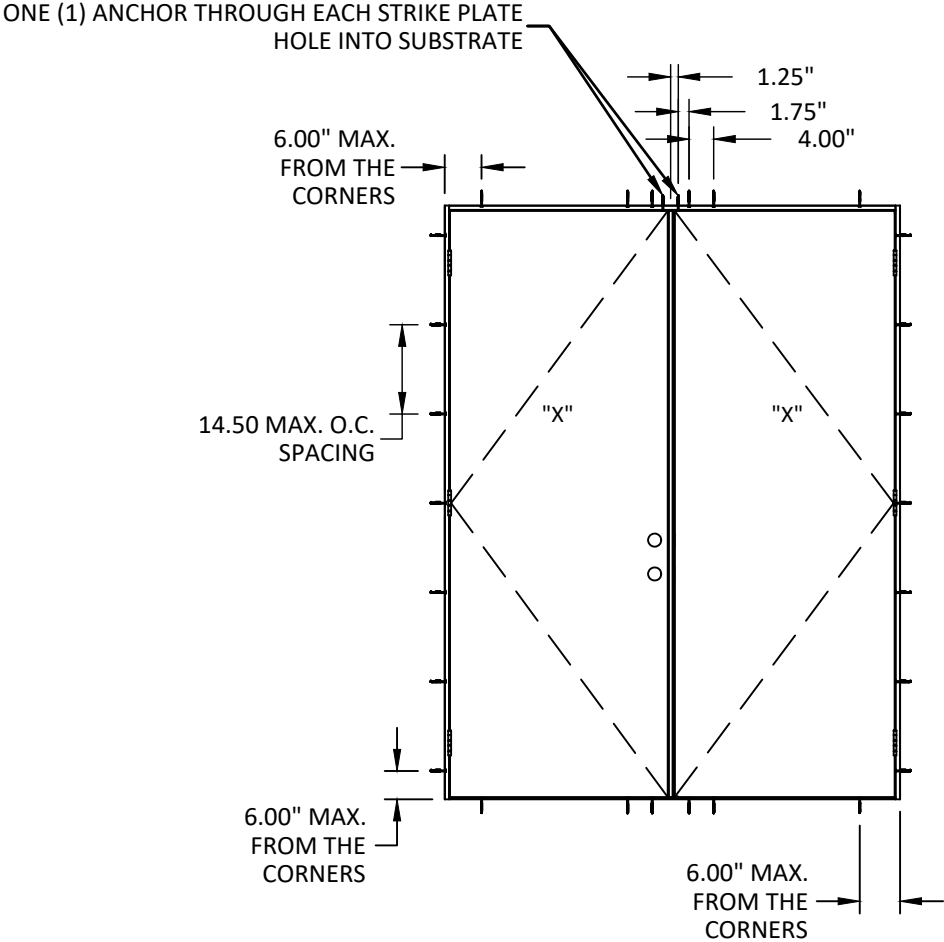

ANCHOR LAYOUT
XX CONFIGURATION
THROUGH FRAME INSTALLATION

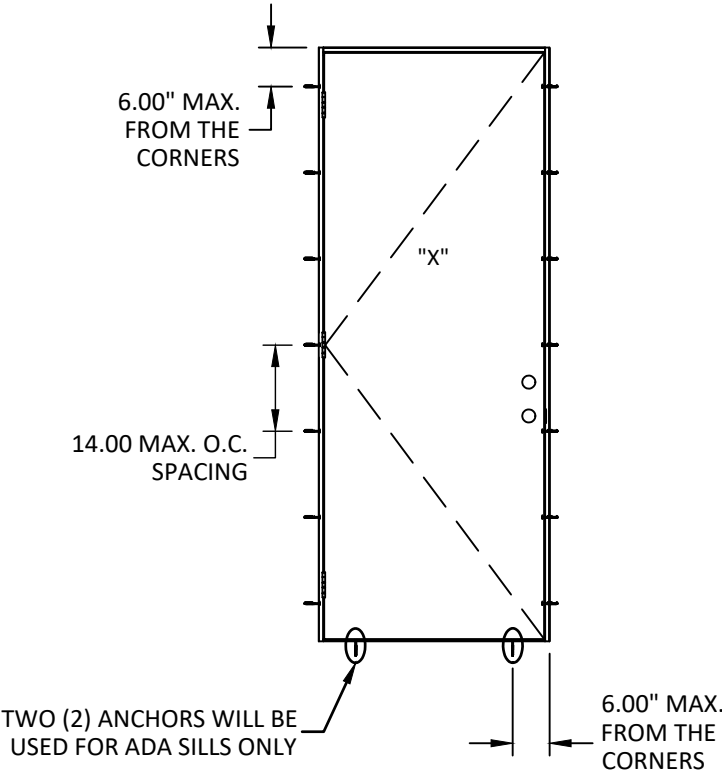

ANCHOR LAYOUT
X CONFIGURATION
THROUGH FRAME INSTALLATION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900


TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)
ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

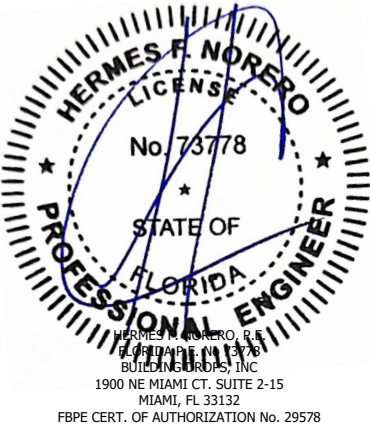

FL #:	FL47925
DATE:	12.08.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	ODL013
SHEET:	REV.
8	A



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY: PLITI DTIC DD0000 TN0

1900 NE MIAMI CT. SUITE 2-15
MIAMI FL 33132

PH: (954)399-8478


FAX: (954)744.4738
WEB: www.buildingadrons.com

REMARKS
2026 FBC

BY
JR

7/2

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC INSTALLATION DOCUMENTS FOR USE WITH THIS DOCUMENT.

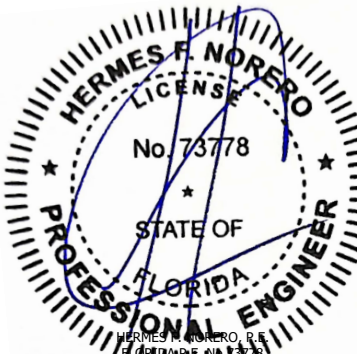

HERMES M. NORERO, P.E.
FLORIDA P.E. NO. 13778
BUILDINGCORPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47925

DATE: 12.08.2025

DWG. BY
JR

CHK. BY:
HFN

SCALE: NTS

DWG. #: ODL013


SHEET:

REV


9

A


OF 23

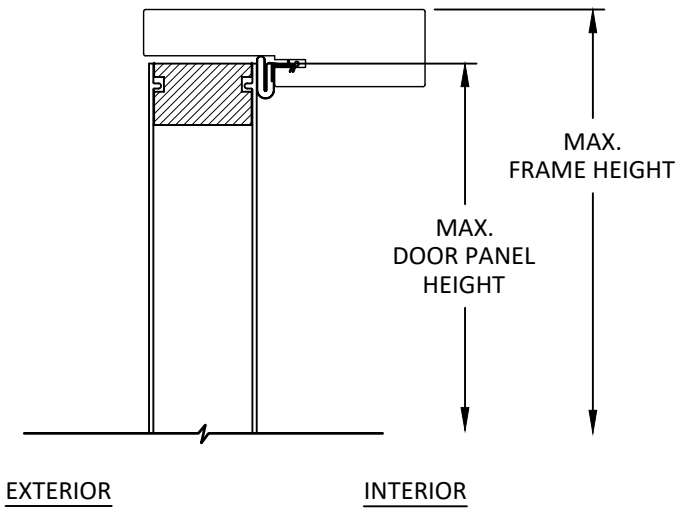

VERTICAL SECTION
OUTSWING DOOR - HEAD

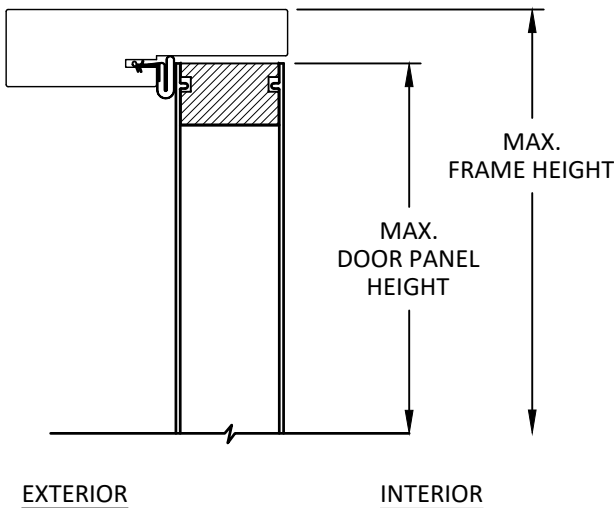


C
9 **VERTICAL SECTION**
INSWING DOOR - HEAD

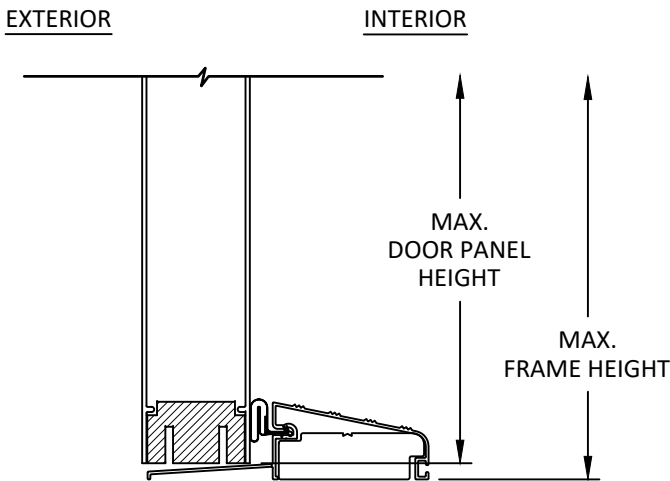

B
9

VERTICAL SECTION


QOSH SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

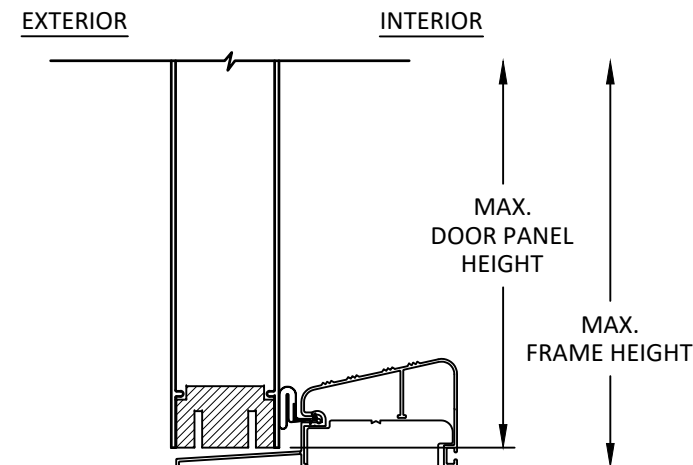

D
9


VERTICAL SECTION

QOSR SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

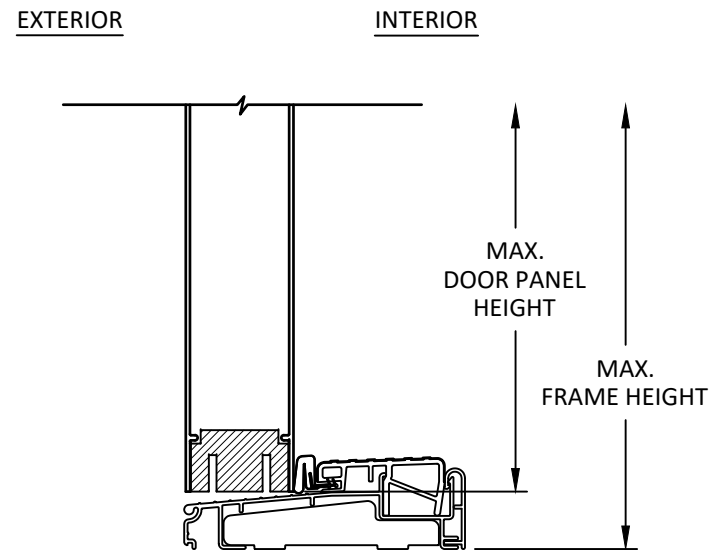


VERTICAL SECTION

ENDURA ZOB4565FN SILL
SIDELITE QUALIFIED FOR USE WITH SILL
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

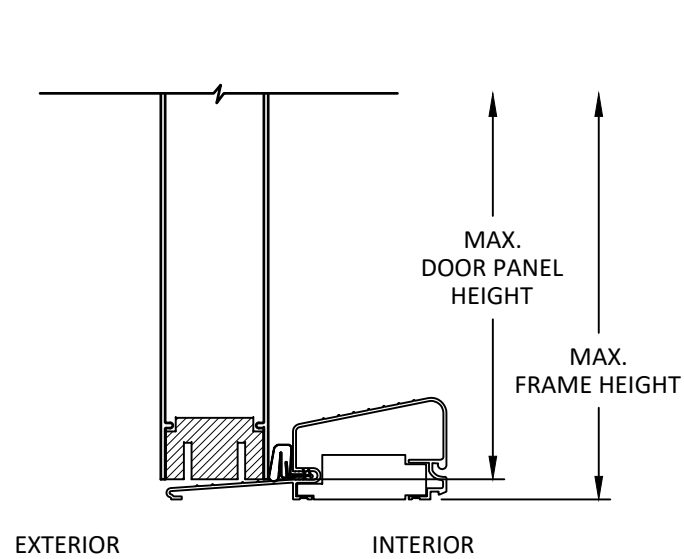


VERTICAL SECTION

10 AFCO H-497 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 60 PSF FOR 6'8" DOORS
RATED TO MAX. DESIGN PRESSURE +/- 55 PSF FOR 8'0" DOORS

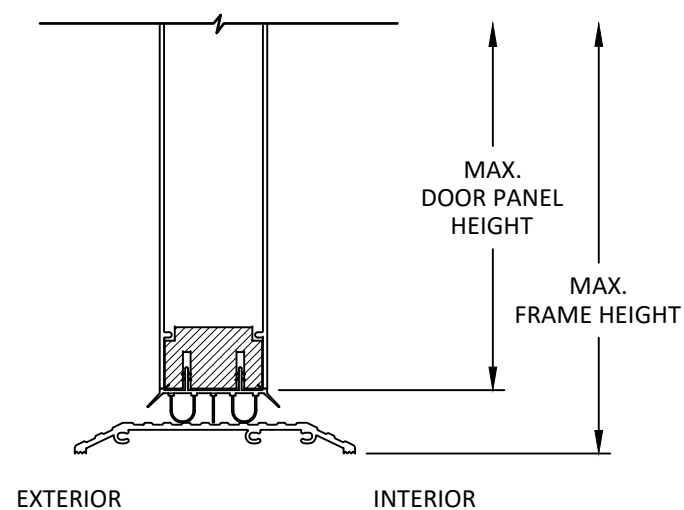


D
10 **VERTICAL SECTION**
DLP ADA DB4565DL SILL
BOX CONSTRUCTION

DLP ADA DB4565DL SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE + 65/ - 70 PSF

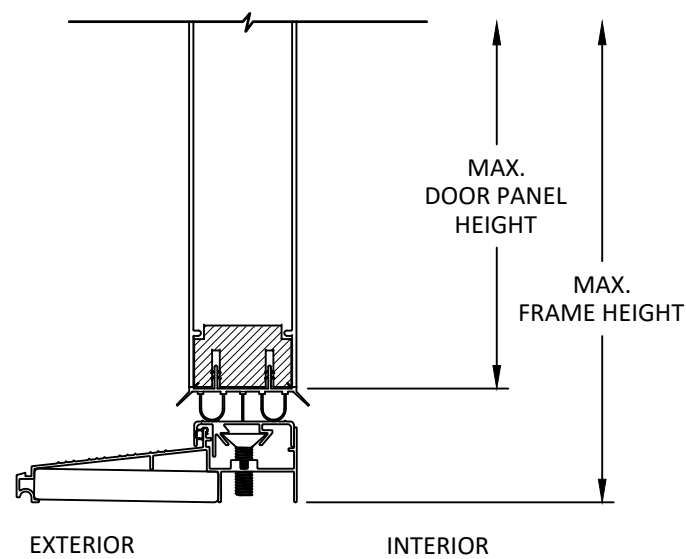


B 10 VERTICAL SECTION

DLP ISCS SILL
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH SIDELITE BASE
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

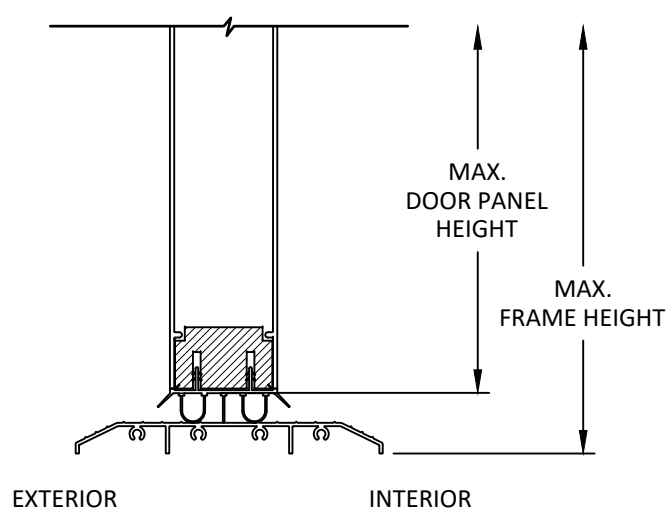


E 10 VERTICAL SECTION
ENDURA HC15000 ADA SILL
BOX CONSTRUCTION

ENDURA HC15000 ADA SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE + 65 / - 70 PSF

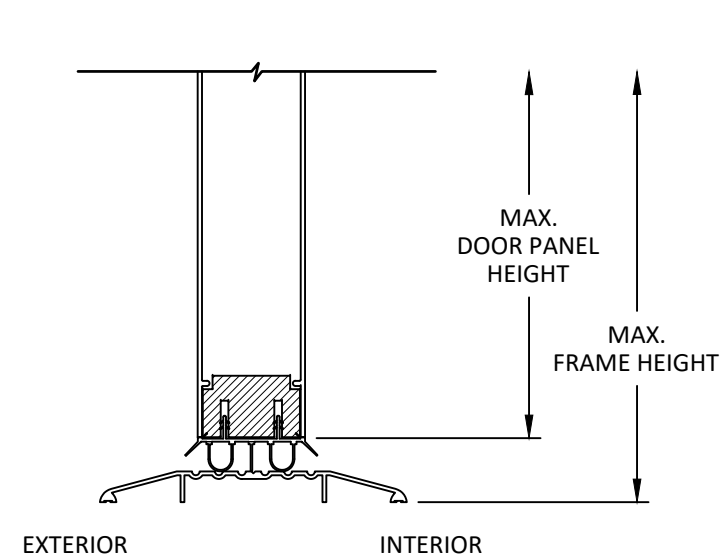

C
10 VERTICAL SECTION
ADA ISHC SILL
BOX CONSTRUCTION

ADA ISHC SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

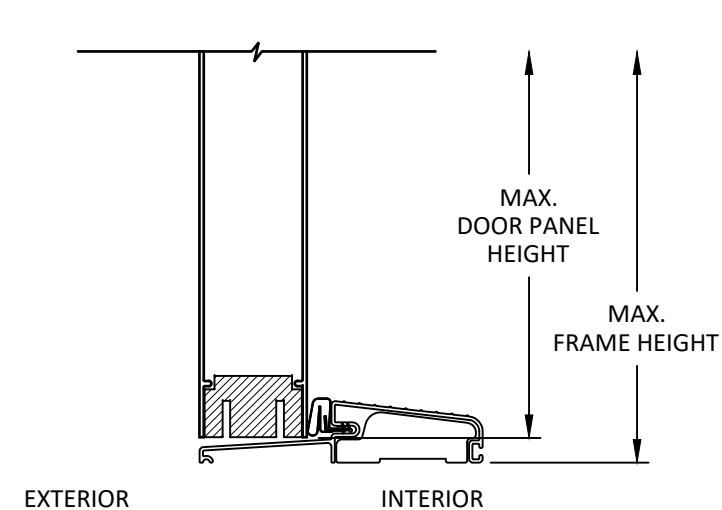

F 10 **VERTICAL SECTION**
ENDURA FOB4565 SILL
SIDEITE CHANNEL FOR USE WITH GU

10 ENDURA FOB4565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 60 PSF FOR 6'8" DOORS
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF FOR 8'0" DOORS



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
**INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)**


VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

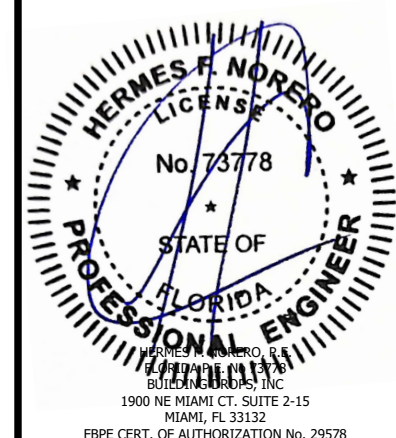

FL #: **FL47925**

DATE: 12.08.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: ODL013

SHEET:	REV.
10	A

OF 23


PH: (800) 253-3900

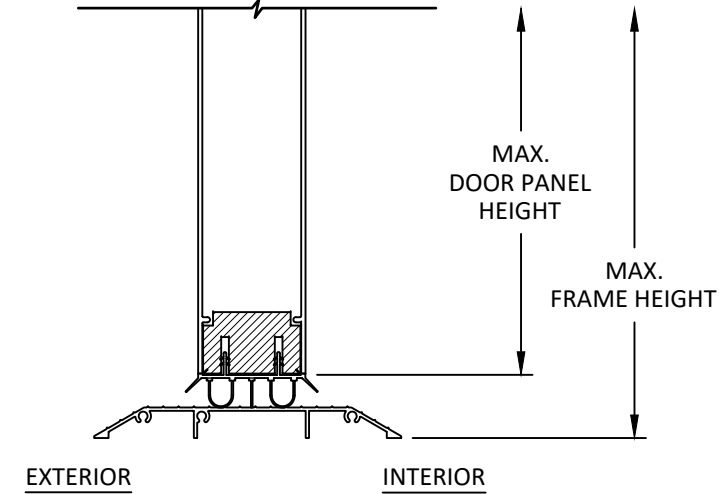



VERTICAL SECTION

AFCO A-204 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE + 65 / - 70 PSF
NOT RATED FOR WATER INFILTRATION

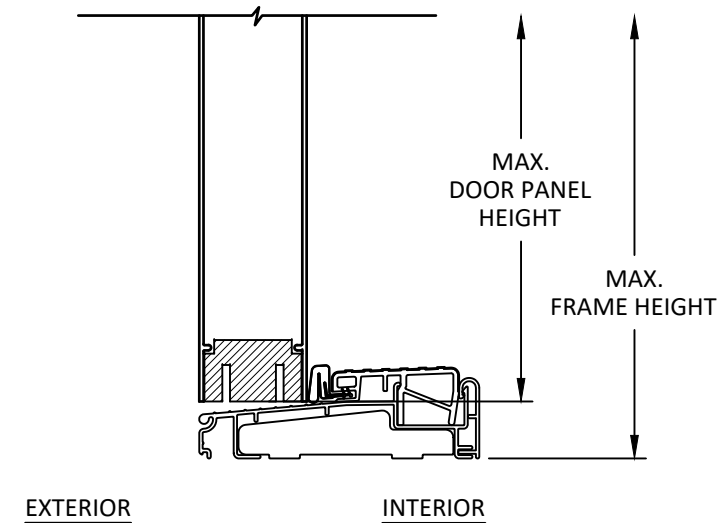



VERTICAL SECTION

ENDURA ZOBL4565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
CONTINUOUS & BOX CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 65 PSF


VERTICAL SECTIONS

MIAMI, FL 33132
PH: (954)399-8478



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

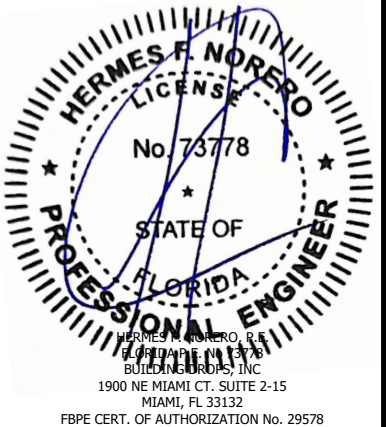

FL #: **FL47925**

DATE: 12.08.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: ODL013

SHEET:	REV.
--------	------


11

REV. A


c:\users\julianarodriguez\building_drops, inc\building drops\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg (1/4/25) (odl013 - a.dwg) 8/5/2026 3:12 PM

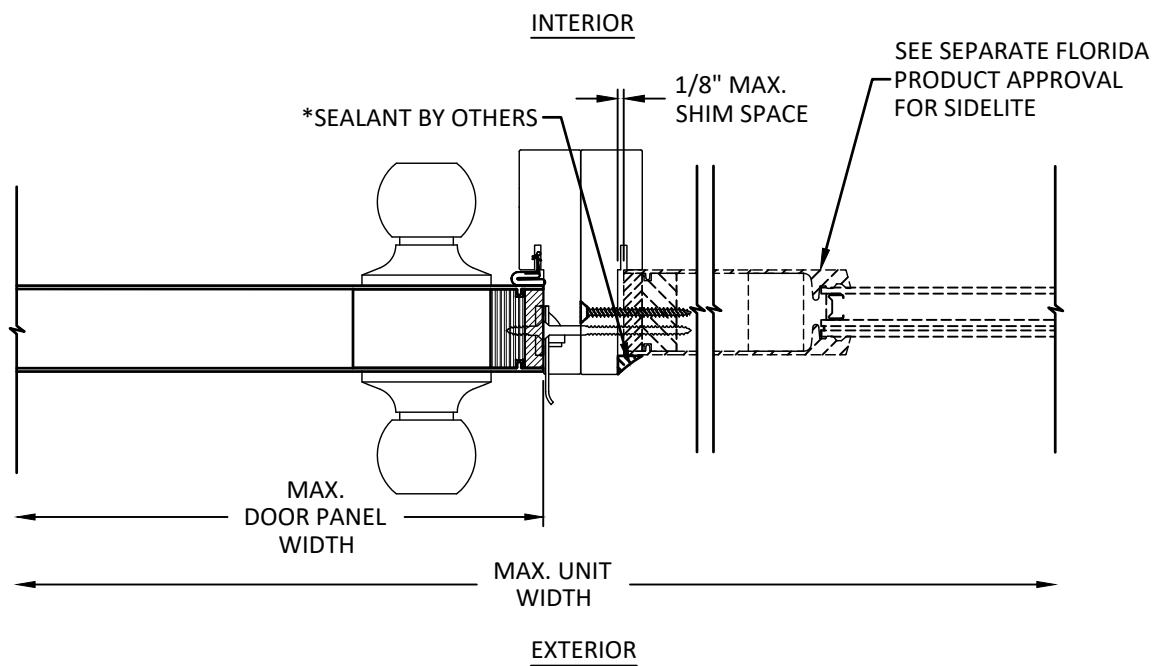


A
13 **HORIZONTAL SECTION**
OUTSWING - BOXED MULLION
BOXED CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

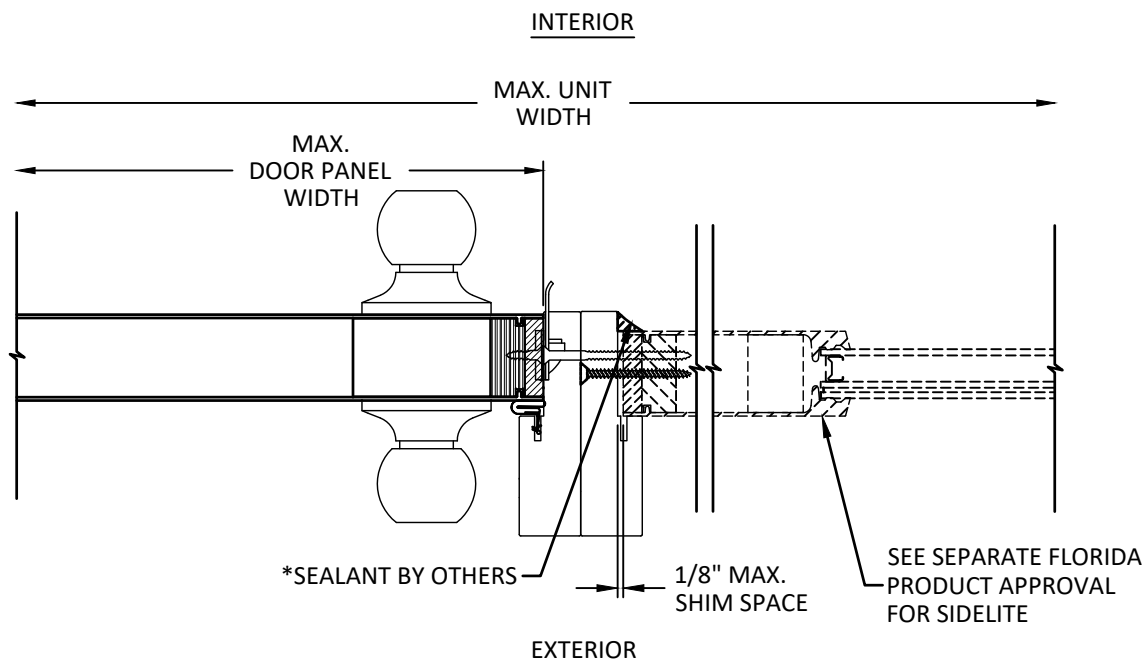

B
13 **HORIZONTAL SECTION**
INSWING - BOXED MULLION
BOXED CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

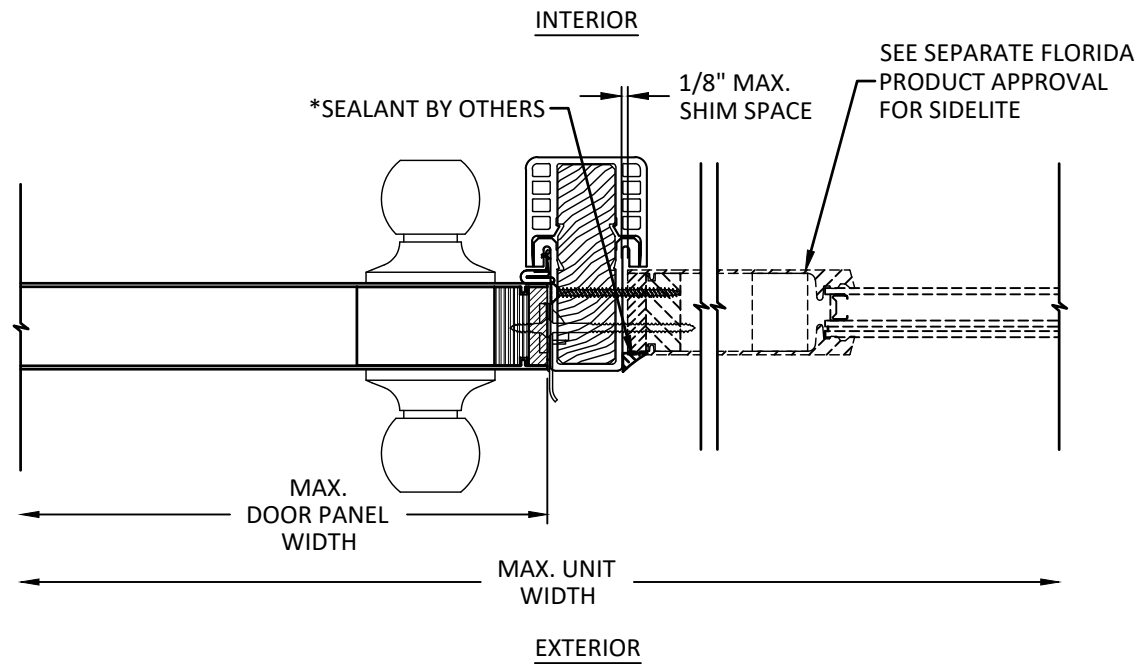

C
13 **HORIZONTAL SECTION**
OUTSWING - ENDURA FUSION MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

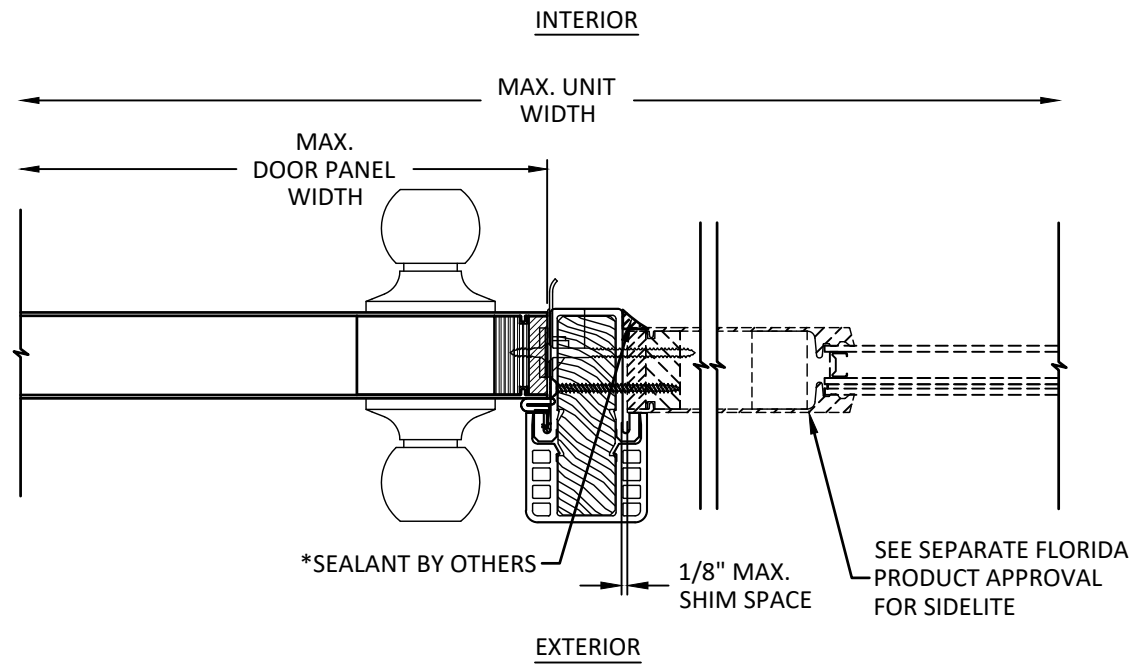

D
13 **HORIZONTAL SECTION**
INSWING - ENDURA FUSION MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

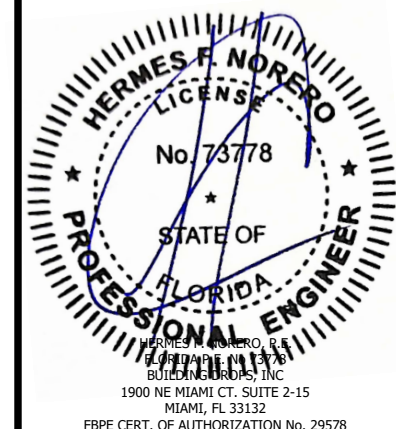

FL #:
FL47925

DATE: **12.08.2025**

DWG. BY:	CHK. BY:
JR	HFN


SCALE: **NTS**

DWG. #: **ODL013**


SHEET:	REV.
13	A

OF 23


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change projects\odl, inc\cc-26-03-40.1 - a.dwg 8/5/2026 3:12 PM

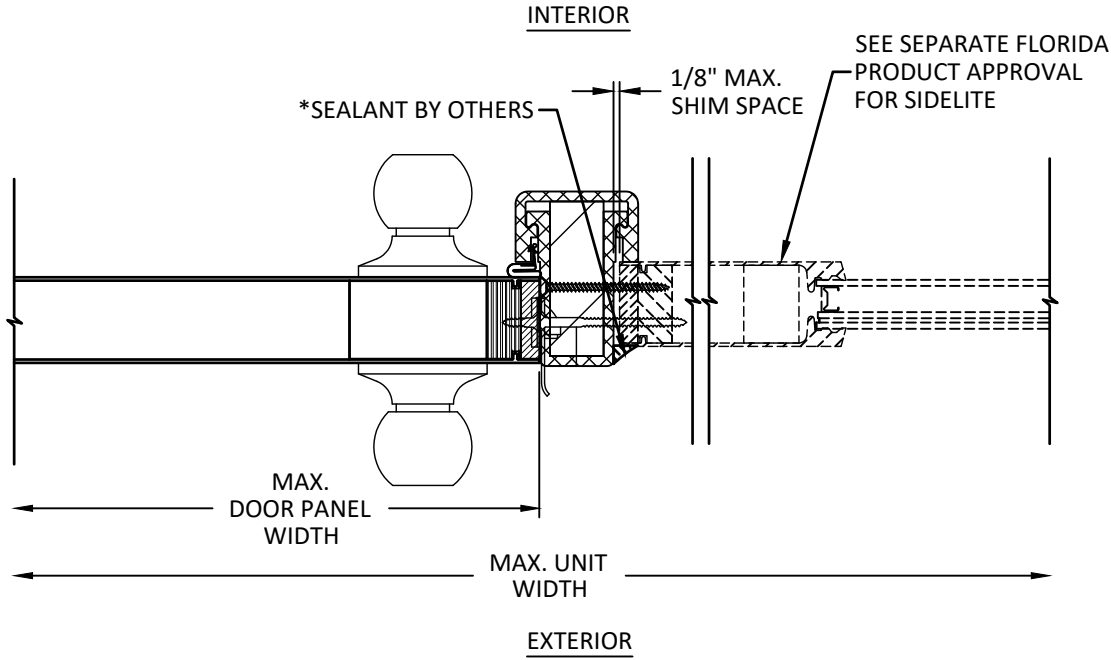


A
14 HORIZONTAL SECTION
OUTSWING - PLASTPRO MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

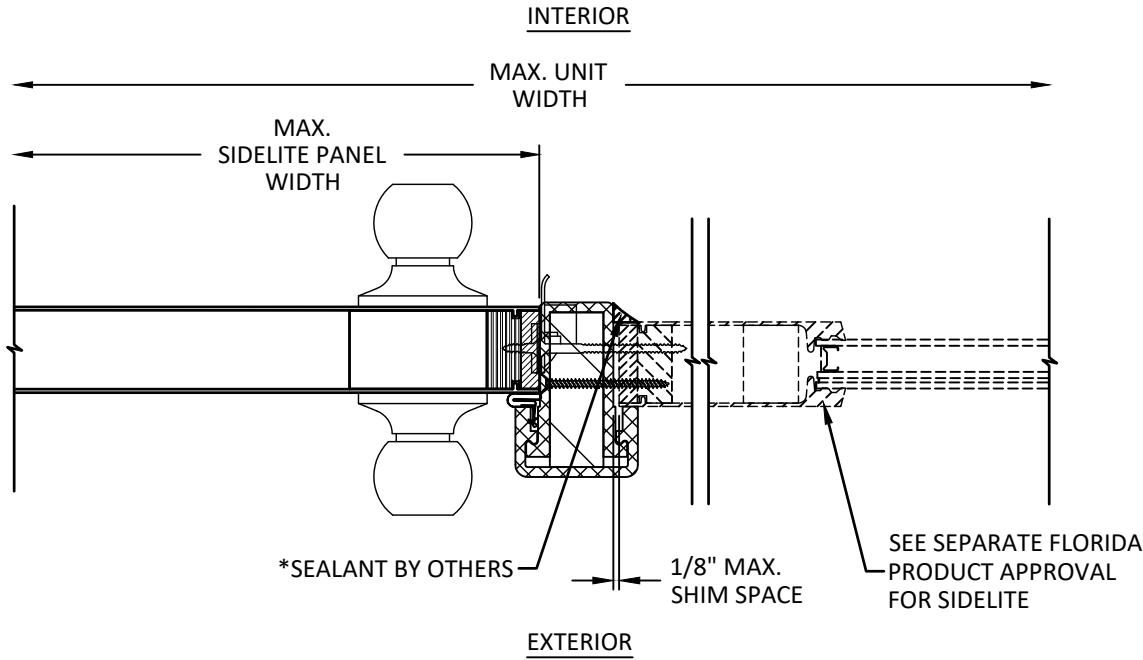

B
14 HORIZONTAL SECTION
INSWING - PLASTPRO MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

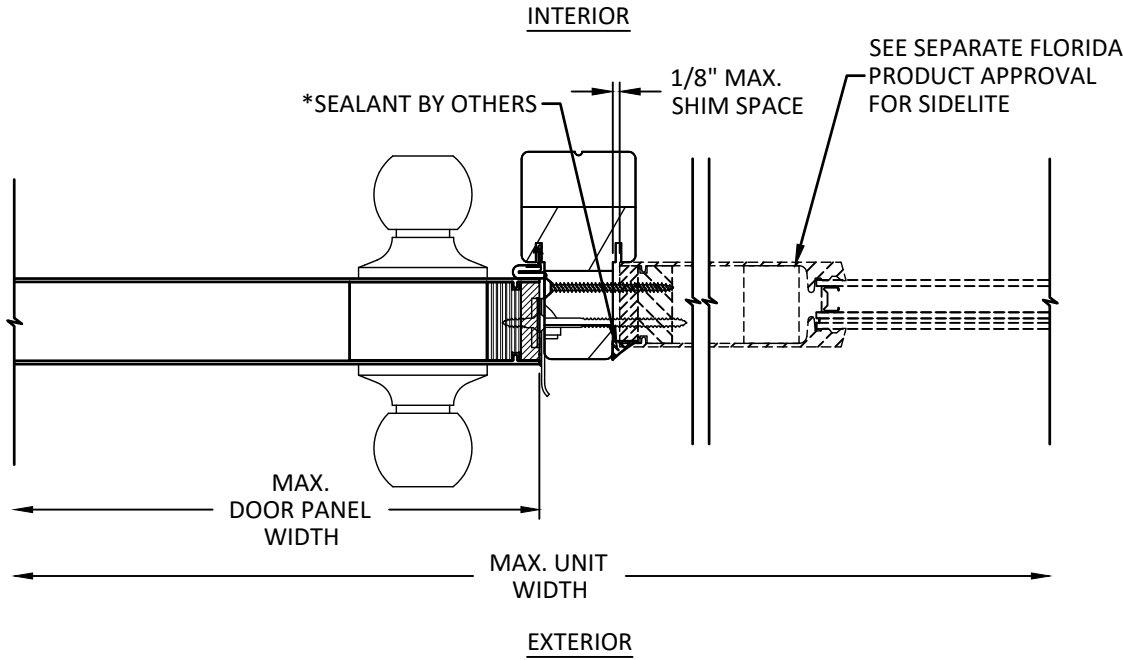

C
14 HORIZONTAL SECTION
OUTSWING - WOOD PINE MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

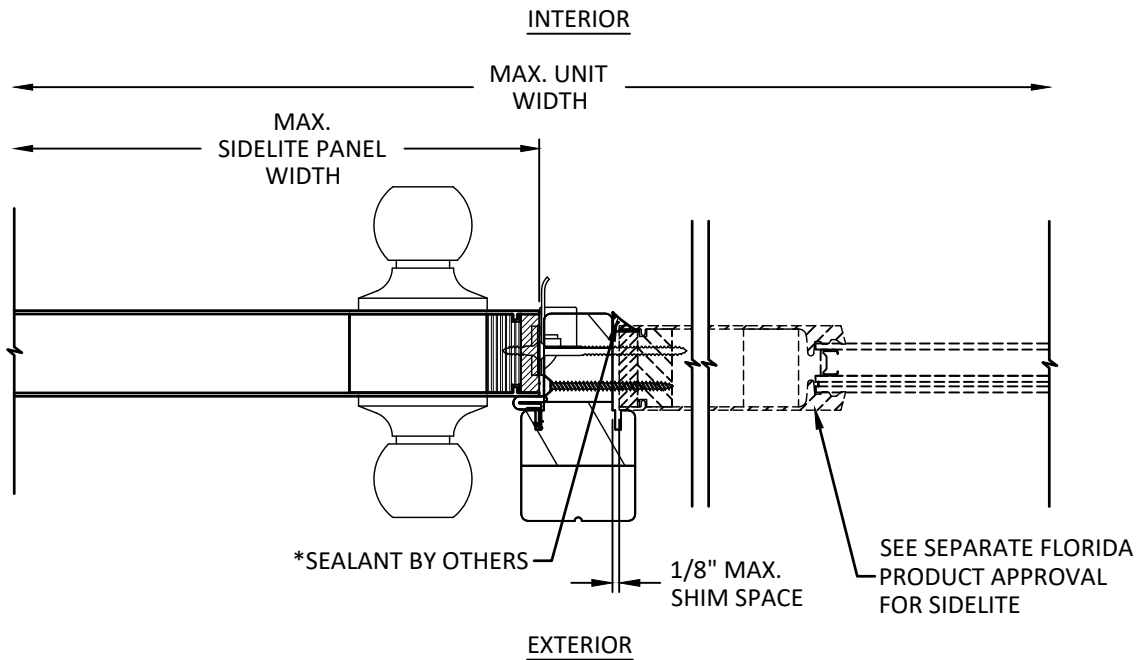

D
14 HORIZONTAL SECTION
INSWING - WOOD PINE MULLION
CONTINUOUS CONSTRUCTION
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464
PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com






REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

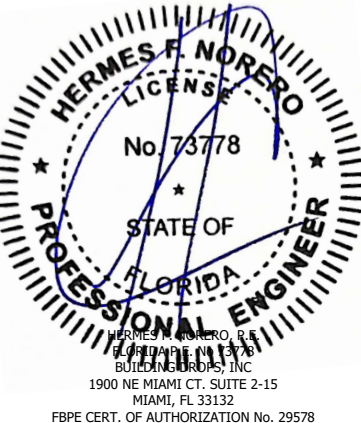


FL #:	FL47925
DATE:	12.08.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	ODL013
SHEET:	REV.
14	A

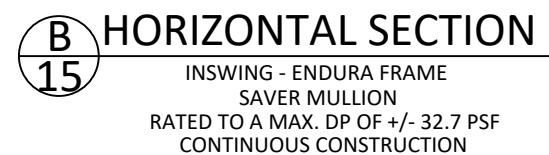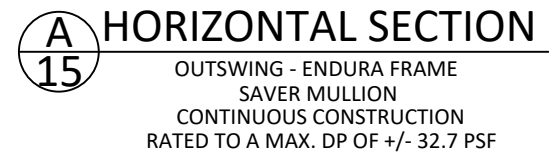


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

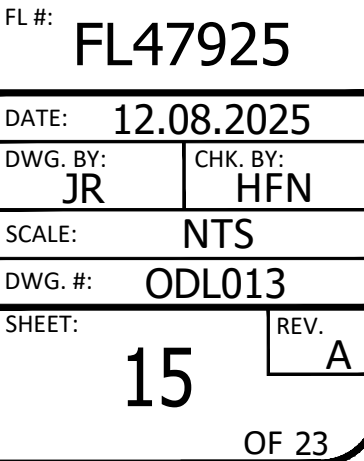


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change.dwg\147925\odi013 - a.dwg 8/5/2026 3:13 PM

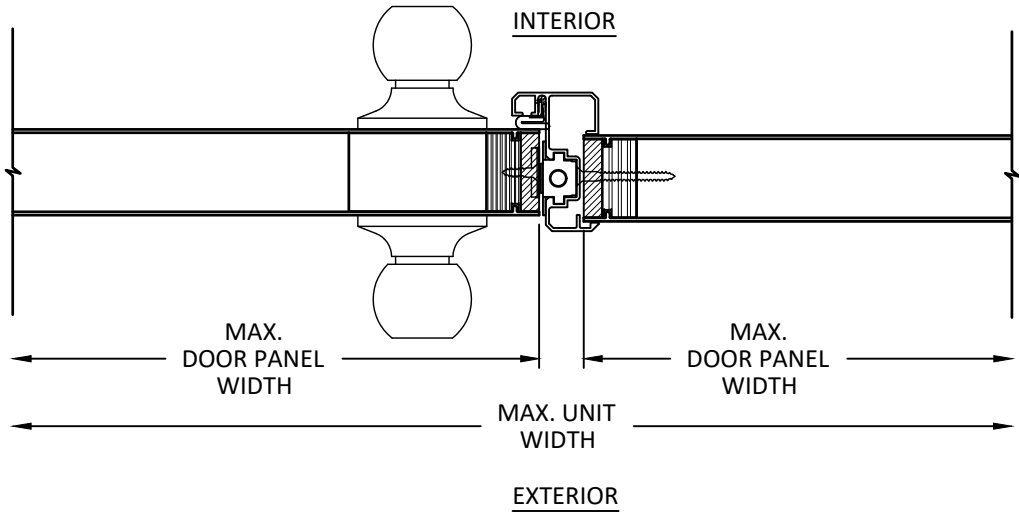


A
16 HORIZONTAL SECTION
OUTSWING - DLP MODERN ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

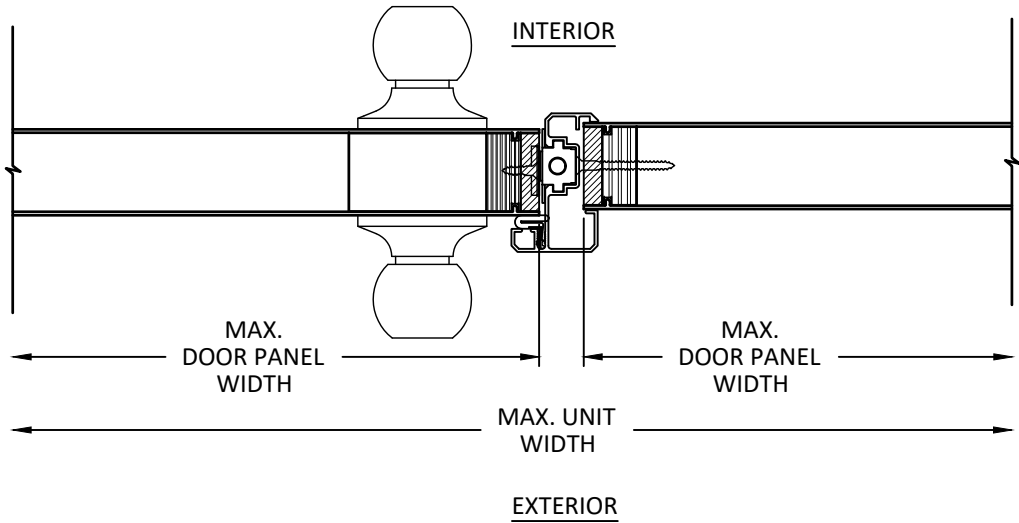

B
16 HORIZONTAL SECTION
INSWING - DLP MODERN ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

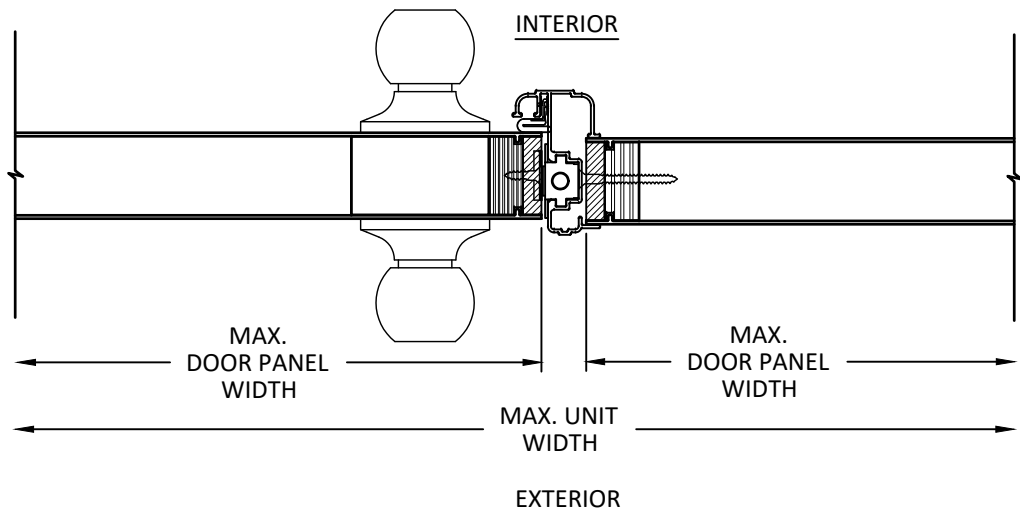

C
16 HORIZONTAL SECTION
OUTSWING - DLP TRADITIONAL ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF

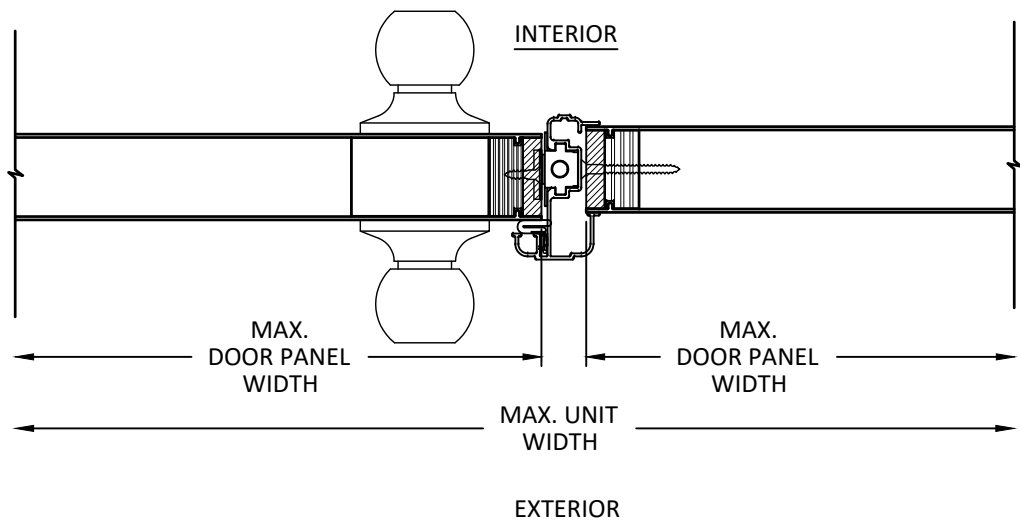

D
16 HORIZONTAL SECTION
INSWING - DLP TRADITIONAL ASTRAGAL
RATED TO MAX. DESIGN PRESSURE +/- 50 PSF



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

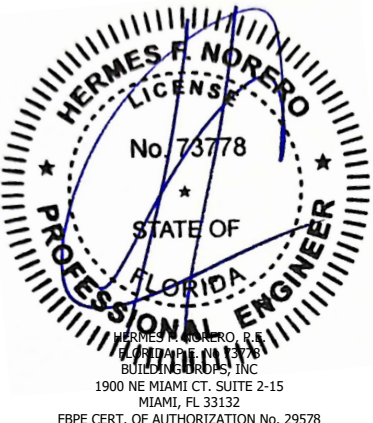

FL #:	FL47925
DATE:	12.08.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	ODL013
SHEET:	REV.
16	A
OF 23	




1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR THROUGH FRAME INSTALLATION.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - 7.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - 7.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.


ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. S.G. = 0.55	#10 WOOD SCREW	1.50"	0.75"
	CONCRETE (MIN. f'c = 3000 PSI) OR CMU (PER ASTM C90)	3/16" ITW TAPCON	1.00"	2.50"
	STEEL MIN. 18 GA. (MIN. Fy = 36 KSI) ALUM. MIN. 1/8" THK. (MIN. 6063-T5)	#12 SELF-TAPPING OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"




c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change.dwg (1/4/25) (10/13) - a.dwg 8/5/2026 3:13 PM

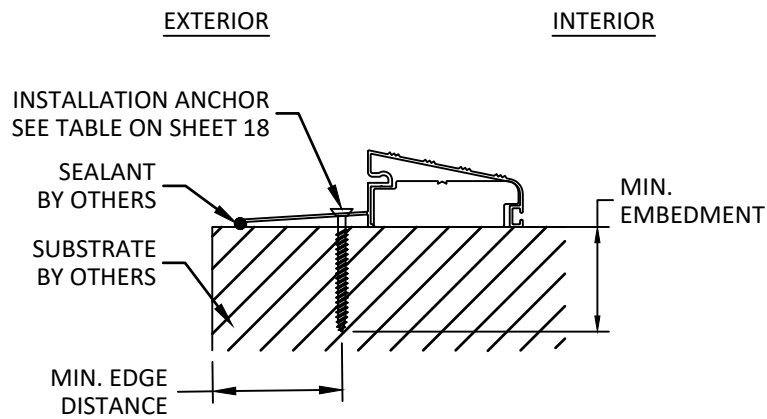


A
19 ANCHOR DETAIL
QOSH SILL

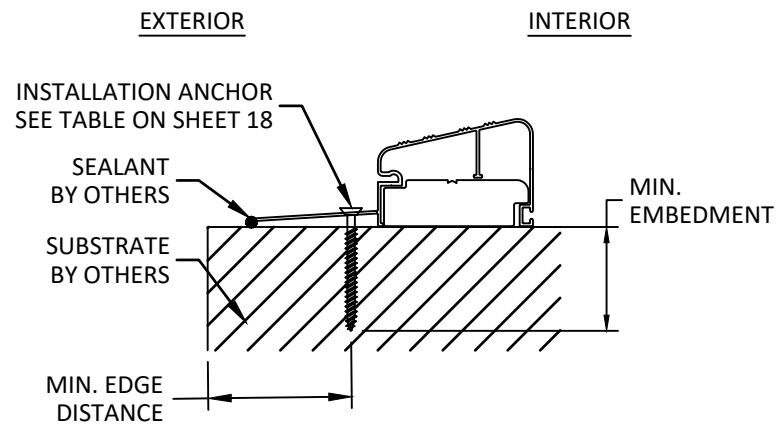


B
19 ANCHOR DETAIL
QOSR SILL

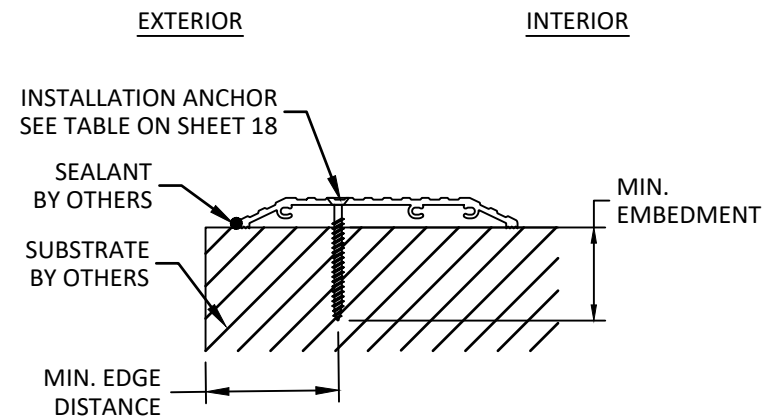


C
19 ANCHOR DETAIL
DLP ADA DB4565DL SILL

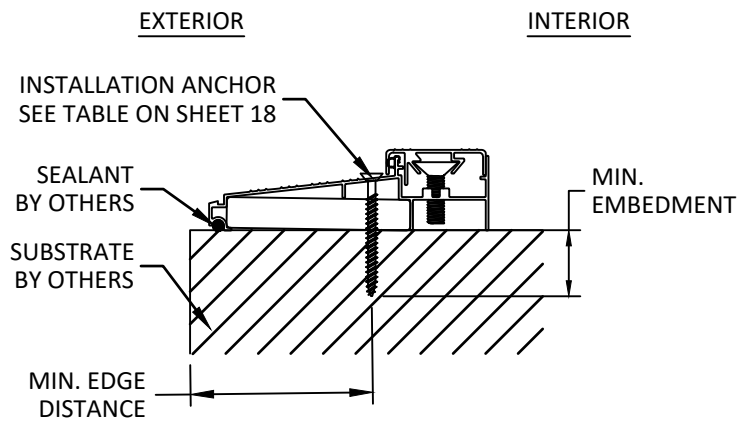

D
19 ANCHOR DETAIL
DLP ISCS SILL

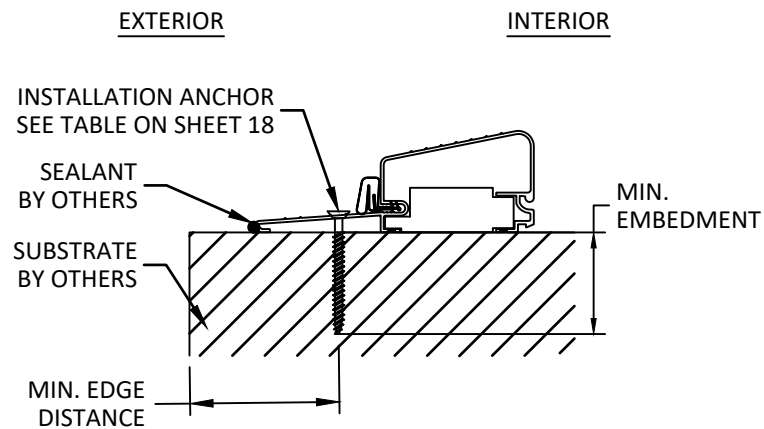

E
19 ANCHOR DETAIL
AFCO H-497 SILL

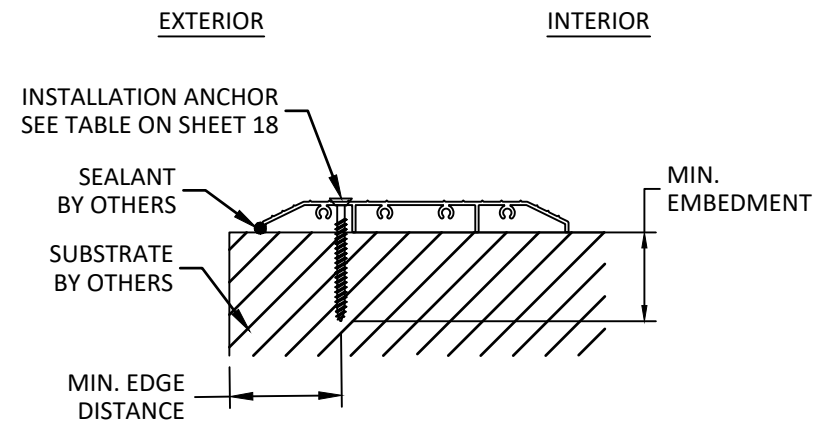

F
19 ANCHOR DETAIL
ENDURA HC15000 ADA SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.


1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

PH: (954) 599-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

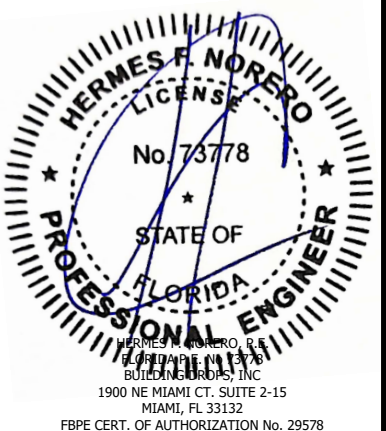


FL #:	FL47925
DATE:	12.08.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL013
SHEET:	19
REV.	A
	OF 23

c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg(147925)\odl013 - a.dwg 8/5/2026 3:12 PM

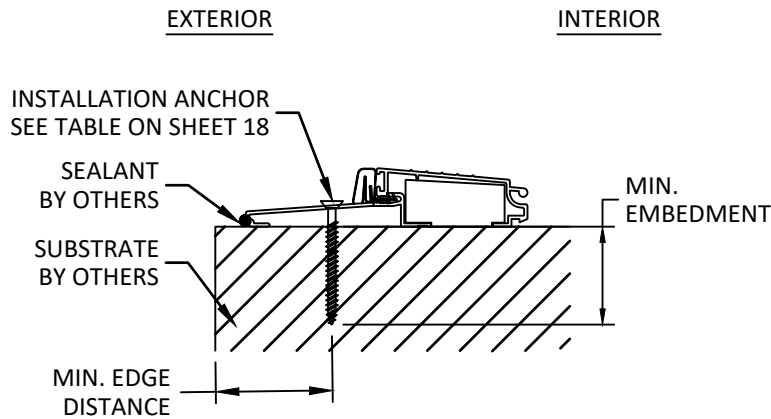


A
20

ANCHOR DETAIL
AFco A-117 SILL

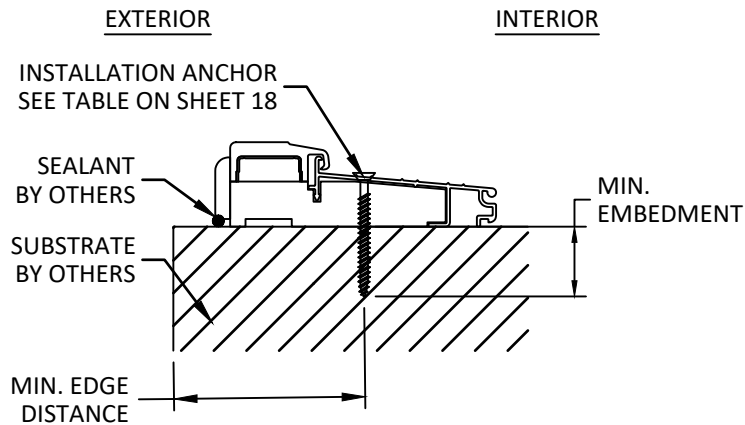


B
20

ANCHOR DETAIL
AFco A-276 SILL

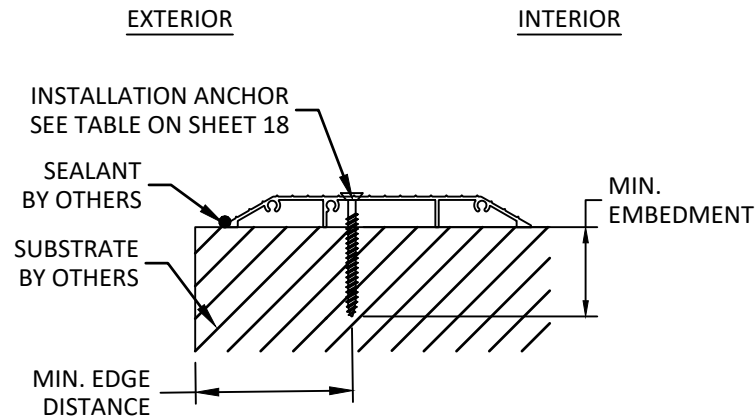


C
20

ANCHOR DETAIL
AFco A-204 SILL

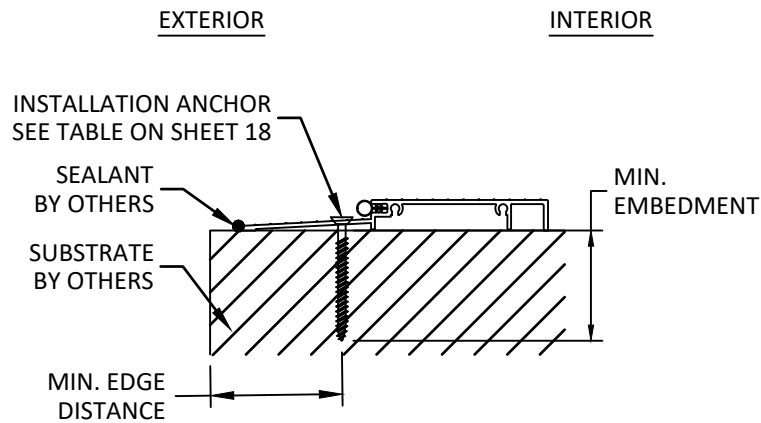


D
20

ANCHOR DETAIL
AFco A-204T SILL

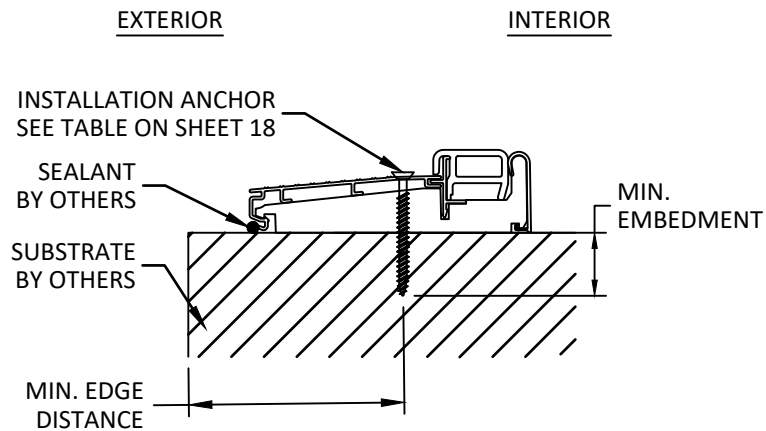

E
20

ANCHOR DETAIL
ENDURA ZAILAA4565 SILL

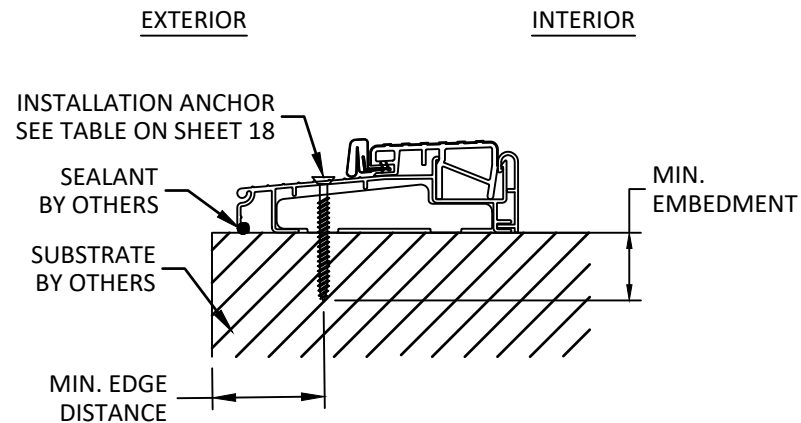

F
20

ANCHOR DETAIL
ENDURA ZOBL4565 SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

ANCHOR DETAILS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

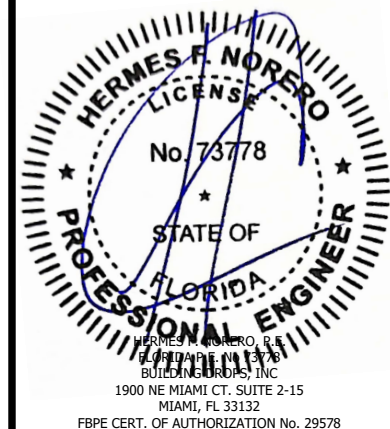

FL #:
FL47925

DATE: **12.08.2025**

DWG. BY: **JR**
CHK. BY: **HFN**


SCALE: **NTS**






DWG. #: **ODL013**

SHEET: **20**
REV. **A**


 The logo for Bridging Roads, featuring a stylized bridge graphic and the text "BRIDGING ROADS" in a bold, sans-serif font.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

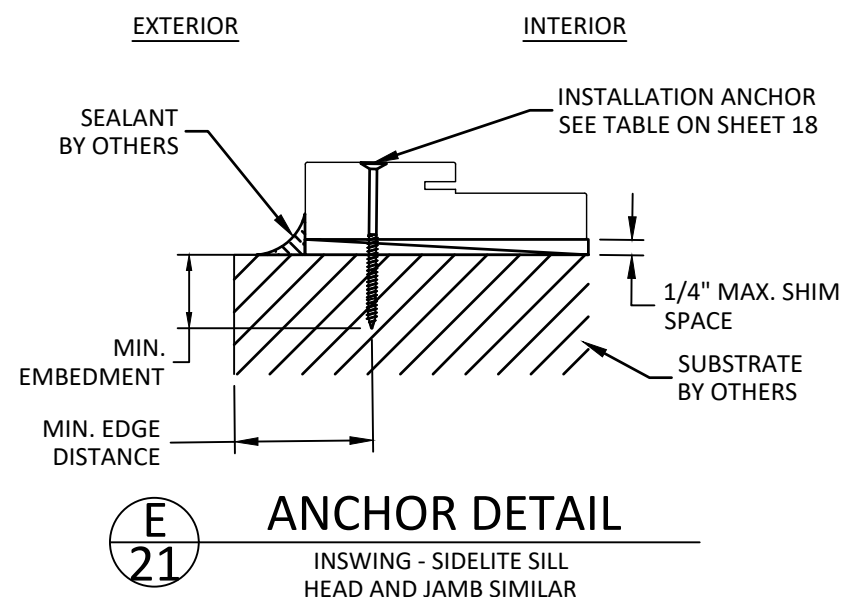




THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg\147925\odl013 - a.dwg 8/5/2026 3:12 PM


20 DLP ISCS SILL

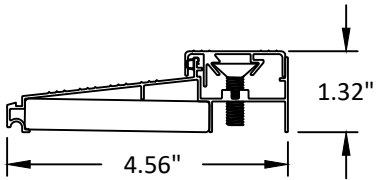


21 DLP ADA ISHC SILL

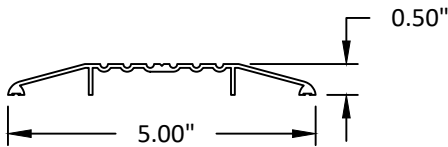


22 DLP DB4565DL SILL

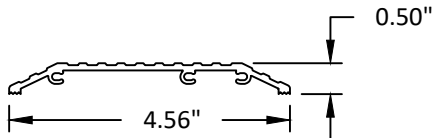


23 ENDURA HC15000 ADA SILL

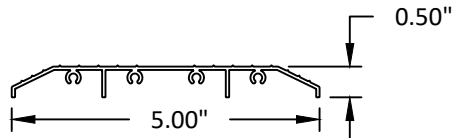


24 ENDURA FOB4565 SILL

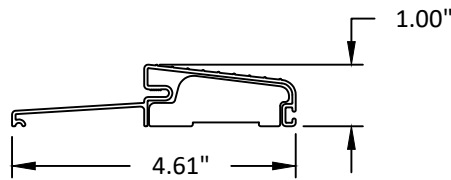


25 ENDURA ZOB4565FN SILL

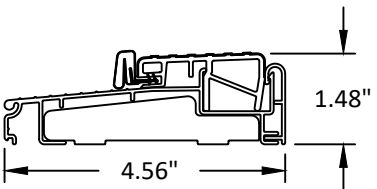


26 AFCO A-117 SILL

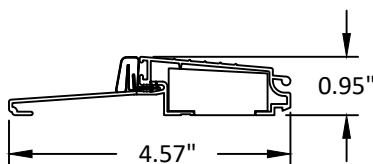


27 AFCO A-276 SILL

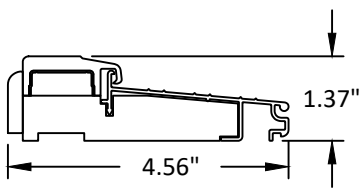


28 AFCO A-204 SILL

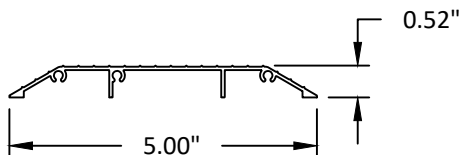


29 AFCO A-204T SILL

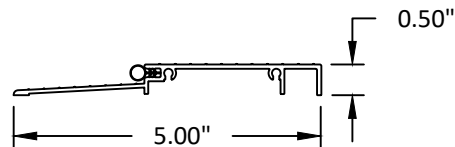


30 ENDURA ZAILAA4565 SILL

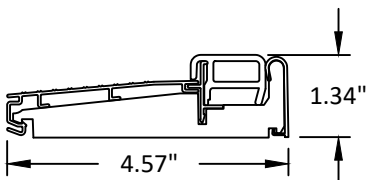


31 ENDURA ZOBL4565 SILL

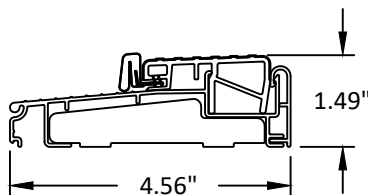


32 AFCO SIDELITE BASE

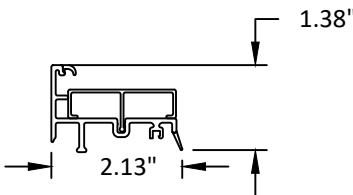


33 ENDURA SIDELITE BASE




34 ENDURA ULTIMATE HURRICANE ASTRAGAL




35 ENDURA ULTIMATE PUSH BUTTON ASTRAGAL




36 PLASTPRO MULLION



37 WOOD PINE MULLION

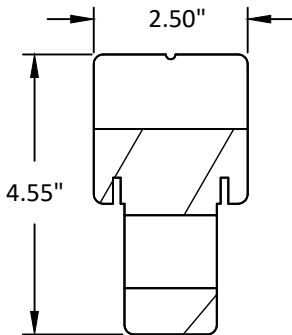

38 ENDURA FRAME SAVER MULLION

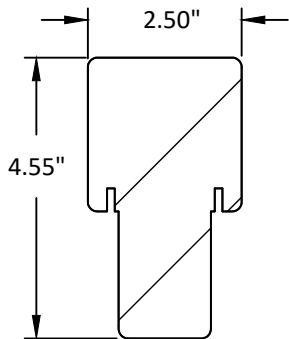

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING OPAQUE
FIBERGLASS DOOR (NON-HVHZ)
(NON-IMPACT)

COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

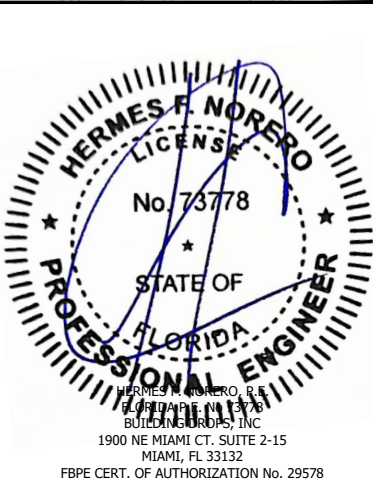

FL #:	FL47925
DATE:	12.08.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL013
SHEET:	23
REV.	A
OF 23	