

8/5/2026 2:45 PM

c:\users\julianarodriguez\building drops, inc\building drops, inc\change projects\odl, inc\cc-26-0340.1 - 2026 code change projects\odl, inc\cc-26-0340.1 - a.dwg

ODL, INC.

INSWING & OUTSWING FLUSH GLAZED FIBERGLASS DOOR

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1.

THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - ASTM E330-14
 - ASTM E331-00(23)
 - ASTM E283-04
2.

ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3.

1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4.

INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6.

APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7.

DOOR SKIN MATERIAL: FIBERGLASS
8.

GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	PRODUCT SPECIFICATIONS TABLE
3	GLAZING DETAILS
4	OXXO ELEVATION
5	OXO ELEVATION
6	X & XX ELEVATIONS
7	ANCHOR LAYOUTS
8	ANCHOR LAYOUTS
9	VERTICAL SECTIONS
10	VERTICAL SECTIONS
11	VERTICAL SECTIONS
12	VERTICAL SECTIONS
13	HORIZONTAL SECTIONS
14	HORIZONTAL SECTIONS
15	HORIZONTAL SECTIONS
16	HORIZONTAL SECTIONS
17	HORIZONTAL SECTIONS
18	HORIZONTAL SECTIONS
19	ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES
20	ANCHOR DETAILS
21	ANCHOR DETAILS
22	ANCHOR DETAILS
23	BILL OF MATERIALS & COMPONENTS
24	COMPONENTS




215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

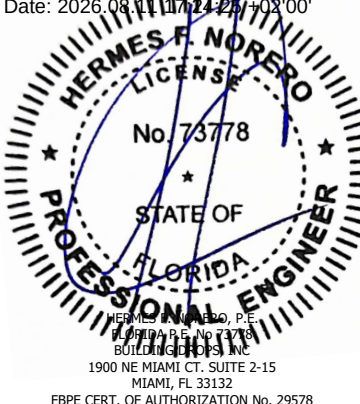

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		
Digitally signed by Hermes F. Norero, P.E. Reason: I am approving this document Date: 2026.08.11 17:22:27 -03'00'		
		
HERMES F. NORERO, P.E. FLORIDA P.E. No. 73778 BUILDING DROPS, INC. 1900 NE MIAMI CT. SUITE 2-15 MIAMI, FL 33132 FBPE CERT. OF AUTHORIZATION No. 29578		
FL #: FL47925		
DATE: 12.04.2025		
DWG. BY: JR	CHK. BY: HFN	
SCALE: NTS		
DWG. #: ODL014		
SHEET: 1	REV. A	

OF 24

c:\users\julianarodriguez\building_drops, inc\building_drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change projects\odi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:45 PM

PRODUCT SPECIFICATIONS								
JAMB TYPE	DOOR SIZE	OUTSWING (OS) / INSWING (IS)	UNIT CONFIGURATIONS & CORRESPONDING MAX. DESIGN PRESSURES (PSF)					BOXED (BOX) / CONTINUOUS CONSTRUCTION (CHS)
			X	OX	OXO	XX	OXXO	
WOOD	6'8"	IS	+/- 50	+/- 50	+/- 50	+/- 50	+/- 50	BOX
		OS	+/- 50	+/- 50	+/- 50	+/- 50	+/- 50	
	8'0"	IS	+/- 50	+/- 50	+/- 50	+ 40 / - 45	+ 40 / - 45	
		OS	+/- 50	+/- 50	+/- 50	+/- 50	+/- 50	
COMPOSITE	6'8"	IS	+/- 50	+/- 50	+/- 50	+/- 50	+/- 50	
		OS	+/- 50	+/- 50	+/- 50	+/- 50	+/- 50	
	8'0"	IS	+/- 50	+/- 50	+/- 50	+ 40 / - 45	+ 40 / - 45	
		OS	+/- 50	+/- 50	+/- 50	+/- 50	+/- 50	
WOOD	6'8"	IS	-	+/- 50	+/- 50	-	+/- 50	CHS
		OS		+/- 50	+/- 50		+/- 50	
	8'0"	IS		+/- 50	+/- 50		+/- 50	
		OS		+/- 50	+/- 50		+/- 50	
COMPOSITE	6'8"	IS		+/- 50	+/- 50		+/- 50	
		OS		+/- 50	+/- 50		+/- 50	
	8'0"	IS		+/- 50	+/- 50		+/- 50	
		OS		+/- 50	+/- 50		+/- 50	



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
PRODUCT SPECIFICATIONS
TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47925**

DATE: **12.04.2025**

DWG. BY:
JR

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ODL014**

SHEET:
2


REV.
A

OF 24

8/5/2026 2:46 PM

c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change projects\odl, inc\cc-26-03-40.1 - a.dwg

ELEVATION
OXO CONFIGURATION

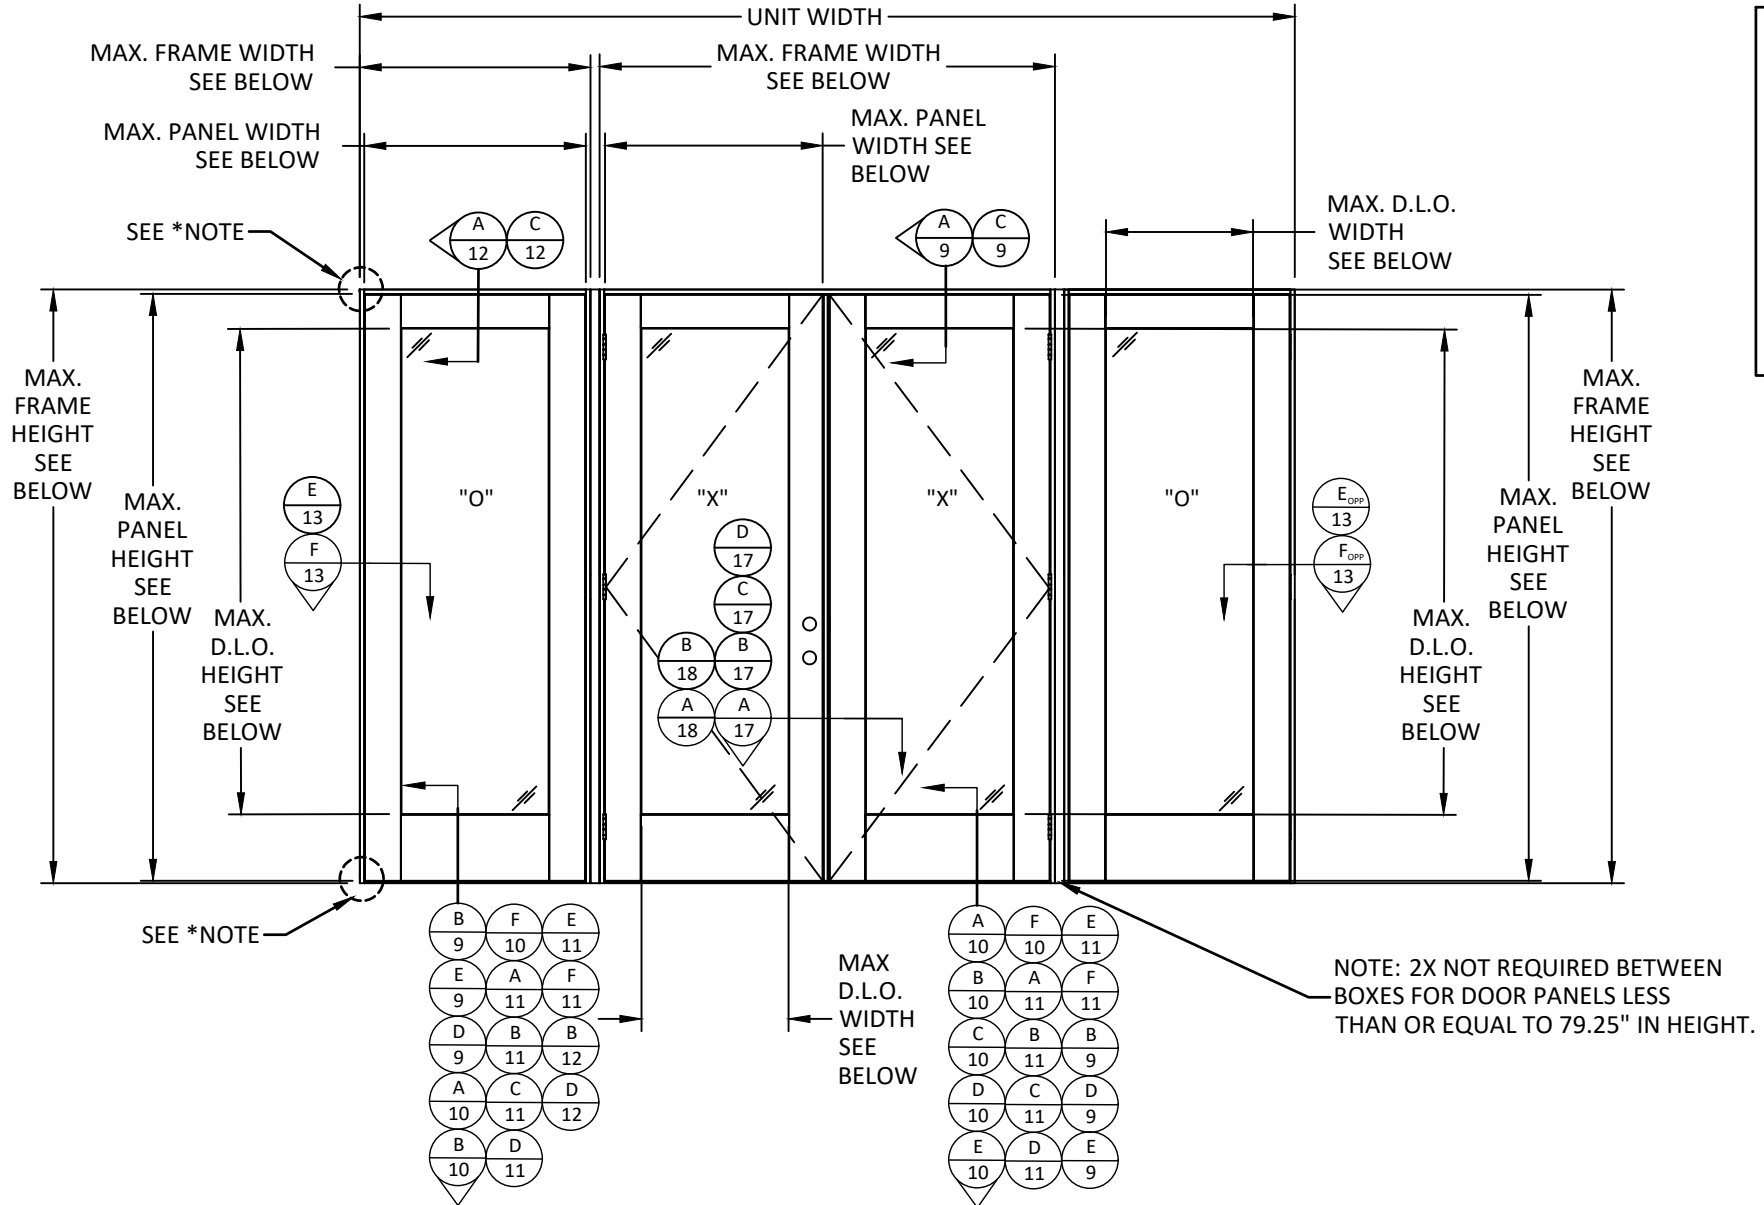

NOTE: BOXED CONSTRUCTION SHOWN, CONTINUOUS CONSTRUCTION QUALIFIED. SEE SHEETS 14-16 FOR HORIZONTAL SECTION DETAILS FOR CONTINUOUS CONSTRUCTION.

*NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.




215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464
PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
OXO ELEVATION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

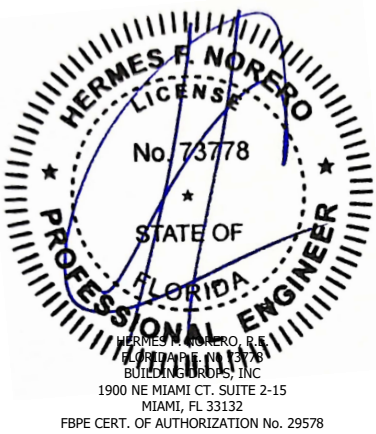

FL #:
FL47925

DATE: **12.04.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL014**

SHEET: **4** REV. **A**


OF 24

SIDELITE: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. SIDELITE FRAME WIDTH (IN)	MAX. SIDELITE FRAME HEIGHT (IN)	MAX. SIDELITE PANEL WIDTH (IN)	MAX. SIDELITE PANEL HEIGHT (IN)	MAX. SIDELITE D.L.O. WIDTH (IN)	MAX. SIDELITE D.L.O. HEIGHT (IN)
6'8" FLUSH GLAZED	37.50	82.00	35.75	79.25	23.90	62.90
6'8" EXTENDED FLUSH GLAZED	37.50	82.00	35.75	79.25	23.90	64.90
8'0" FLUSH GLAZED	37.50	98.00	35.75	95.25	23.90	78.90

DOOR: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)	MAX. DOOR D.L.O. WIDTH (IN)	MAX. DOOR D.L.O. HEIGHT (IN)
6'8" FLUSH GLAZED	XX: 74.50 X: 37.50	82.00	35.75	79.25	23.90	62.90
6'8" EXTENDED FLUSH GLAZED	XX: 74.50 X: 37.50	82.00	35.75	79.25	23.90	64.90
8'0" FLUSH GLAZED	XX: 74.50 X: 37.50	98.00	35.75	95.25	23.90	78.90

c:\users\julianarodriguez\building drops, inc\building drops\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change projects\odi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:46 PM

ELEVATION
OXO CONFIGURATION

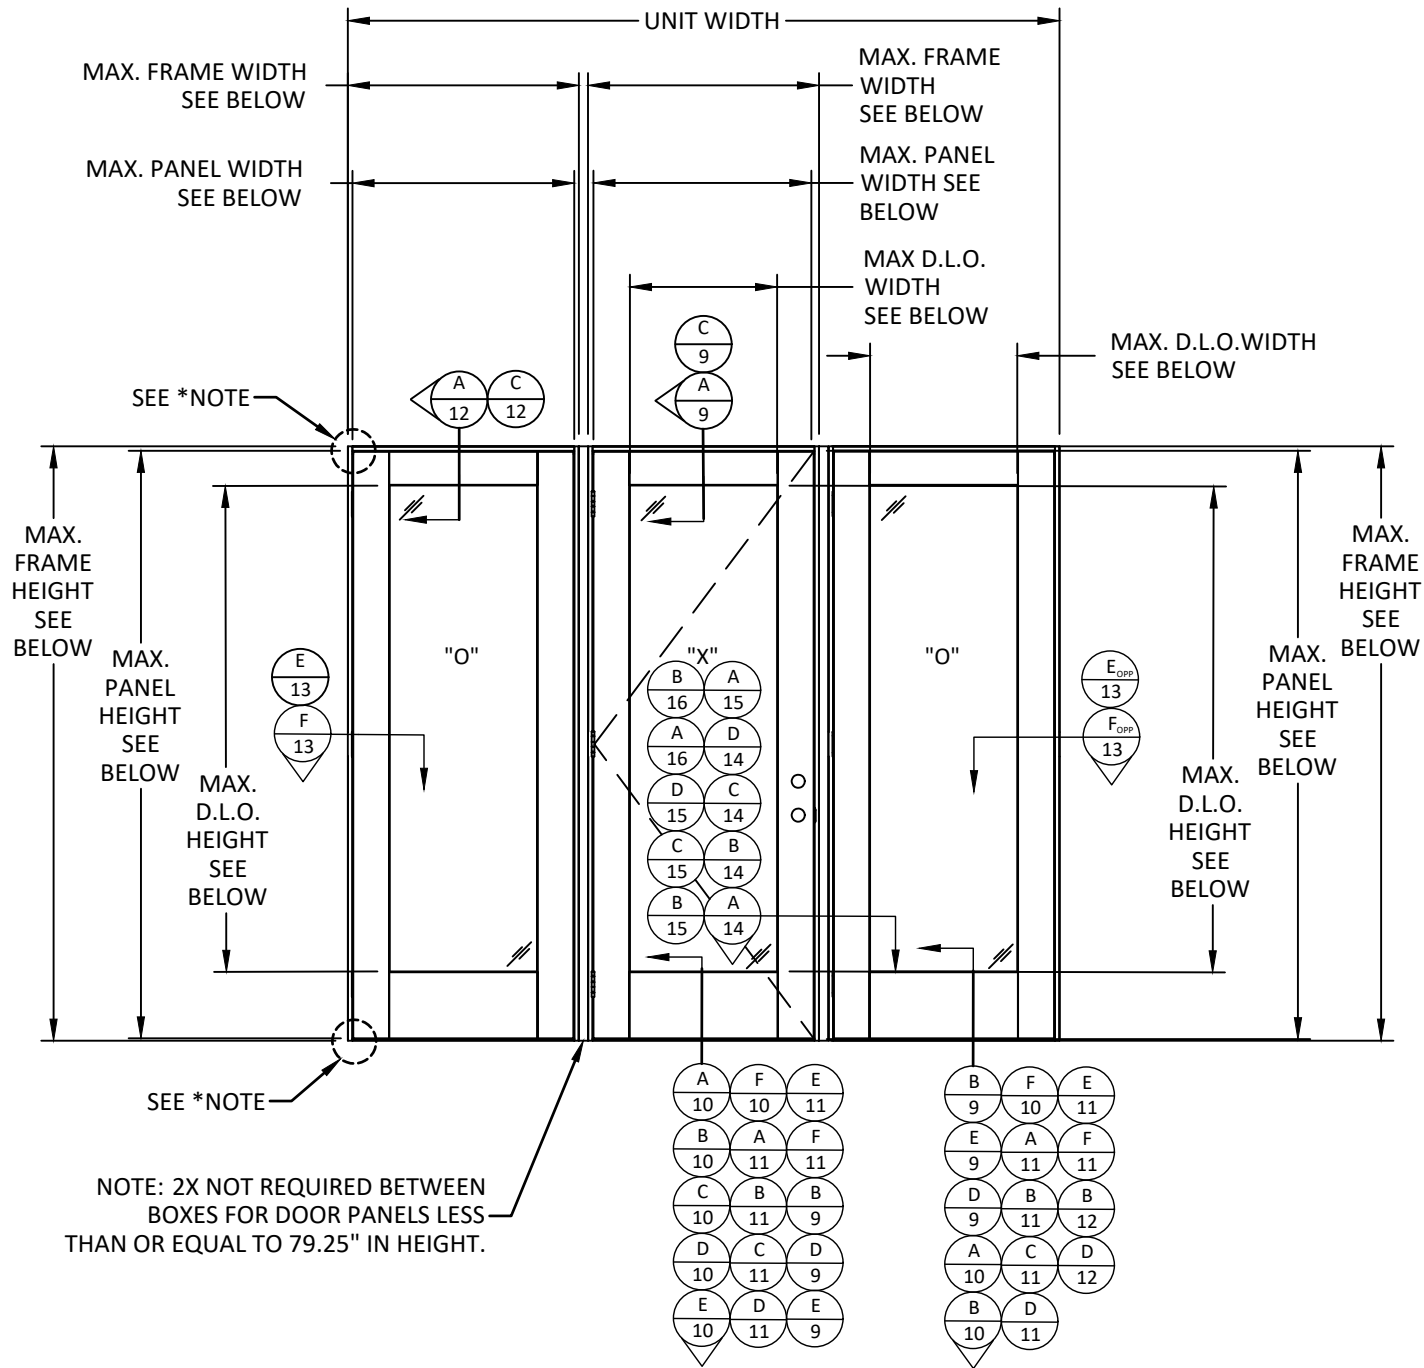

NOTE: BOXED CONSTRUCTION SHOWN, CONTINUOUS CONSTRUCTION QUALIFIED. SEE SHEETS 14-16 FOR HORIZONTAL SECTION DETAILS FOR CONTINUOUS CONSTRUCTION.

*NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)

OXO ELEVATION

PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

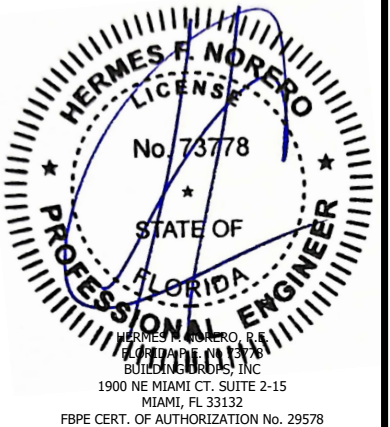

FL #: **FL47925**

DATE: **12.04.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **ODL014**

SHEET: **5** REV. **A**


OF 24

c:\users\julianarodriguez\building_drops, inc\building drops, inc\documents\common\projects\2026 code change projects\tdi, inc\cc-26-03-40.1 - 2026 code change projects\tdi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:46 PM

ELEVATION
XX CONFIGURATION

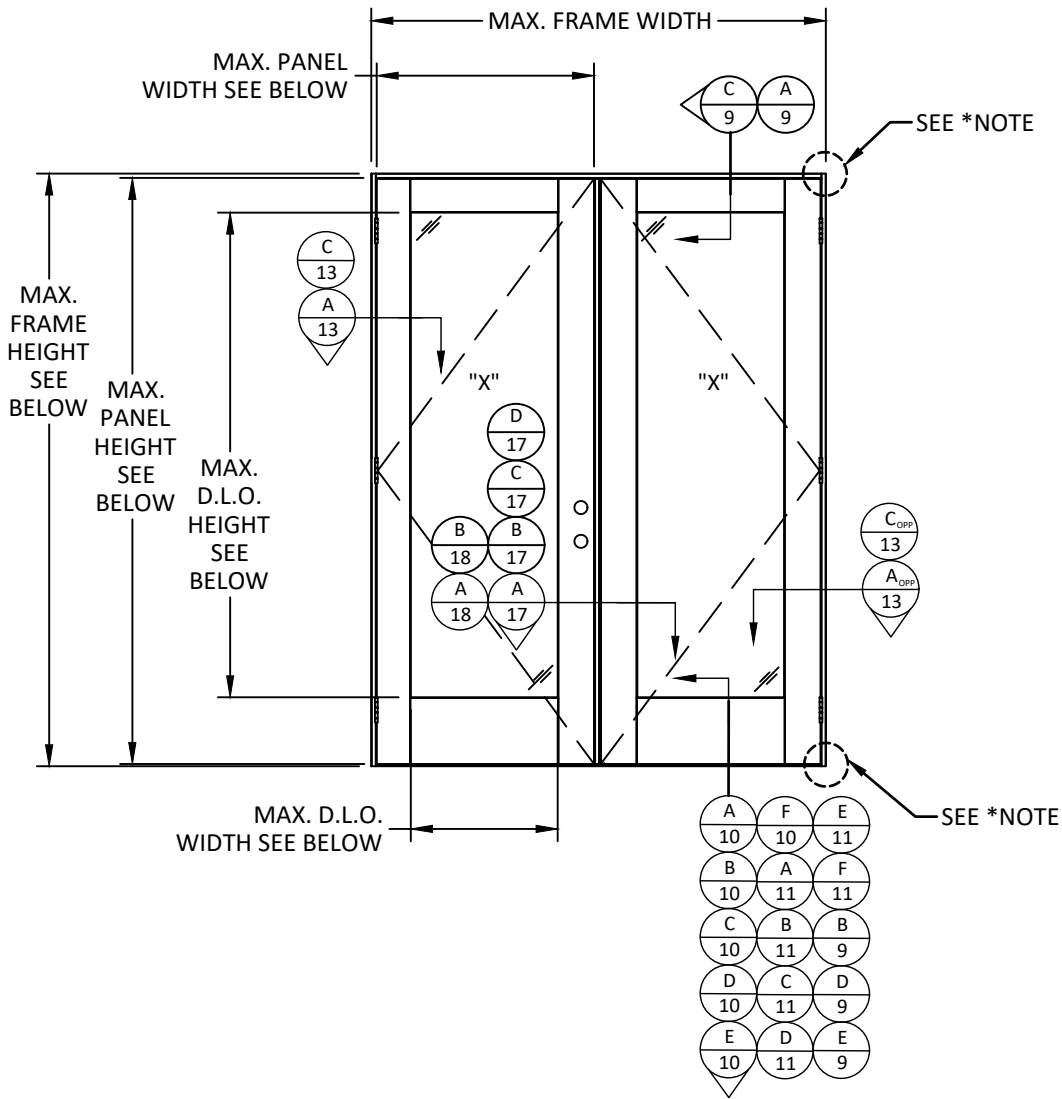

ELEVATION
X CONFIGURATION

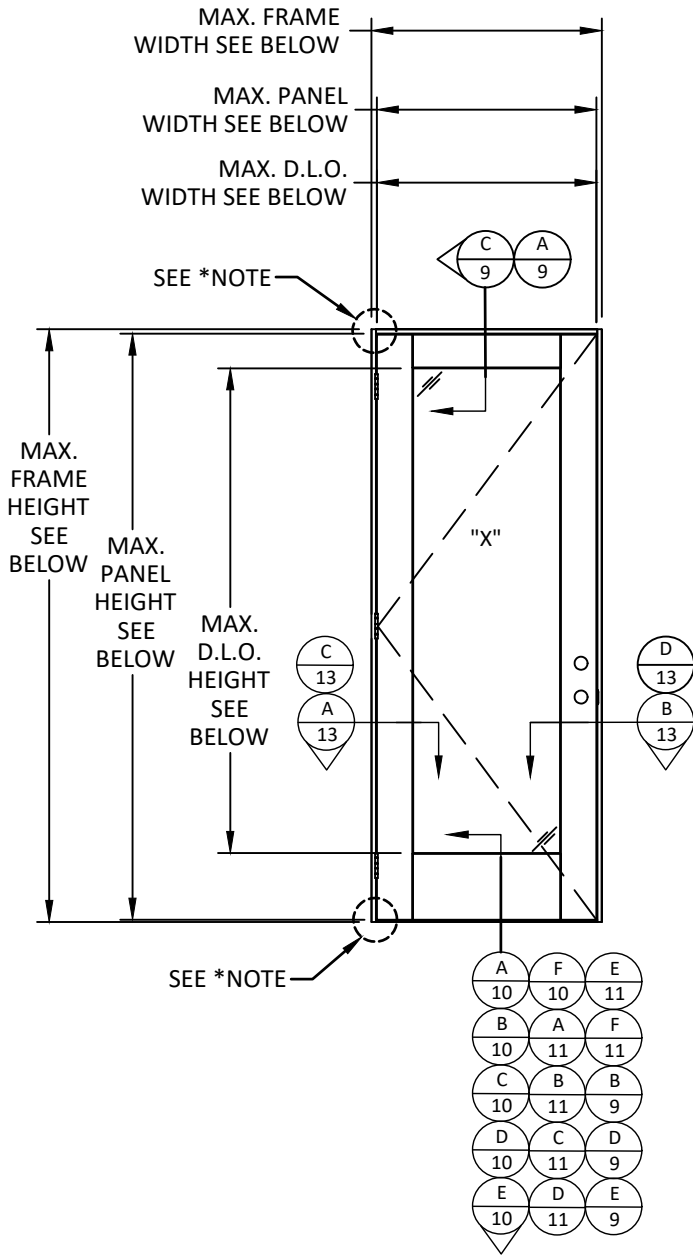

*NOTE: OPTION TO ATTACH FRAME CORNERS WITH 7/16" X 2" 16 GAGE STAPLES WITH (4) PER CORNER ON THE HEAD AND (2) PER CORNER ON THE SILL. ANOTHER OPTION IS TO FASTEN EACH CORNER WITH #9 X 2-1/2" PHILLIPS HEAD SCREWS WITH (3) PER CORNER ON THE HEAD FOR ALL SILLS. FOR ENDURA AND DLP ADA SILLS, (3) SCREWS PER CORNER ON THE SILL. ALL OTHER SILLS CAN HAVE (2) SCREWS PER CORNER.



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)

X & XX ELEVATIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

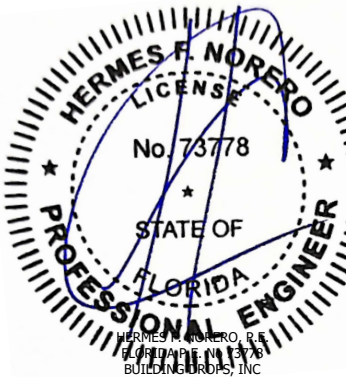

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47925**

DATE: **12.04.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL014**

SHEET: **6** REV. **A**

DOOR: PRODUCT DIMENSIONS TABLE						
PRODUCT	MAX. DOOR FRAME WIDTH (IN)	MAX. DOOR FRAME HEIGHT (IN)	MAX. DOOR PANEL WIDTH (IN)	MAX. DOOR PANEL HEIGHT (IN)	MAX. DOOR D.L.O. WIDTH (IN)	MAX. DOOR D.L.O. HEIGHT (IN)
6'8" FLUSH GLAZED	XX: 74.50 X: 37.50	82.00	35.75	79.25	23.90	62.90
6'8" EXTENDED FLUSH GLAZED	XX: 74.50 X: 37.50	82.00	35.75	79.25	23.90	64.90
8'0" FLUSH GLAZED	XX: 74.50 X: 37.50	98.00	35.75	95.25	23.90	78.90

ANCHOR LAYOUT

OXO CONFIGURATION

THROUGH FRAME INSTALLATION

6.00" MAX.
FROM THE
CORNERS

6.00" MAX.
FROM THE
CORNERS

ANCHOR LAYOUTS

1900 NE MIAMI CT. SUITE 2-15
MIAMI FL 33132


PH: (954)399-8478




THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change\dwgs\147925\odi014 - a.dwg 8/5/2026 2:46 PM

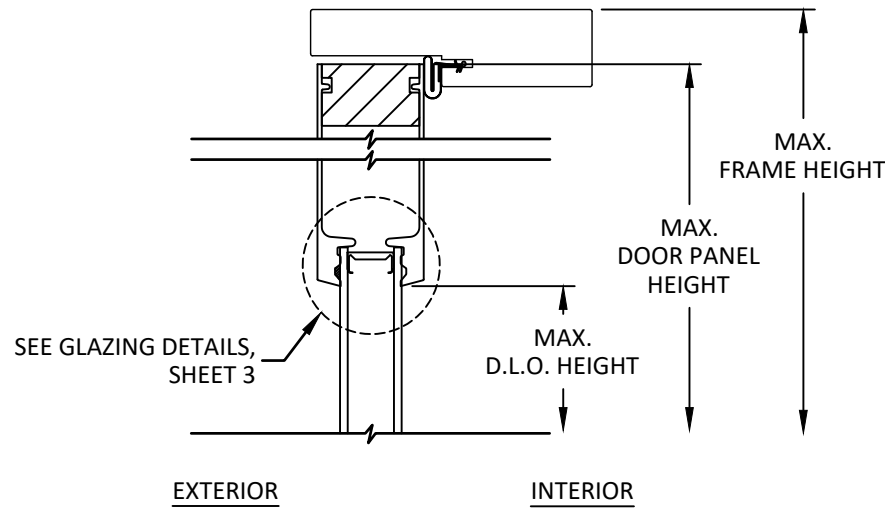


A
9 VERTICAL SECTION
OUTSWING DOOR - HEAD

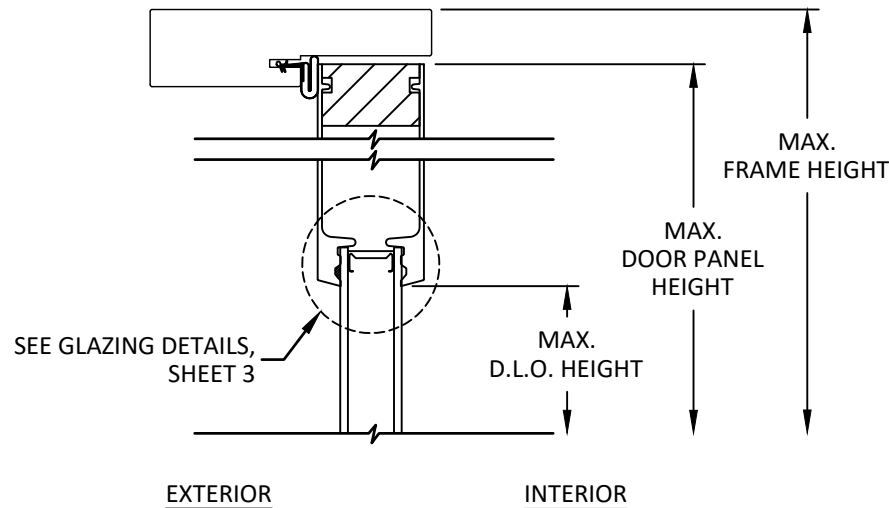


C
9 VERTICAL SECTION
INSWING DOOR - HEAD

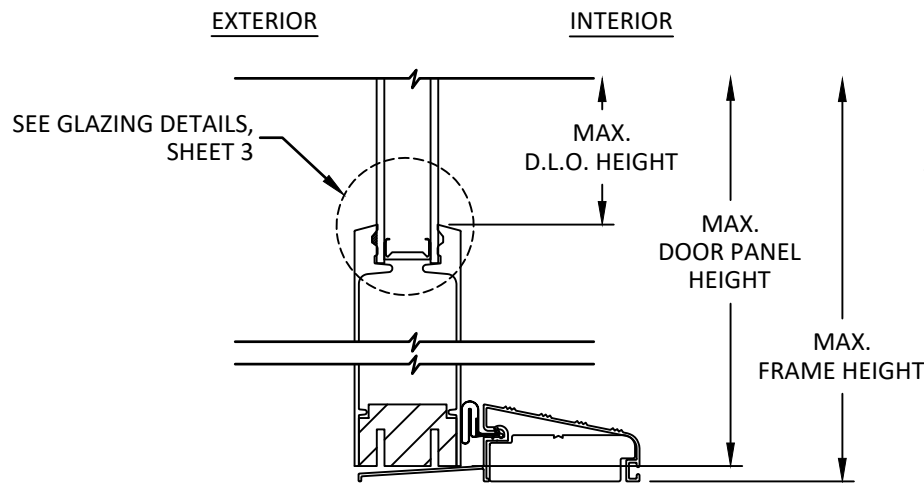

B
9 VERTICAL SECTION
QOSH SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

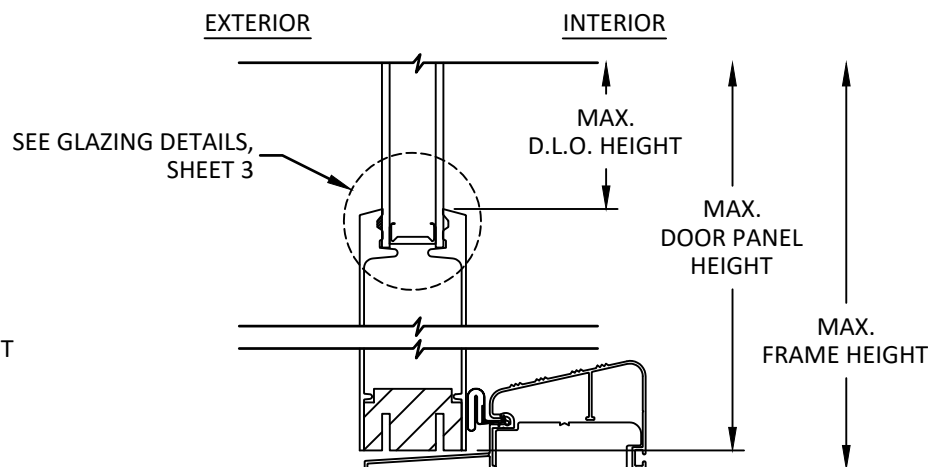

D
9 VERTICAL SECTION
QOSR SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

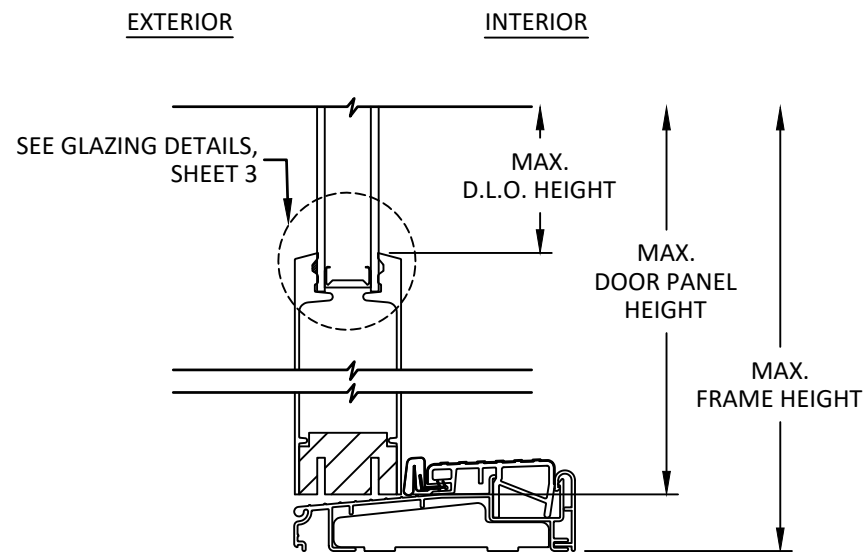

E
9 VERTICAL SECTION
ENDURA ZOB4565FN SILL
SIDELITE QUALIFIED FOR USE WITH SILL
CONTINUOUS CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL47925

DATE: **12.04.2025**


DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **ODL014**

SHEET: **9** REV. **A**


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change projects\odi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:45 PM

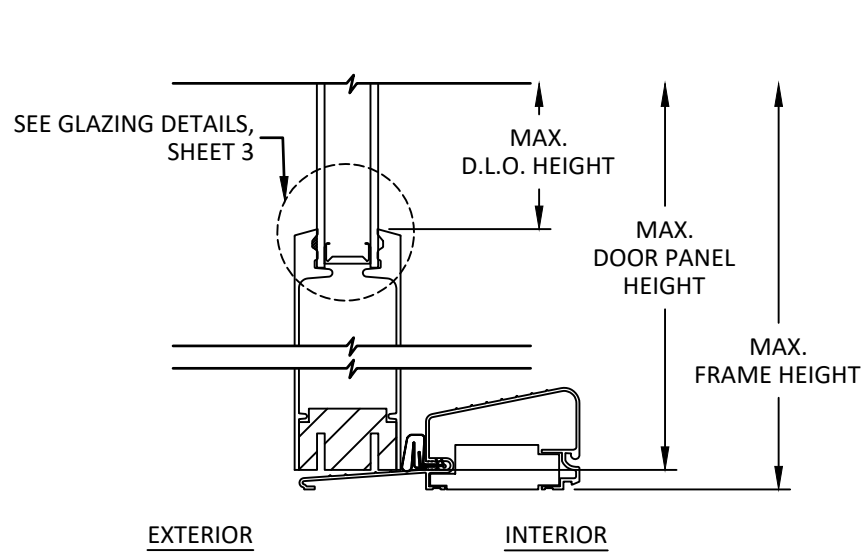


A
10 VERTICAL SECTION
AFco H-497 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

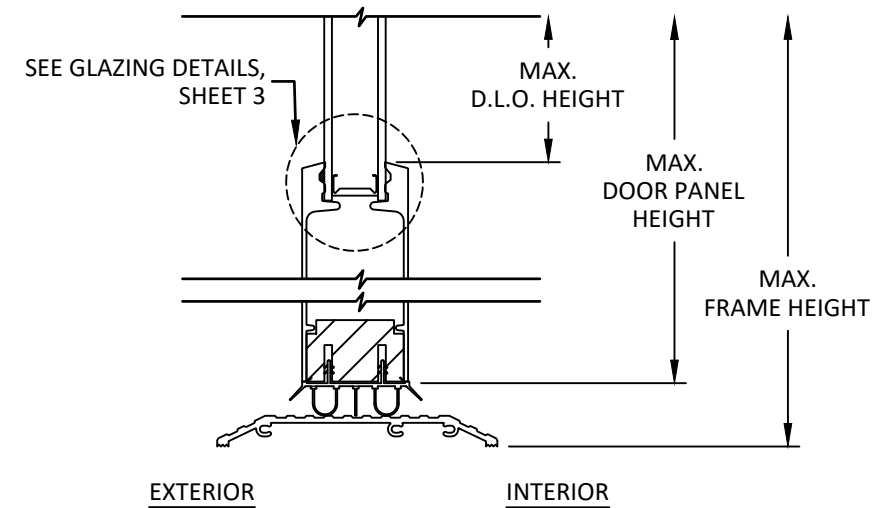


D
10 VERTICAL SECTION
DLP ADA DB4565DL SILL
BOX CONSTRUCTION

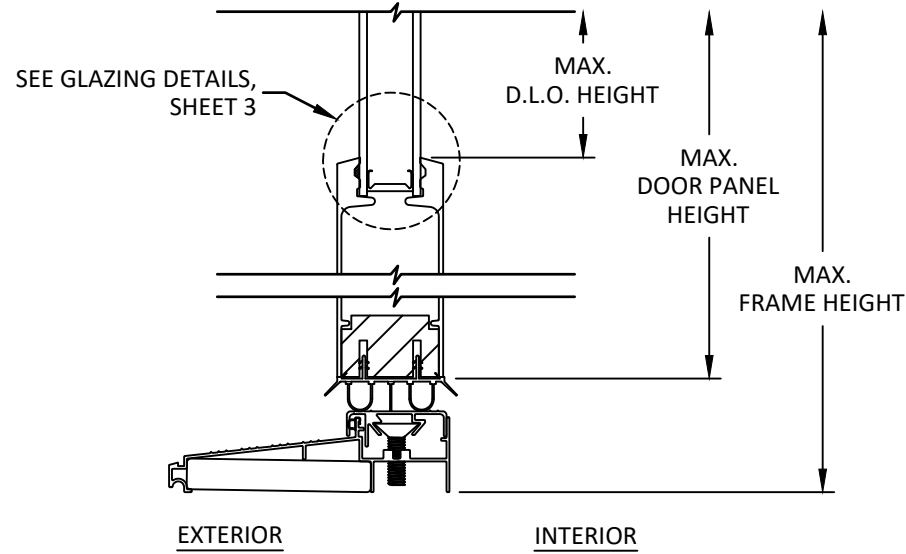


B
10 VERTICAL SECTION
DLP ISCS SILL
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH SIDELITE BASE
BOX CONSTRUCTION

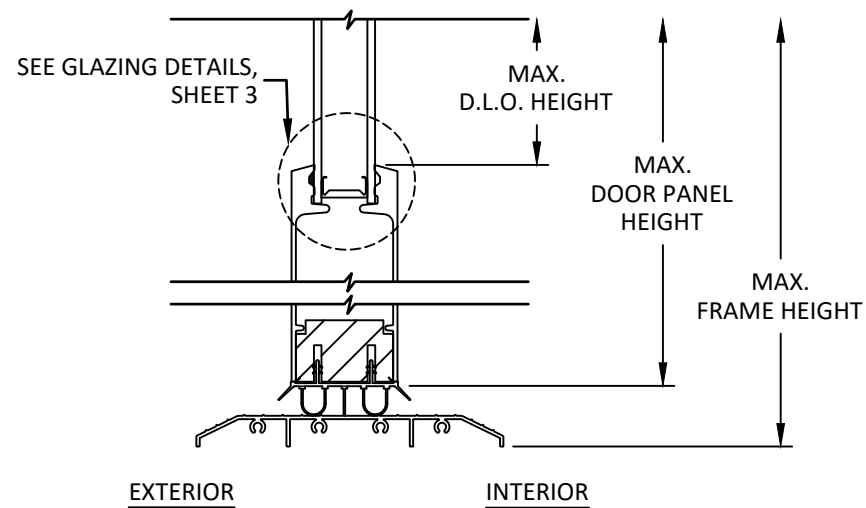

E
10 VERTICAL SECTION
ENDURA HC15000 ADA SILL
BOX CONSTRUCTION

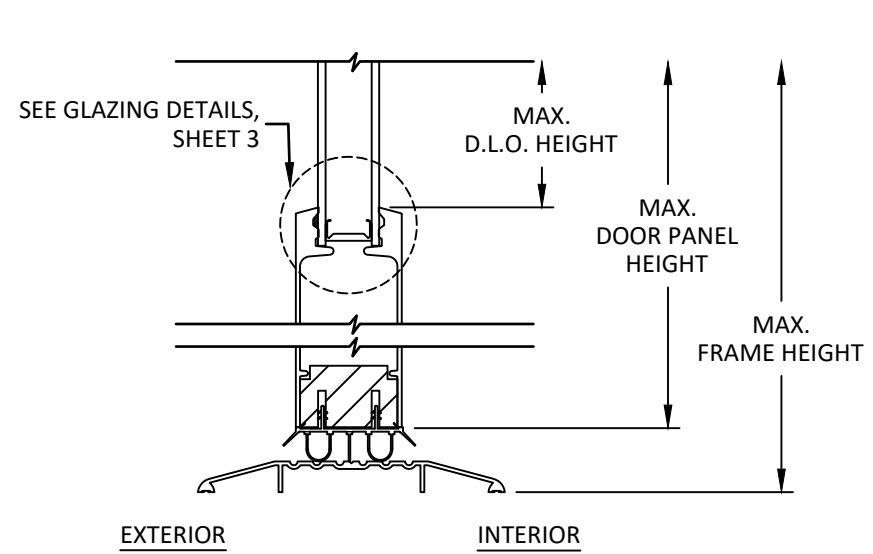

C
10 VERTICAL SECTION
ADA ISHC SILL
BOX CONSTRUCTION

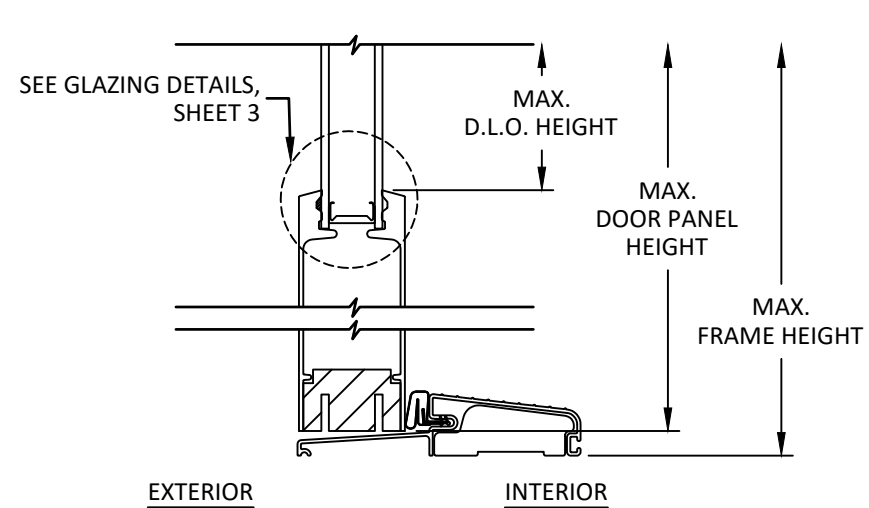

F
10 VERTICAL SECTION
ENDURA FOB4565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
VERTICAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

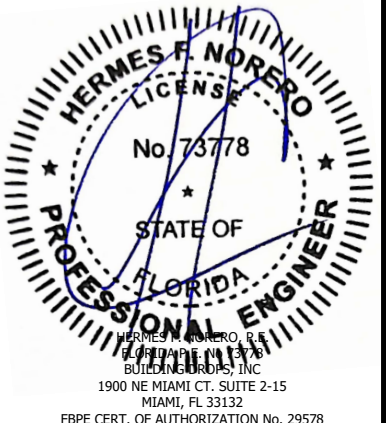


FL #:	FL47925
DATE:	12.04.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL014
SHEET:	10
REV.	A
OF 24	


c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\odi, inc\cc-26-03-40.1 - 2026 code change projects\odi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:45 PM

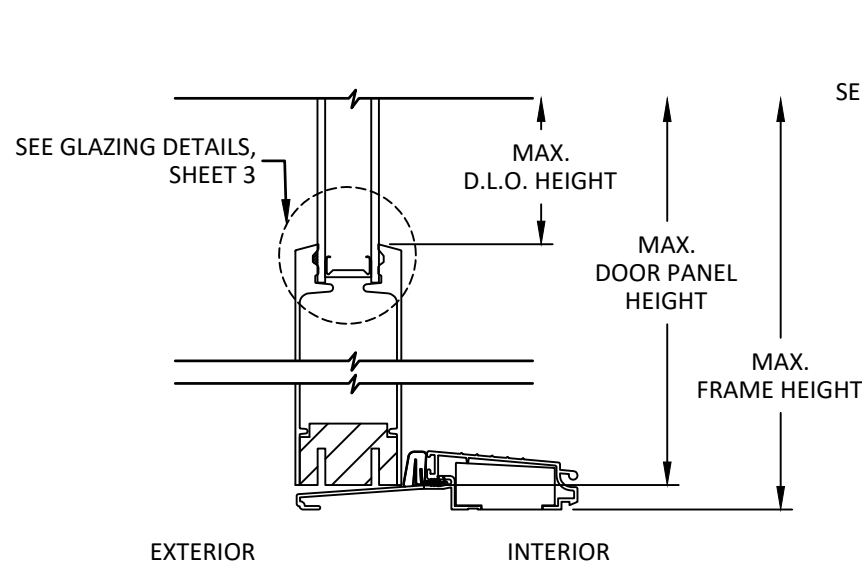


A
11 VERTICAL SECTION
AFCO A-117 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

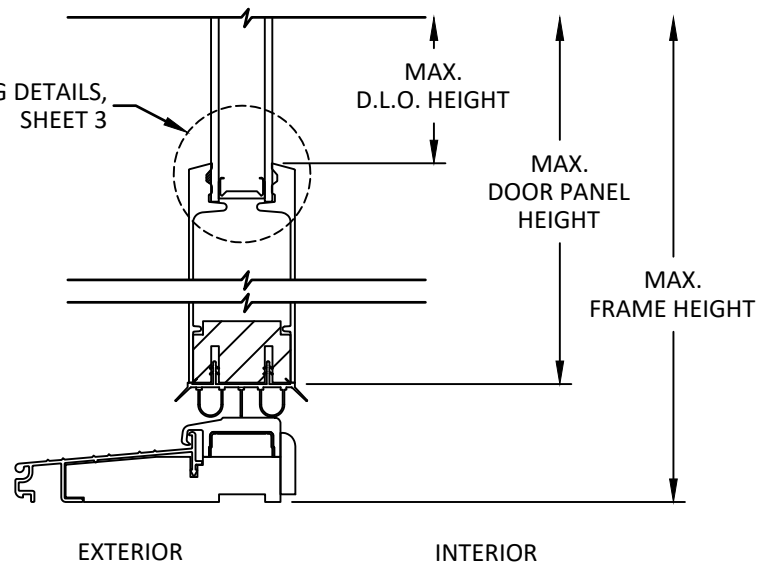


B
11 VERTICAL SECTION
AFCO A-276 SILL
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH AFCO SIDELITE BASE
BOX CONSTRUCTION

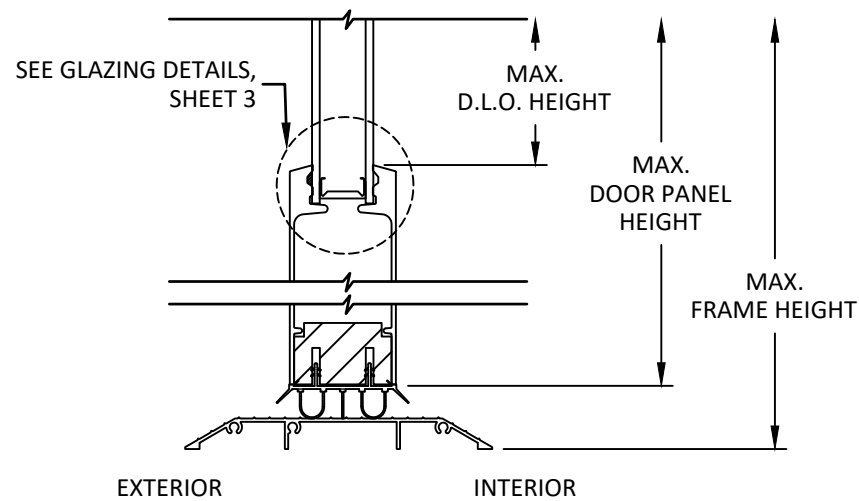


C
11 VERTICAL SECTION
AFCO A-204 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

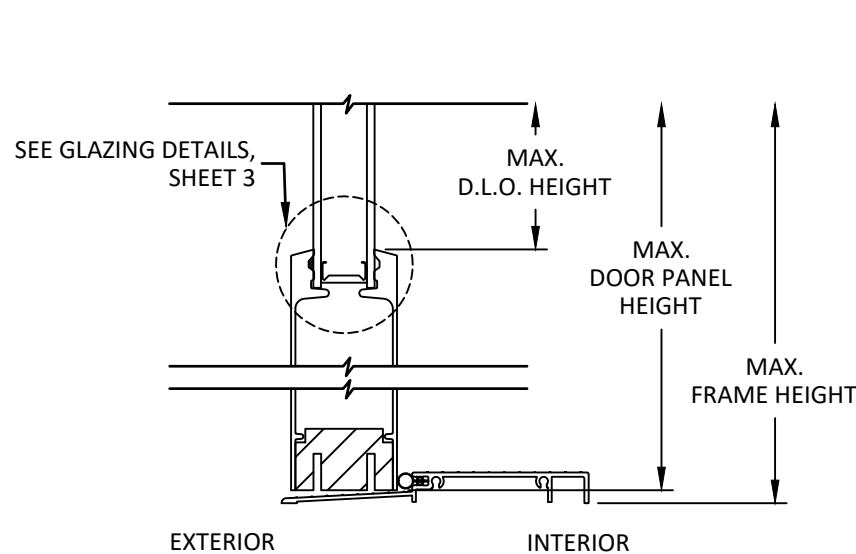

D
11 VERTICAL SECTION
AFCO A-204T SILL
SIDELITE QUALIFIED FOR USE WITH SILL
BOX CONSTRUCTION

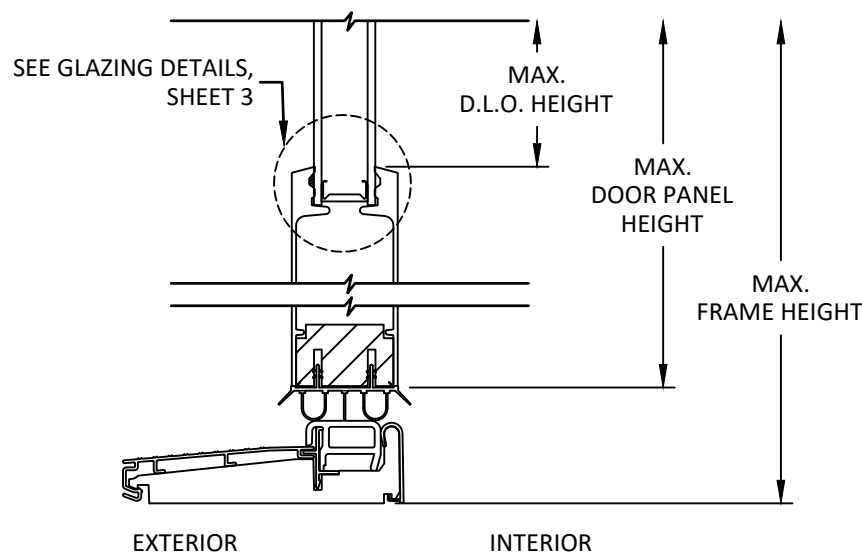

E
11 VERTICAL SECTION
ENDURA ZAILAA4565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL IN
COMBINATION WITH ENDURA SIDELITE BASE
CONTINUOUS & BOX CONSTRUCTION

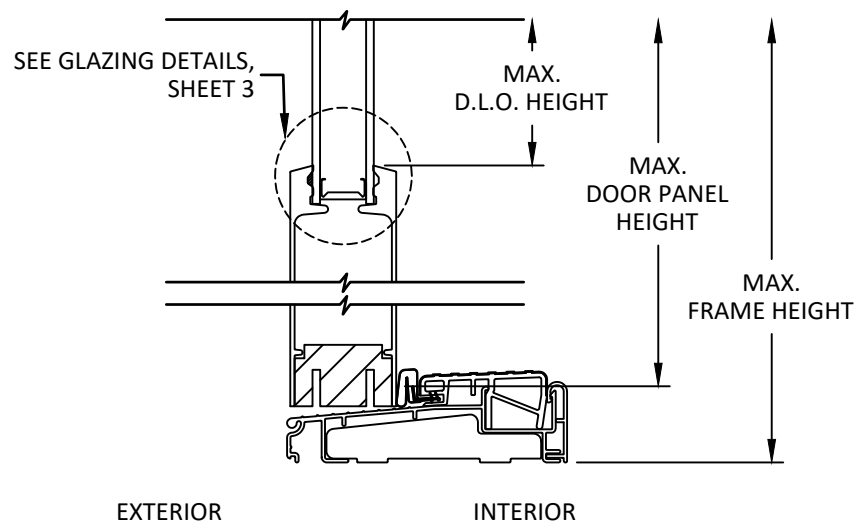

F
11 VERTICAL SECTION
ENDURA ZOBL4565 SILL
SIDELITE QUALIFIED FOR USE WITH SILL
CONTINUOUS & BOX CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132


PH: (954) 599-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

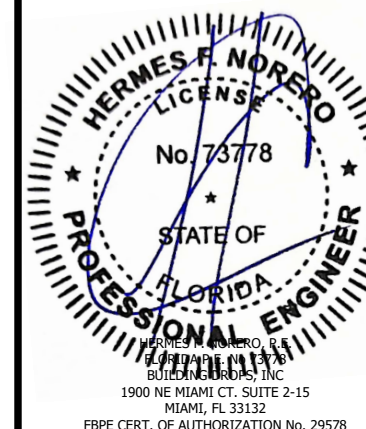

FL #: **FL47925**

DATE: **12.04.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL014**

SHEET: **11** REV. **A**

OF 24

PH: (800) 253-3900

VERTICAL SECTIONS

MIAMI, FL 33132

PH: (954)399-8478
FAX: (954)744-4738



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



DATE: 12.04.2025

SCALE: NTS


DWG. #: ODL014

SHEET:	REV.
--------	------


OF 24



c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change projects\odl, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:46 PM

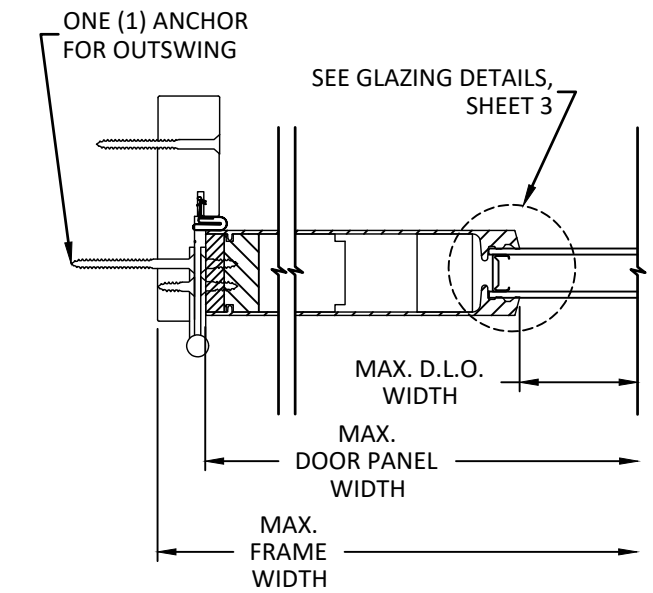

A
13 HORIZONTAL SECTION
OUTSWING - HINGE JAMB

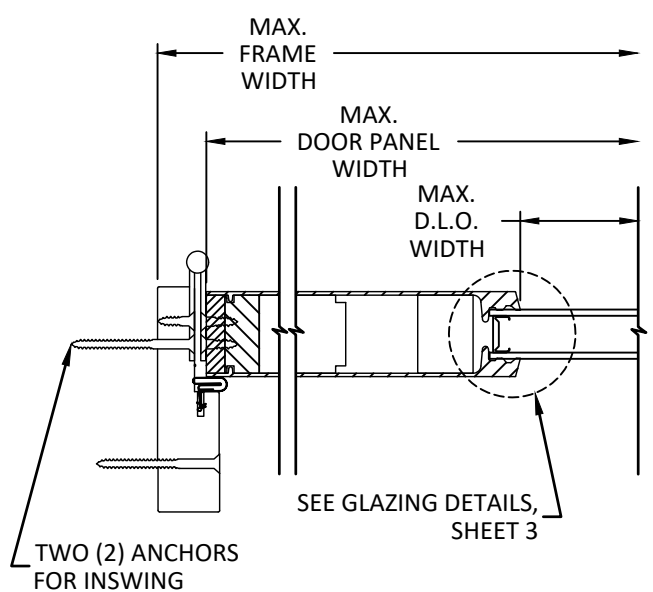


C
13 HORIZONTAL SECTION
INSWING - HINGE JAMB

INTERIOR


EXTERIOR

INTERIOR

EXTERIOR

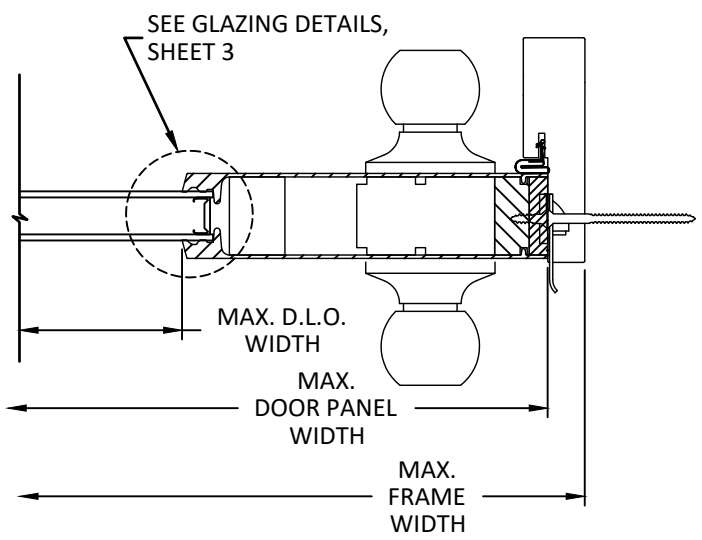

B
13 HORIZONTAL SECTION
OUTSWING - LOCK JAMB

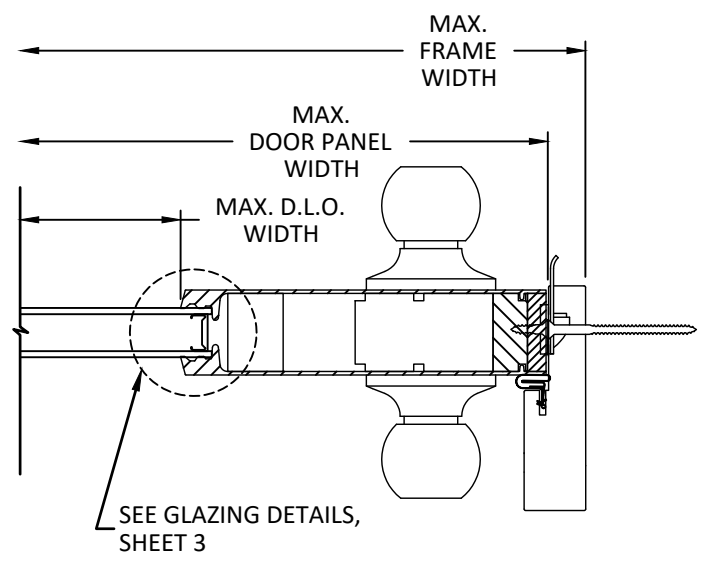


D
13 HORIZONTAL SECTION
INSWING - LOCK JAMB

INTERIOR


EXTERIOR

INTERIOR

EXTERIOR

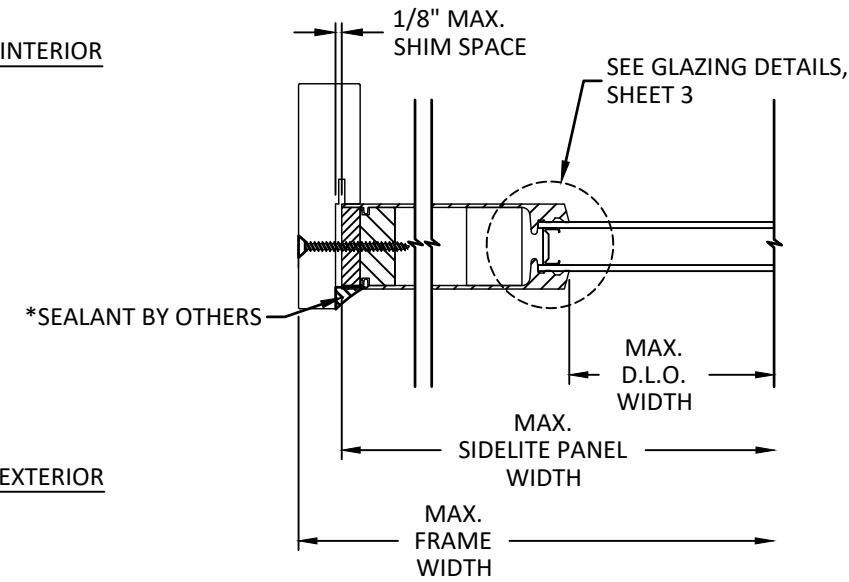

E
13 HORIZONTAL SECTION
OUTSWING - SIDELITE JAMB

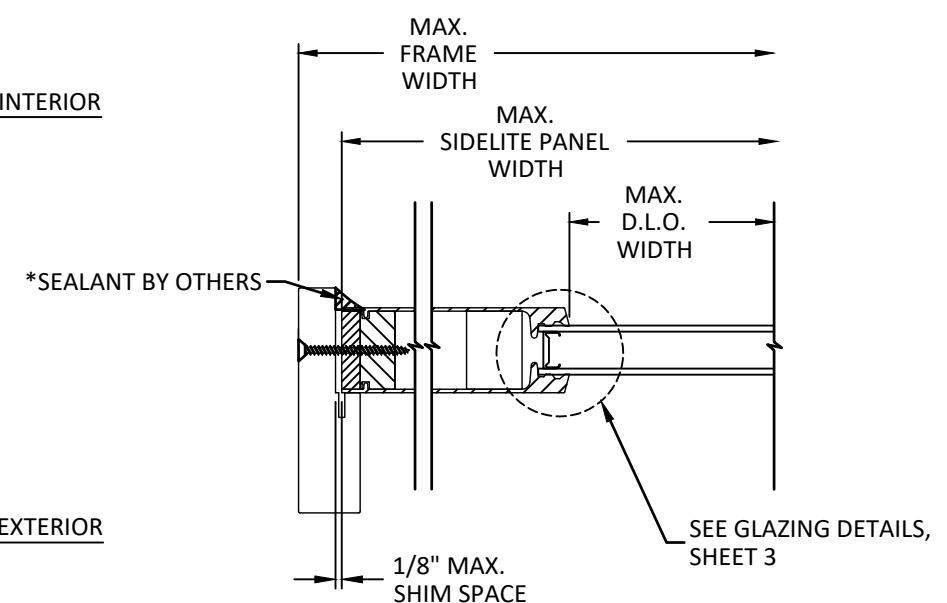

F
13 HORIZONTAL SECTION
INSWING - SIDELITE JAMB



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464
PH: (800) 253-3900


TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

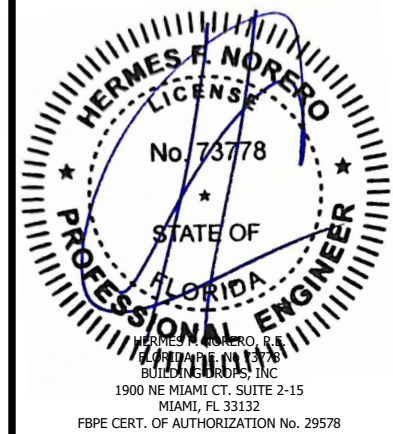


FL #:	FL47925
DATE:	12.04.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ODL014
SHEET:	13
REV.	A


c:\users\julianarodriguez\building_drops, inc\building_drops\projects\2026 code change projects\odl, inc\cc-26-03-40-1 - 2026 code change.dwg (1/4/25) (odl014 - a.dwg) 8/5/2026 2:45 PM

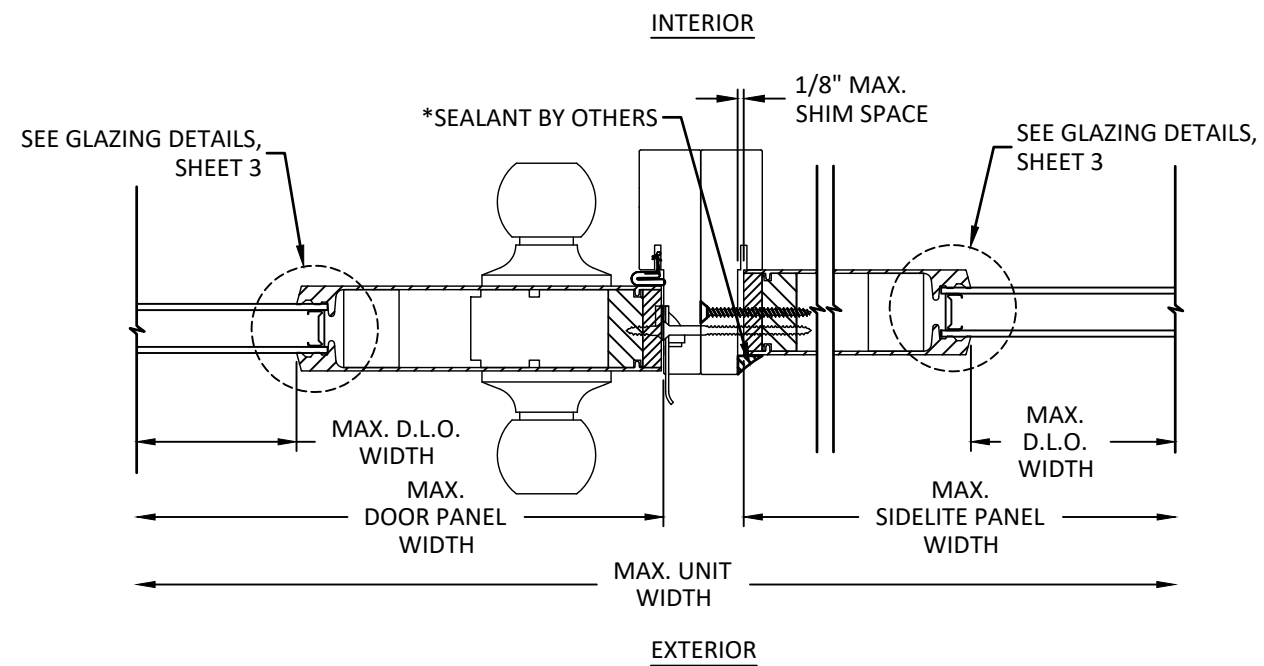


A
14 **HORIZONTAL SECTION**
OUTSWING - BOXED MULLION
BOXED CONSTRUCTION

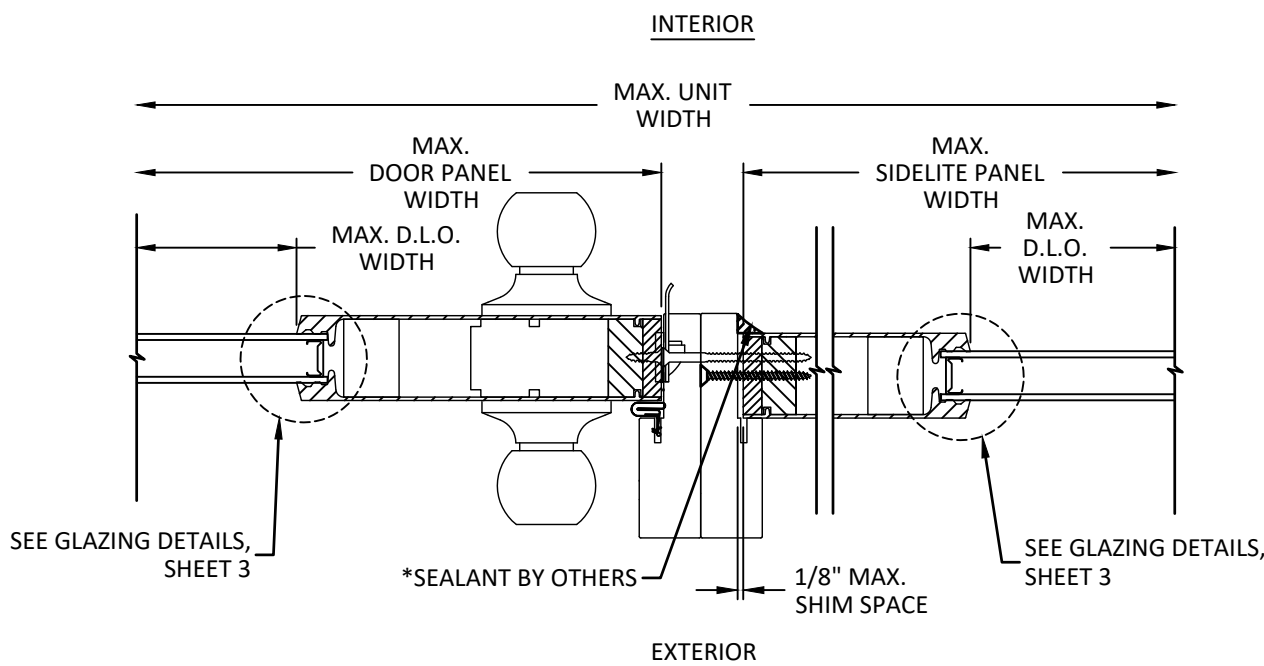

B
14 **HORIZONTAL SECTION**
INSWING - BOXED MULLION
BOXED CONSTRUCTION

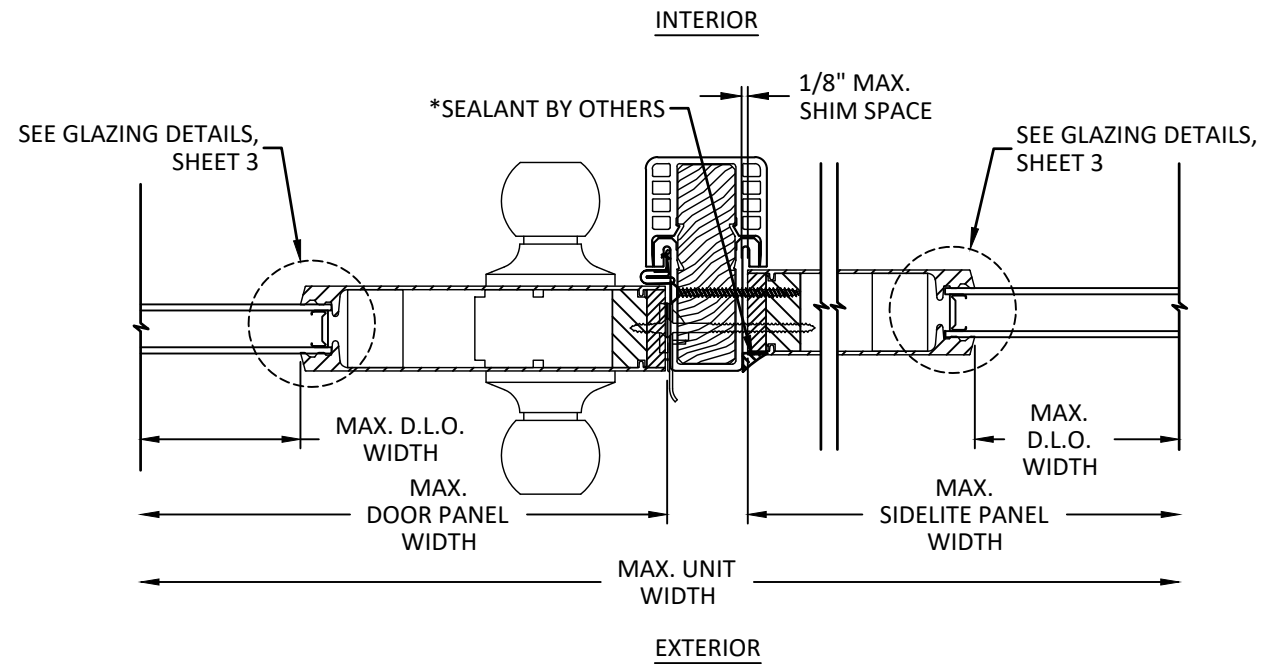

C
14 **HORIZONTAL SECTION**
OUTSWING - ENDURA FUSION MULLION
CONTINUOUS CONSTRUCTION

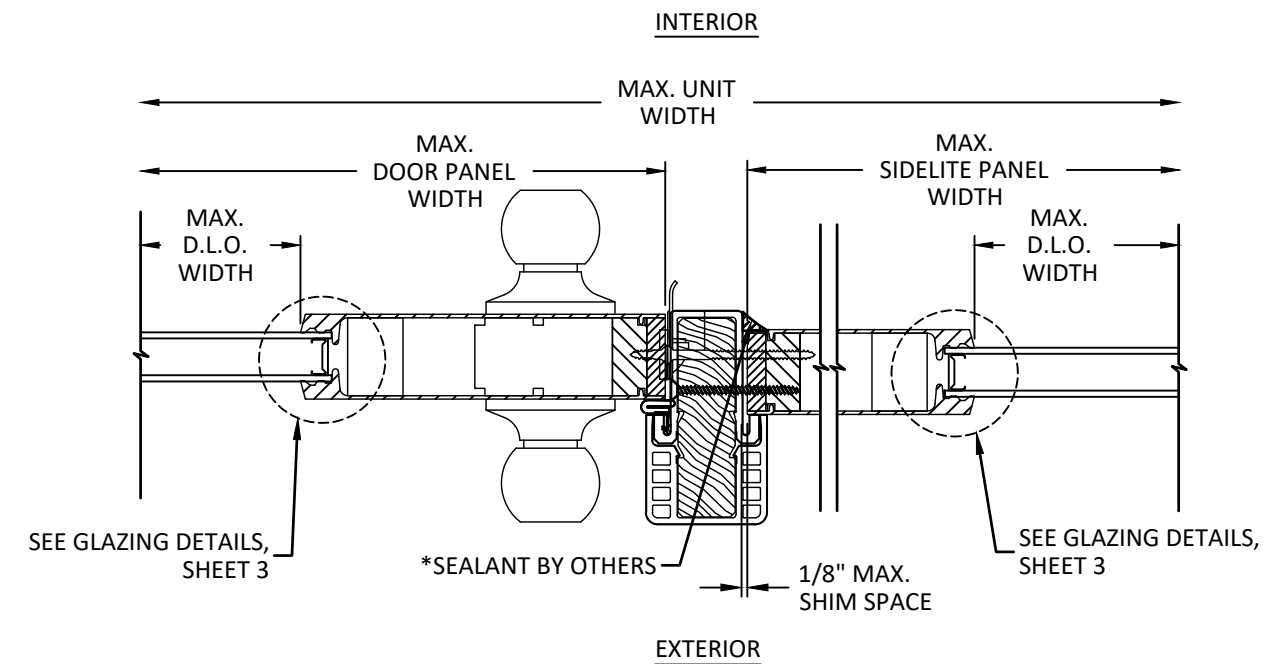

D
14 **HORIZONTAL SECTION**
INSWING - ENDURA FUSION MULLION
CONTINUOUS CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

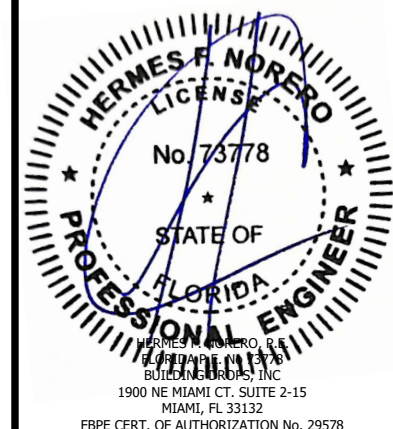

FL #: **FL47925**


DATE: **12.04.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL014**

SHEET: **14** REV. **A**



HORIZONTAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

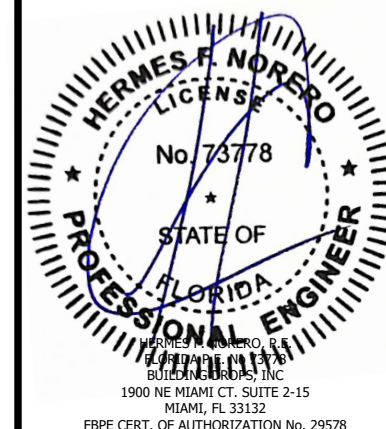

FL #: **FL47925**

DATE: 12.04.2025

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: ODL014


SHEET:	REV.
--------	------

15


REV.	A
------	---

OF 24

c:\users\julianarodriguez\building_drops, inc\building_drops\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change projects\odl, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:46 PM

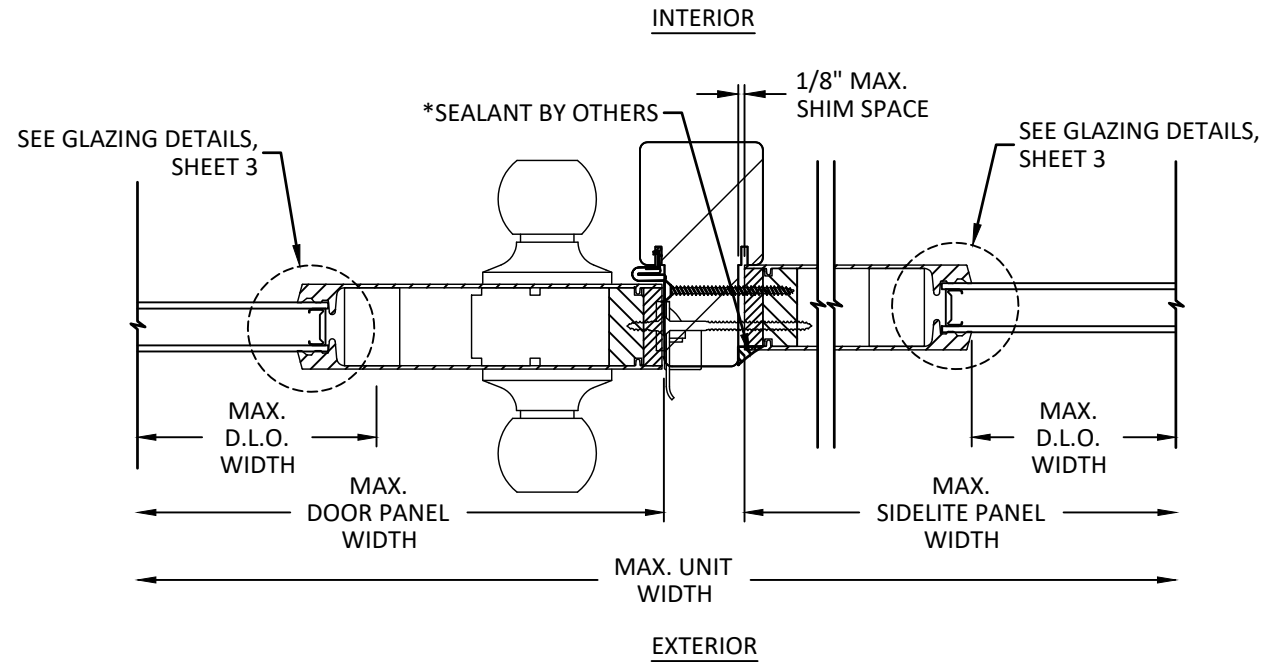

A HORIZONTAL SECTION
16 OUTSWING - ENDURA FRAME
SAVER MULLION
CONTINUOUS CONSTRUCTION
RATED TO A MAX. DP OF +/- 32.7 PSF

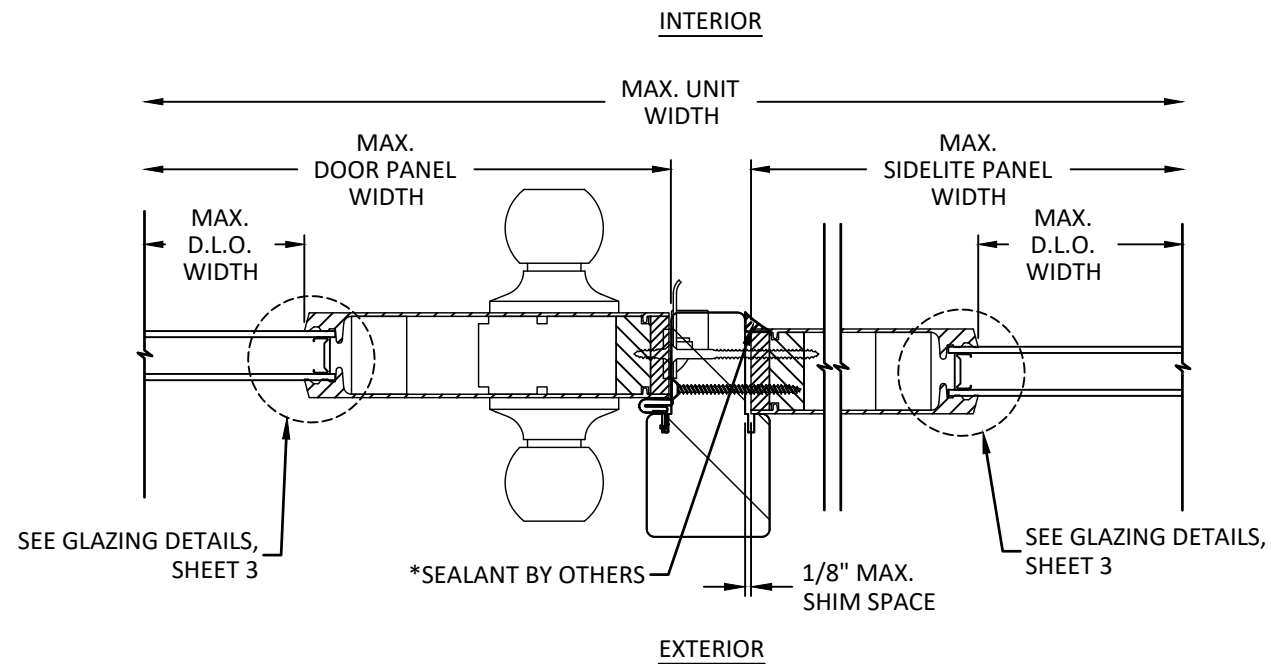

B HORIZONTAL SECTION
16 INSWING - ENDURA FRAME
SAVER MULLION
RATED TO A MAX. DP OF +/- 32.7 PSF
CONTINUOUS CONSTRUCTION



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900


TITLE: INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

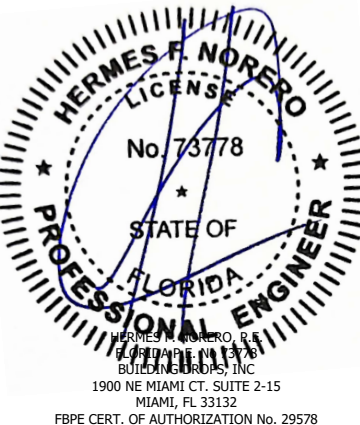

FL #: FL47925

DATE: 12.04.2025

DWG. BY: JR
CHK. BY: HFN

SCALE: NTS

DWG. #: ODL014

SHEET: 16
REV. A

TITLE: INSWING & OUTSWING FLUSH GLAZED FIBERGLASS DOOR (NON-HVHZ) (NON-IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: **BUILDING DROPS, INC.**
1000 NE MIAMI CT SUITE 215


MIAMI, FL 33132

FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

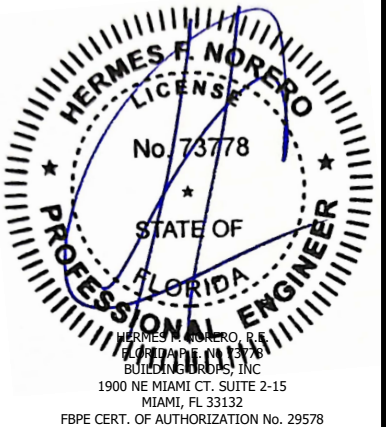

FL #: **FL47925**

DATE: 12.04.2025


DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: ODL014

SHEET:	REV.
17	A


OF 24

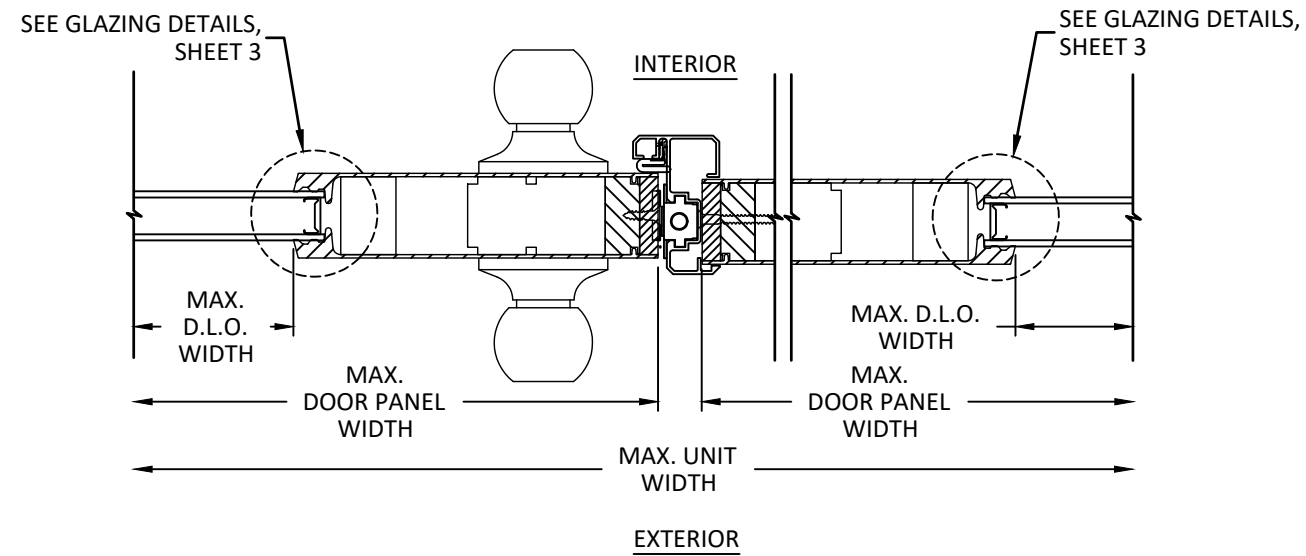


A HORIZONTAL SECTION
17 OUTSWING - DLP MODERN ASTRAGAL

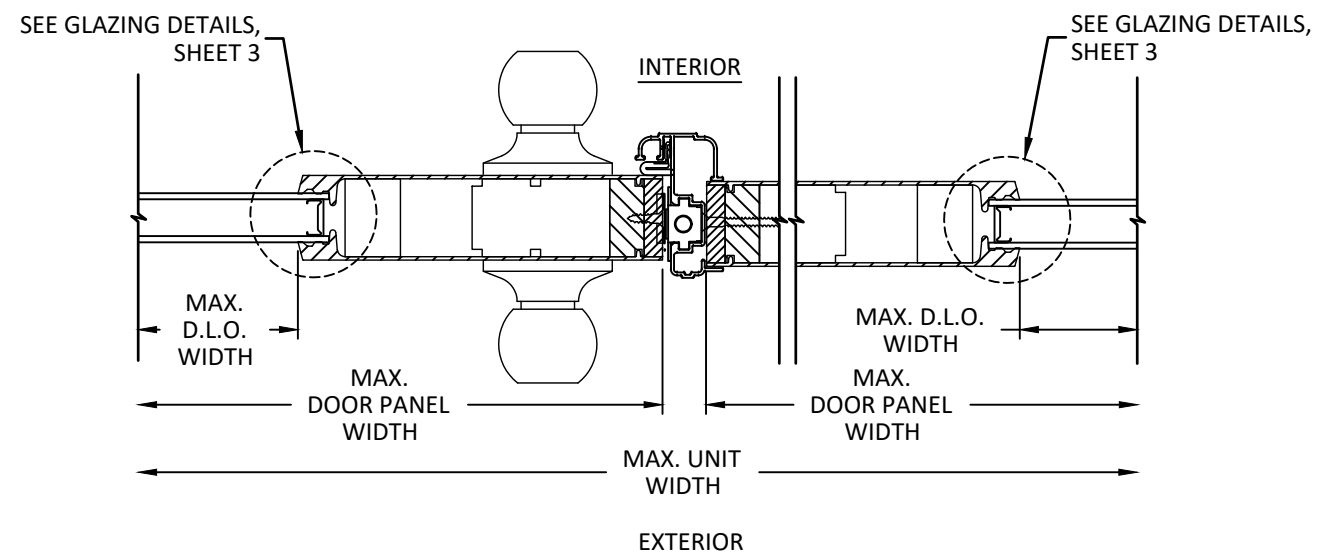

C HORIZONTAL SECTION
17 OUTSWING - DLP TRADITIONAL ASTRAGAL

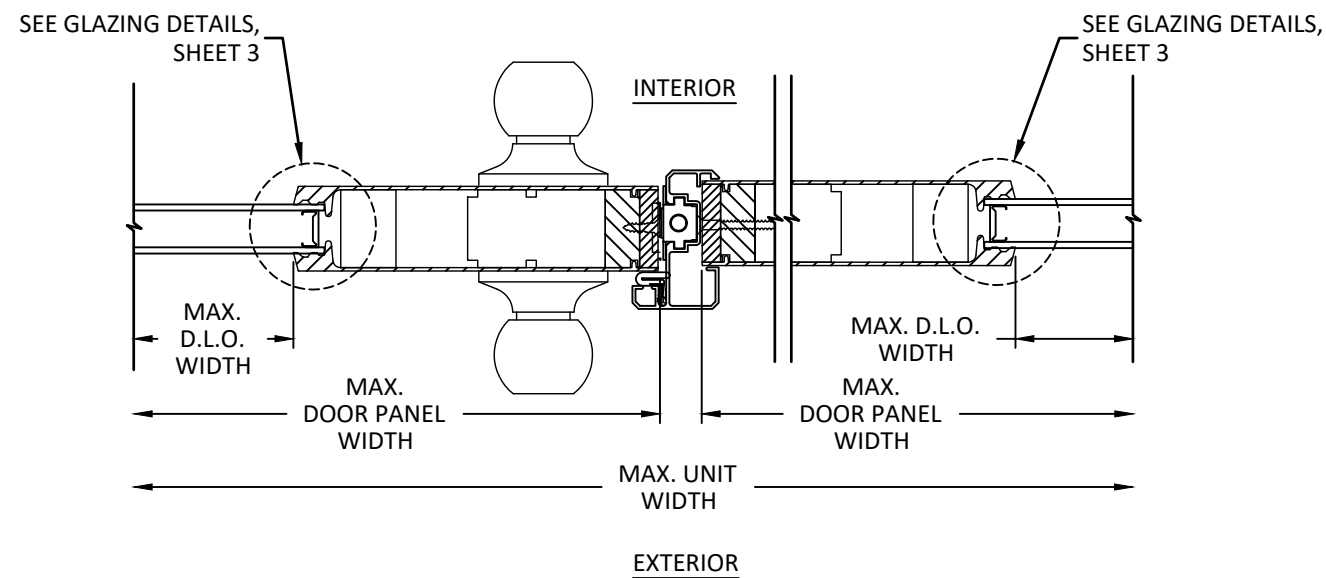


B HORIZONTAL SECTION
17 INSWING - DLP MODERN ASTRAGAL

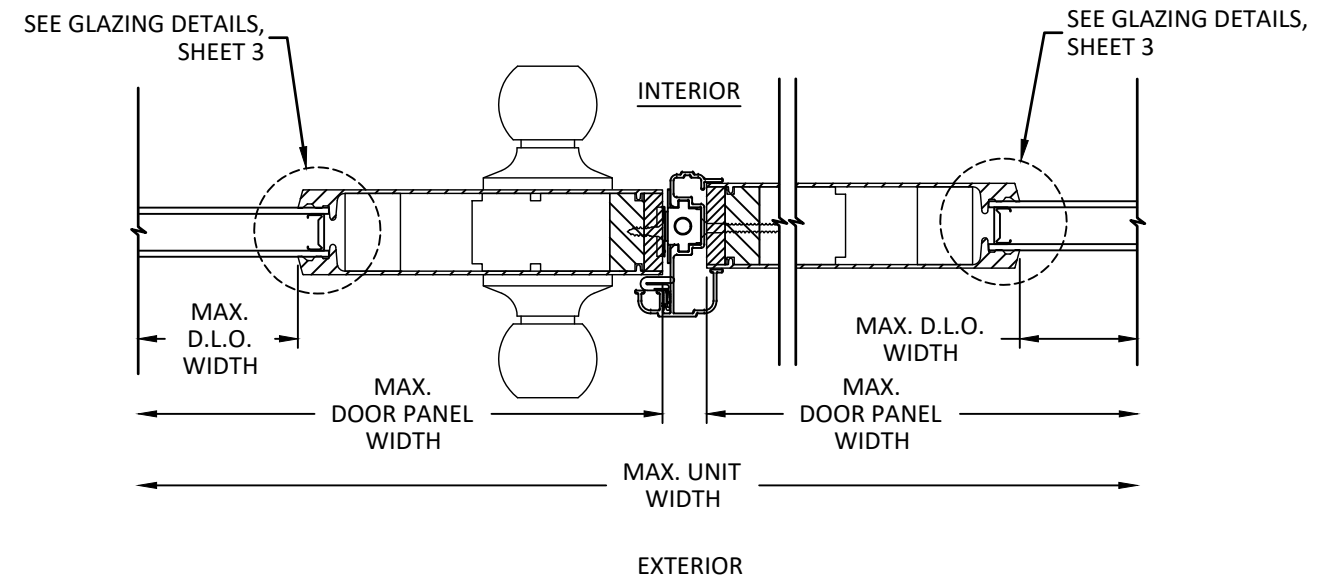

D17 HORIZONTAL SECTION


INSWING - DLP TRADITIONAL ASTRAGAL

c:\users\julianarodriguez\building_drops, inc\building_drops\projects\2026 code change projects\odl, inc\cc-26-03-40-1 - 2026 code change projects\odl, inc\cc-26-03-40-1 - a.dwg 8/5/2026 2:45 PM

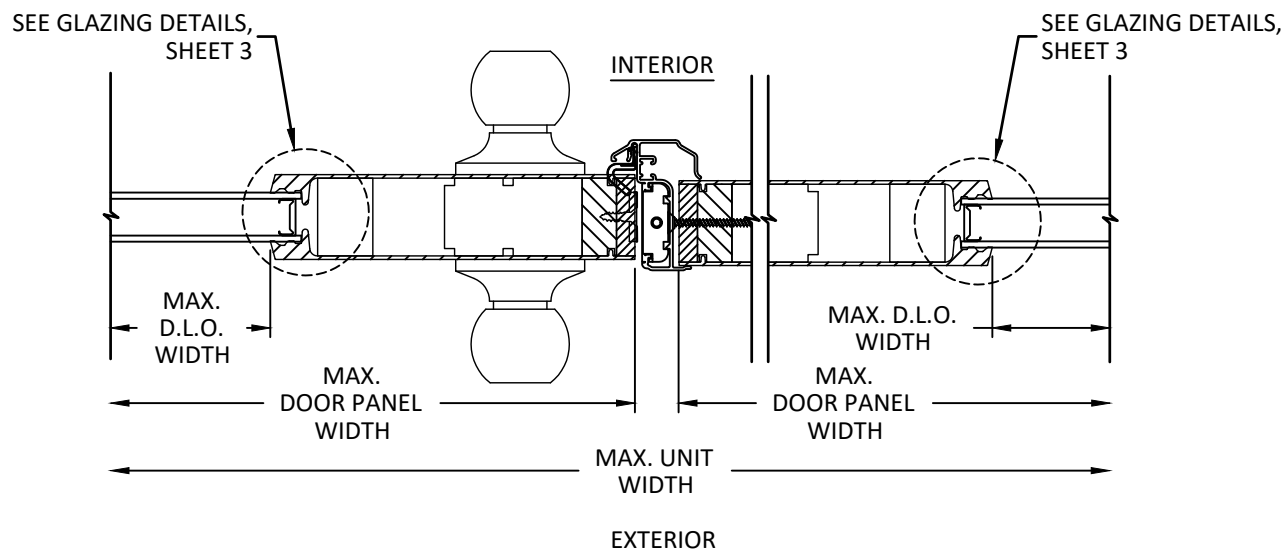

A
18 HORIZONTAL SECTION

OUTSWING - ENDURA ULTIMATE
HURRICANE ASTRAGAL &
ENDURA ULTIMATE PUSH BUTTON
ASTRAGAL

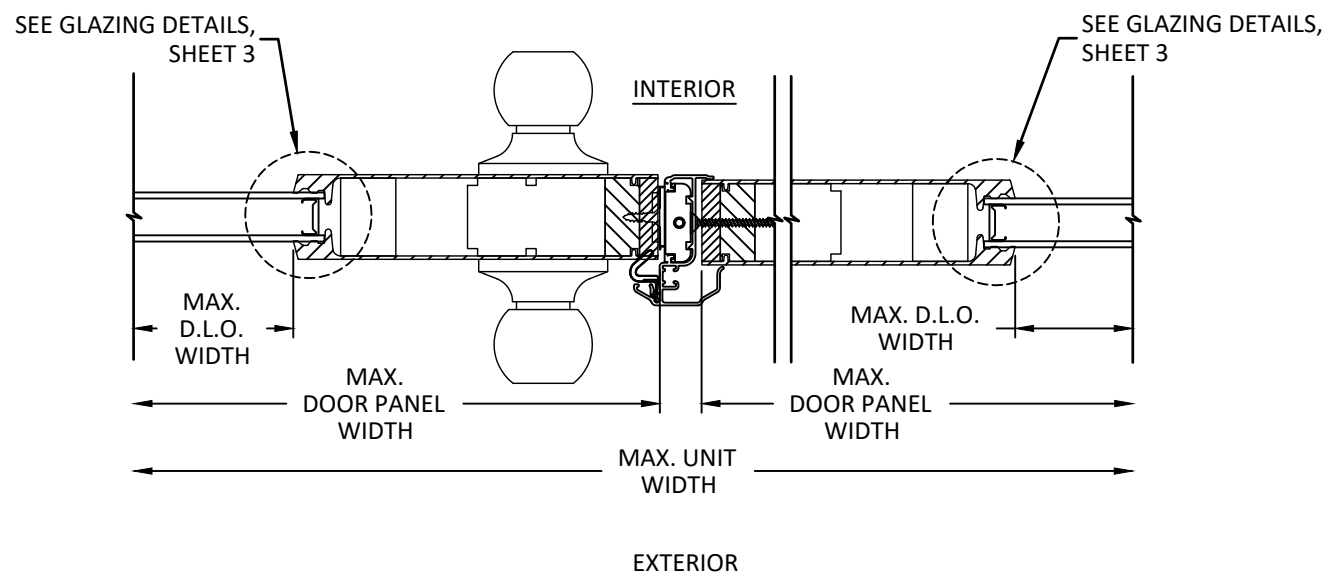

B
18 HORIZONTAL SECTION

INSWING - ENDURA ULTIMATE
HURRICANE ASTRAGAL &
ENDURA ULTIMATE PUSH BUTTON
ASTRAGAL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900


TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

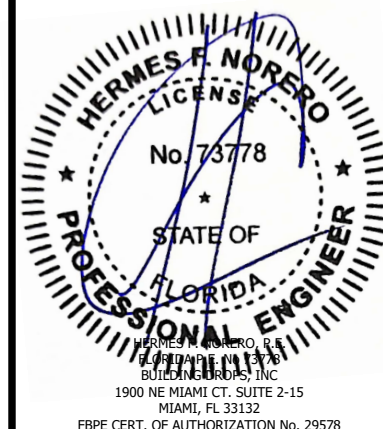

FL #: **FL47925**

DATE: **12.04.2025**


DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **ODL014**

SHEET: **18** REV. **A**

c:\users\julianarodriguez\building_drops, inc\building drops\projects\2026 code change projects\lodi, inc\cc-26-03-40.1 - 2026 code change projects\lodi, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:46 PM

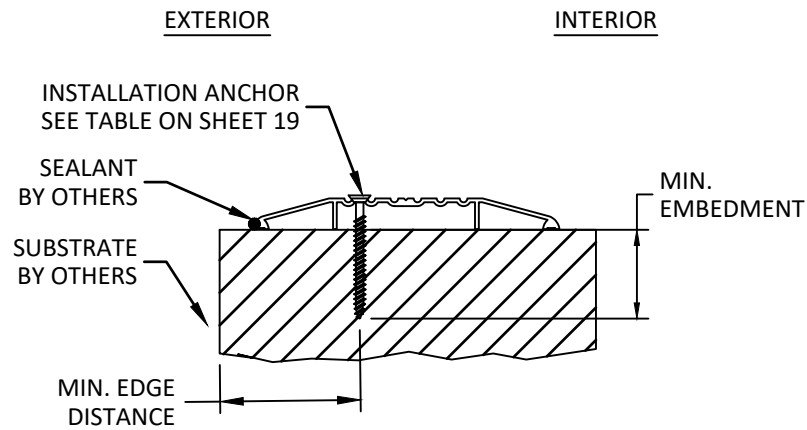

A
19 **ANCHOR DETAIL**
DLP ADA ISHC SILL

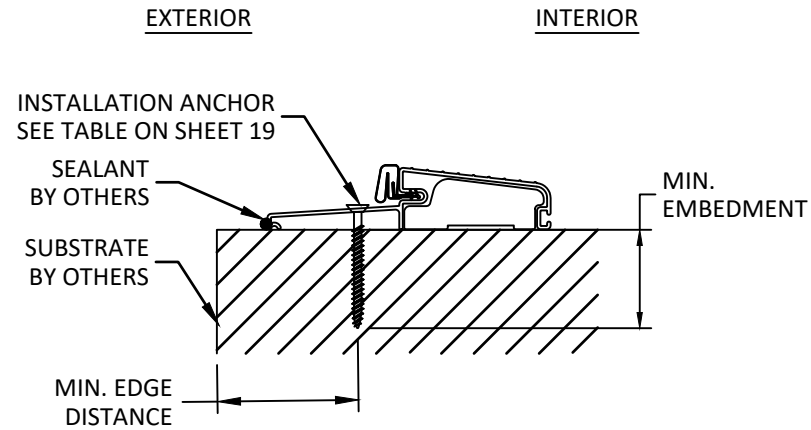

B
19 **ANCHOR DETAIL**
ENDURA FOB4565 SILL

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR THROUGH FRAME INSTALLATION.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. S.G. = 0.55	#10 WOOD SCREW	1.50"	0.75"
	CONCRETE (MIN. f'c = 3000 PSI) OR CMU (PER ASTM C90)	3/16" ITW TAPCON	1.00"	2.50"
	STEEL MIN. 18 GA. (MIN. Fy = 36 KSI) ALUM. MIN. 1/8" THK. (MIN. 6063-T5)	#12 SELF-TAPPING OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900


TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
ANCHOR DETAILS, ANCHOR SCHEDULE,
& INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

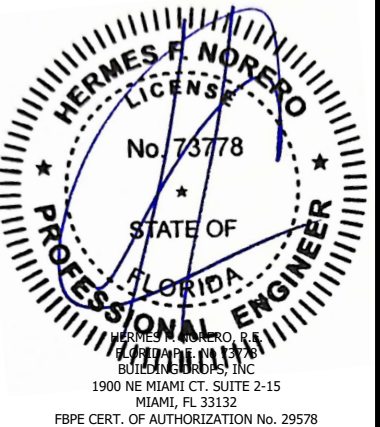

FL #: **FL47925**

DATE: **12.04.2025**


DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ODL014**


SHEET: **19** REV. **A**

c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg(1/47925)odl014 - a.dwg 8/5/2026 2:46 PM

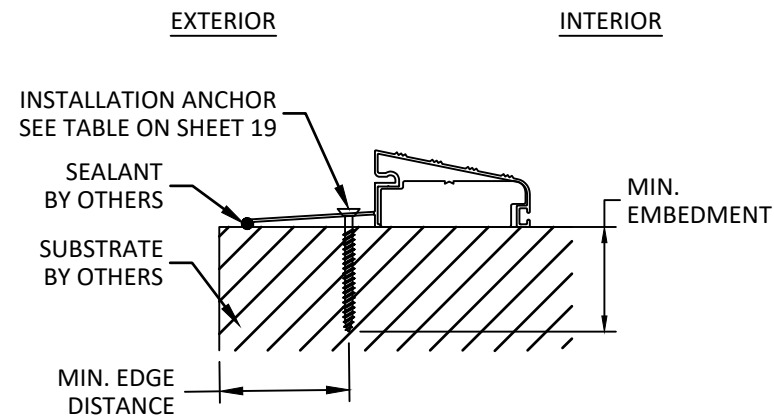


A
20

ANCHOR DETAIL
QOSH SILL

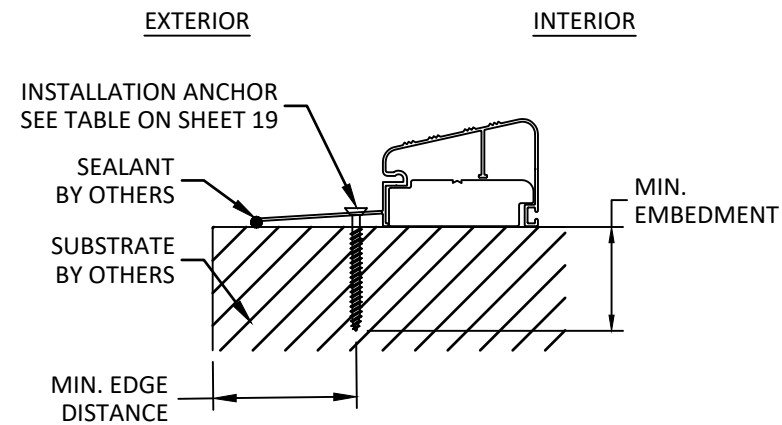


B
20

ANCHOR DETAIL
QOSR SILL

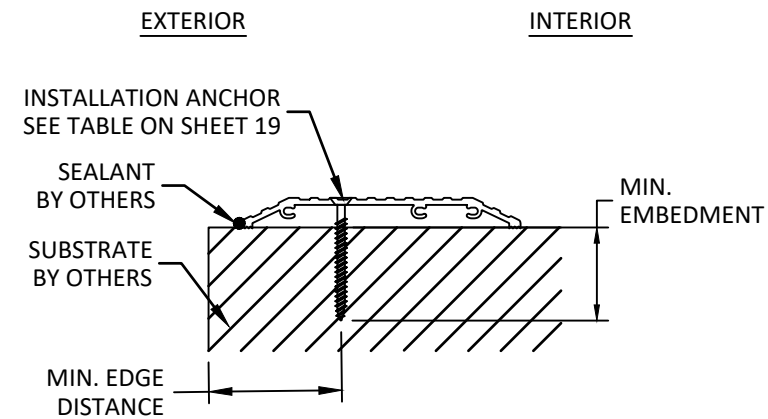


C
20

ANCHOR DETAIL
DLP ADA DB4565DL SILL

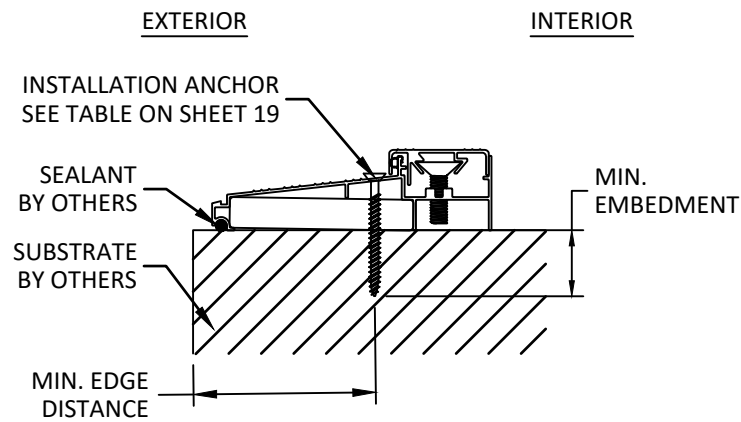


D
20

ANCHOR DETAIL
DLP ISCS SILL

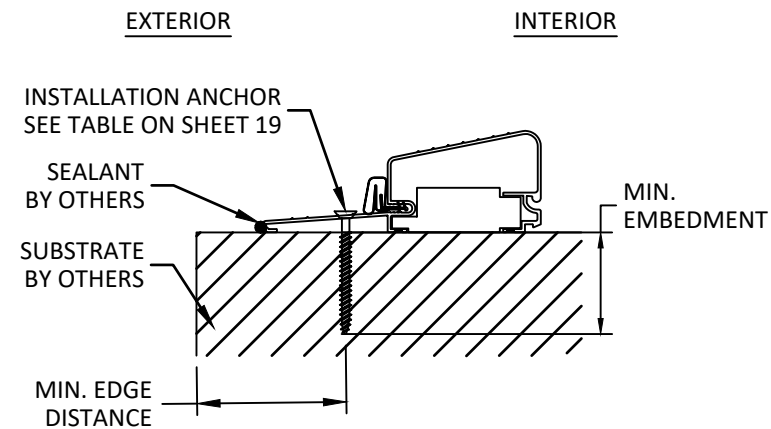

E
20

ANCHOR DETAIL
AFCO H-497 SILL

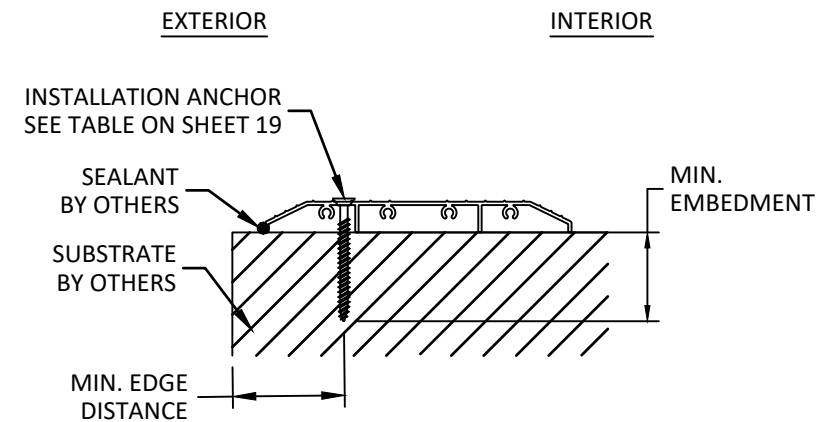

F
20

ANCHOR DETAIL
ENDURA HC15000 ADA SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)

ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL47925

DATE: 12.04.2025

DWG. BY:
JR

CHK. BY:
HFN

SCALE: NTS

DWG. #: ODL014


SHEET:

20

REV.
A


OF 24

c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40-1 - 2026 code change.dwg(147925)odl014 - a.dwg 8/5/2026 2:46 PM

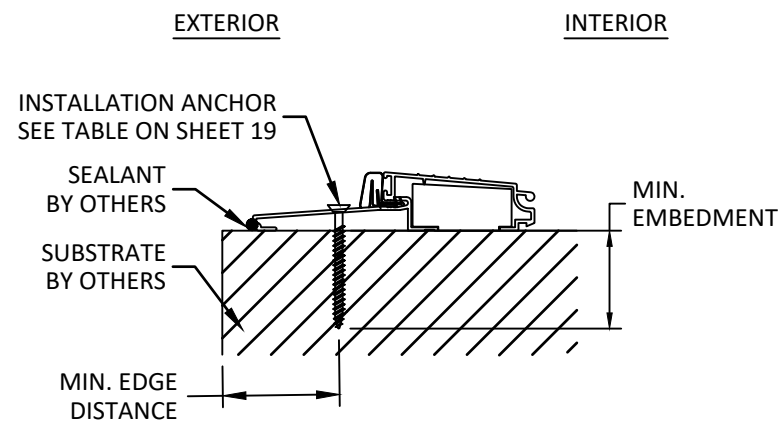


A
21

ANCHOR DETAIL
AFCO A-117 SILL

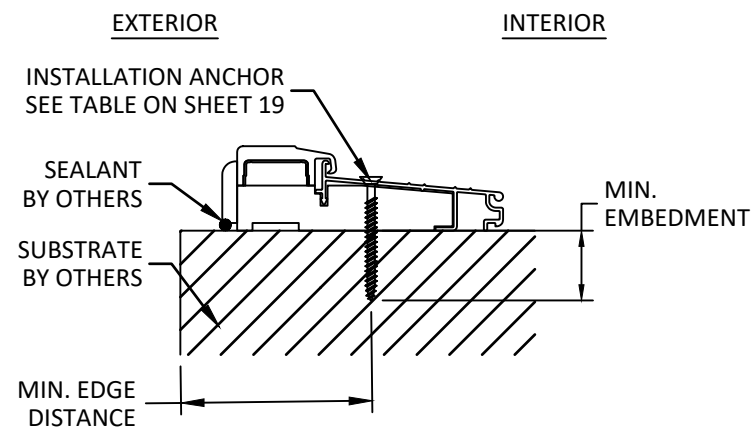


B
21

ANCHOR DETAIL
AFCO A-276 SILL

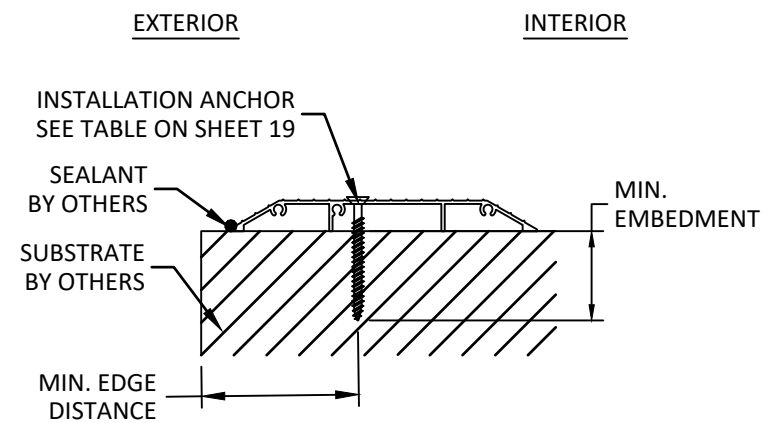


C
21

ANCHOR DETAIL
AFCO A-204 SILL

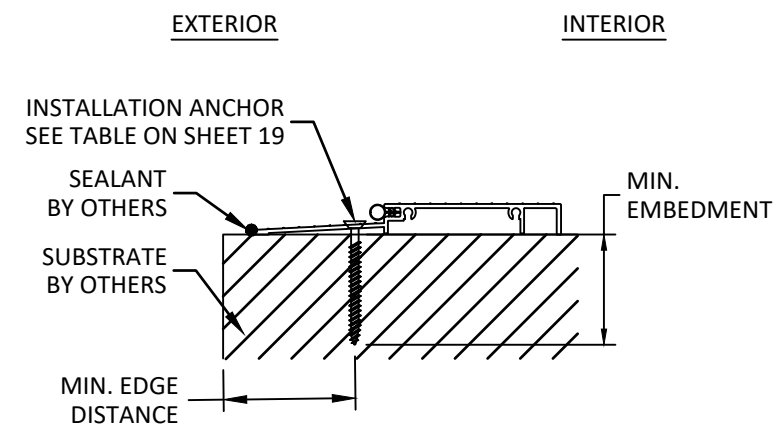


D
21

ANCHOR DETAIL
AFCO A-204T SILL

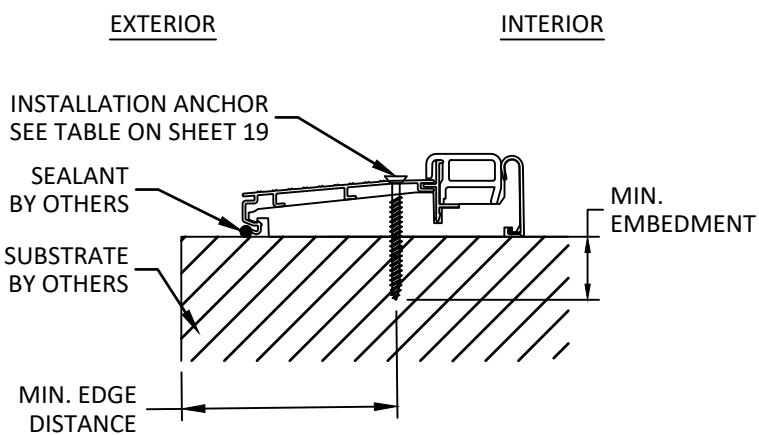

E
21

ANCHOR DETAIL
ENDURA ZAILAA4565 SILL

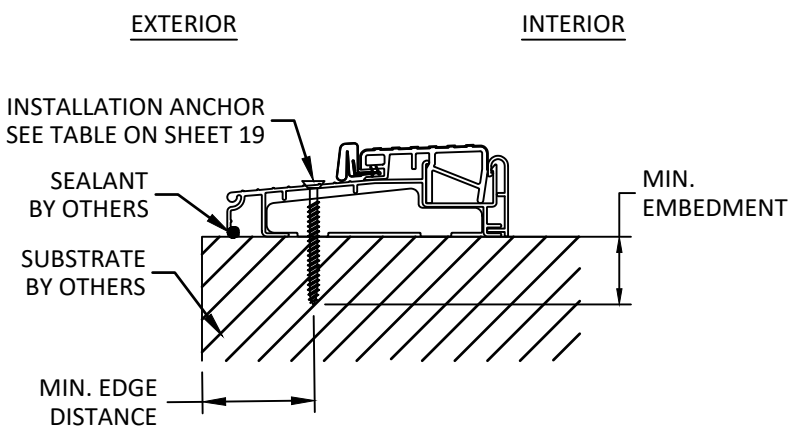

F
21

ANCHOR DETAIL
ENDURA ZOBL4565 SILL



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)

ANCHOR DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

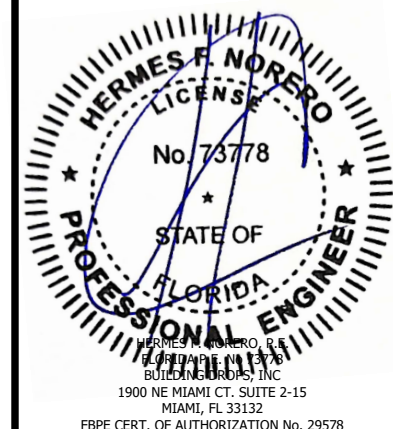

FL #:
FL47925

DATE: **12.04.2025**

DWG. BY: **JR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **ODL014**


SHEET: **21** REV. **A**

OF 24


c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change projects\odl, inc\cc-26-03-40.1 - a.dwg 8/5/2026 2:46 PM

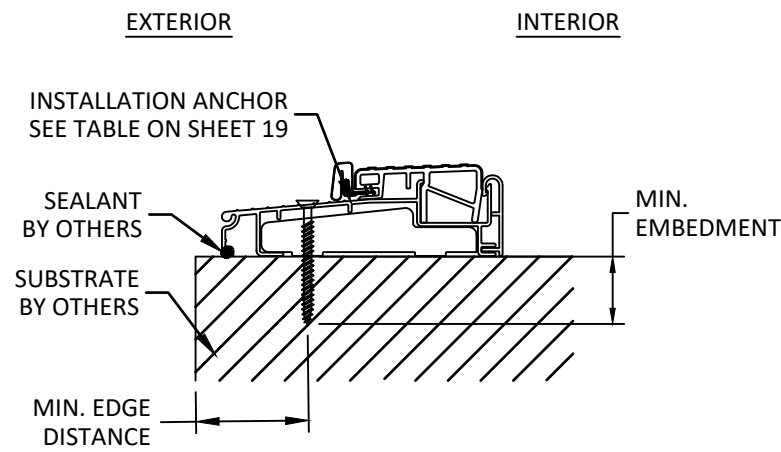


A
22
ANCHOR DETAIL
ENDURA ZOB4565FN SILL

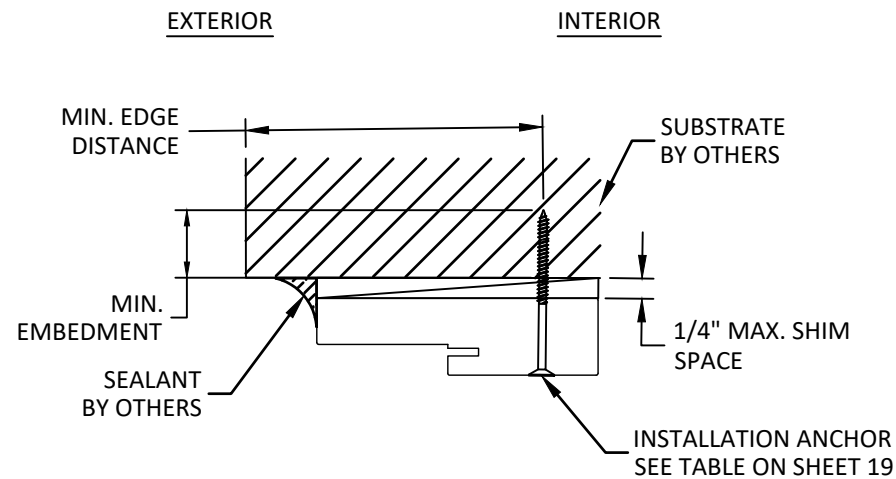


B
22
ANCHOR DETAIL
OUTSWING - DOOR HEAD
JAMB SIMILAR

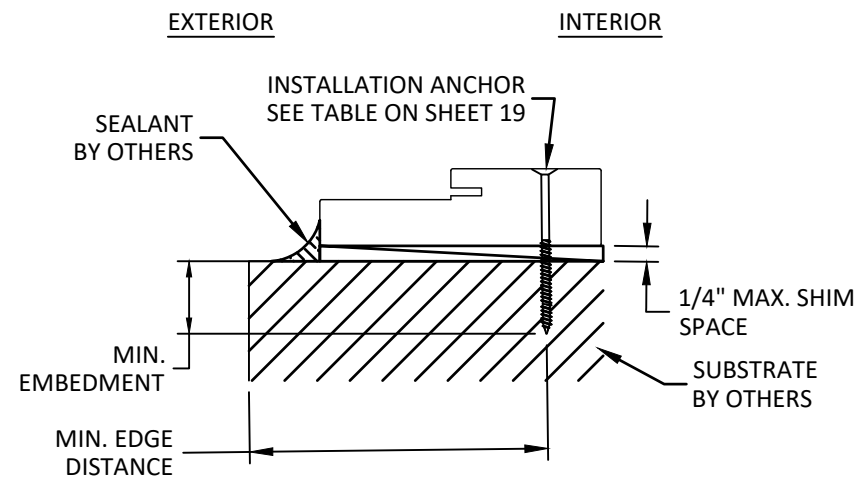

C
22
ANCHOR DETAIL
OUTSWING - SIDELITE SILL
HEAD AND JAMB SIMILAR

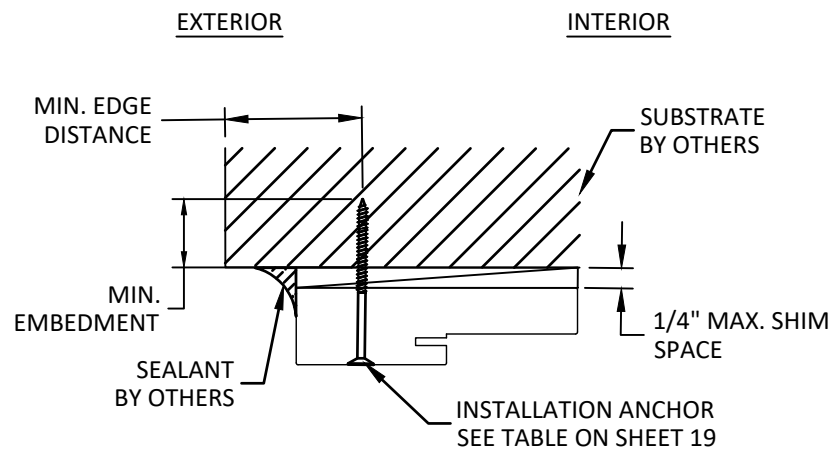

D
22
ANCHOR DETAIL
INSWING - DOOR HEAD
JAMB SIMILAR

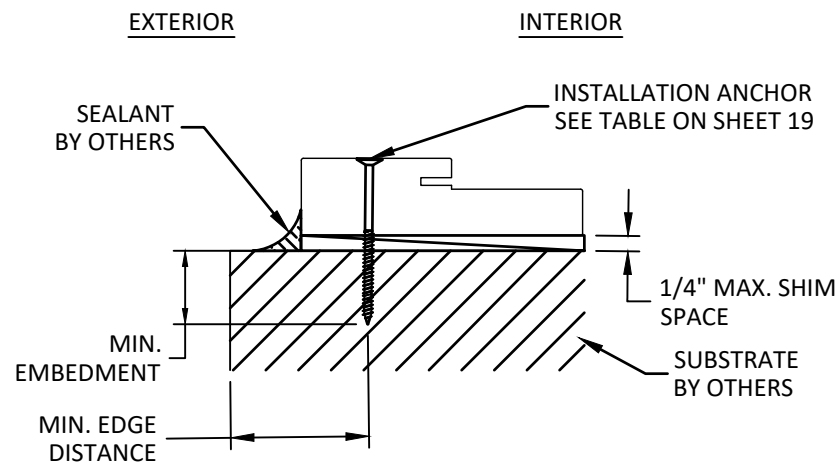

E
22
ANCHOR DETAIL
INSWING - SIDELITE SILL
HEAD AND JAMB SIMILAR



215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900


TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)
ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

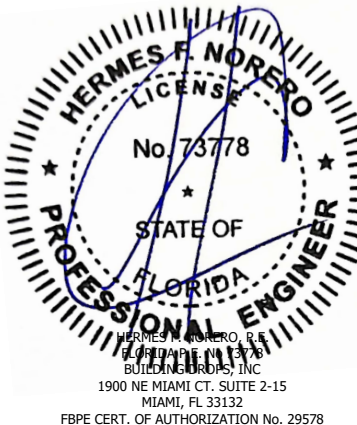

FL #: **FL47925**

DATE: **12.04.2025**

















DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **ODL014**

SHEET: 22	REV. A
---------------------	------------------

BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
1	JAMB	FINGER JOINT PINE, LVL, OR COMPOSITE
2	ENDURA FUSION MULLION	VARIES
3	BOXED MULLION	FINGER JOINT PINE OR LVL
4	WEATHERSTRIP	FOAM
5	DOOR SWEEP	VINYL
6	HINGE	STEEL
7	LOCK SET	STEEL
8	DEADBOLT	STEEL
9	LATCH STRIKE PLATE	STEEL
10	DEADBOLT STRIKE PLATE	STEEL
11	DOOR PANEL	-
12	SIDELITE PANEL	-
13	FASTENERS	STEEL
14	DLP MODERN ASTRAGAL	ALUMINUM
15	DLP TRADITIONAL ASTRAGAL	ALUMINUM
16	ASTRAGAL STRIKE PLATE	STEEL
17	DLP QOSH SILL	ALUMINUM
18	DLP QOSR SILL	ALUMINUM
19	AFCO H-497 SILL	ALUMINUM
20	DLP ISCS SILL	ALUMINUM
21	DLP ADA ISHC SILL	ALUMINUM
22	DLP DB4565DL SILL	ALUMINUM
23	ENDURA HC15000 ADA SILL	ALUMINUM
24	ENDURA FOB4565 SILL	ALUMINUM
25	ENDURA ZOB4565FN SILL	ALUMINUM
26	AFCO A-117 SILL	ALUMINUM
27	AFCO A-276 SILL	ALUMINUM
28	AFCO A-204 SILL	ALUMINUM
29	AFCO A-204T SILL	ALUMINUM
30	ENDURA ZAILAA4565 SILL	ALUMINUM
31	ENDURA ZOBL4565F SILL	ALUMINUM
32	AFCO SIDELITE BASE	PVC / ALUMINUM
33	ENDURA SIDELITE BASE	PVC / ALUMINUM
34	ENDURA ULTIMATE HURRICANE ASTRAGAL	ALUMINUM
35	ENDURA ULTIMATE PUSH BUTTON ASTRAGAL	ALUMINUM
36	PLASTPRO MULLION	VARIES
37	WOOD PINE MULLION	FINGER JOINT PINE
38	ENDURA FRAME SAVER MULLION	FINGER JOINT PINE

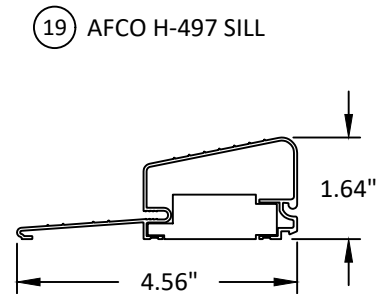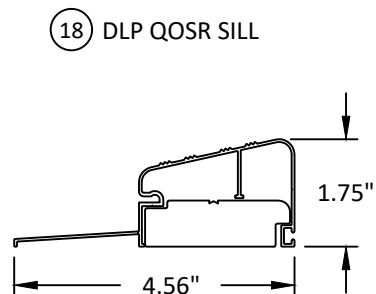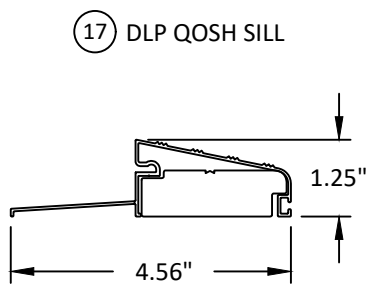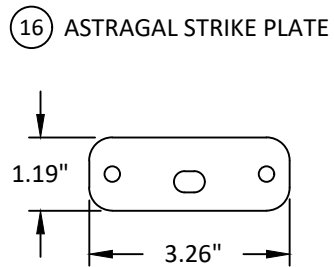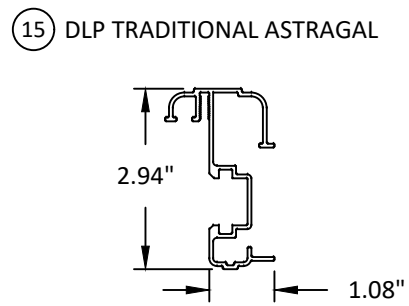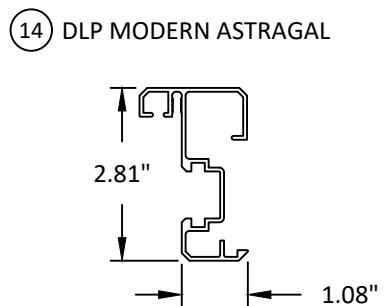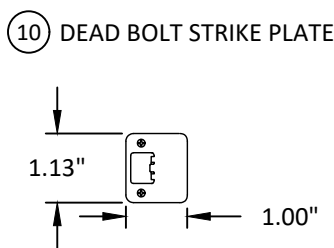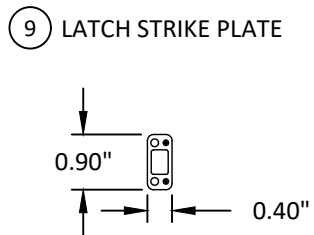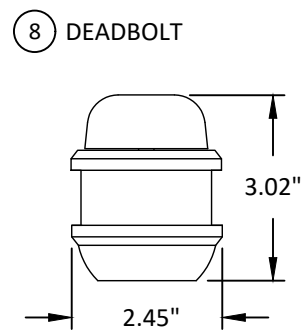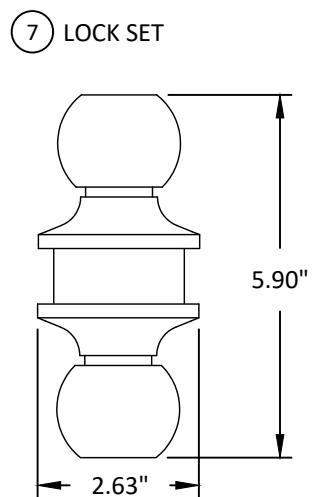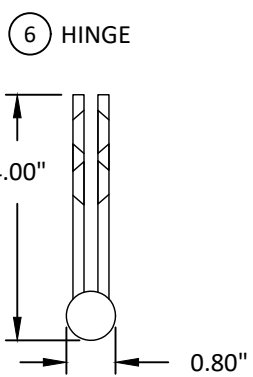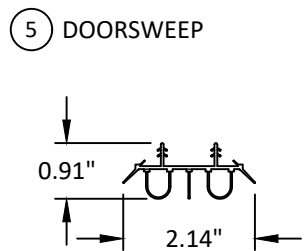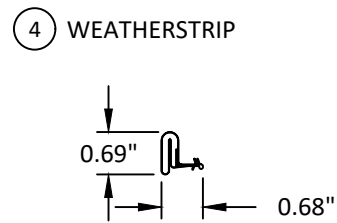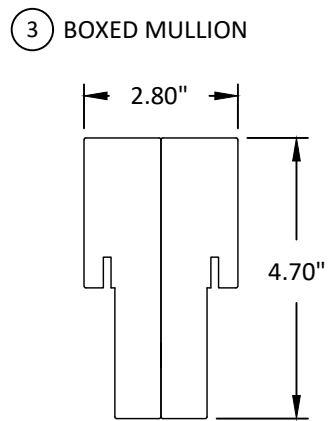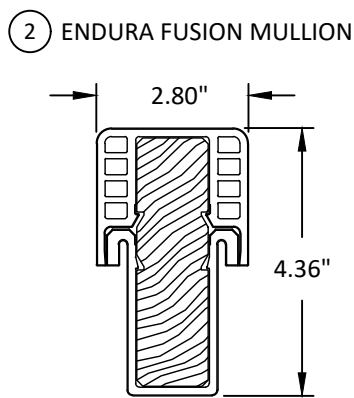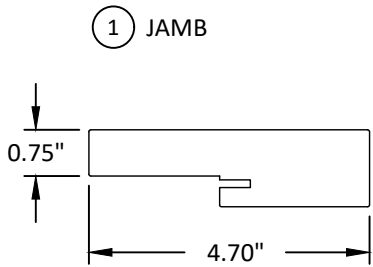

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE: INSWING & OUTSWING FLUSH GLAZED FIBERGLASS DOOR (NON-HVHZ) (NON-IMPACT)

BILL OF MATERIALS & COMPONENTS

PREPARED BY:

ILDING DROPS, INC.

NE MIAMI CT. SUITE 2-15
MIAMI FL 33132

PH: (954)399-8478

FAX: (954) 744.4738
WEB: www.buildingadrons.com



REMARKS	BY	DATE
2026 FBC UPD.	JR	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL47925

DATE: 12.04.2025

DWG. BY:
JR

CHK. BY:
HFN

SCALE: NTS

DWG. #: ODL014

SHEET:

23


REV.

A


OF 24

c:\users\julianarodriguez\building_drops, inc\building drops landing - documents\common\projects\2026 code change projects\odl, inc\cc-26-03-40.1 - 2026 code change.dwg (1/4/25) (odl014 - a.dwg) 8/5/2026 2:45 PM


20 DLP ISCS SILL

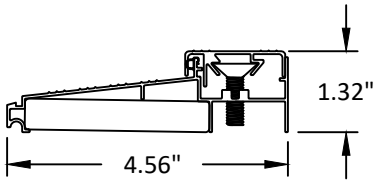


21 DLP ADA ISHC SILL

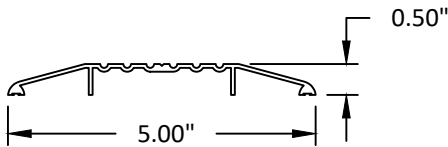


22 DLP DB4565DL SILL

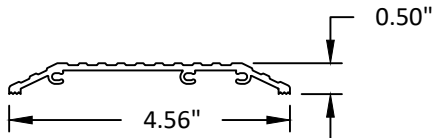


23 ENDURA HC15000 ADA SILL

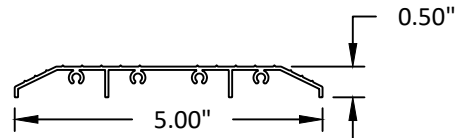


24 ENDURA FOB4565 SILL

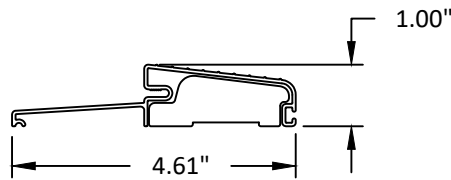


25 ENDURA ZOB4565FN SILL

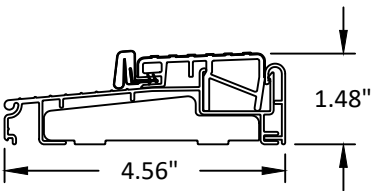


26 AFCO A-117 SILL

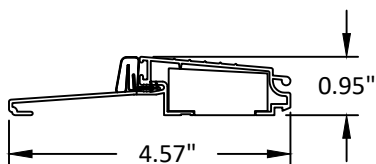


27 AFCO A-276 SILL

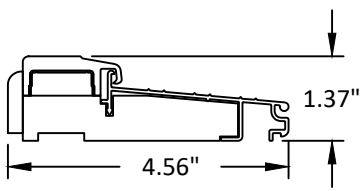


28 AFCO A-204 SILL

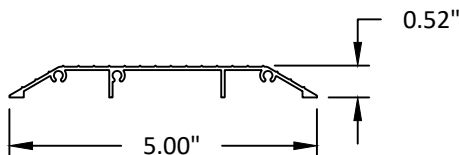


29 AFCO A-204T SILL

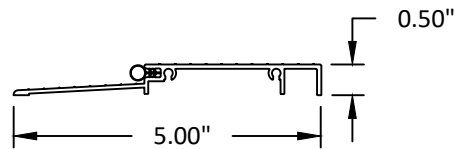


30 ENDURA ZAILAA4565 SILL

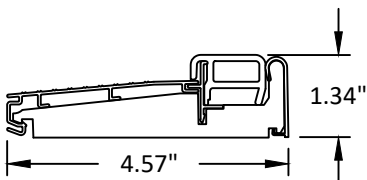


31 ENDURA ZOBL4565 SILL

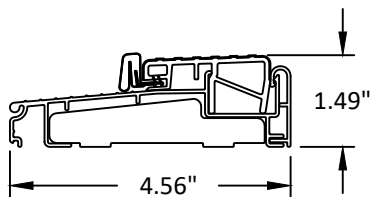


32 AFCO SIDELITE BASE

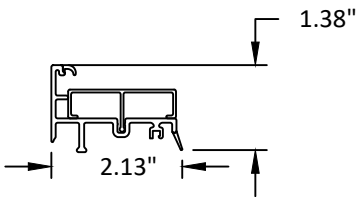


33 ENDURA SIDELITE BASE




34 ENDURA ULTIMATE HURRICANE ASTRAGAL




35 ENDURA ULTIMATE PUSH BUTTON ASTRAGAL




36 PLASTPRO MULLION



37 WOOD PINE MULLION

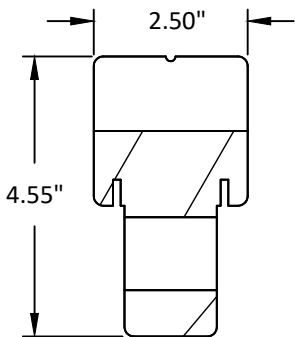

38 ENDURA FRAME SAVER MULLION

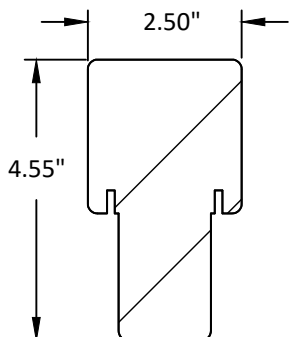

215 EAST ROOSEVELT AVE.,
ZEELAND, MICHIGAN 49464

PH: (800) 253-3900

TITLE:
INSWING & OUTSWING FLUSH
GLAZED FIBERGLASS DOOR
(NON-HVHZ) (NON-IMPACT)

COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS

BY


DATE

2026 FBC UPD.

JR

07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

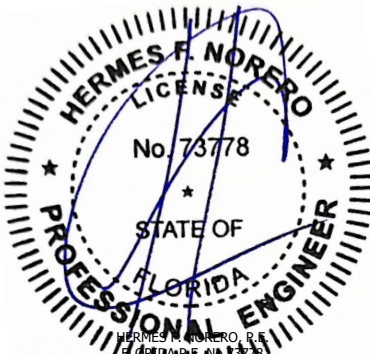

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.

1900 NE MIAMI CT., SUITE 2-15
MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47925

DATE: 12.04.2025

DWG. BY:

JR

CHK. BY:

HFN

SCALE: NTS

DWG. #: ODL014

SHEET:

24

REV.

A

OF 24