


c:\users\jvanhavata\building_drops, inc\building_drops_landing - common\projects\drutex, s.a\fbc-25-0250 - fbc submittal - iglo edge_products\dwgs\iglo edge dual tilt & turn window - nldrw075 - nldwg 12/12/2025 1:32 PM

DRUTEX S.A.

IGLO EDGE DUAL TILT & TURN WINDOW (NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: uPVC
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.
- CUSTOM SIZES AVAILABLE UPON REQUEST. CUSTOM DESIGN PRESSURE WILL BE ASSIGNED EQUAL TO NEXT LARGER STANDARD SIZE.

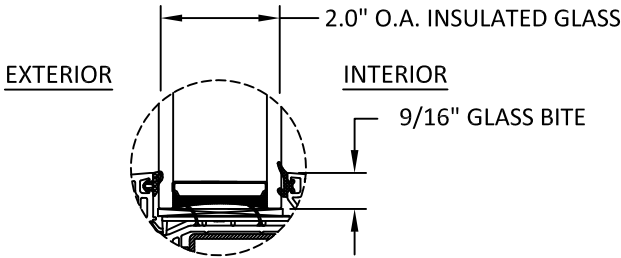

GLAZING DETAIL 1

GLAZING NOTES:

- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION
3	DESIGN PRESSURE TABLE
4	ANCHOR LAYOUT
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS AND INSTALLATION NOTES

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
XX	SEE TABLE ON SHEET 3			-



LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)
GENERAL NOTES &
GLAZING DETAIL


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.12.03 13:45:00'

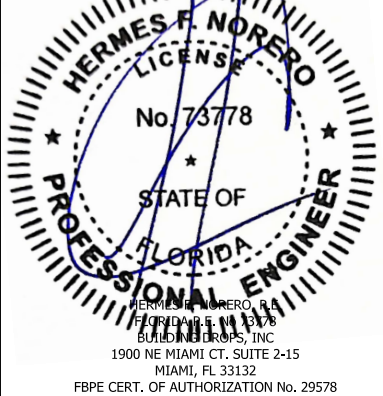

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: **JR**
CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **DRU075**

SHEET:

1

OF 7




c:\users\yvanivata\building_drops, inc\building_drops landing - common\projects\drutex, s.a\bc-25-0250 - fbc submittal - iglo edge products\dwgs\lgl tilt & turn window - nldru075 - nldwg 12/12/2025 1:32 PM

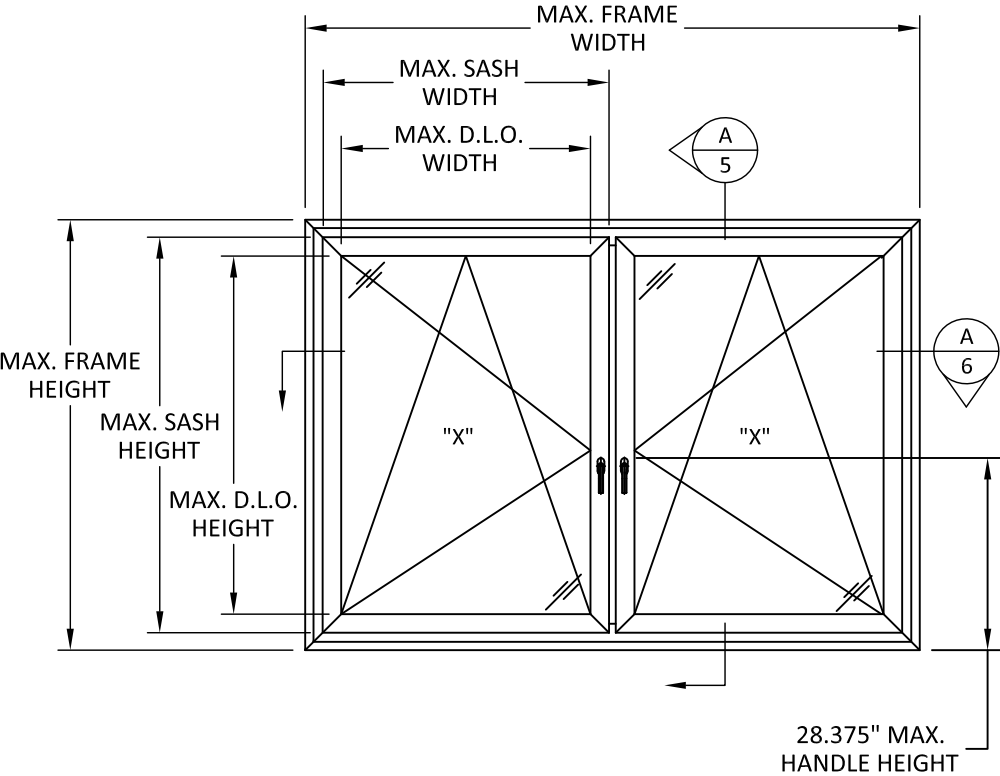

"XX" ELEVATION

SASH HEIGHT = FRAME HEIGHT - 7.825"
SASH WIDTH = FRAME WIDTH/2 - 8.4825"
D.L.O. HEIGHT = FRAME HEIGHT - 8.9375"
D.L.O. WIDTH = FRAME WIDTH/2 - 8.0625"

QUALIFIED
CONFIGURATIONS

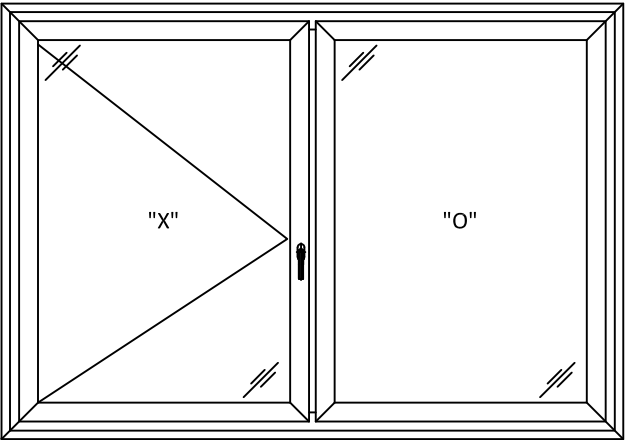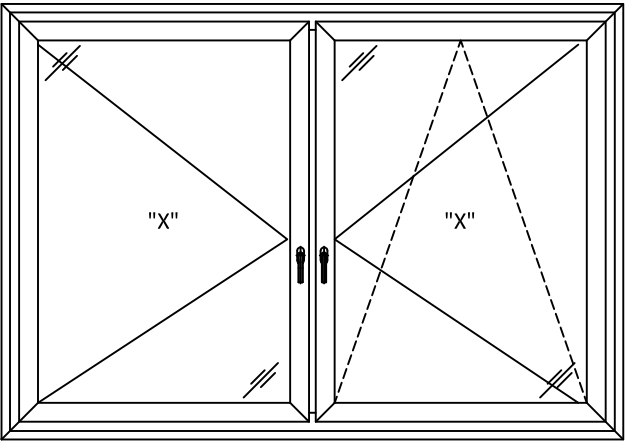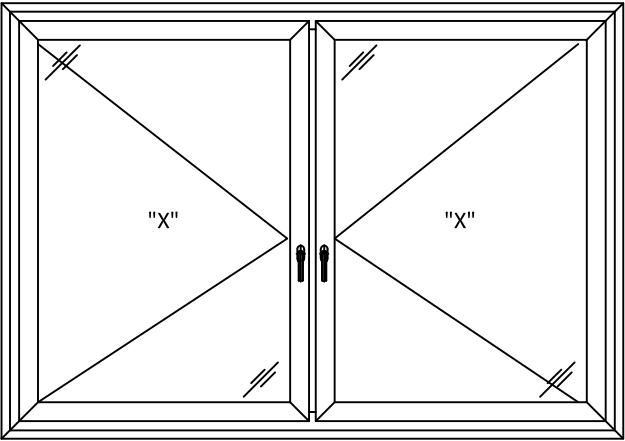

LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)

ELEVATION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

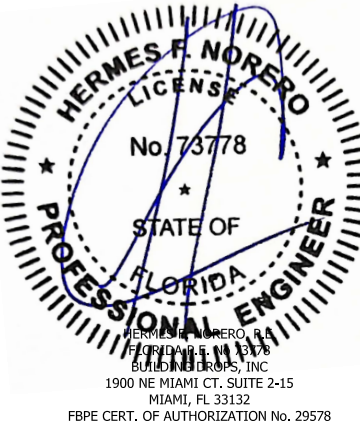

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **DRU075**

SHEET:

2

OF 7

c:\users\jvanivata\building_drops, inc\building_drops landing - common\projects\drutex, s.a\bc-25-0250 - fbc submittal - iglo edge_products\dwgs\iglo tilt & turn window - nldru075 - nldwg 12/12/2025 1:32 PM

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
60	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
66	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
72	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
78	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
84	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
90	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
96	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
100	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
102	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
108	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
114	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
120	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
126	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
132	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
138	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
144	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
150	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
156	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
162	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
168	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
174	30	70.00	70.00
	36	70.00	70.00
180	30	70.00	70.00
	36	70.00	70.00
186	30	70.00	70.00
	36	70.00	70.00
192	30	70.00	70.00
	36	70.00	70.00
198	30	70.00	70.00
	36	70.00	70.00
204	30	70.00	70.00
210	30	70.00	70.00
216	30	70.00	70.00
222	30	70.00	70.00
228	30	70.00	70.00
234	30	70.00	70.00
240	30	70.00	70.00

NOTE: ALL PRESSURES MEET WATER INFILTRATION REQUIREMENTS.



LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)

DESIGN PRESSURE TABLE


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

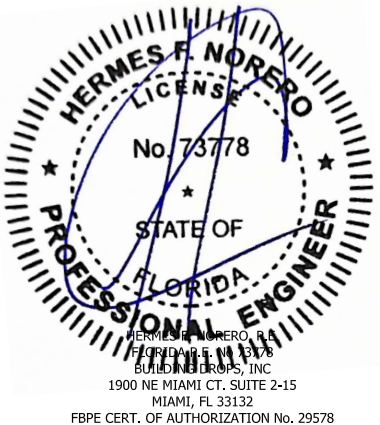

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **DRU075**

SHEET:

3

OF 7

c:\users\jvanivata\building_drops, inc\building_drops landing - common\projects\drutex, s.a\bc-25-0250 - fbc submittal - iglo edge_products\dwgs\ltilt & turn window - nldrw075 - nldwg 12/12/2025 1:32 PM

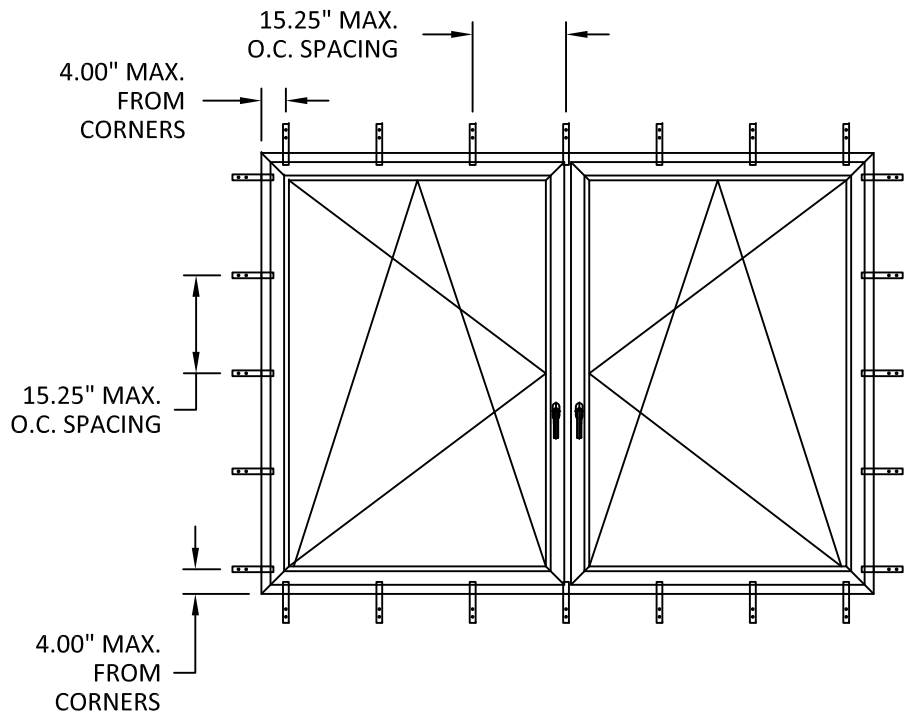

ANCHOR LAYOUT
DUAL TILT & TURN WINDOW - STRAP
INSTALLATION

NOTE: TWO (2) INSTALLATION ANCHORS
PER STRAP LOCATION.



LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)

ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

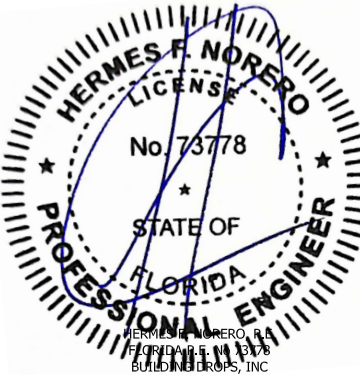

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **DRU075**

SHEET:

4

OF 7

c:\users\jvanitwata\building_drops, inc\building_drops landing - common\projects\drutex, s.a\fbc-25-0250 - fbc submittal - iglo edge_products\dwgs\ltilt & turn window - nldru075 - nldwg 12/12/2025 1:32 PM

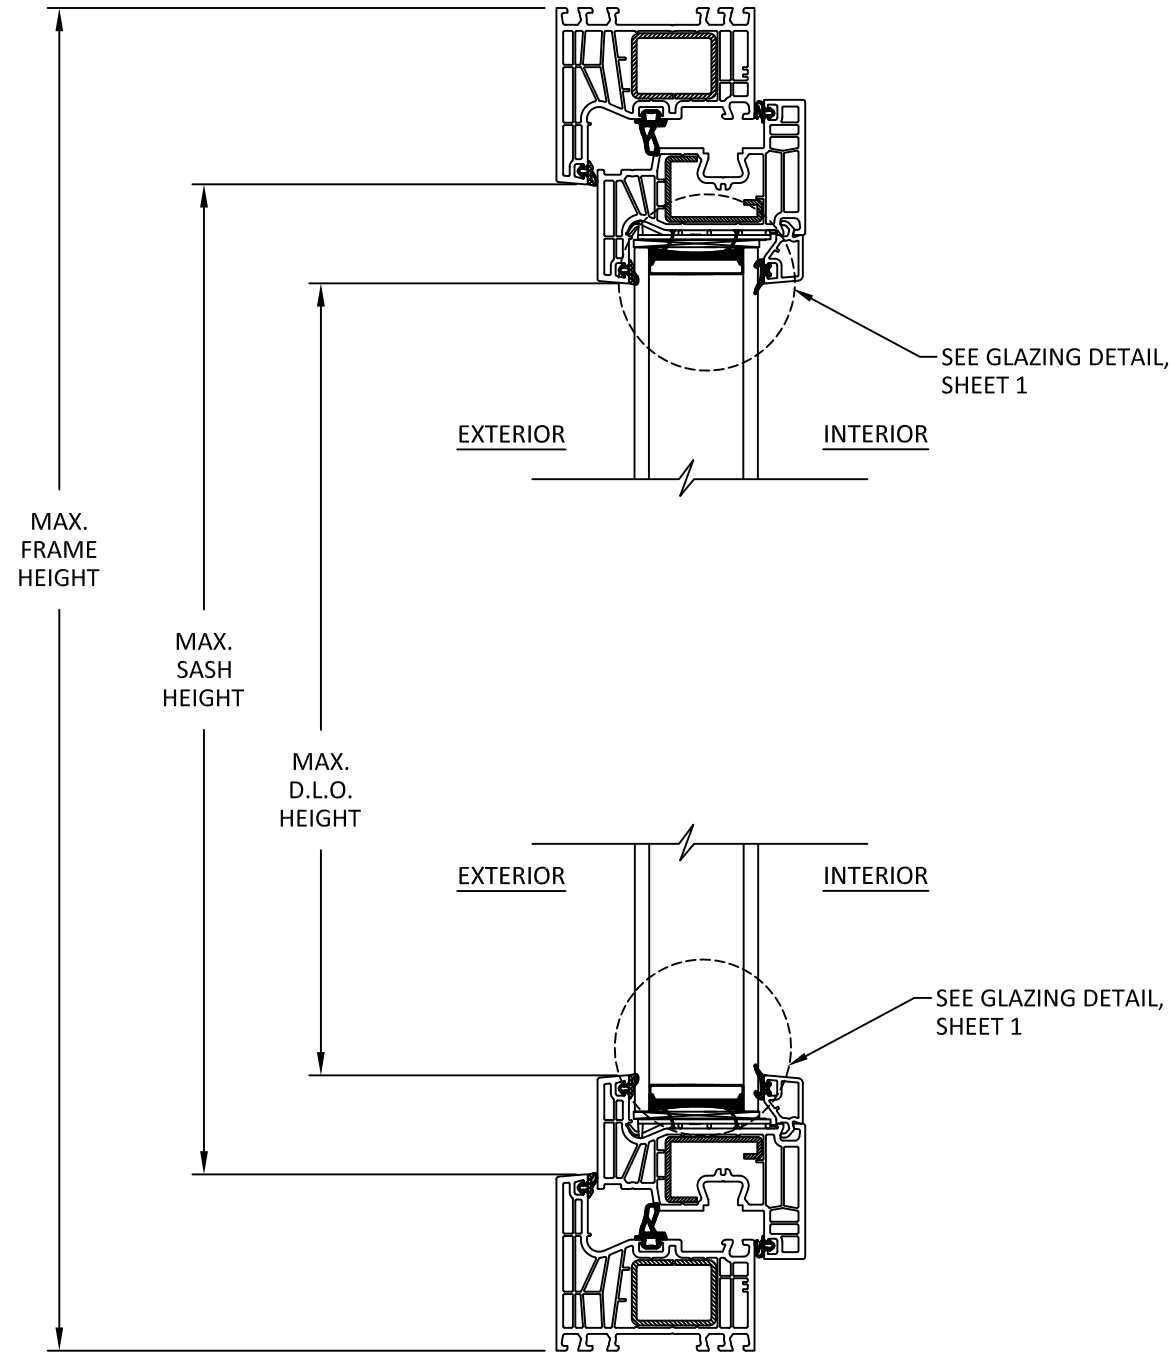

A
5 **VERTICAL SECTION**
TYP. HEAD AND SILL DETAIL



LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

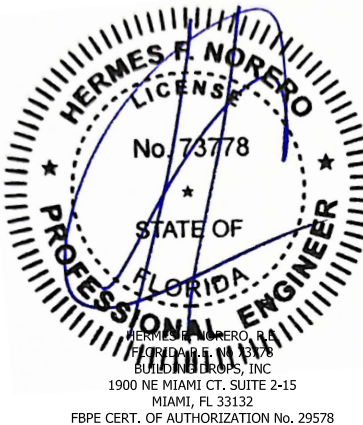

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **DRU075**

SHEET:

5

OF 7

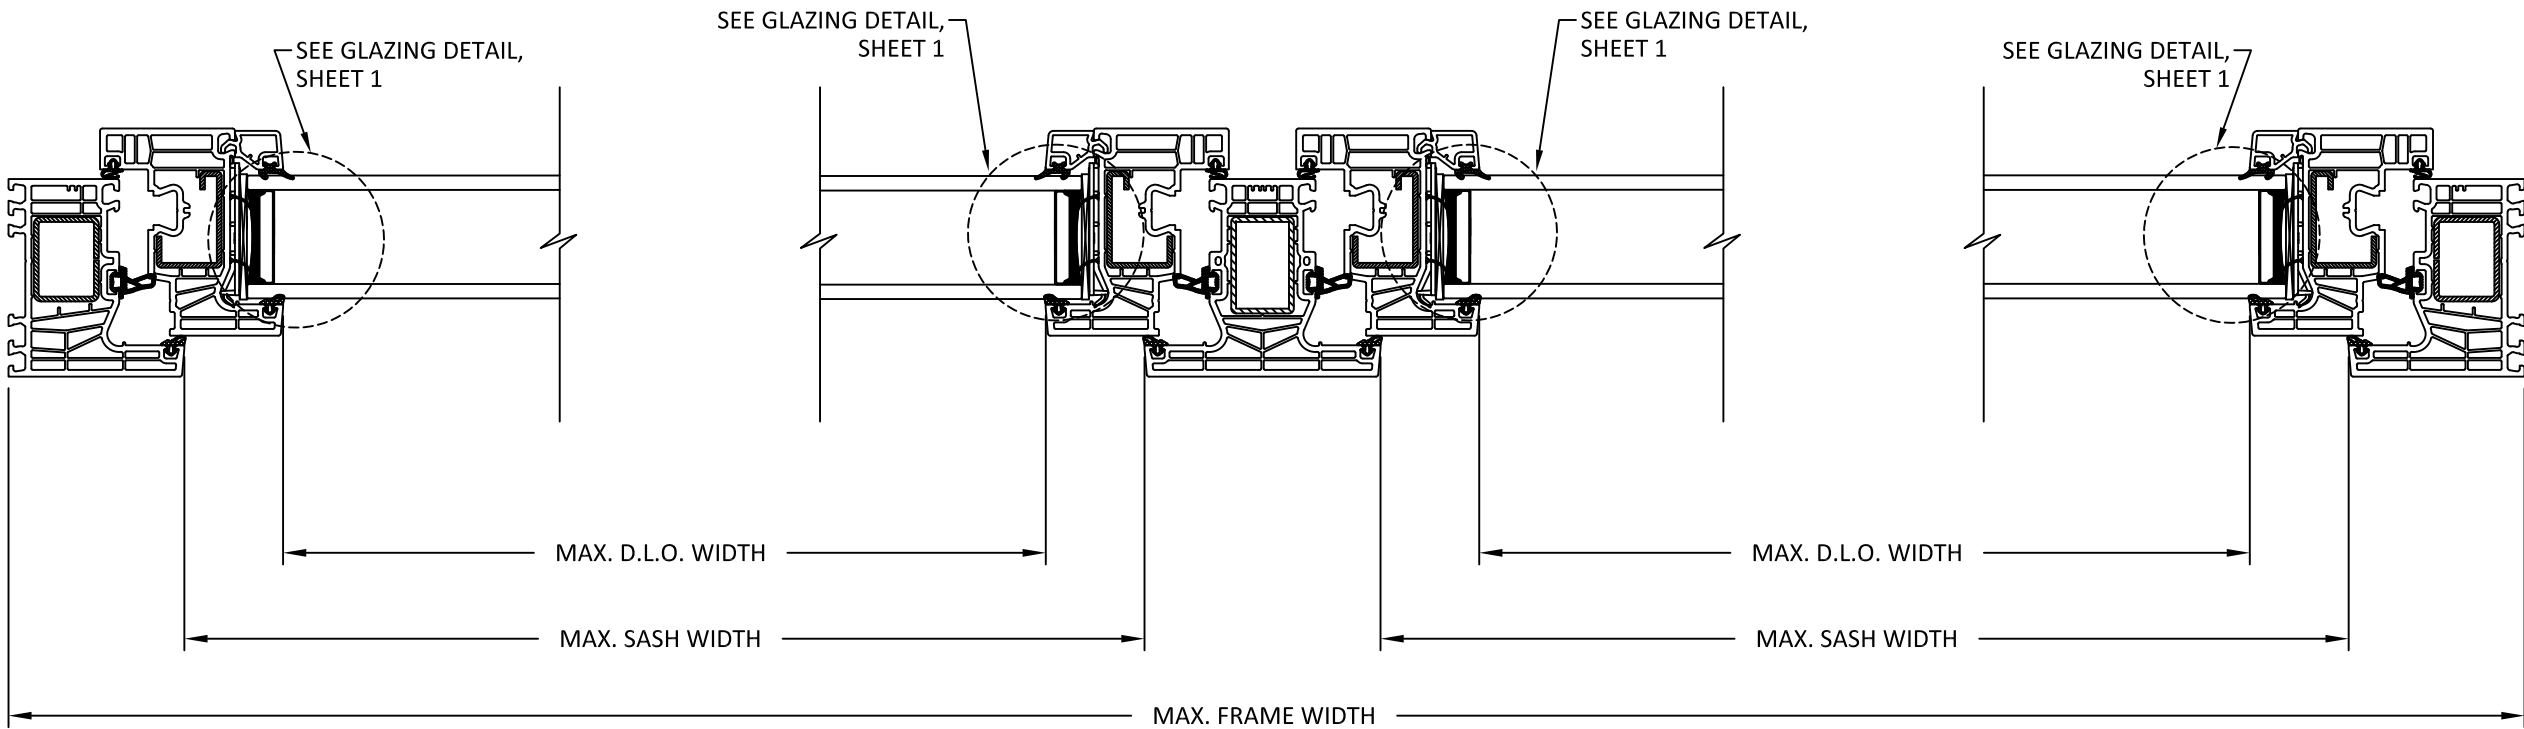

A
6 **HORIZONTAL SECTION**
TYP. JAMB AND MULLION DETAIL



LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

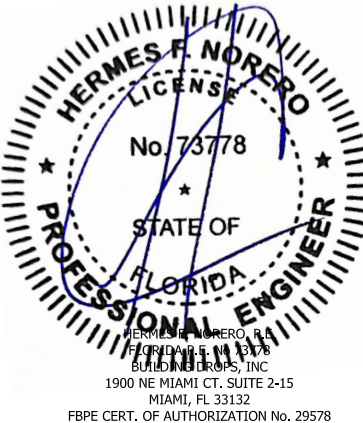

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **DRU075**

SHEET:
6

OF 7

c:\users\jvanivata\building_drops, inc\building_drops landing - common\projects\drutex, s.a\bc-25-0250 - fbc submittal - iglo edge_products\dwgs\iglo tilt & turn window - nldrw075 - nldwg 12/12/2025 1:32 PM

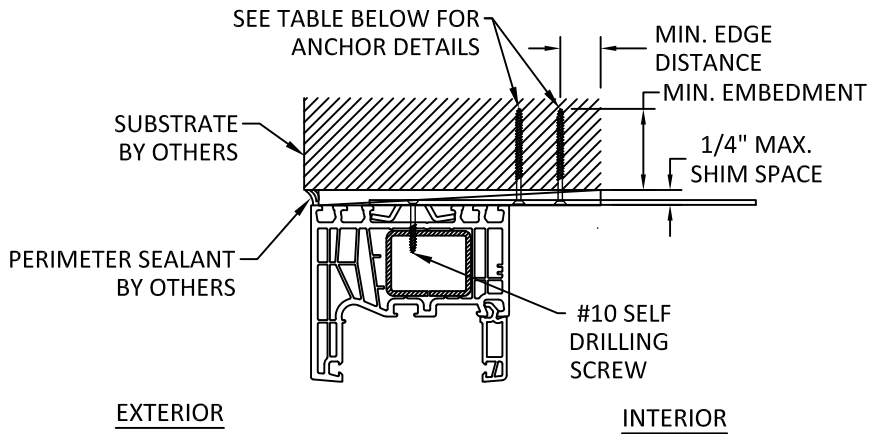

A
7

VERTICAL SECTION

HEAD - STRAP

NOTE: SILL & JAMB SIMILAR

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 4.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1.000 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
STRAP	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON	1.25"	2.00"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"



LEBORSKA 31, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
IGLO EDGE DUAL TILT & TURN
WINDOW (NON-HVHZ) (NON-IMPACT)

ANCHOR DETAILS &
INSTALLATION NOTES


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

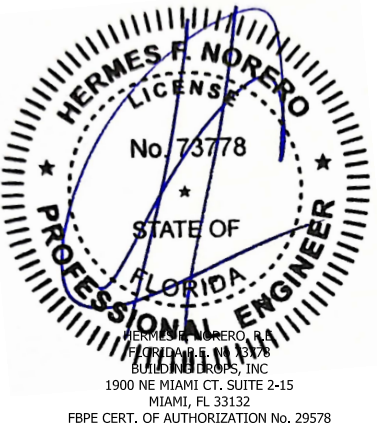

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY:
JR

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **DRU075**

SHEET:

7

OF 7