


DRUTEX S.A.

IGLO EDGE DUAL TILT & TURN WINDOW (WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), INCLUDING WZ3 AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - ASTM E1886-19
 - ASTM E1996-20
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS. THIS PRODUCT **DOES REQUIRE** IMPACT PROTECTIVE SYSTEMS IN HVHZ AND WIND ZONE 4 REGIONS.
7. WINDOW FRAME MATERIAL: uPVC
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

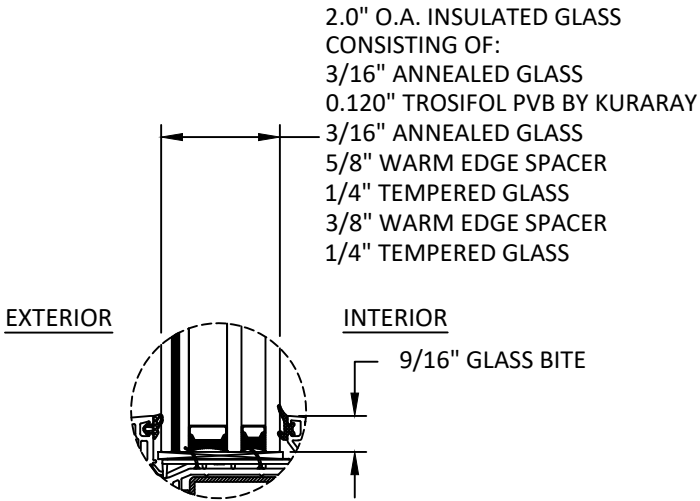

GLAZING DETAIL 1

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION
3	DESIGN PRESSURE TABLE
4	ANCHOR LAYOUT
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS AND INSTALLATION NOTES

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
XX	SEE TABLE ON SHEET 3			LARGE & SMALL MISSILE IMPACT



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: GLO EDGE DUAL TILT & TURN WINDOW (WZ3) (IMPACT)

GENERAL NOTES & GLAZING DETAIL

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.07 10:11:47 -0400

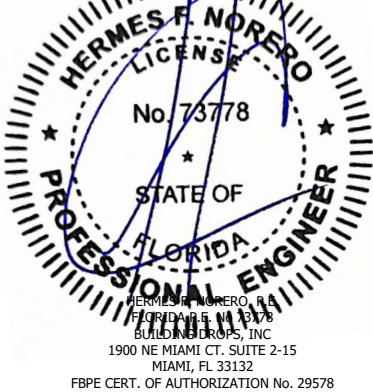

FL #:
FL47928

DATE: **12.03.2025**

DWG. BY: **JR**CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **DRU074**

SHEET:
1

REV. **A**

OF 7




c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg s:\47928-r0\drut074.dwg 7/13/2026 11:18 AM

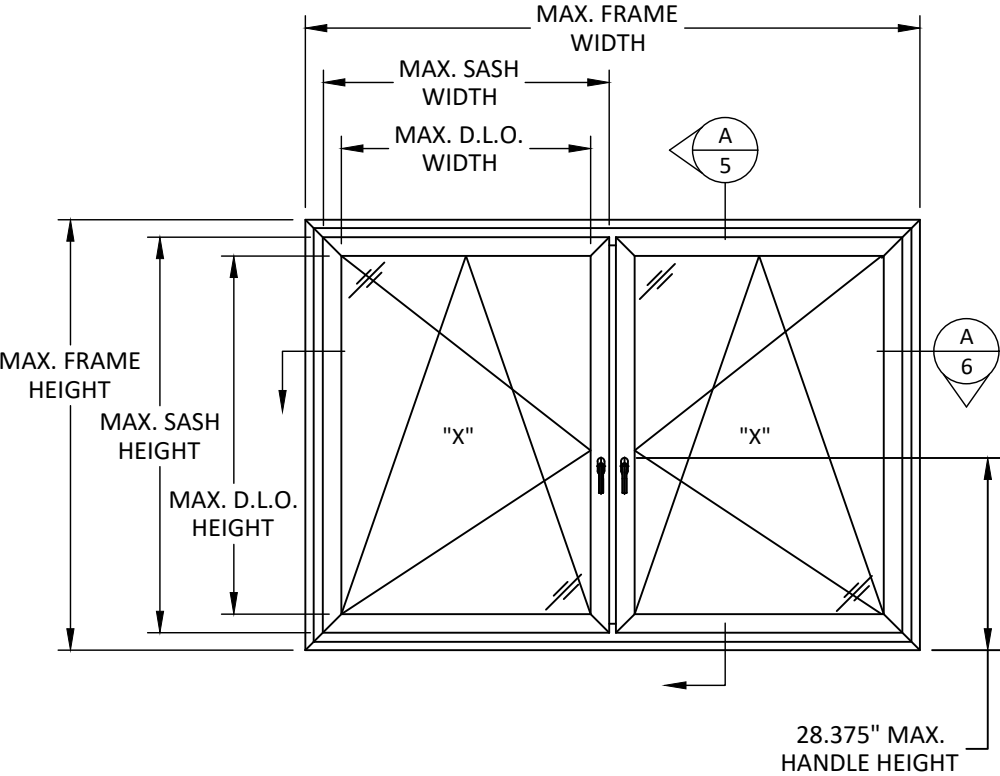

"XX" ELEVATION

SASH HEIGHT = FRAME HEIGHT - 7.825"
SASH WIDTH = FRAME WIDTH/2 - 8.4825"
D.L.O. HEIGHT = FRAME HEIGHT - 8.9375"
D.L.O. WIDTH = FRAME WIDTH/2 - 8.0625"

QUALIFIED CONFIGURATIONS

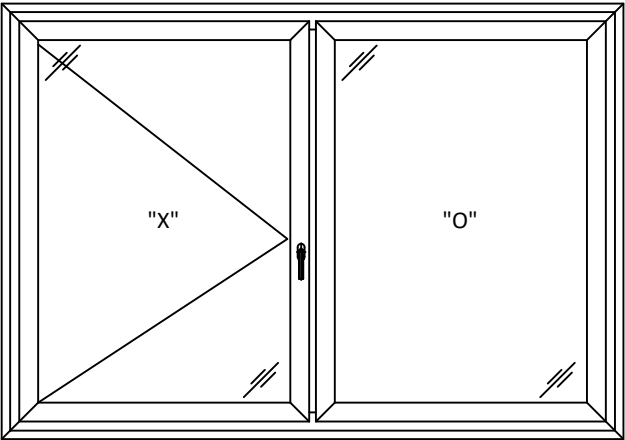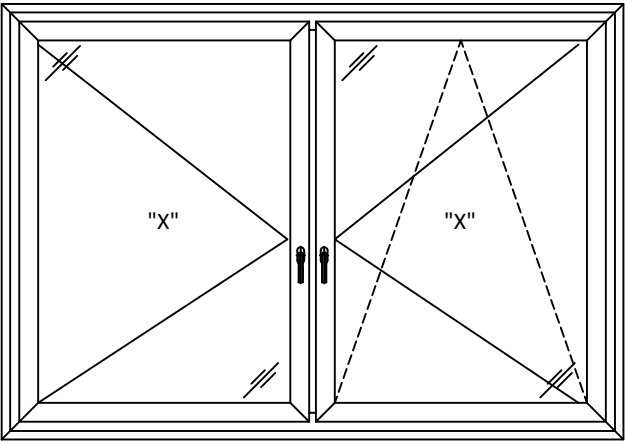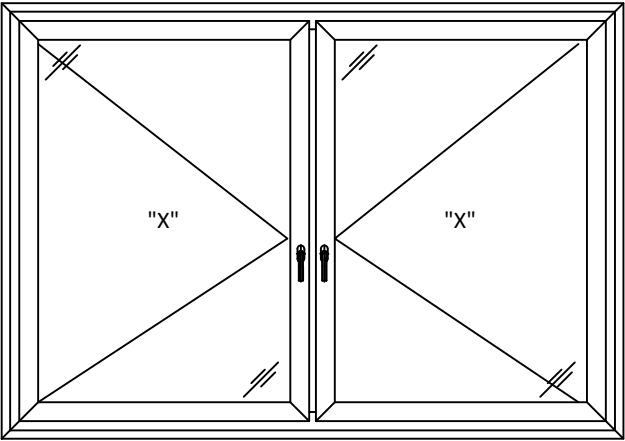

LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: GLO EDGE DUAL TILT & TURN WINDOW (WZ3) (IMPACT)

ELEVATION

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47928
DATE:	12.03.2025
DWG. BY: JR	CHK. BY: HFN
SCALE:	NTS
DWG. #:	DRU074
SHEET:	2
REV.	A

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg s\47928-r0\dr074.dwg 7/13/2026 11:18 AM

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
60	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
66	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
72	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
78	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
84	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
90	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
96	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
100	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
102	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00
108	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
	66	70.00	70.00
	72	70.00	70.00

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
114	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
120	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
126	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
132	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
	54	70.00	70.00
	60	70.00	70.00
138	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
144	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
150	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
	48	70.00	70.00
156	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
162	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
168	30	70.00	70.00
	36	70.00	70.00
	42	70.00	70.00
174	30	70.00	70.00
	36	70.00	70.00
180	30	70.00	70.00
	36	70.00	70.00
186	30	70.00	70.00
	36	70.00	70.00
192	30	70.00	70.00
	36	70.00	70.00
198	30	70.00	70.00
	36	70.00	70.00
204	30	70.00	70.00
210	30	70.00	70.00
216	30	70.00	70.00
222	30	70.00	70.00
228	30	70.00	70.00
234	30	70.00	70.00
240	30	70.00	70.00

NOTE: ALL PRESSURES MEET WATER INFILTRATION REQUIREMENTS.



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: GLO EDGE DUAL TILT & TURN WINDOW (WZ3) (IMPACT)

DESIGN PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

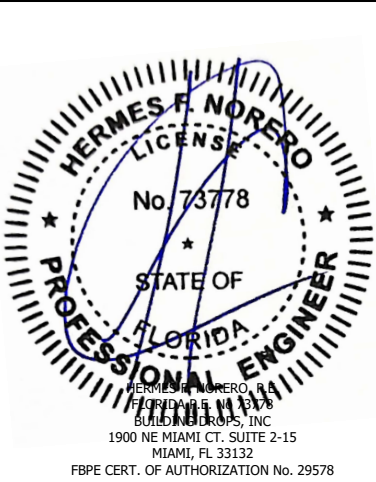

FL #: **FL47928**

DATE: **12.03.2025**

DWG. BY: **JR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **DRU074**

SHEET: **3** REV. **A**

OF 7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg(147928-r0)dru074.dwg 7/13/2026 11:18 AM

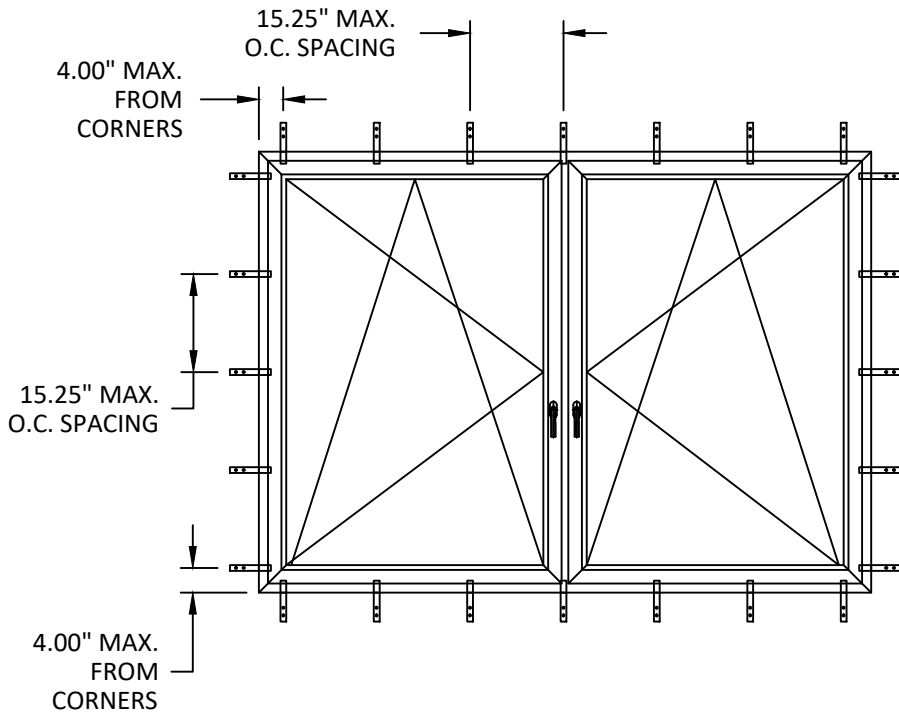

ANCHOR LAYOUT
DUAL TILT & TURN WINDOW - STRAP
INSTALLATION

NOTE: TWO (2) INSTALLATION ANCHORS
PER STRAP LOCATION.



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: /GLO EDGE DUAL TILT & TURN WINDOW (WZ3) (IMPACT)

ANCHOR LAYOUT

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.

FLORIDA PROFESSIONAL ENGINEER

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47928**

DATE: **12.03.2025**

DWG. BY: **JR**

CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **DRU074**

SHEET: **4**

REV. **A**

OF 7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg(47928-r0)dru074.dwg 7/13/2026 11:18 AM

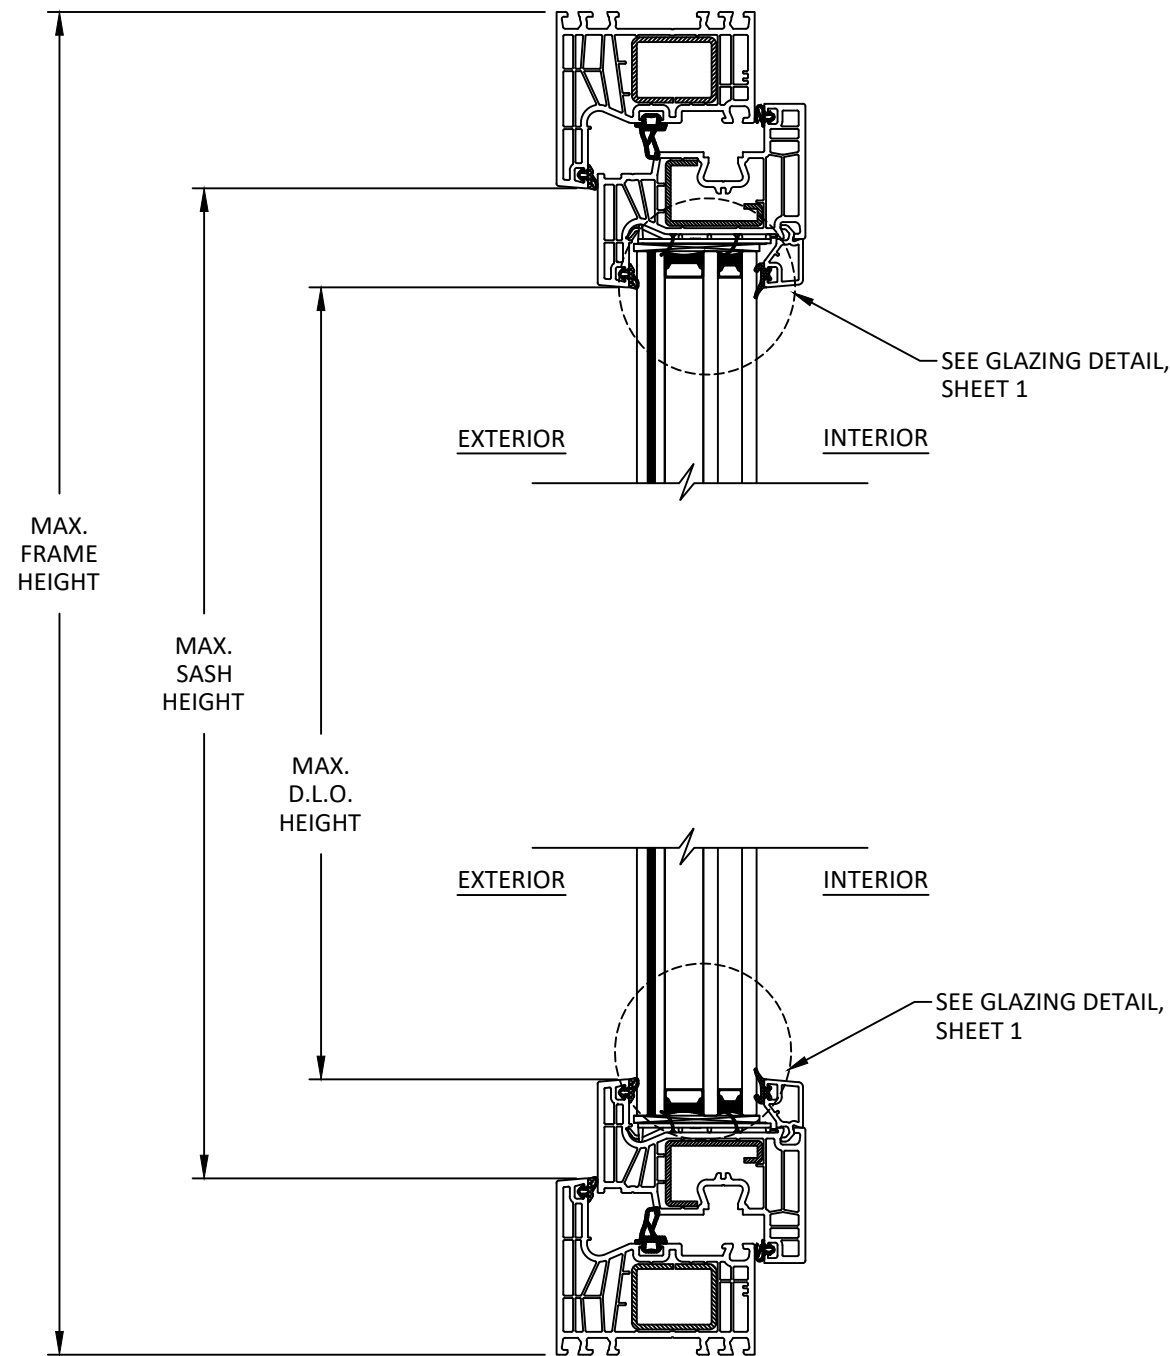

A
5 **VERTICAL SECTION**
TYP. HEAD AND SILL DETAIL



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: /GLO EDGE DUAL TILT & TURN
WINDOW (WZ3) (IMPACT)

VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744.4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

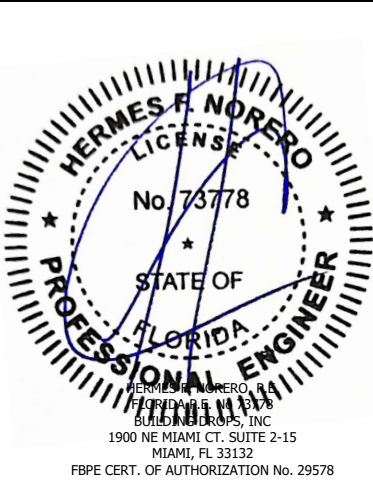

FL #:		FL47928
DATE:		12.03.2025
DWG. BY:	CHK. BY:	
JR	HFN	
SCALE:		NTS
DWG. #:		DRU074
SHEET:	REV.	
5	A	
OF 7		

FILE: IGLO EDGE DUAL TILT & TURN
WINDOW (WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954)399-8478
FAX: (954)744.4738

WEB: www.buildingdrops.com



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



DATE: 12.03.2025

CHK. BY:
HFN


DWG. #: DRU074

REV.

A

OF 7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg(147928-r0)dru074.dwg 7/13/2026 11:18 AM

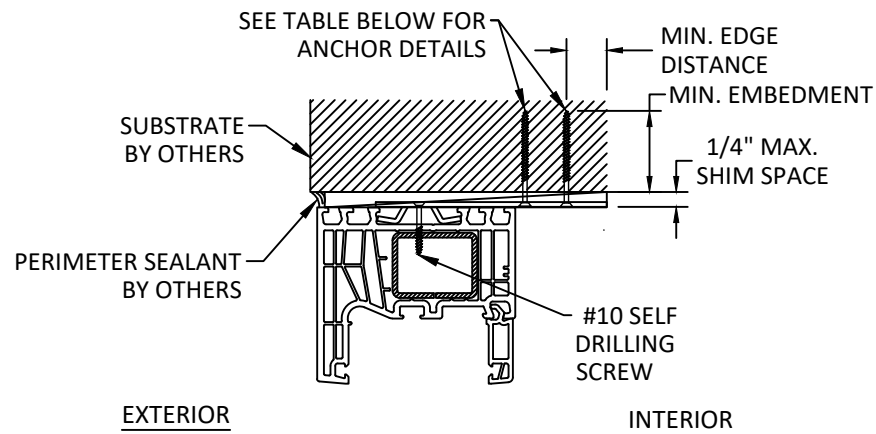

A
7

VERTICAL SECTION
HEAD - STRAP

NOTE: SILL & JAMB SIMILAR

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN EMBEDMENT	MIN. EDGE DISTANCE
STRAP	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON	1.25"	2.00"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: /GLO EDGE DUAL TILT & TURN
WINDOW (WZ3) (IMPACT)

ANCHOR DETAILS &
INSTALLATION NOTES

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

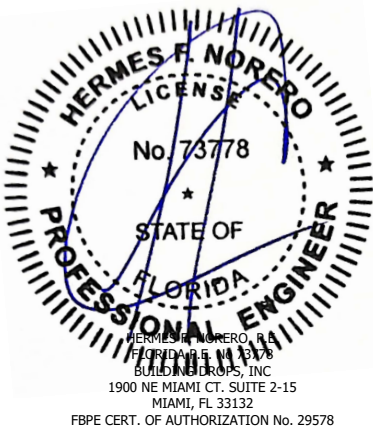

FL #:	FL47928
DATE:	12.03.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	DRU074
SHEET:	7
REV.	A
OF 7	