


ARCADIA CUSTOM

T225 - OUTSWING FRENCH/SINGLE DOOR (WZ4) (IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-22
 - ASTM E283/E283M-19
 - ASTM E330/E330M-14(21)
 - ASTM E331-00(23)
 - ASTM E1886-19
 - ASTM E1996-23
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- FRAME MATERIAL: ALUMINUM (MIN. 6063-T5).
- ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
- GLASS MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

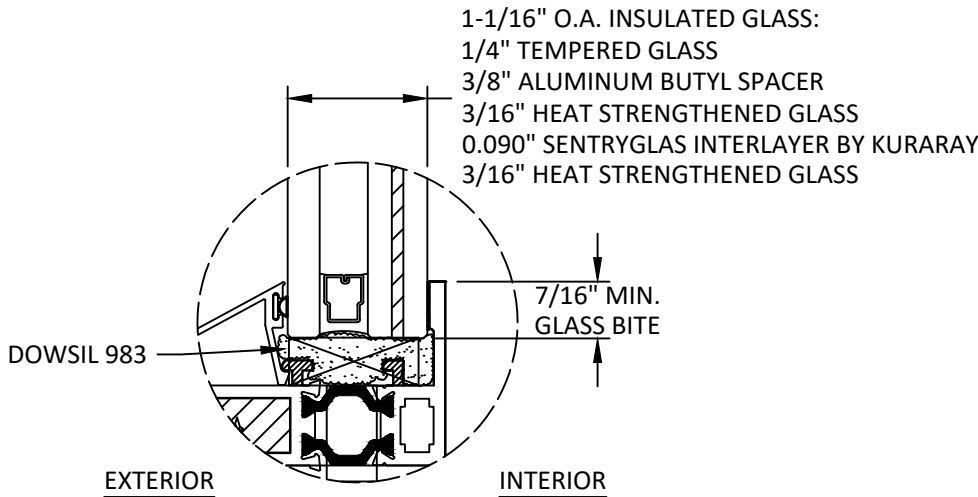

GLAZING DETAIL

GLAZING NOTES:

- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN SHEET 2.

TABLE OF CONTENTS

SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	TYPICAL ELEVATIONS AND DESIGN PRESSURE TABLE
3	TYPICAL ELEVATIONS
4	ANCHOR LAYOUTS
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	INSTALLATION DETAILS
8	INSTALLATION NOTES & ANCHOR SCHEUDLE

DESIGN PRESSURE RATING

FRAME SIZE	DESIGN PRESSURE	MISSILE RATING
SEE SHEET 2		LARGE AND SMALL MISSILE IMPACT



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225 - OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

GENERAL NOTES & GLAZING DETAIL

PREPARED BY:


BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.


Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.06 17:45:44 -07'00'

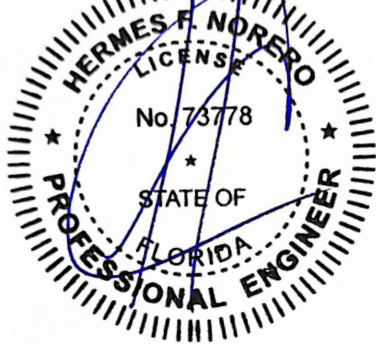

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47937
DATE:	11.18.2025
DWG. BY:	CHK. BY:
MS	HFN
SCALE:	NTS
DWG. #:	ADC023
SHEET:	REV.
1	A

c:\users\harley\pnt\building drops, inc\building drops landing - common\projects\2026 code change projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\1147937\adc023-a.dwg 10/1/2026 9:58 AM


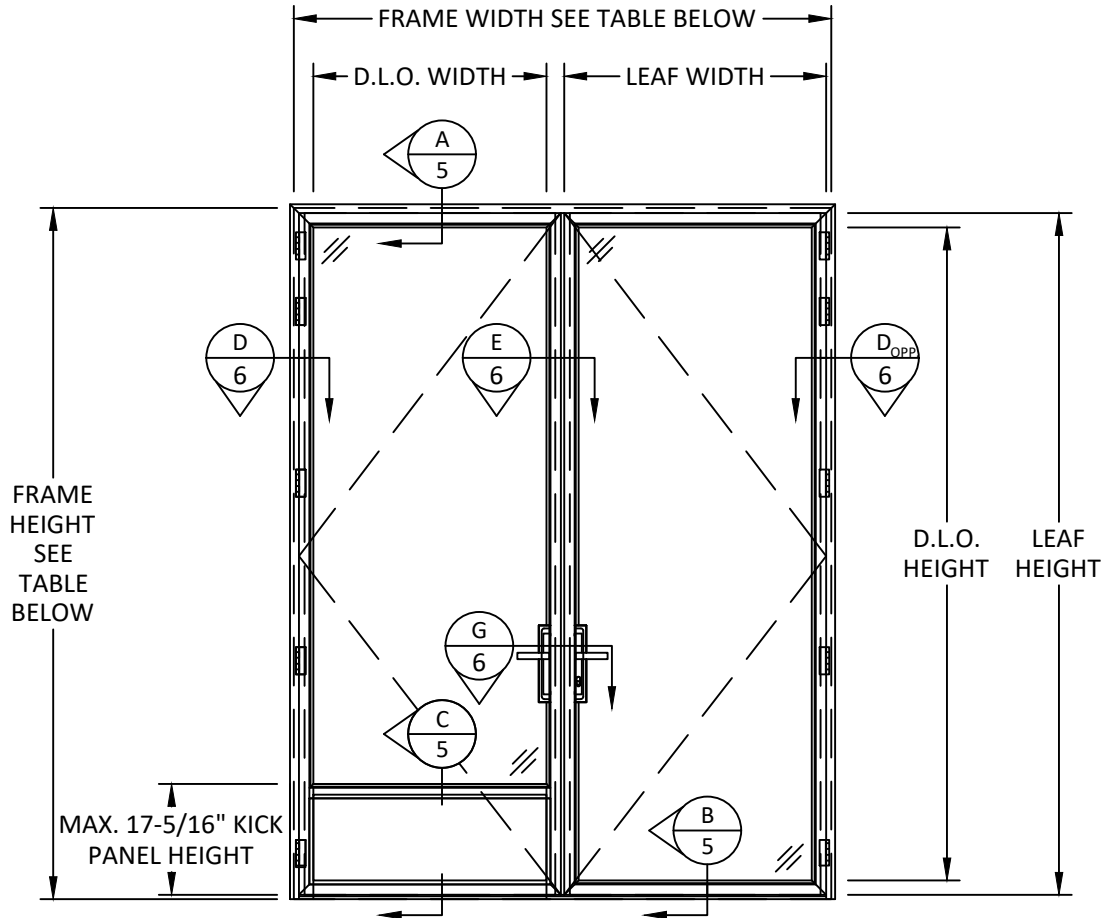


TYPICAL ELEVATION
FRENCH DOOR

DESIGN PRESSURE TABLE (+/- PSF) - FRENCH DOOR											
FRAME HEIGHT (IN.)	FRAME WIDTH (IN.)										
	48	54	60	66	72	78	84	90	96	102	108
80	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	40.51	31.61	25.03
84	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	40.51	31.61	-
90	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	40.51	-	-
96	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	-	-	-
102	70.00	70.00	70.00	70.00	70.00	70.00	70.00	-	-	-	-
108	70.00	70.00	70.00	70.00	70.00	70.00	70.00	-	-	-	-

NOTE:

- ADDITIONAL HINGES AND LOCK POINTS SHALL BE REQUIRED FOR DOOR TALLER THAN 108" TO MAINTAIN THE SAME MAXIMUM SPACING BETWEEN HINGES AND LOCK POINTS AS THE 108" TALL DOOR.
- IN AREAS THAT REQUIRE WATER INFILTRATION, THE DOOR IS LIMITED FOR A MAXIMUM DESIGN PRESSURE OF THE LESSER VALUE BETWEEN +50/-70 PSF AND VALUES IN THE TABLES ON THIS SHEET.
- WHEN THE PRODUCT IS INSTALLED IN AREAS DON'T REQUIRE WATER INFILTRATION OR IS PROTECTED BY OVERHANG SUCH THAT OVERHANG (OH) RATIO (OH LENGTH ÷ OH HEIGHT) ≥ 1.0, THE DESIGN PRESSURE IS NOT LIMITED.

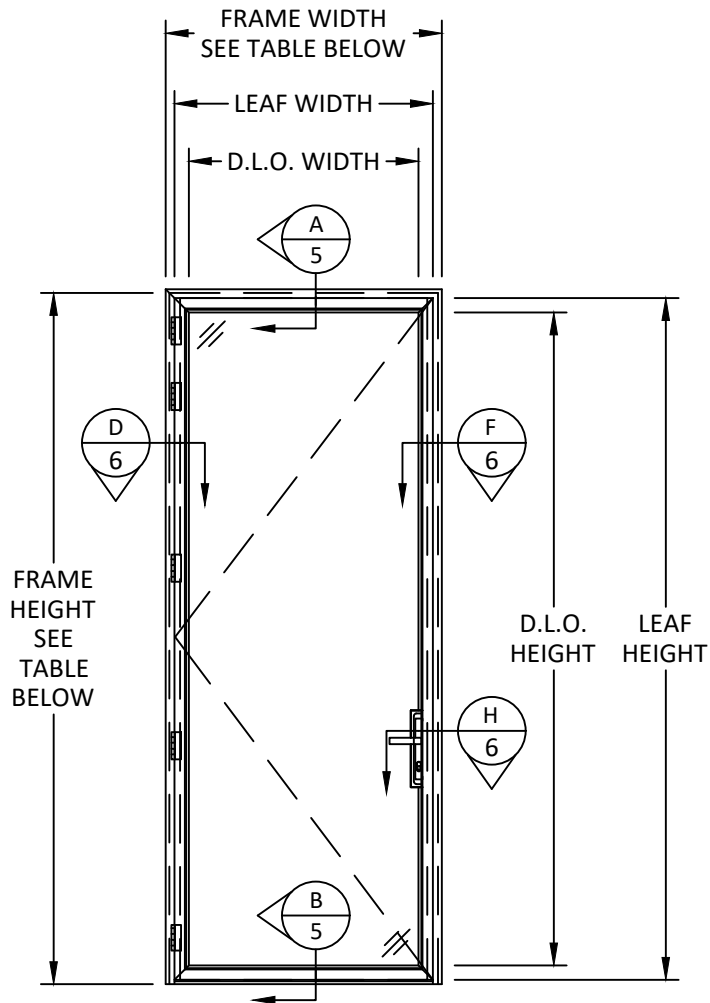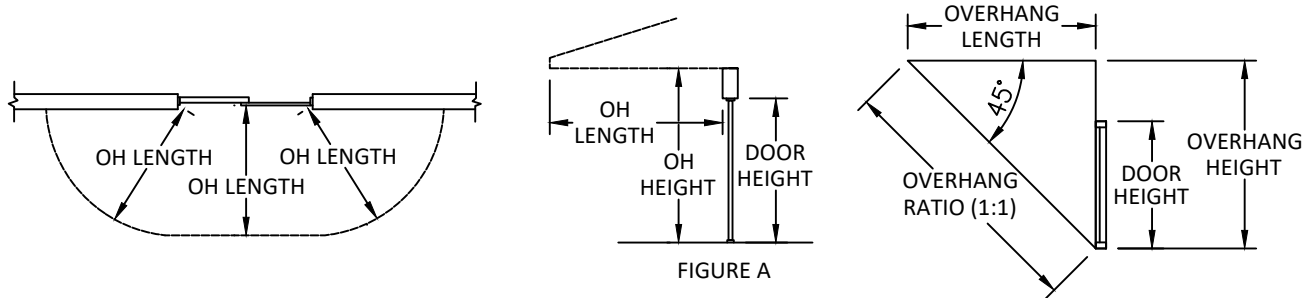

TYPICAL ELEVATION
SINGLE DOOR

DESIGN PRESSURE TABLE (+/- PSF) - SINGLE DOOR											
FRAME HEIGHT (IN.)	FRAME WIDTH (IN.)										
	24	27	30	33	36	39	42	45	48	51	54
80	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	40.51	31.61	25.03
84	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	40.51	31.61	-
90	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	40.51	-	-
96	70.00	70.00	70.00	70.00	70.00	70.00	70.00	52.75	-	-	-
102	70.00	70.00	70.00	70.00	70.00	70.00	70.00	-	-	-	-
108	70.00	70.00	70.00	70.00	70.00	70.00	70.00	-	-	-	-
114	70.00	70.00	70.00	70.00	70.00	70.00	-	-	-	-	-
120	70.00	70.00	70.00	70.00	70.00	-	-	-	-	-	-
126	70.00	70.00	70.00	70.00	70.00	-	-	-	-	-	-
132	70.00	70.00	70.00	70.00	-	-	-	-	-	-	-
138	70.00	70.00	70.00	70.00	-	-	-	-	-	-	-
144	70.00	70.00	70.00	-	-	-	-	-	-	-	-
156	70.00	70.00	70.00	-	-	-	-	-	-	-	-
168	70.00	70.00	-	-	-	-	-	-	-	-	-

LEAF HEIGHT = FRAME HEIGHT - 1 15/32"
FRENCH DOOR LEAF WIDTH = FRAME WIDTH/2 - 1 1/16"
SINGLE DOOR LEAF WIDTH = FRAME WIDTH - 1 5/8"

D.L.O. HEIGHT = FRAME HEIGHT - 5 31/32"
FRENCH DOOR D.L.O. WIDTH = FRAME WIDTH/2 - 5 9/16"
SINGLE DOOR D.L.O. WIDTH = FRAME WIDTH - 6 1/8"



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225 - OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

TYPICAL ELEVATIONS &
DESIGN PRESSURE TABLE


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

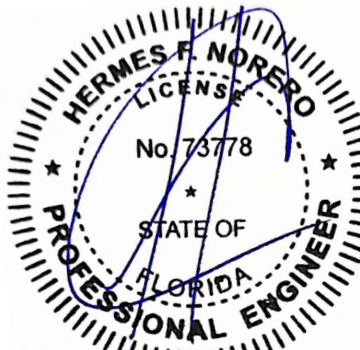


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47937
DATE:	11.18.2025
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ADC023
SHEET:	2
REV.	A


c:\users\harley\appdata\local\temp\building drops, inc\building drops landing - common\projects\2026 code change projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\1147937\adc023-a.dwg 10/1/2026 9:58 AM

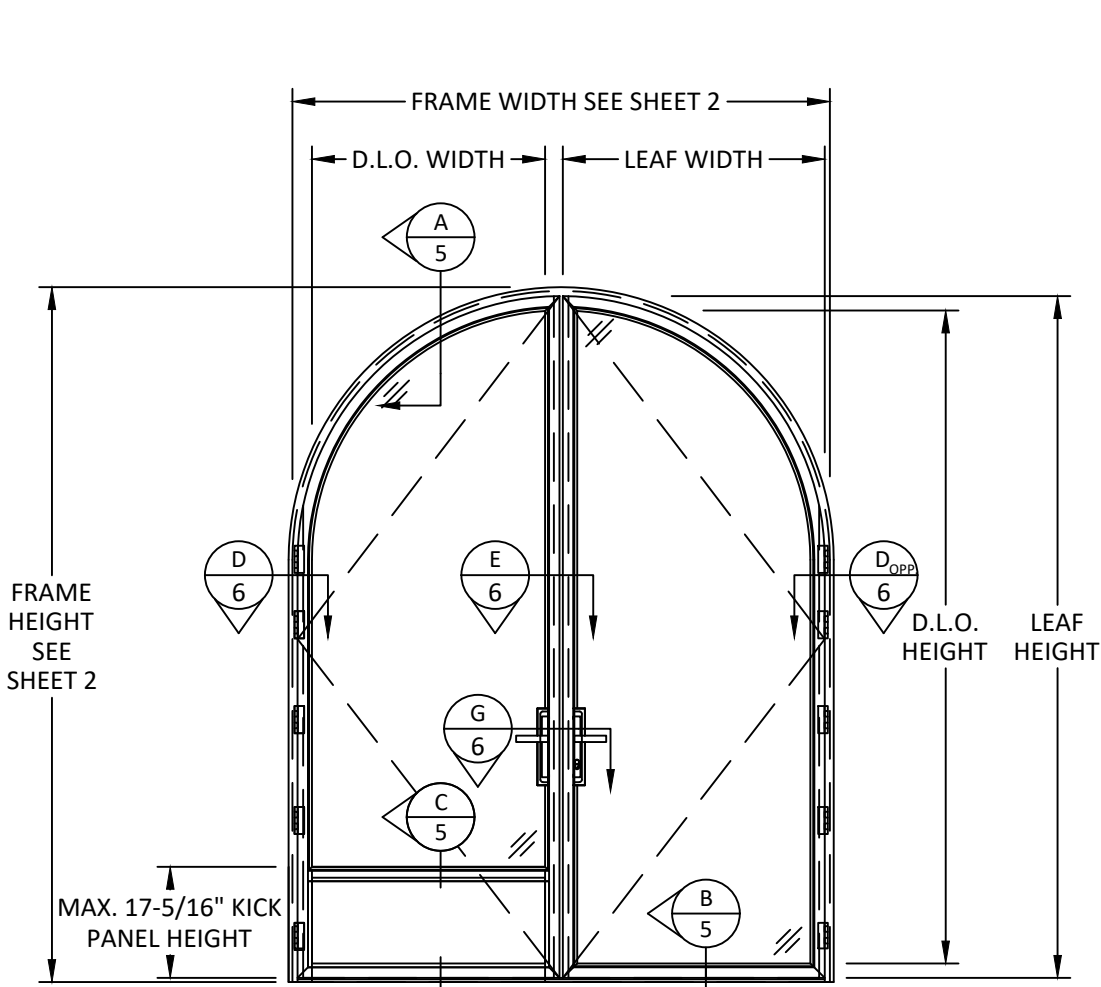


TYPICAL ELEVATION
FRENCH DOOR, ROUND TOP

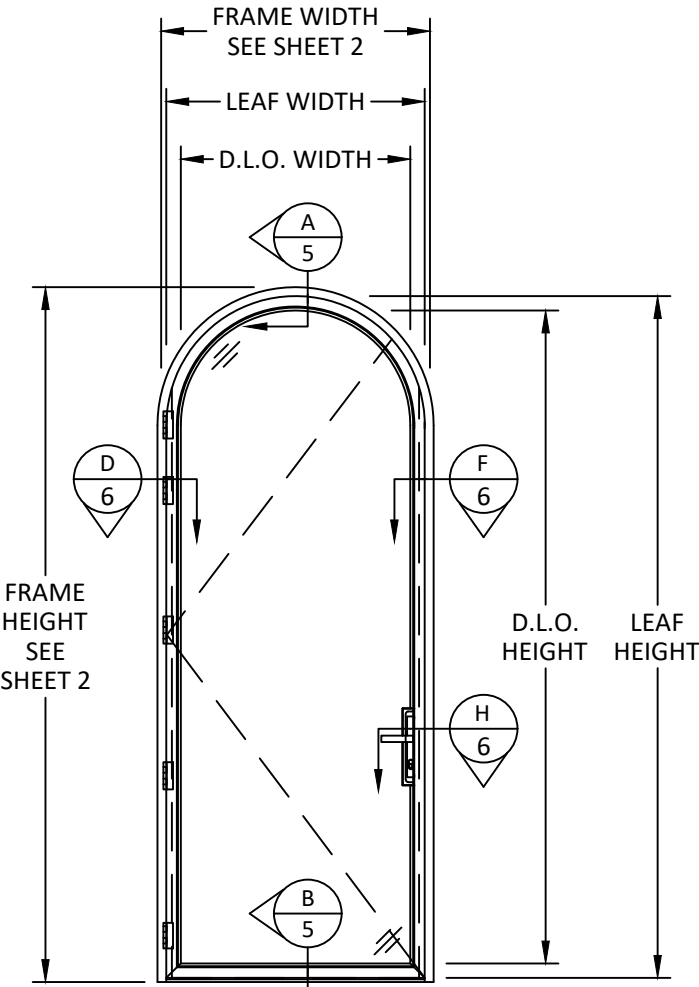

TYPICAL ELEVATION
SINGLE DOOR, ROUND TOP

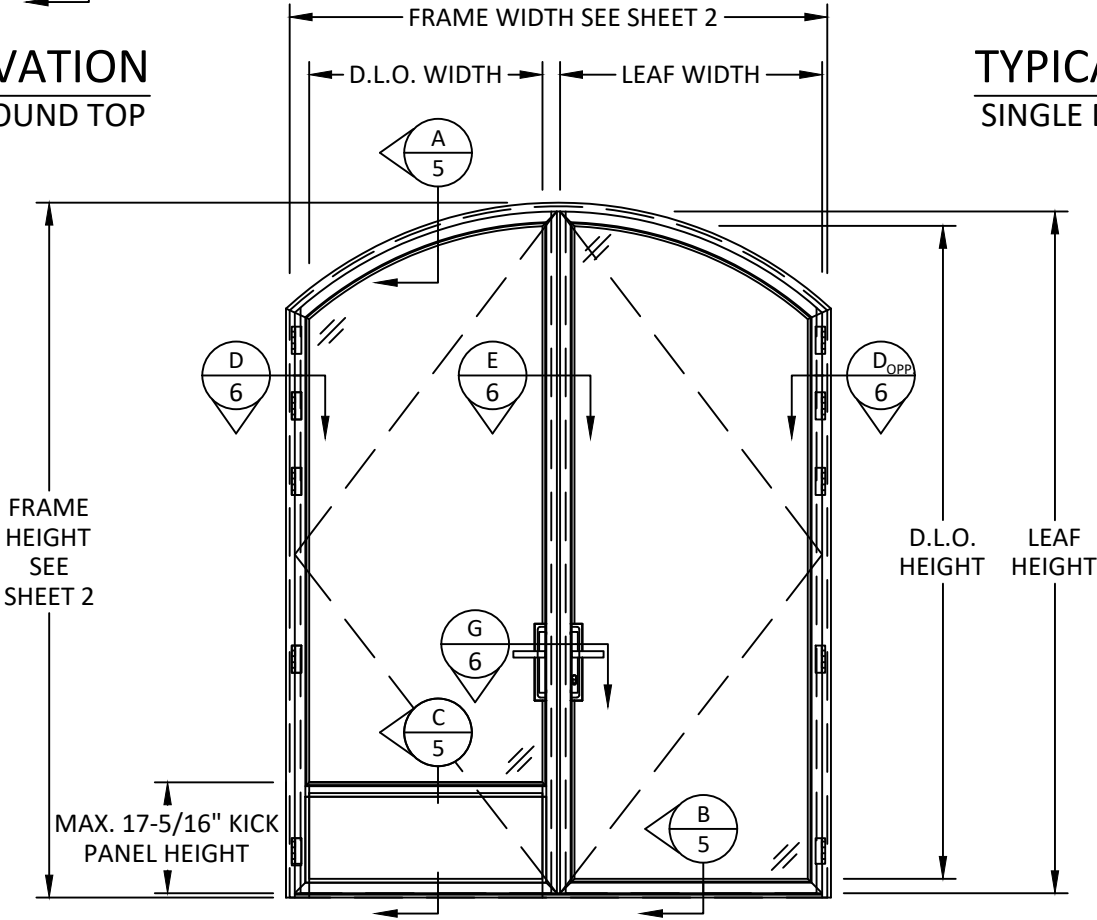

TYPICAL ELEVATION
FRENCH DOOR, ARCH TOP

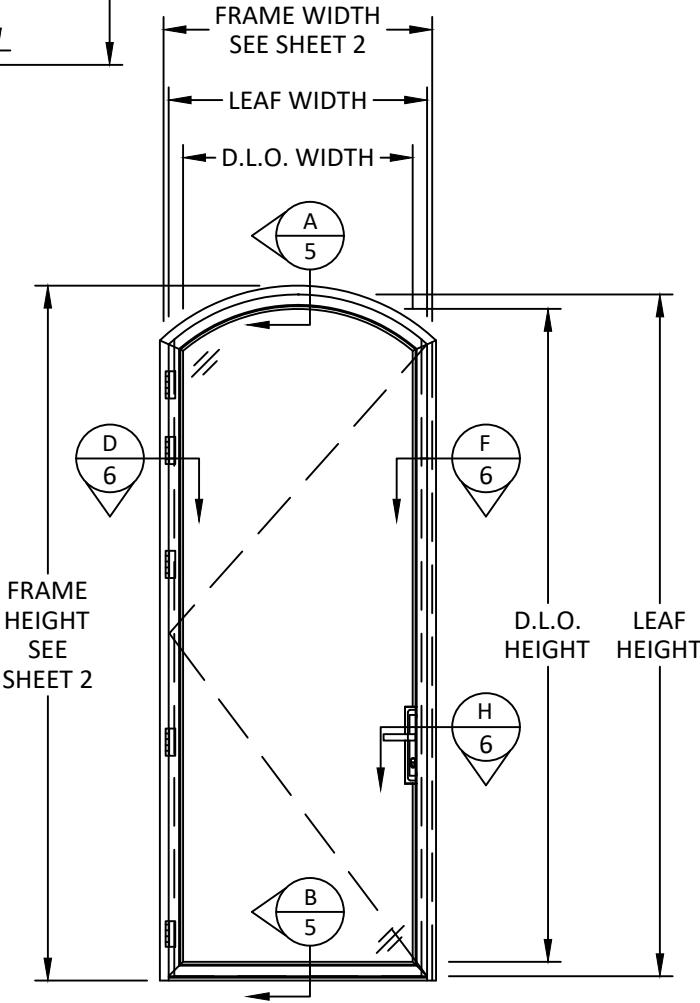

TYPICAL ELEVATION
SINGLE DOOR, ARCH TOP

LEAF HEIGHT = FRAME HEIGHT - 1 15/32"
FRENCH DOOR LEAF WIDTH =
FRAME WIDTH/2 - 1 1/16"
SINGLE DOOR LEAF WIDTH =
FRAME WIDTH - 1 5/8"

D.L.O. HEIGHT = FRAME HEIGHT - 5 31/32"
FRENCH DOOR D.L.O. WIDTH =
FRAME WIDTH/2 - 5 9/16"
SINGLE DOOR D.L.O. WIDTH =
FRAME WIDTH - 6 1/8"



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225- OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

TYPICAL ELEVATIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

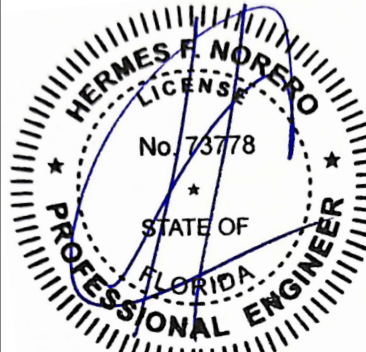


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47937
DATE:	11.18.2025
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ADC023
SHEET:	3
REV.	A


c:\users\harley\my\building drops, inc\building drops landing - common\projects\2026 code change projects\arcadia custom\cc-26-0126 - 2026 code change projects\arcadia custom\cc-26-0126 - 2026 code change projects\dwgs\1147937\adc023-a.dwg 10/1/2026 9:58 AM

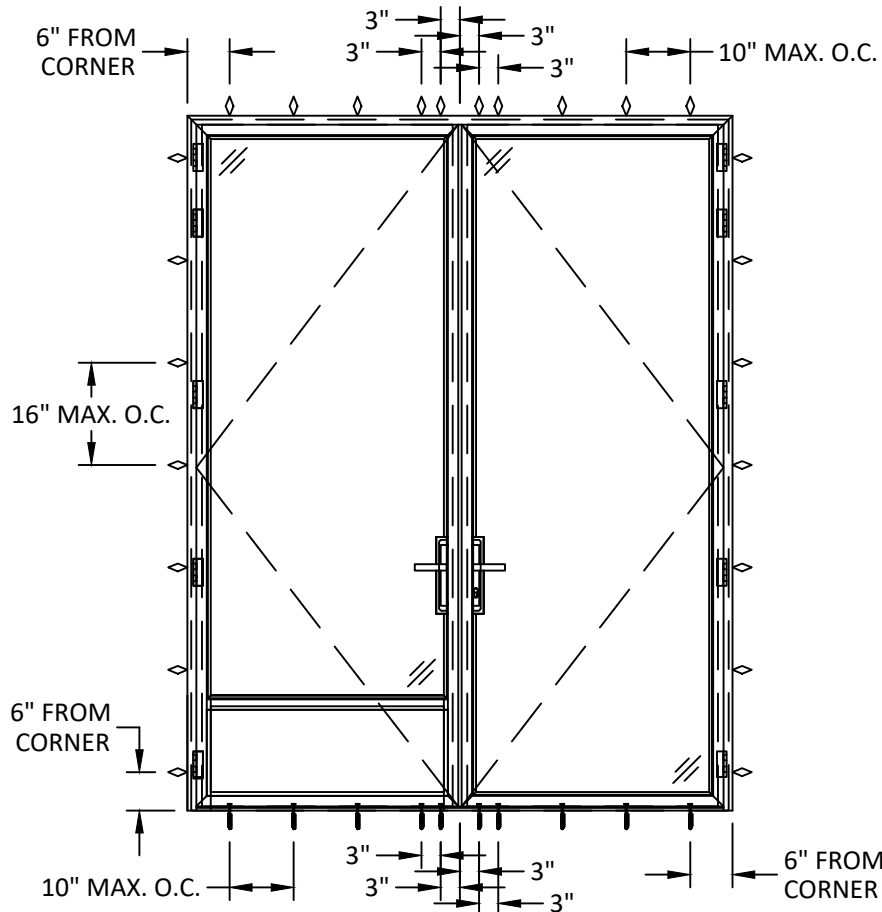


ANCHOR LAYOUT
FRENCH DOOR, THRU. STRAP ONLY

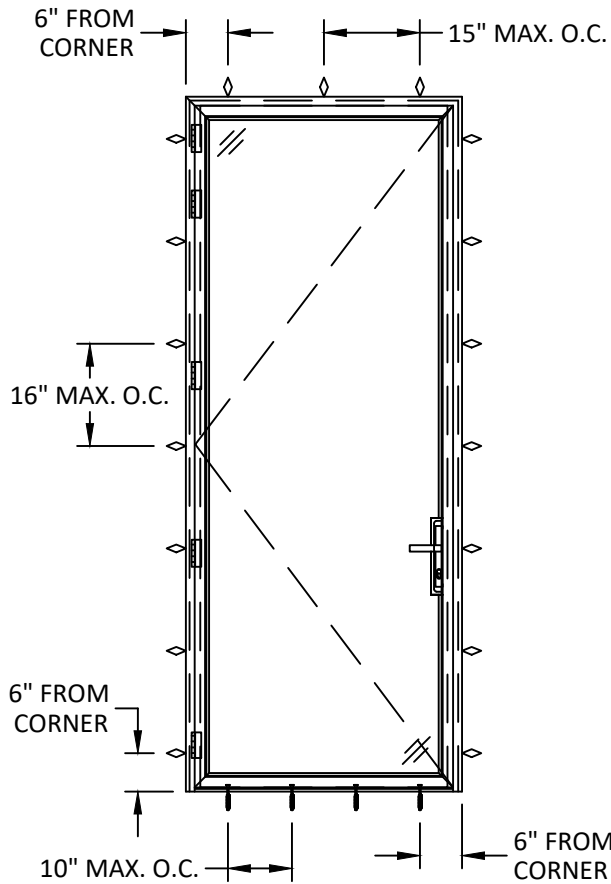

ANCHOR LAYOUT
SINGLE DOOR, THRU. STRAP ONLY

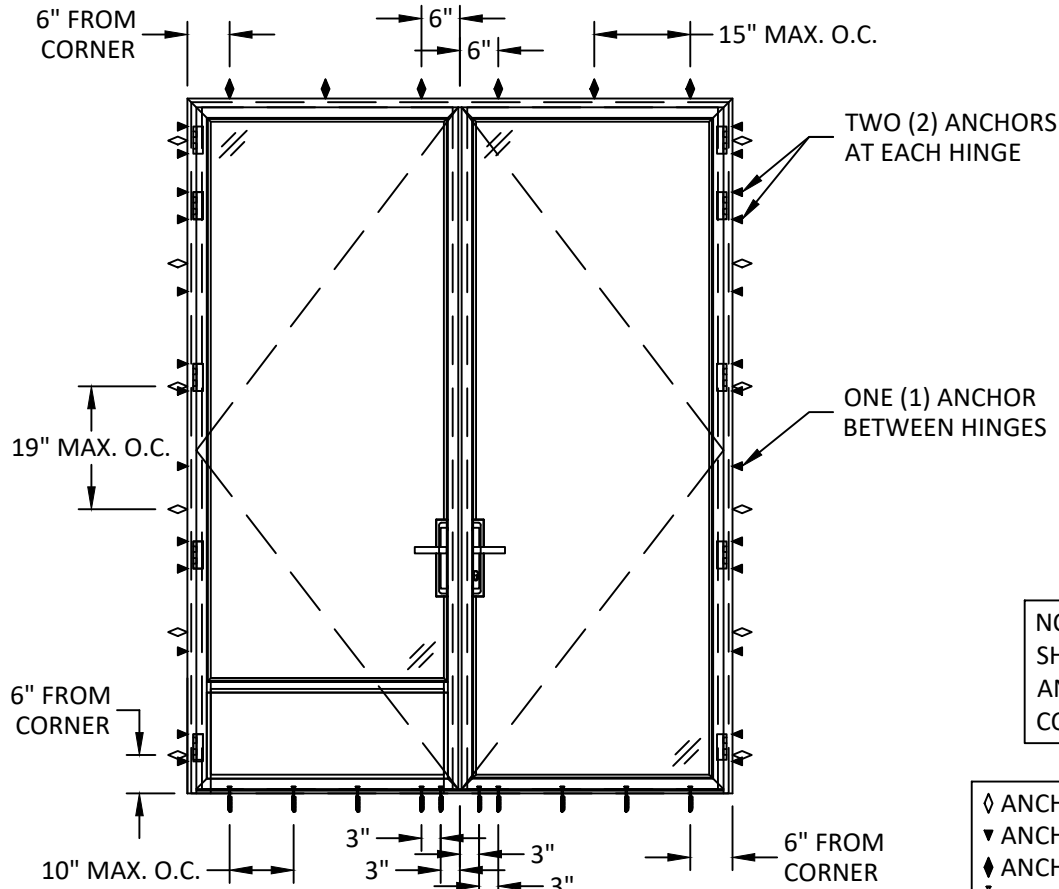

ANCHOR LAYOUT
FRENCH DOOR, THRU. STRAP & FRAME

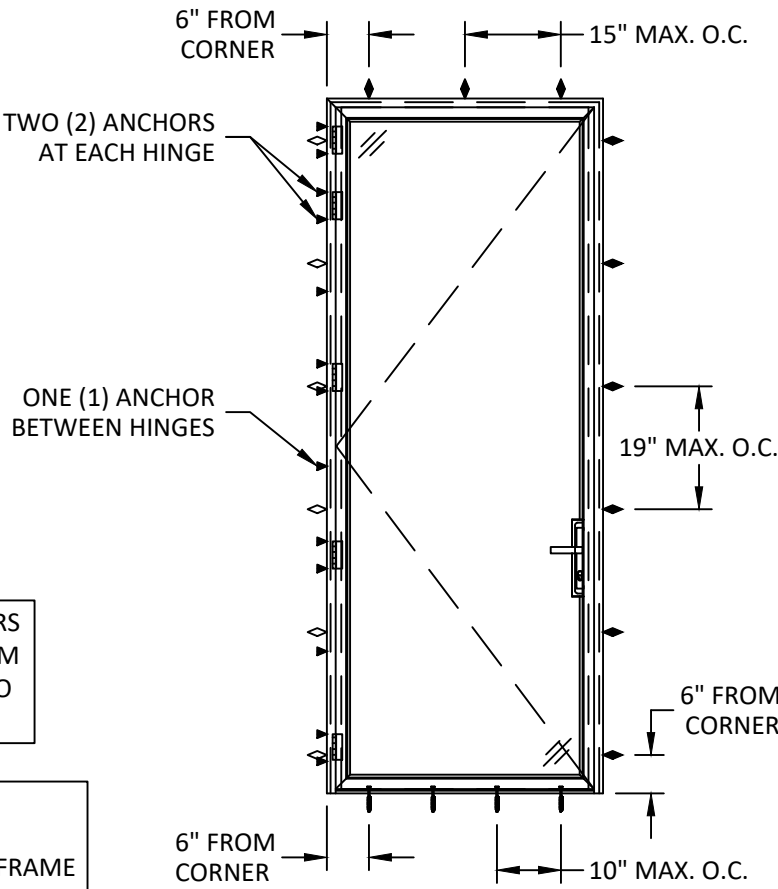

ANCHOR LAYOUT
SINGLE DOOR, THRU. STRAP & FRAME

NOTE: ROUND AND ARCH TOP DOORS
SHALL FOLLOW THE SAME MAXIMUM
ANCHOR SPACING AND DISTANCE TO
CORNER DESCRIBED ON THIS SHEET.

- ◇ ANCHOR THROUGH CLIP
- ▼ ANCHOR THROUGH FRAME
- ◆ ANCHOR THRU. CLIP + ANCHOR THRU. FRAME
- ┆ ANCHOR THROUGH THRESHOLD



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225 - OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

ANCHOR LAYOUTS

PREPARED BY:


BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

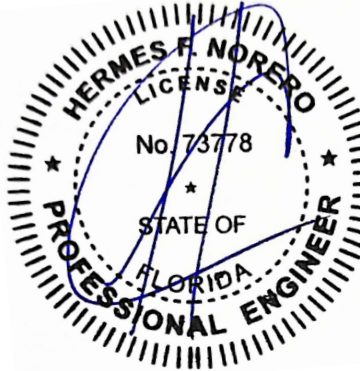


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL47937
DATE:	11.18.2025
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ADC023
SHEET:	4
REV.	A
	OF 8

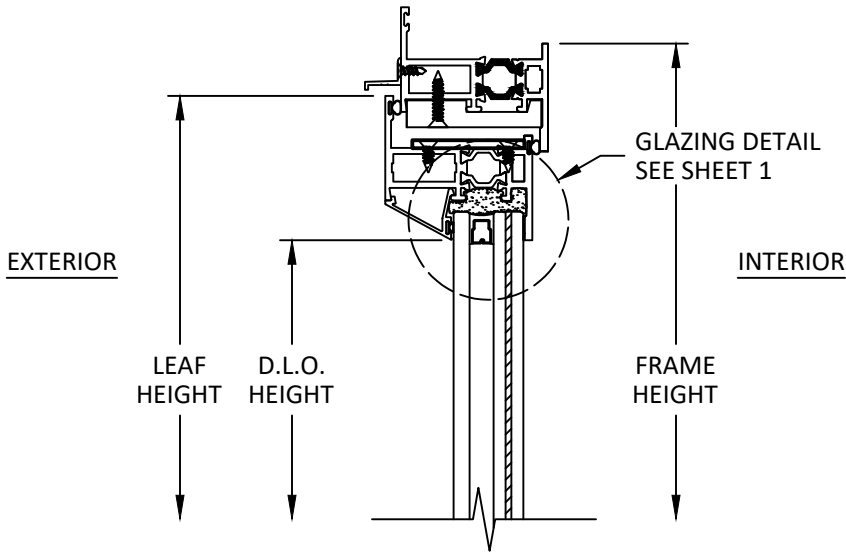

A
5 VERTICAL SECTION
HEAD

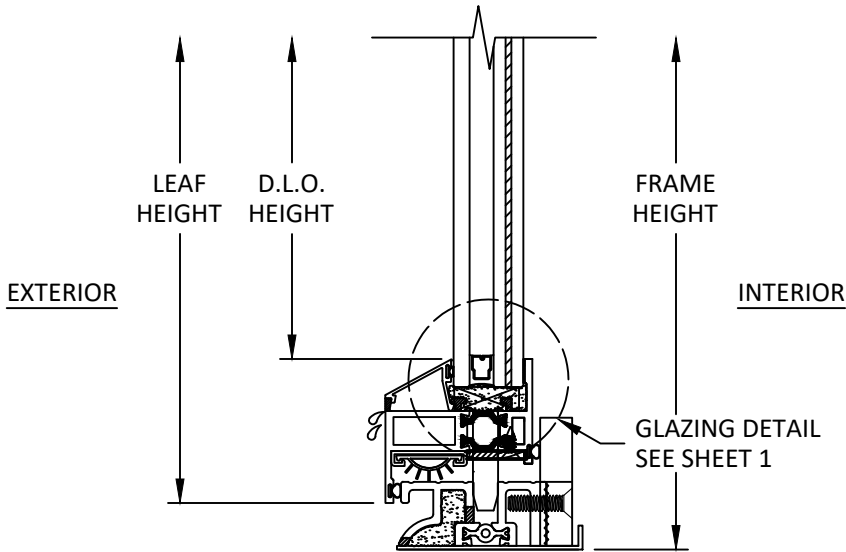

B
5 VERTICAL SECTION
SILL

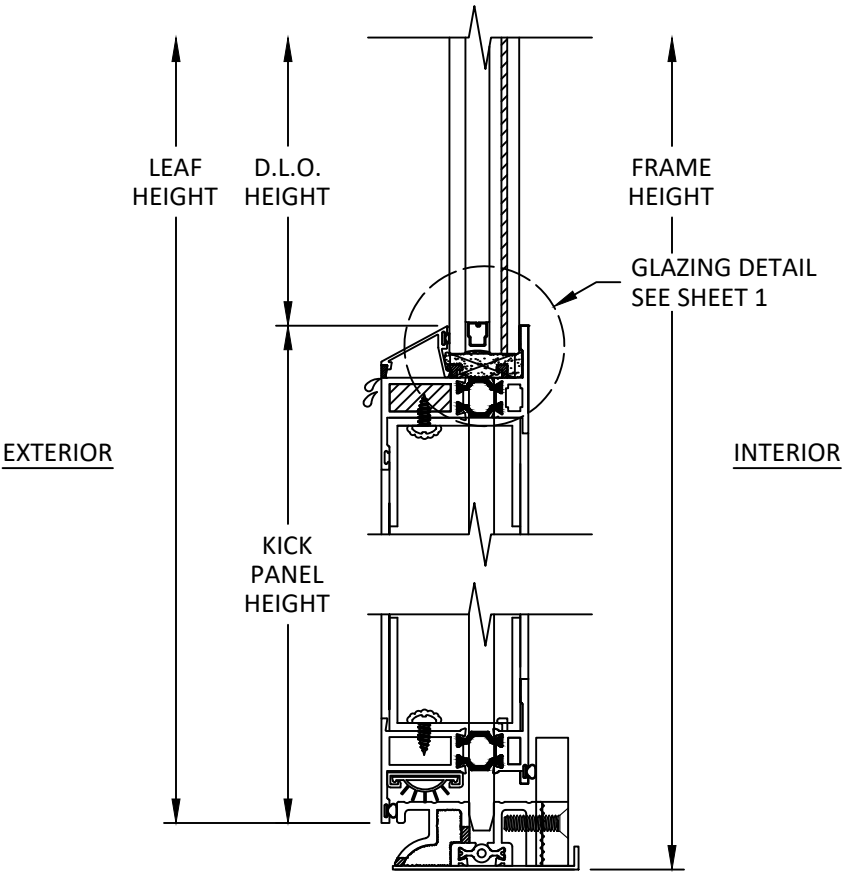

C
5 VERTICAL SECTION
SILL
W/ KICK PANEL



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225 - OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL47937	
DATE:	11.18.2025	
DWG. BY:	MS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	ADC023	
SHEET:	5	REV. A

HORIZONTAL SECTIONS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT OR SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




6


8




c:\users\harley\appdata\local\temp\arcadia custom\cc-26-0126 - 2026 code change\projects\arcadia custom\cc-26-0126 - 2026 code change\dwgs\147937\adc023-a.dwg 10/1/2026 9:58 AM

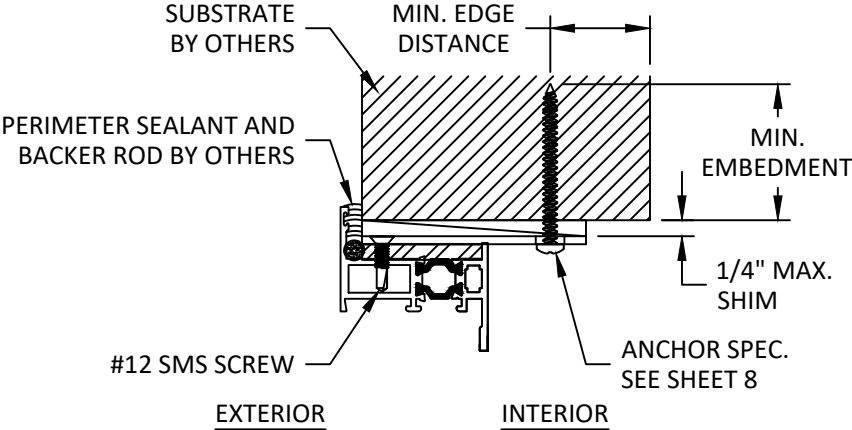

I
7 **INSTALLATION DETAILS**
HEAD SHOWN, JAMB SIMILAR
ANCHOR THROUGH STRAP ONLY

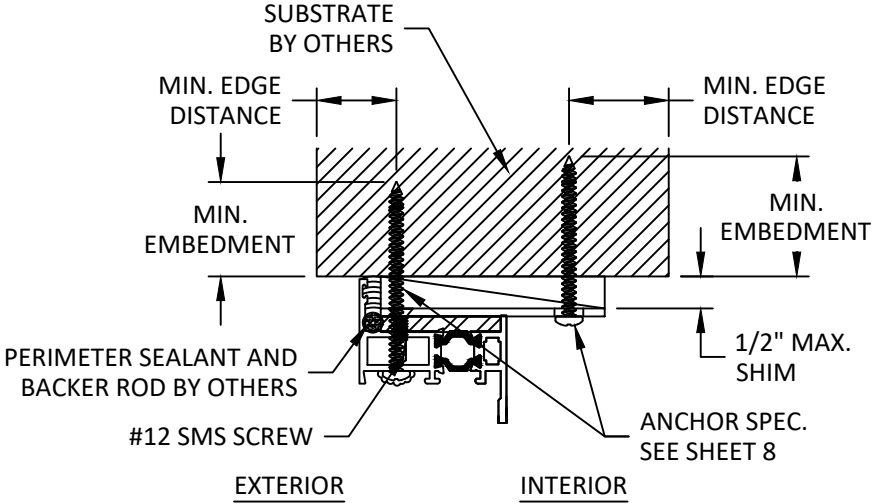

J
7 **INSTALLATION DETAILS**
HEAD SHOWN, JAMB SIMILAR
ANCHOR THROUGH STRAP AND FRAME

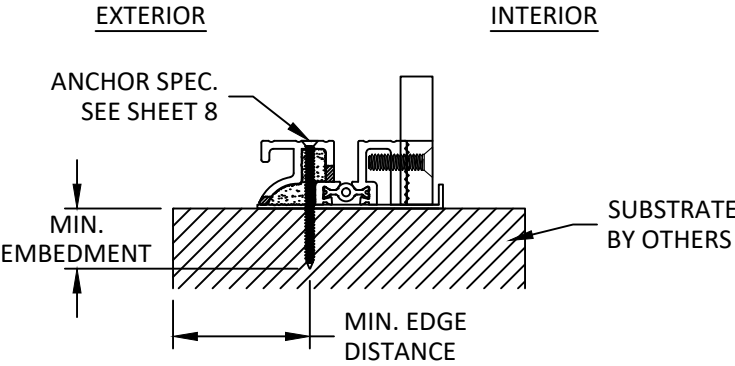

K
7 **INSTALLATION DETAILS**
SILL SHOWN



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225 - OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

INSTALLATION DETAILS

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47937	
DATE:	11.18.2025	
DWG. BY:	MS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	ADC023	
SHEET:	7	
REV.	A	

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION AS SPECIFIED ON SHEETS 4 AND 7.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

• FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

• CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH STRAP/ FRAME	WOOD: MIN. S.G. = 0.55	#12 WOOD SCREW	1-1/2"	1"
	STEEL: MIN. 18 GA. MIN. Fy = 33 ksi	#12 GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
	CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1-1/2"	1-1/2"
	MASONRY: HOLLOW OR GROUT- FILLED BLOCK per ASTM C90, MIN. 2000 PSI		1"	2"
THROUGH THRESHOLD	WOOD: MIN. S.G. = 0.55	#8 WOOD SCREW	1-1/2"	1"
	STEEL: MIN. 18 GA. MIN. Fy = 33 ksi	#8 GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
	CONCRETE: MIN. f'c = 3000 psi	3/16" ITW TAPCON	1"	1-1/4"
	MASONRY: HOLLOW OR GROUT- FILLED BLOCK per ASTM C90, MIN. 2000 PSI		1"	2"



ARCADIA CUSTOM
9280 E OLD VAIL RD
TUCSON, AZ 85747
PH: (520) 284-2061

TITLE:
T225 - OUTSWING FRENCH/SINGLE DOOR
(WZ4) (IMPACT)

INSTALLATION NOTES
& ANCHOR SCHEDULE

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47937**

DATE: **11.18.2025**

DWG. BY:
MS

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ADC023**

SHEET:

REV.
A