



A

**NOTE:** TRACK CONFIGURATION ABOVE  
THE DOOR OPENING DOES NOT AFFECT  
THE WIND LOAD RATING OF THIS DOOR.

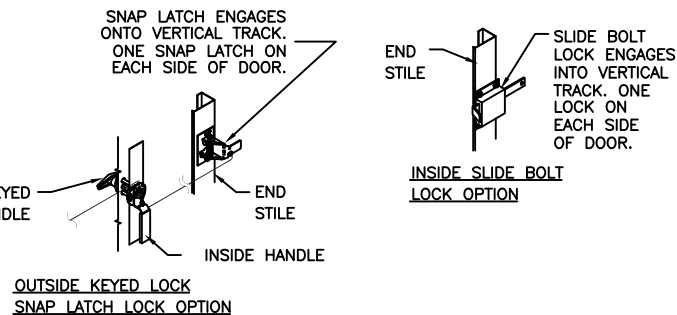

|                |      |
|----------------|------|
| DOOR<br>HEIGHT | "L"  |
| 8'-6"          | 94"  |
| 9'-0"          | 100" |
| 9'-6"          | 106" |
| 10'-0"         | 112" |
| 10'-6"         | 118" |
| 11'-0"         | 124" |
| 11'-6"         | 130" |
| 12'-0"         | 136" |

**NOTE:** FOR DOORS OVER 12'-0" HIGH, TRACK CONFIGURATION SHALL NOT EXCEED MAXIMUM SPACING PROVIDED. CONSULT FACTORY FOR MORE DETAIL IF RQD.

(4) #14x5/8" SHEET METAL SCREWS


(4) 1/4"x3/4" SELF TAPPING SCREWS

14 GA. END HINGE


18 GA. INTERMEDIATE

VERTICAL JAMB ATTACHMENT (C-90 BLOCK  
OR 2000 PSI MIN. CONCRETE COLUMN):  
3/8"x4" SLEEVE ANCHORS ON 24" CENTERS  
(BOTH C-90 BLOCK OR 2000 PSI MIN.  
CONCRETE) OR 1/4"x4" TAPCON SCREWS  
ON 24" CENTERS (2000 PSI MIN.  
CONCRETE). WASHERS INCLUDED WITH  
SLEEVE ANCHORS. 1" O.D. WASHERS  
REQUIRED WITH TAPCONS. ANCHORS MAY  
BE COUNTERSUNK (BUT NOT REQUIRED) TO  
PROVIDE A FLUSH MOUNTING SURFACE.  
HORIZONTAL JAMBS DO NOT TRANSFER  
LOAD.

VERTICAL JAMB ATTACHMENT (WOOD FRAME BUILDINGS):  
1/2"x3" LAG SCREWS ON 24" CENTERS. 1" O.D. WASHER  
REQUIRED. LAG SCREWS MAY BE COUNTERSUNK (BUT NOT  
REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE.  
HORIZONTAL JAMBS DO NOT TRANSFER LOAD.

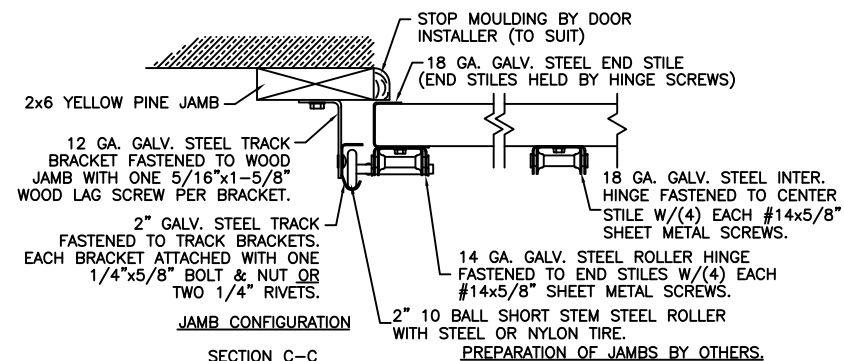

**NOTE:** THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

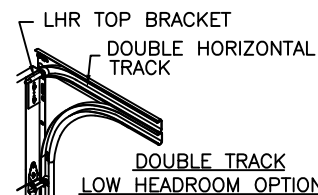

Unless Stated Otherwise  
TOLERANCES are

|         |   |        |
|---------|---|--------|
| .0      | = | ±.031  |
| .00     | = | ±.015  |
| .000    | = | ±.005  |
| .0000   | = | ±.001  |
| Degrees | = | ± 1/2° |

Unless Stated Otherwise  
DIMENSIONS ARE IN INCHES

DESIGN LOADS: +30.0 P.S.F. & -32.0 P.S.F.  
TEST LOADS: +45.0 P.S.F. & -48.0 P.S.F.

MPC: DSIU-1F171

8585 Duke Boulevard  
Mason, OH 45040 USA  
Tel. No. 513-770-4800  
Fax No. 513-770-4853

|                        |
|------------------------|
| CLOPAY WINDLOAD RATING |
| W5                     |

|              |                                                 |
|--------------|-------------------------------------------------|
| DESCRIPTION: | 9200 SERIES: 2" RESI PUR +30/-32 PSF SINGLE CAR |
|--------------|-------------------------------------------------|

|              |                |            |       |
|--------------|----------------|------------|-------|
| DRAWN BY: SH | DATE: 05/25/09 | SCALE: NTS | DWG D |
|--------------|----------------|------------|-------|

|                |                |              |        |
|----------------|----------------|--------------|--------|
| CHECKED BY: SH | DATE: 06/05/09 | SHEET 1 OF 1 | SIZE B |
|----------------|----------------|--------------|--------|

|                 |          |
|-----------------|----------|
| DWG NO : 104188 | VFR: JBC |
|-----------------|----------|

A circular professional engineer seal for James D. Wheeler. The outer ring contains the text "JAMES D. WHEELER" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by two stars. Inside this ring, the word "LICENSE" is at the top, "No. 91932" is in the center, and "STATE OF FLORIDA" is at the bottom, also separated by two stars. The seal has a dotted inner circle and a dashed outer circle.

Digitally signed by Jim Wheeler  
Date: 2026.08.19 16:07:31 -04'00'

FLORIDA PRODUCT APPROVAL 47958.16