



MODELS	1-3/8" THICK URETHANE		
CLOPAY/GALLERY	GD1SU, GR1SU	GD1LU, GR1LU	9132, HDPC13
HOLMES/ARTISTRY	AR1SU	AR1LU	7132
IDEAL/EXPRESSIONS	ED1SU	ED1LU	8135, MFC38U
	SHORT PANEL	LONG PANEL	FLUSH

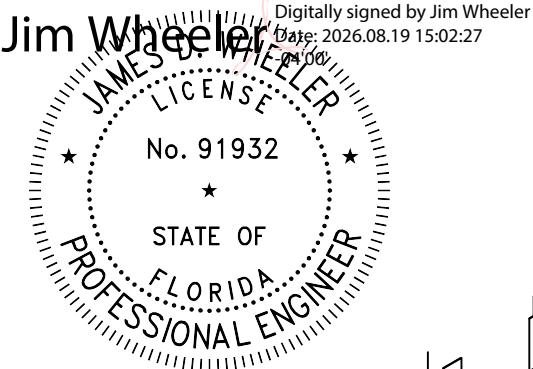


REV	DATE	ECD NUMBER	APPROVED	DESCRIPTION
00	05/23/12		SH	INITIAL RELEASE
01	03/30/17			REVISED FOR 16'0" HIGH DOORS.
02	11/18/20		SH	UPDATED TITLE BLOCK AND REMOVED WIND CHART.

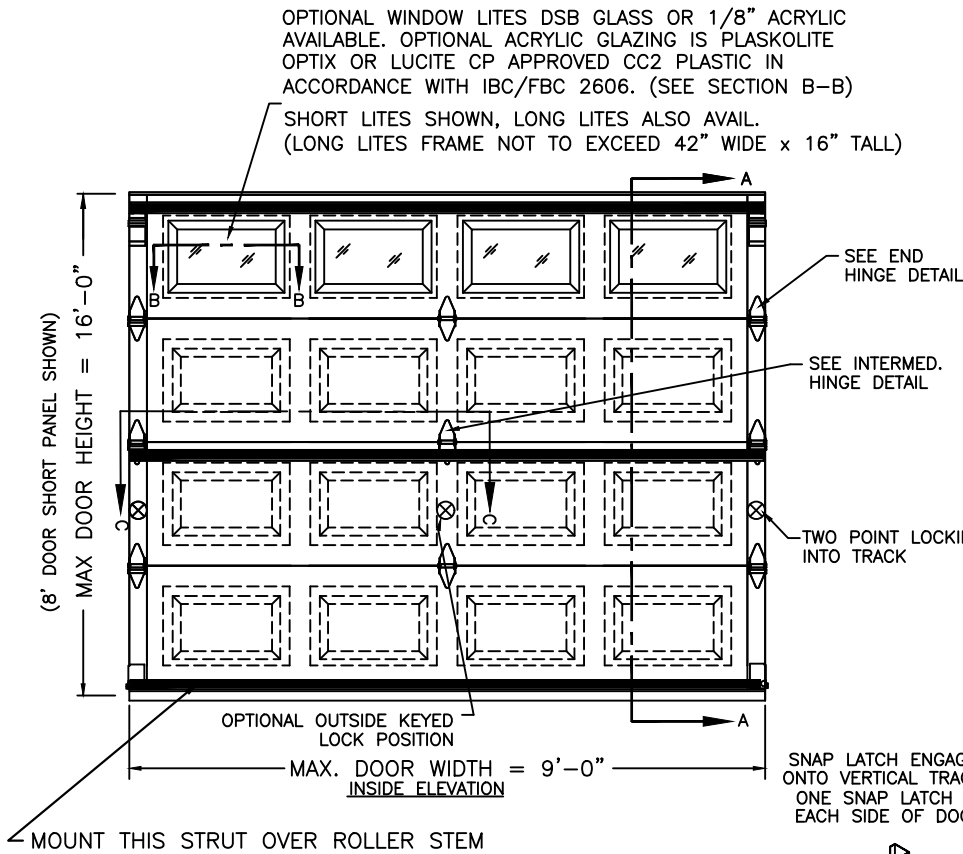


VERTICAL JAMB ATTACHMENT (C-90 BLOCK OR 2000 PSI MIN. CONCRETE COLUMN):
3/8"x4" SLEEVE ANCHORS ON 24" CENTERS (BOTH C-90 BLOCK OR 2000 PSI MIN. CONCRETE) OR 1/4"x4" TAPCON SCREWS ON 24" CENTERS (2000 PSI MIN. CONCRETE). WASHERS INCLUDED WITH SLEEVE ANCHORS. 1" O.D. WASHERS REQUIRED WITH TAPCONS. ANCHORS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.

VERTICAL JAMB ATTACHMENT (WOOD FRAME BUILDINGS):
1/2"x3" LAG SCREWS ON 24" CENTERS. 1" O.D. WASHER REQUIRED. LAG SCREWS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.






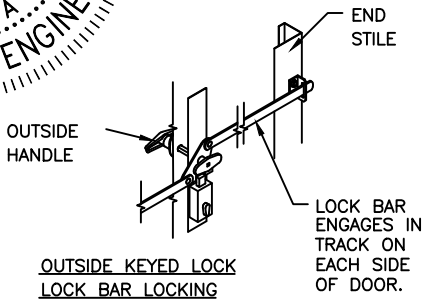


NOTE: TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING OF THIS DOOR.

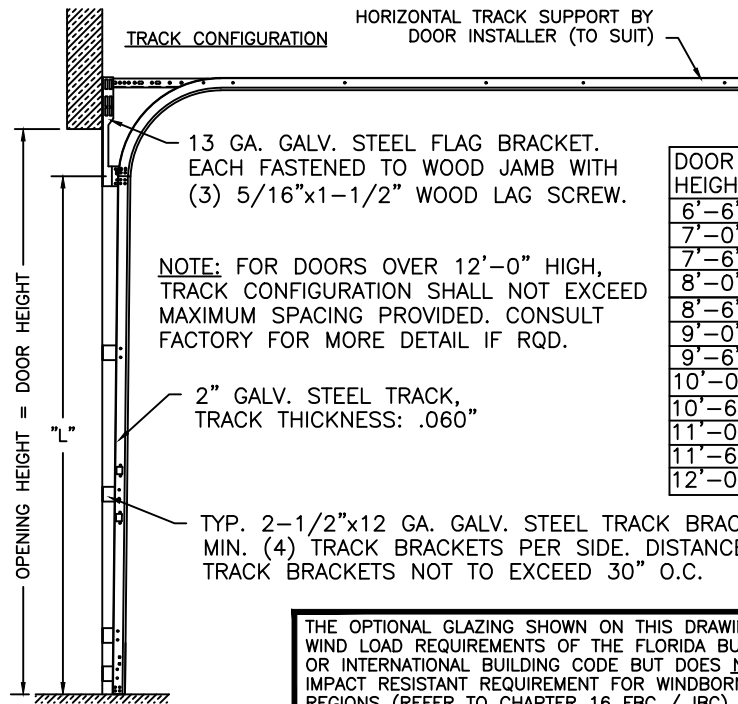

DOOR HEIGHT	"L"
6'-6"	70"
7'-0"	76"
7'-6"	82"
8'-0"	88"
8'-6"	94"
9'-0"	100"
9'-6"	106"
10'-0"	112"
10'-6"	118"
11'-0"	124"
11'-6"	130"
12'-0"	136"

DOOR HEIGHT	"L"
12'-6"	142"
13'-0"	148"
13'-6"	154"
14'-0"	160"
14'-6"	166"
15'-0"	172"
15'-6"	178"
16'-0"	184"

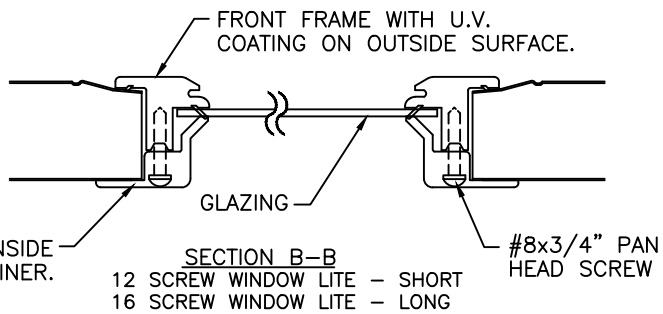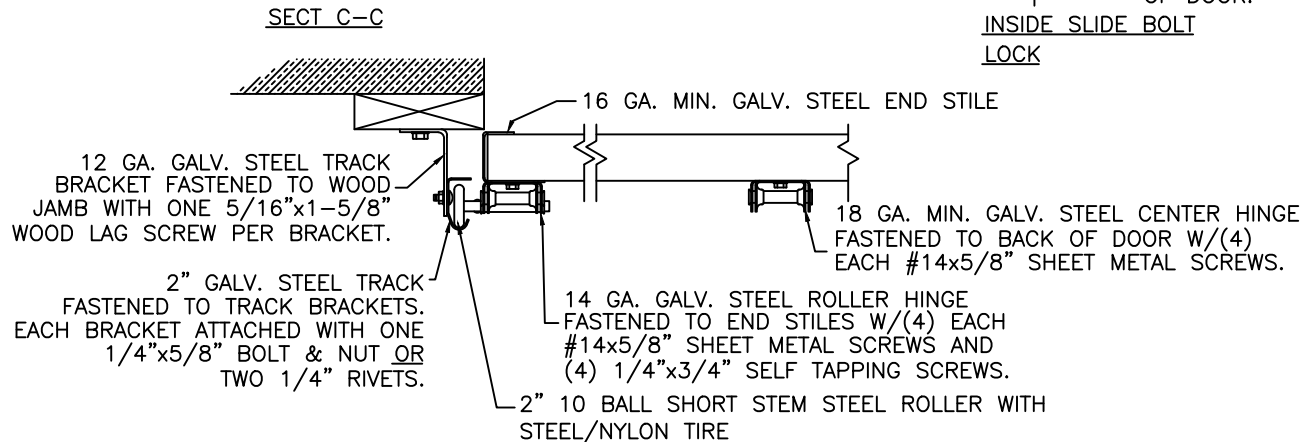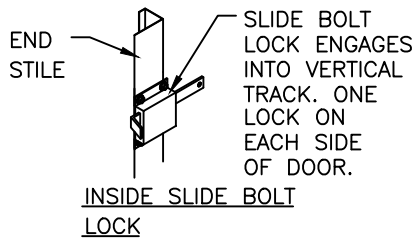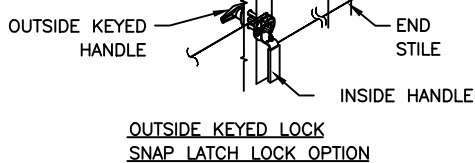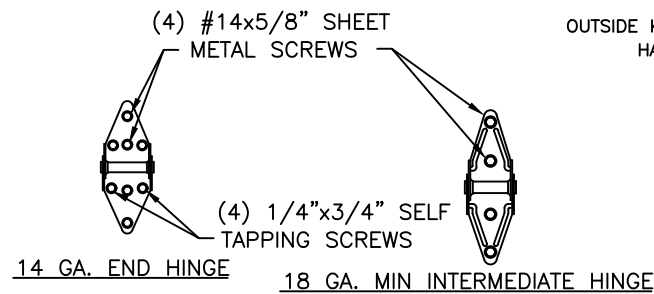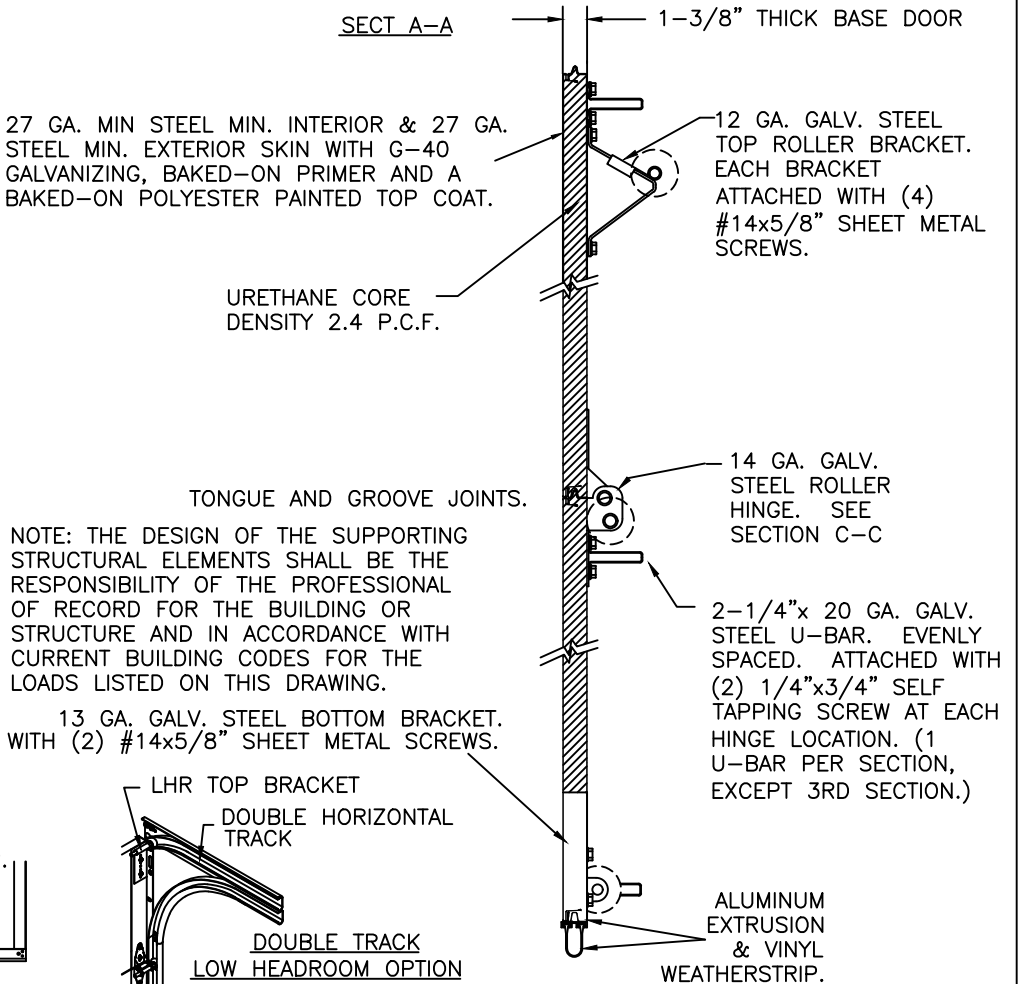

DESIGN ENGINEER: JAMES D. WHEELER, P.E.
FLORIDA P.E. #91932

DESIGN LOADS: +20.0 P.S.F. & -21.0 P.S.F.
TEST LOADS: +30.0 P.S.F. & -31.5 P.S.F.

Clopay
CORPORATION

CLOPAY CORPORATION
8585 DUKE BOULEVARD
CINCINNATI, OH 45040
(513) 770-4800

Clopay Corporation All Rights Reserved.

MANUFACTURING PRODUCT CODE DSIU-1A471	WINDLOAD RATING W3	MAX. SIZE: 9'0" x 16'0"
DATE: 5/23/12	DESCRIPTION: GALLERY 1-3/8" PUR SC +20/-21 PSF	
DRAWN BY: BFA	B	DRAWING NUMBER: 104424
CHECKED BY:		VER: IBC

FLORIDA PRODUCT APPROVAL 47958.9