

# ARCADIA CUSTOM

## T225 - FIXED WINDOW


### (WZ4) (IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - AAMA/WDMA/CSA 101/I.S.2/A440-17
  - ASTM E283/E283M-19
  - ASTM E330/E330M-14(21)
  - ASTM E331-00(16)
  - ASTM E1886-19
  - ASTM E1996-20
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- FRAME MATERIAL: ALUMINUM (MIN. 6063-T5).
- ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
- GLASS MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

| TABLE OF CONTENTS |                                                            |
|-------------------|------------------------------------------------------------|
| SHEET             | SHEET DESCRIPTION                                          |
| 1                 | GENERAL NOTES AND GLAZING DETAIL                           |
| 2                 | TYPICAL ELEVATION, ANCHOR LAYOUT AND DESIGN PRESSURE TABLE |
| 3                 | QUALIFIED SHAPES                                           |
| 4                 | VERTICAL SECTIONS                                          |
| 5                 | HORIZONTAL SECTIONS                                        |
| 6                 | INSTALLATION DETAILS AND NOTES                             |

| DESIGN PRESSURE RATING |                 |                                |
|------------------------|-----------------|--------------------------------|
| FRAME SIZE             | DESIGN PRESSURE | MISSILE RATING                 |
| SEE SHEET 2            |                 | LARGE AND SMALL MISSILE IMPACT |

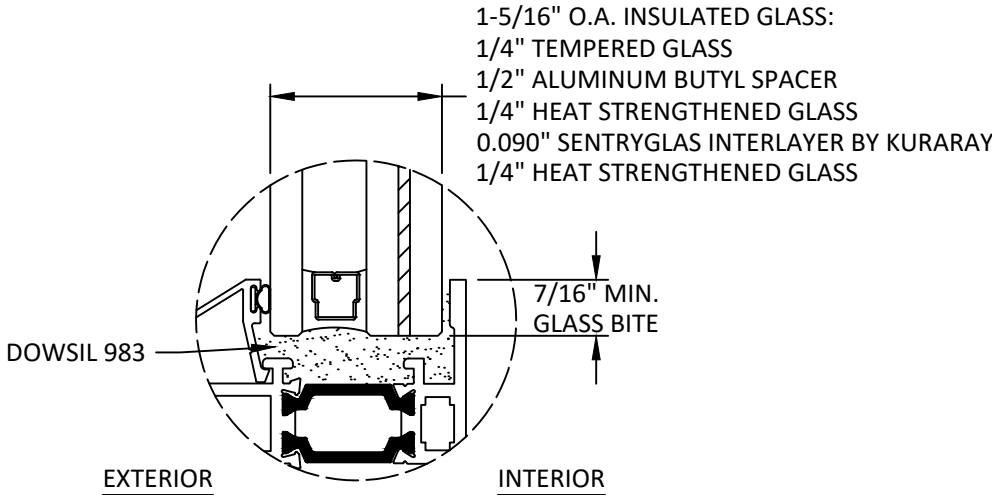

### GLAZING DETAIL

- GLAZING NOTES:
- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
  - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
  - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
  - D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN SHEET 2.



ARCADIA CUSTOM  
9280 E OLD VAIL RD  
TUCSON, AZ 85747  
PH: (520) 284-2061

TITLE:  
T225 - FIXED WINDOW  
(WZ4) (IMPACT)


GENERAL NOTES & GLAZING DETAIL

PREPARED BY:  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.  
Reason: I am approving this document  
Date: 2026.01.29 12:51:35 -05'00'

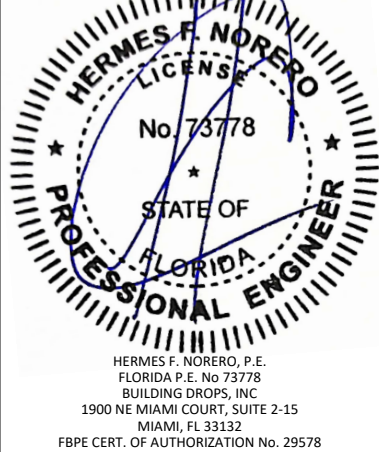

FL #:  
**FL48003**

DATE:  
**01.12.2026**

DWG. BY:  
**MS**

CHK. BY:  
**HFN**


SCALE:  
**NTS**

DWG. #:  
**ADC026**

SHEET:  
**1**


1/29/2026 12:16 PM

c:\users\mengqium\building drops, inc\building drops landing - common\projects\wilson partition - commercial\bc-19-1205-1.dwg\$1225 fixed window adc026.dwg

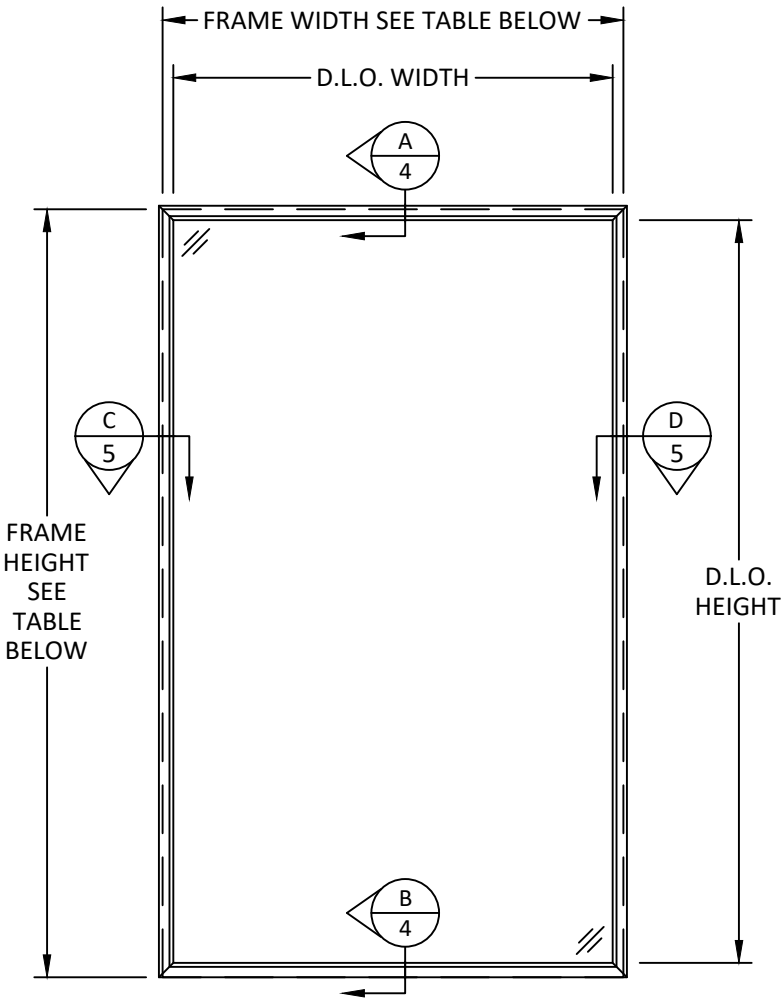


TYPICAL ELEVATION

D.L.O. HEIGHT = FRAME HEIGHT - 3 15/16"  
D.L.O. WIDTH = FRAME WIDTH - 3 3/8"

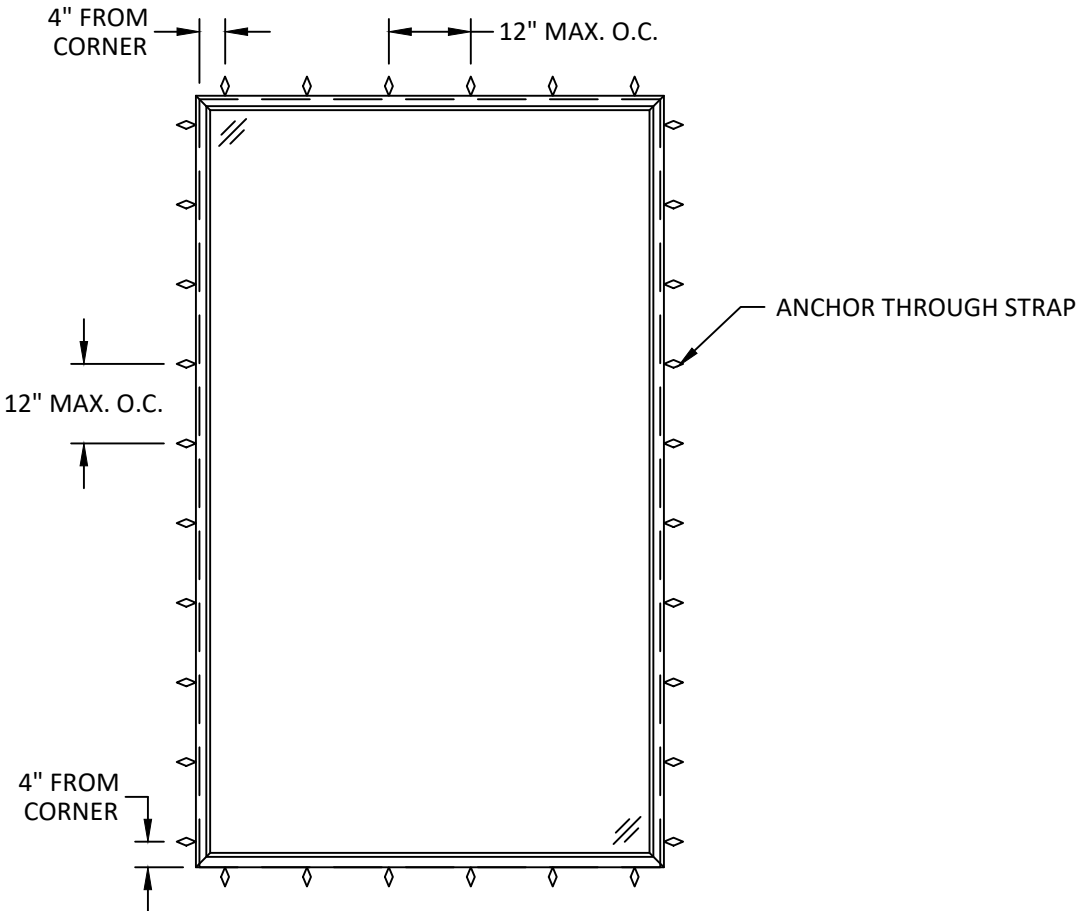

ANCHOR LAYOUT

| DESIGN PRESSURE TABLE (+/- PSF) - T225 Fixed Window |                   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
|-----------------------------------------------------|-------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| FRAME HEIGHT (IN.)                                  | FRAME WIDTH (IN.) |       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
|                                                     | 40                | 42    | 48    | 54    | 60    | 66    | 72    | 78    | 84    | 90    | 96    | 102   | 108   | 114   | 120   | 126   |
| 42                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 |
| 48                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 |
| 54                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 |
| 60                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 |
| 66                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 |
| 72                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 |
| 78                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 64.87 | 64.87 | 64.87 | 64.87 | 64.87 | 64.87 | -     | -     |
| 84                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 64.37 | 60.00 | 60.00 | 60.00 | 60.00 | -     | -     | -     | -     |
| 90                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 64.37 | 59.58 | 55.82 | -     | -     | -     | -     | -     | -     |
| 96                                                  | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 64.37 | 59.58 | -     | -     | -     | -     | -     | -     | -     |
| 102                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 64.37 | 59.58 | -     | -     | -     | -     | -     | -     | -     |
| 108                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 64.37 | -     | -     | -     | -     | -     | -     | -     | -     |
| 114                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 120                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 126                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 132                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 138                                                 | 70.00             | 70.00 | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 144                                                 | 70.00             | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 156                                                 | 70.00             | 70.00 | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 174                                                 | 70.00             | 70.00 | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 198                                                 | 70.00             | 70.00 | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |
| 210                                                 | 70.00             | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     | -     |

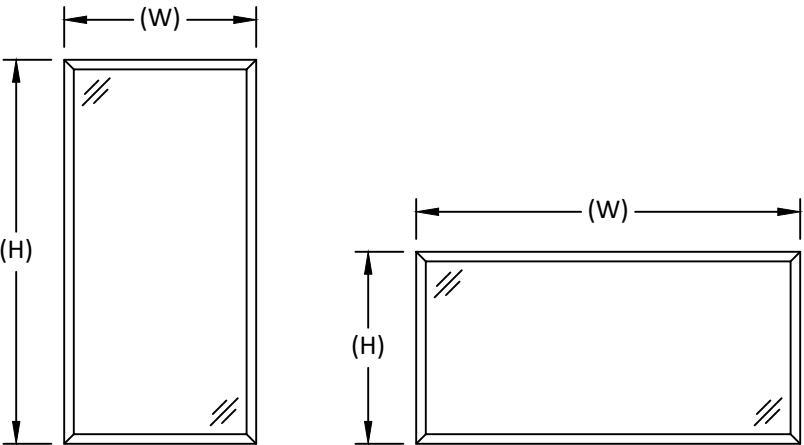

NOTES:  
FRAME WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA. ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN ABOVE FOR LONG OR SHORT LEG OF UNIT.



ARCADIA CUSTOM  
9280 E OLD VAIL RD  
TUCSON, AZ 85747  
PH: (520) 284-2061


TITLE:  
T225 - FIXED WINDOW (WZ4) (IMPACT)  
TYPICAL ELEVATION, ANCHOR LAYOUT & DESIGN PRESSURE TABLE

PREPARED BY:  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

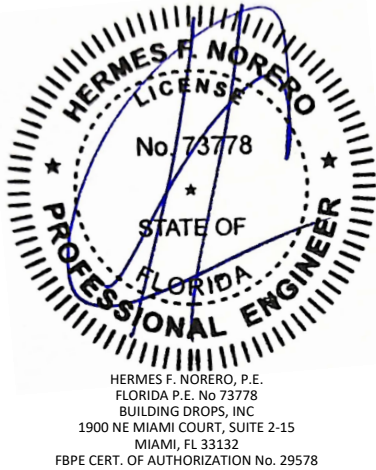

FL #: **FL48003**

DATE: **01.12.2026**


DWG. BY: **MS**      CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **ADC026**

SHEET: **2**


c:\users\mengqisun\building drops, inc\building drops landing - common\projects\wilson partition - commercial\bc-19-1205-1.dwg s:\t225 fixed window\adc026.dwg 1/29/2026 12:16 PM




CHORD




CIRCLE TOP




TRIANGLE




RIGHT TRIANGLE




QUARTER CIRCLE - R

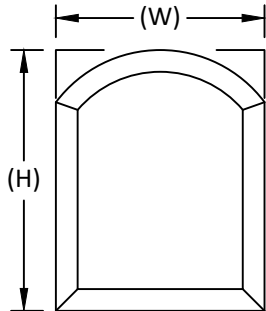


EQUAL LEG ARCH

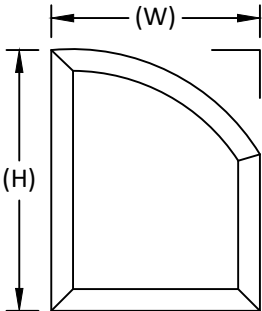


UNEQUAL LEG ARCH

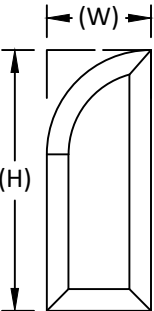


HALF SPRINGLINE

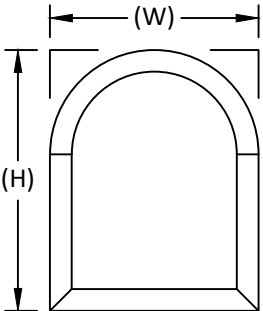


SPRINGLINE

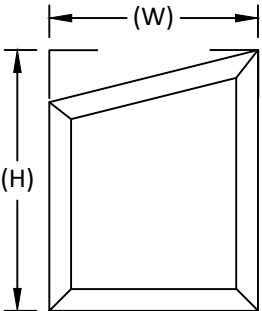


TRAPEZOID




PENTAGON




PEAK PENTAGON



HEXAGON



OCTAGON



CIRCLE

QUALIFIED SHAPES



ARCADIA CUSTOM  
9280 E OLD VAIL RD  
TUCSON, AZ 85747  
PH: (520) 284-2061


TITLE:  
T225 - FIXED WINDOW  
(WZ4) (IMPACT)  
QUALIFIED SHAPES

PREPARED BY:  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

  
BUILDING DROPS

| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

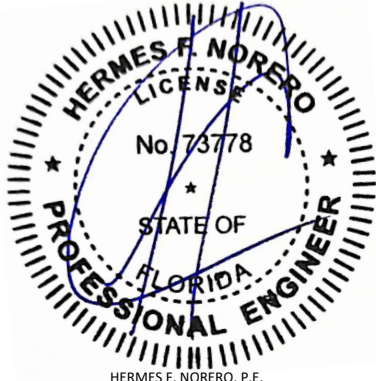

HERMES F. NORERO, P.E.  
FLORIDA P.E. No. 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48003**

DATE: **01.12.2026**

DWG. BY: **MS**      CHK. BY: **HFN**



SCALE: **NTS**

DWG. #: **ADC026**

SHEET:  
**3**

1/29/2026 12:16 PM

c:\users\mengqisun\building drops .inc\building drops landing - common\projects\wilson partition - commercial\bc-19-1205-1\dwg\st225 fixed window\adc026.dwg

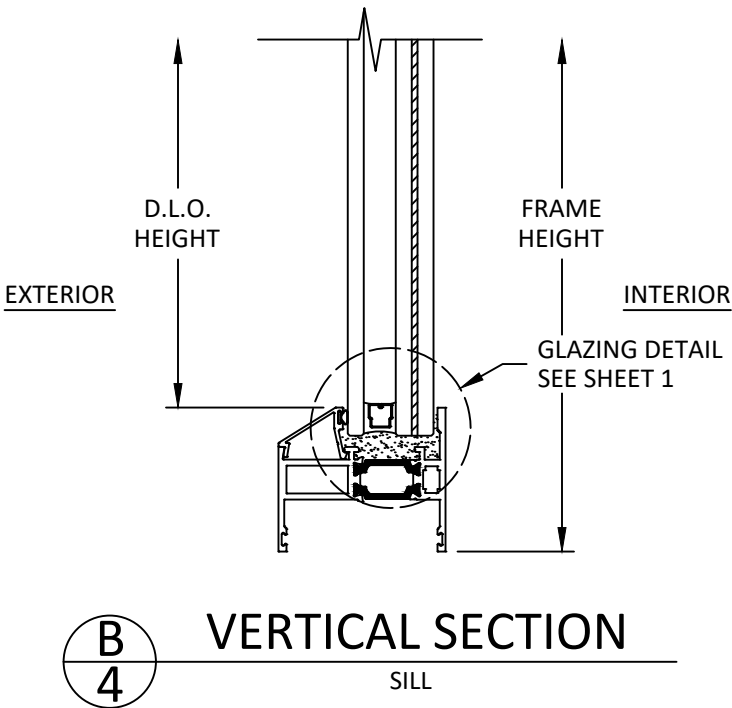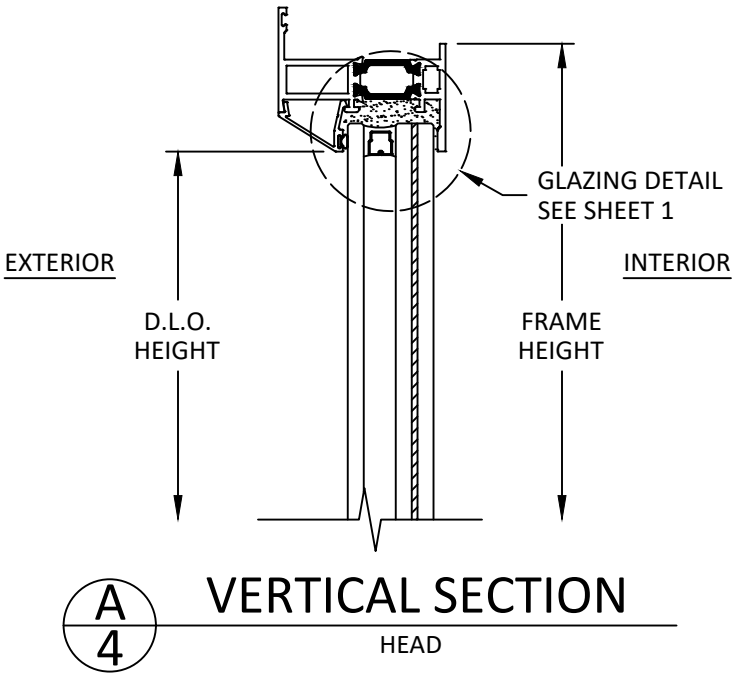

ARCADIA CUSTOM  
9280 E OLD VAIL RD  
TUCSON, AZ 85747  
PH: (520) 284-2061

TITLE:

T225 - FIXED WINDOW  
(WZ4) (IMPACT)

VERTICAL SECTIONS


PREPARED BY:

**BUILDING DROPS**

**BUILDING DROPS, INC.**  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

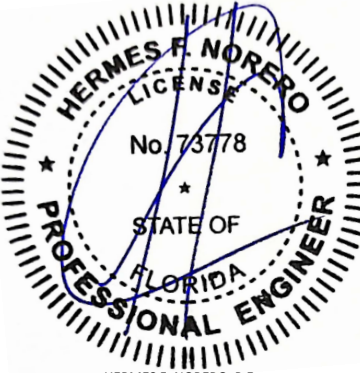

HERMES F. NORERO, P.E.  
FLORIDA P.E. No 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48003**

DATE: **01.12.2026**

DWG. BY:  
**MS**

CHK. BY:  
**HFN**

SCALE: **NTS**



DWG. #: **ADC026**

SHEET:  

**4**

OF 6

c:\users\mengqisun\building drops, inc\building drops landing - common\projects\wilson partition - commercial\bc-19-1205-1.dwg;t1225 fixed window\adc026.dwg 1/29/2026 12:16 PM

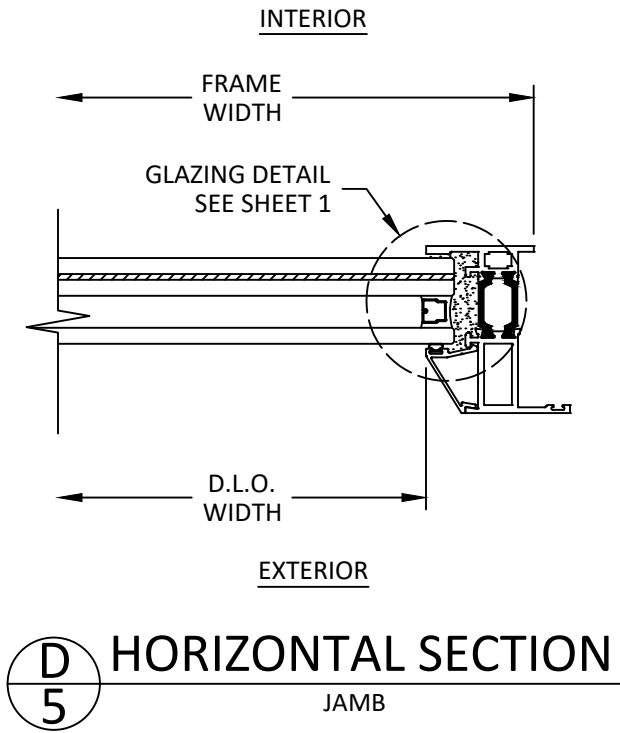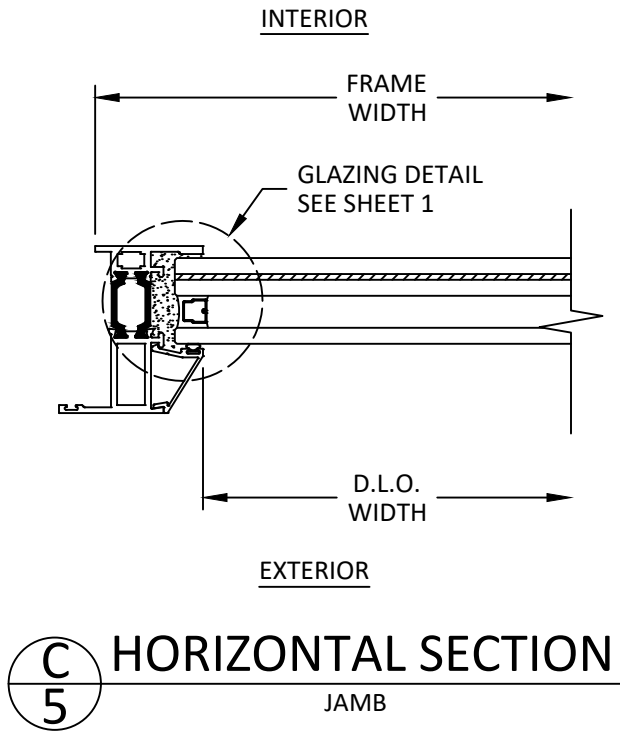

ARCADIA CUSTOM  
9280 E OLD VAIL RD  
TUCSON, AZ 85747  
PH: (520) 284-2061

TITLE:  
T225 - FIXED WINDOW  
(WZ4) (IMPACT)  
  
HORIZONTAL SECTIONS

PREPARED BY:  
  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.  
FLORIDA P.E. No 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48003**


DATE: **01.12.2026**

DWG. BY: **MS**      CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **ADC026**

SHEET:  
**5**

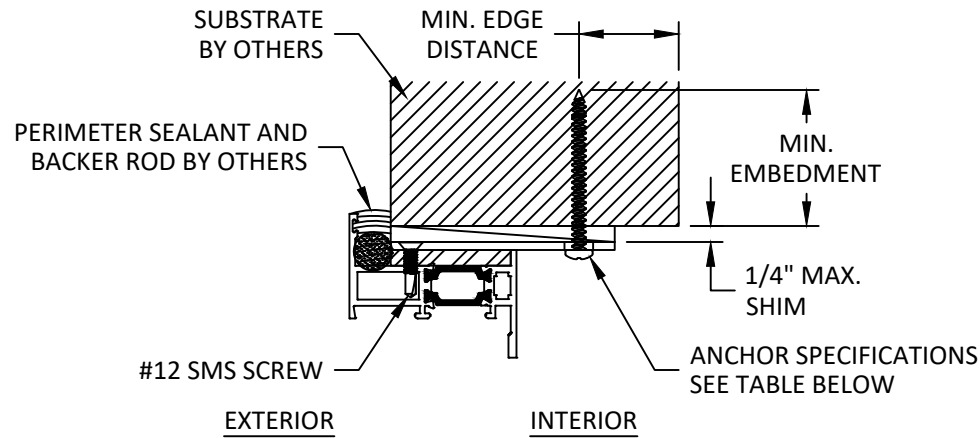

**E**  
**6** **INSTALLATION DETAILS**  
HEAD SHOWN, JAMB SIMILAR  
ANCHOR THROUGH STRAP

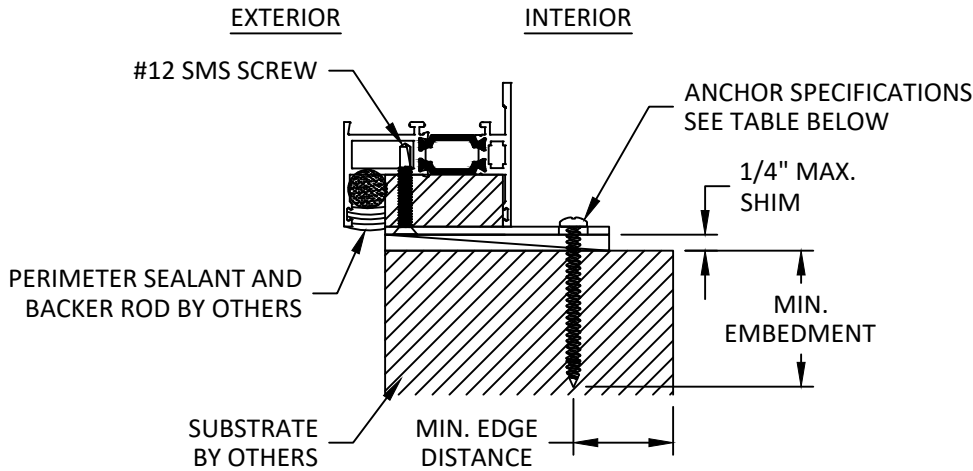

**F**  
**6** **INSTALLATION DETAILS**  
SILL  
ANCHOR THROUGH STRAP

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR INTO SUBSTRATE IS REQUIRED AT EACH ANCHOR LOCATION.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF  $\pm 1/4$  INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

| ANCHOR SCHEDULE |                                                                             |                                                     |                                              |                    |
|-----------------|-----------------------------------------------------------------------------|-----------------------------------------------------|----------------------------------------------|--------------------|
| METHOD          | SUBSTRATE                                                                   | ANCHOR TYPE                                         | MIN. EMBEDMENT                               | MIN. EDGE DISTANCE |
| THROUGH STRAP   | WOOD:<br>MIN. S.G. = 0.55                                                   | #12 WOOD SCREW                                      | 1-1/2"                                       | 1"                 |
|                 | STEEL:<br>MIN. 18 GA.<br>MIN. Fy = 33 ksi                                   | #12 GRADE 5<br>SELF-DRILLING/<br>SELF-TAPPING SCREW | 3 THREADS MIN<br>PENETRATION<br>BEYOND METAL | 1/2"               |
|                 | ALUMINUM:<br>MIN. 1/8" THICK<br>MIN. 6063-T5                                |                                                     |                                              |                    |
|                 | CONCRETE:<br>MIN. f'c = 3000 psi                                            | 1/4" ITW TAPCON                                     | 1-1/2"                                       | 1-1/2"             |
|                 | MASONRY:<br>HOLLOW OR GROUT-<br>FILLED BLOCK per ASTM<br>C90, MIN. 2000 PSI |                                                     | 1"                                           | 2"                 |



ARCADIA CUSTOM  
9280 E OLD VAIL RD  
TUCSON, AZ 85747  
PH: (520) 284-2061

TITLE: T225 - FIXED WINDOW (WZ4) (IMPACT)


INSTALLATION DETAILS & NOTES

PREPARED BY: BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

**BD**  
BUILDING DROPS

| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

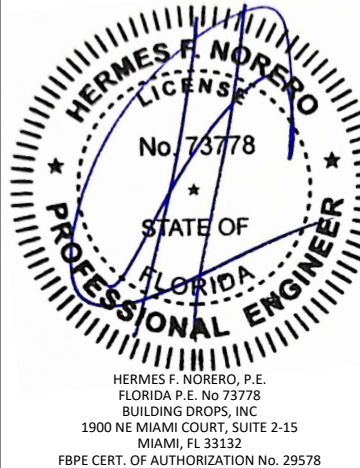

FL #: **FL48003**

DATE: **01.12.2026**

DWG. BY: **MS**      CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ADC026**

SHEET: **6**