


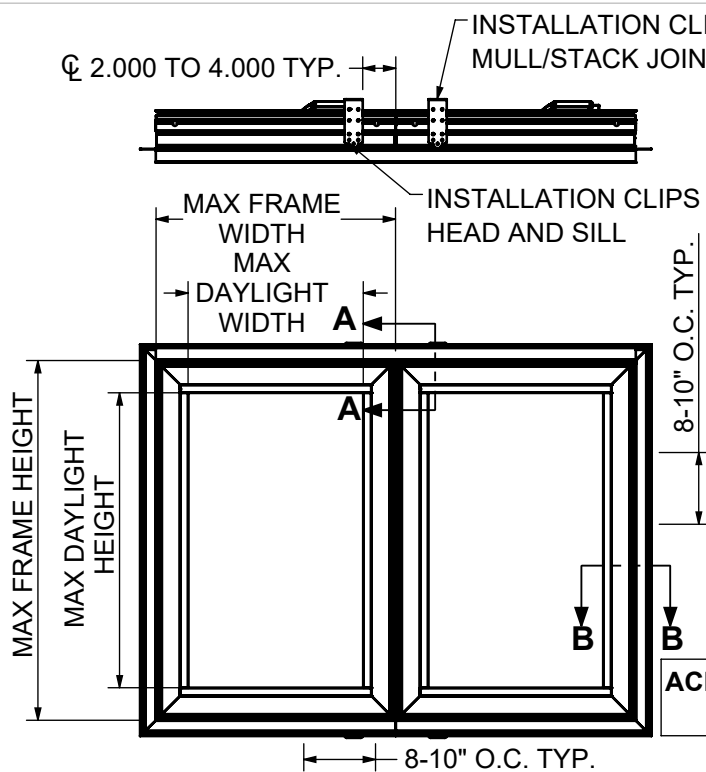

ACM03 CA-CA ALUMINUM REINFORCED
MULL NAILING FIN INSTALLATION

Product I.D.	Description	Conf.	Frame Size		Daylight Size		DP Rating (psf)
			Width	Height	Width	Height	
ACM03	Casement	2-wide	41.25	119.3	35.841	113.84	+/-35

NOTE(S):

1. INSTALLATION QUALIFIES SINGLE AND MULLED CONFIGURATIONS.
2. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
3. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
4. THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE WINDOW(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDES DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.
5. FASTENERS, ANCHORS, AND CONNECTORS SHALL COMPLY WITH THE CORROSION RESISTANCE REQUIREMENTS OF THE 2026 FLORIDA BUILDING CODE, SECTION 1711, BASED ON EXPOSURE CONDITIONS AND PROXIMITY TO A SALTWATER SHORELINE AND NOT ALL THE ONES SHOWN HERE NECESSARILY APPLY.

PELLA CORPORATION
102 MAIN STREET, PELLA, IOWA 50219

DRAWN: RL
ENGR.: RL
DATE CREATED: 2/2/2026
CLASS: FILE NAME: ACM03
ECO:

TOLERANCES UNLESS OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE: ACM03, CA-CA ALUMINUM REINFORCED MULL NAILING FIN INSTALLATION
PAGE 1 OF 1
DRAWING NUMBER 45-45234
REV

#6 X (1-5/8") NON-CORROSIVE SCREW 1-1/2" MIN PENETRATION INTO FRAMING MEMBER 8-10" ON CENTER THRU NAILING FIN AROUND THE UNIT'S ENTIRE PERIMETER TYP.

USE SILICONE SEALANT AROUND ENTIRE PERIMETER BETWEEN NAILING FIN & WOOD BUCK BY OTHERS TYP.

3/4" MIN EDGE DISTANCE TYP.

SECTION A-A
SCALE 1 : 3

HEAD/SILL ANCHORAGE

1-1/2" MINIMUM PENETRATION INTO SUBSTRATE TYP.

#6 X (1-5/8") NON-CORROSIVE SCREW 1-1/2" MIN PENETRATION INTO FRAMING MEMBER THRU INSTALLATION CLIPS

1/4" MAX SHIM SPACE TYP.

#6 X 1/2" PPH SCREWS MUST BE USED TO ATTACH INSTALLATION CLIP TO UNIT TYP.

1/4" MAX SHIM SPACE TYP.

WOOD BUCK BY OTHERS TYP.

1-1/2" MINIMUM PENETRATION INTO SUBSTRATE TYP.

SECTION B-B
SCALE 1 : 3

3/4" MIN EDGE DISTANCE TYP.

USE SILICONE SEALANT AROUND ENTIRE PERIMETER BETWEEN NAILING FIN & WOOD BUCK BY OTHERS TYP.

#6 X (1-5/8") NON-CORROSIVE SCREW 1-1/2" MIN PENETRATION INTO FRAMING MEMBER 8-10" ON CENTER THRU NAILING FIN AROUND THE UNIT'S ENTIRE PERIMETER TYP.

SIDE ANCHORAGE