


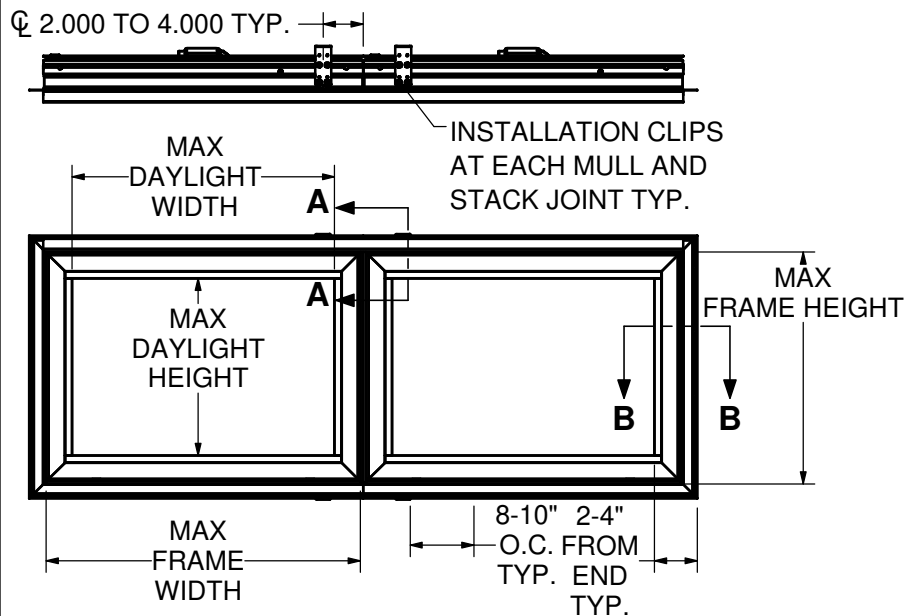

#6 X (1 -5/8") NON-CORROSIVE SCREW 1-1/2" PENETRATION INTO FRAMING MEMBER 8-10" ON CENTER THRU NAILING FIN AROUND THE UNIT'S ENTIRE PERIMETER TYP.

USE SILICONE SEALANT AROUND ENTIRE PERIMETER BETWEEN NAILING FIN & WOOD BUCK BY OTHERS TYP.

3/4" MIN EDGE DISTANCE TYP.

HEAD/SILL ANCHORAGE

1-1/2" MINIMUM PENETRATION INTO SUBSTRATE TYP.

#6 X (1-5/8") NON-CORROSIVE SCREW 1-1/2" MIN PENETRATION INTO FRAMING MEMBER THRU INSTALLATION CLIPS.

.250 MAX SHIM SPACETYP.

#6 X 1/2" PPH SCREWS MUST BE USED TO ATTACH INSTALLATION CLIPS TO UNITS TYP.

SECTION A-A
SCALE 1 : 3

SIDE ANCHORAGE

WOOD BUCK BY OTHERS TYP.

.250 MAX SHIM SPACE TYP.

SECTION B-B
SCALE 1 : 3

USE SILICONE SEALANT AROUND ENTIRE PERIMETER BETWEEN NAILING FIN & WOOD BUCK BY OTHERS TYP.

1-1/2" MINIMUM PENETRATION INTO SUBSTRATE TYP.

GENERAL NOTE(S):

1. INSTALLATION QUALIFIES SINGLE AND MULLED CONFIGURATIONS.
2. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
3. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
 - * AAMA/WDMA/CSA 101/I.S.2/A440-11
 - * AAMA/WDMA/CSA 101/I.S.2/A440-17
4. THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE WINDOW(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.

PELLA CORPORATION

102 MAIN STREET, PELLA, IOWA 50219

DRAWN:

ENGR.: RL

DATE CREATED:
1/28/26

CLASS

FILE NAME:

AAW02

ECO:

TOLERANCES UNLESS OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE:

AAW02, AW-AW MULLING INSTALLATION INSTRUCTIONS

PAGE

1 OF 1

DRAWING NUMBER

45-45225

REV

0