


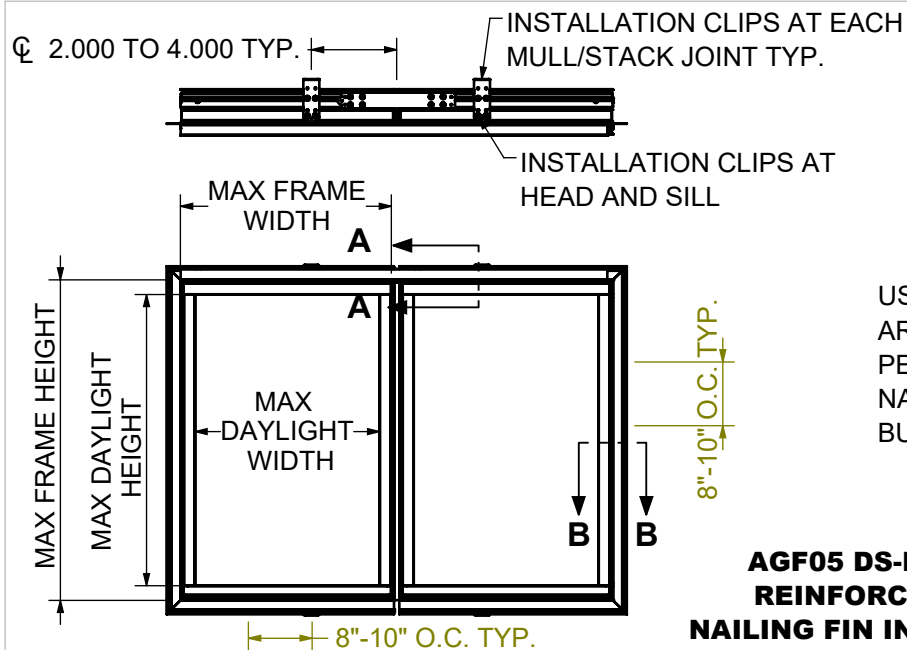



**AGF05 DS-DS STEEL
REINFORCED MULL
NAILING FIN INSTALLATION**

Product I.D.	Description	Conf.	Frame Size		Daylight Size		DP Rating (psf)	Frame Material
			Width	Height	Width	Height		
AGF05	Direct Set	2-wide	93.625	141.625	90.947	138.947	+/-25	Aluminum

GENERAL NOTE(S):

1. INSTALLATION QUALIFIES SINGLE AND MULLED CONFIGURATIONS.
2. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
3. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
* AAMA/WDMA/CSA 101/I.S.2/A440-11
* AAMA/WDMA/CSA 101/I.S.2/A440-17
4. THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE WINDOW(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.
5. FASTENERS, ANCHORS, AND CONNECTORS SHALL COMPLY WITH THE CORROSION RESISTANCE REQUIREMENTS OF THE 2026 FLORIDA BUILDING CODE, SECTION 1711, BASED ON EXPOSURE CONDITIONS AND PROXIMITY TO A SALTWATER SHORELINE AND NOT ALL THE ONES SHOWN HERE NECESSARILY APPLY.

HEAD/SILL ANCHORAGE

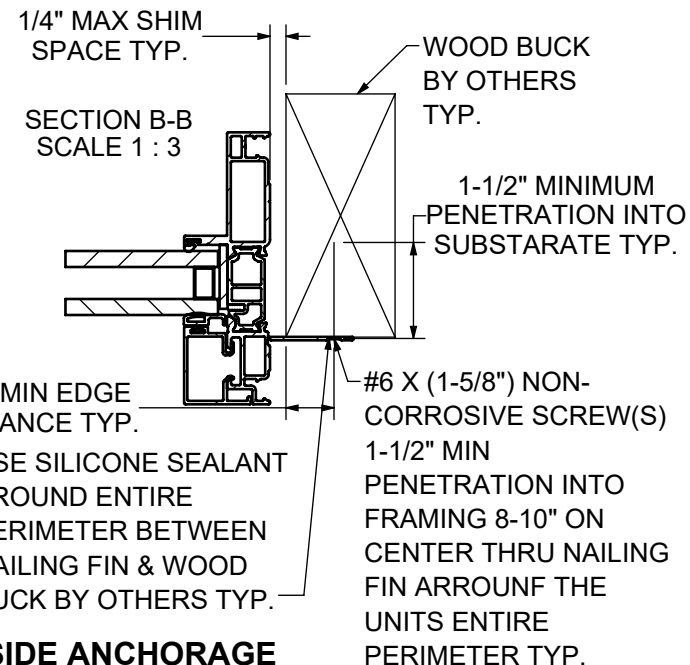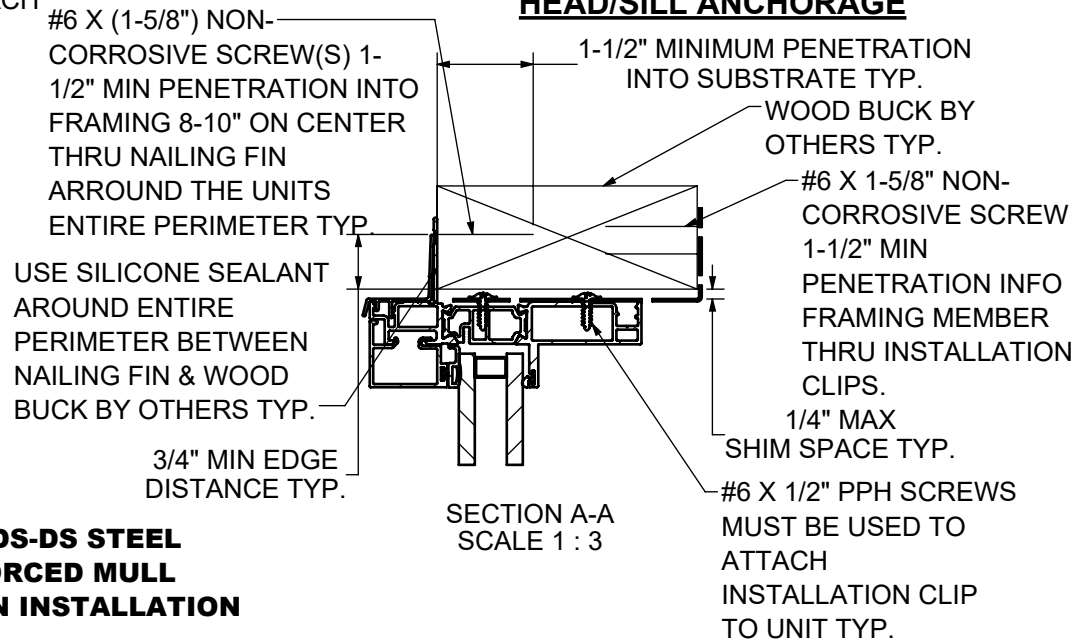

SIDE ANCHORAGE

PELLA CORPORATION
102 MAIN STREET, PELLA, IOWA 50219

DRAWN:	CLASS
ENGR.: RL	FILE NAME: AGF05
DATE CREATED: 2/3/2026	ECO:

TOLERANCES UNLESS OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE: DS-DS AL REINFORCEMENT MULL FBC INSTALLATION		
PAGE	DRAWING NUMBER	REV
1 OF 1	45-45236	