


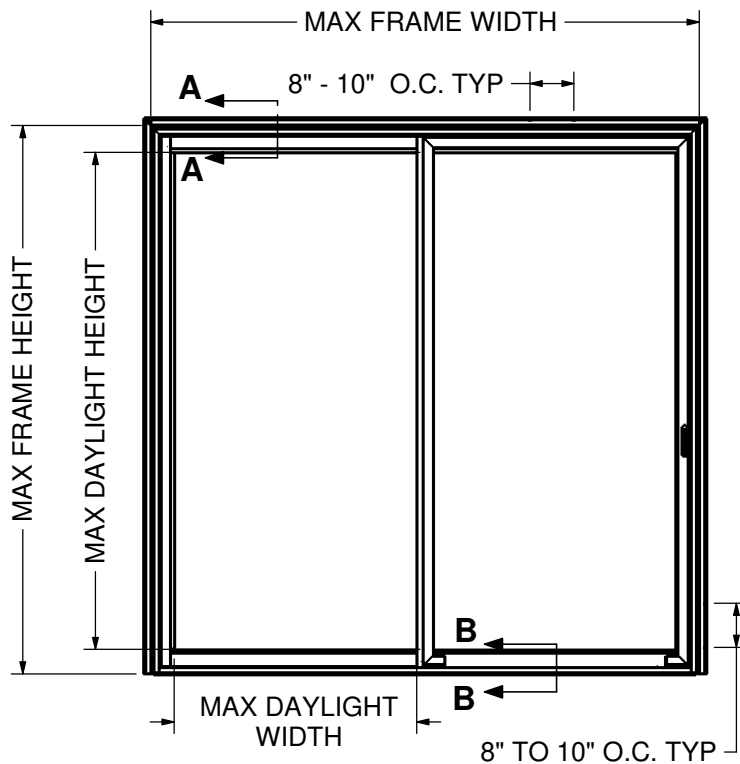


#6 X (1-5/8") NON-CORROSIVE
SCREW(S) 8"-10" O.C. THRU
NAILING FIN INTO BUCK AROUND
ENTIRE PERIMETER TYP.
MINIMUM 1-1/2" EMBEDMENT


USE SILICONE SEALANT
AROUND ENTIRE
PERIMETER BETWEEN
NAILING FIN & WOOD BUCK
BY OTHERS TYP.

.750 MIN EDGE
DISTANCE TYP.

**ASD01 SLIDING PATIO
DOOR
INTERMEDIATE
INTERLOCK
NAILING FIN
INSTALLATION**

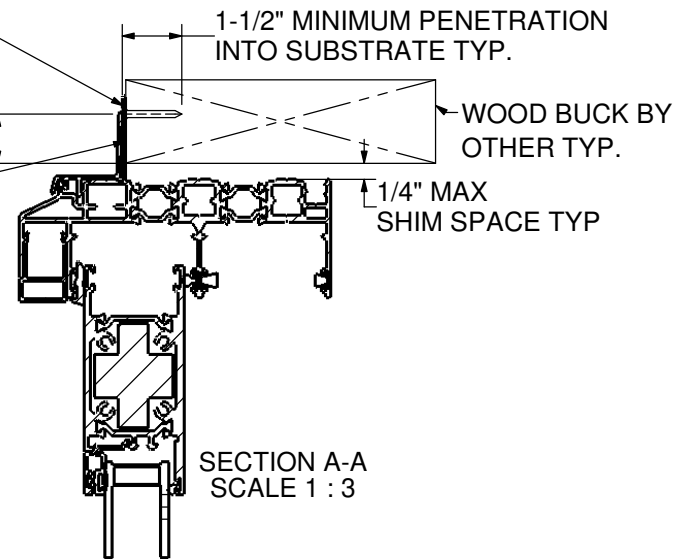

SECTION A-A
SCALE 1 : 3

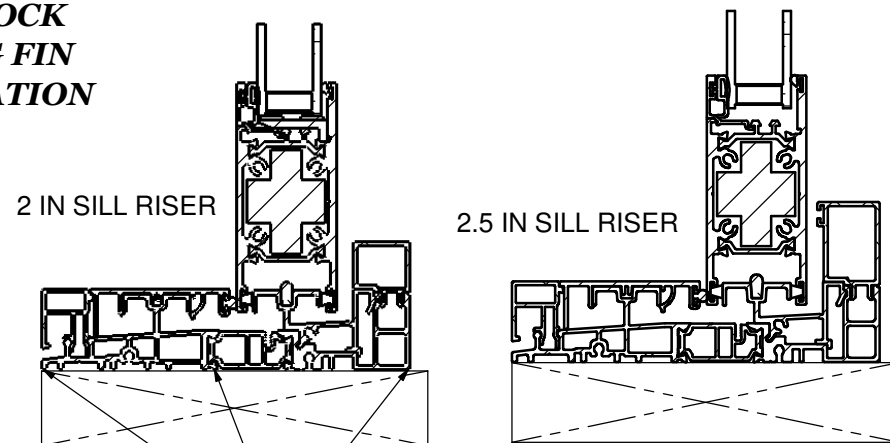

SECTION B-B
SCALE 1 : 3

ADD 3 ROWS OF SEALANT FULL WIDTH OF THE
DOOR AT SPECIFIED AREAS TYP. DETAIL
TYPICAL FOR ALL SILL RISER TYPES.

GENERAL NOTE(S):

1. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
2. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
* AAMA/WDMA/CSA 101/I.S.2/A440-17
* AAMA/WDMA/CSA 101/I.S.2/A440-22
3. THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE DOOR(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.

PELLA CORPORATION
102 MAIN STREET, PELLA, IOWA 50219

DRAWN:

ENGR.:

DATE CREATED:
2/4/2026

RL

CLASS

FILE NAME:

ECO:

ASD01

TOLERANCES UNLESS
OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE:

ASD01, SPD 2-WIDE FBC INSTALLATION INSTRUCTIONS,
INTERMEDIATE INTERLOCK


PAGE

1 OF 2


DRAWING NUMBER

45-45251

REV

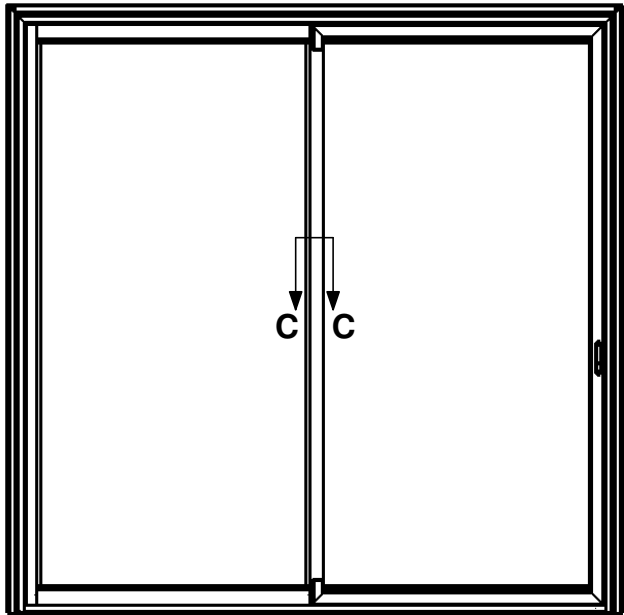

INTERMEDIATE INTERLOCK

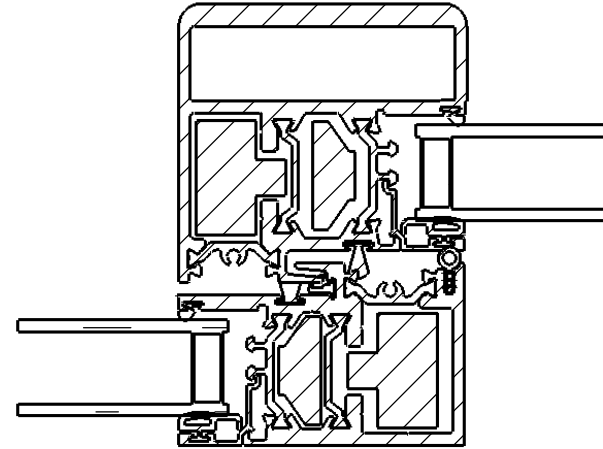

SECTION C-C
SCALE 1 : 2

DESCRIPTION	MAX FRAME SIZE		MAX DAYLIGHT OPENING		DESIGN PRESSURE (PSI)	FRAME MATERIAL
	WIDTH (IN)	HEIGHT (IN)	WIDTH (IN)	HEIGHT (IN)		
ASD01, 2-WIDE INTERMEDIATE INTERLOCK, 2.5" RISER	143.25	119.5	65.851	110.101	+25/-25	ALUMINUM
ASD01, 2-WIDE INTERMEDIATE INTERLOCK, 2" RISER, LIMITED WATER-DP20	143.25	119.5	65.851	110.101	+25/-25	ALUMINUM

PELLA CORPORATION
102 MAIN STREET, PELLA, IOWA 50219

DRAWN:

ENGR.:

DATE CREATED:
2/4/2026

RL

CLASS

FILE NAME:

ECO:

ASD01

TOLERANCES UNLESS
OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE:

ASD01, SPD 2-WIDE FBC INSTALLATION INSTRUCTIONS,
INTERMEDIATE INTERLOCK

PAGE

2 OF 2

DRAWING NUMBER

45-45251

REV