



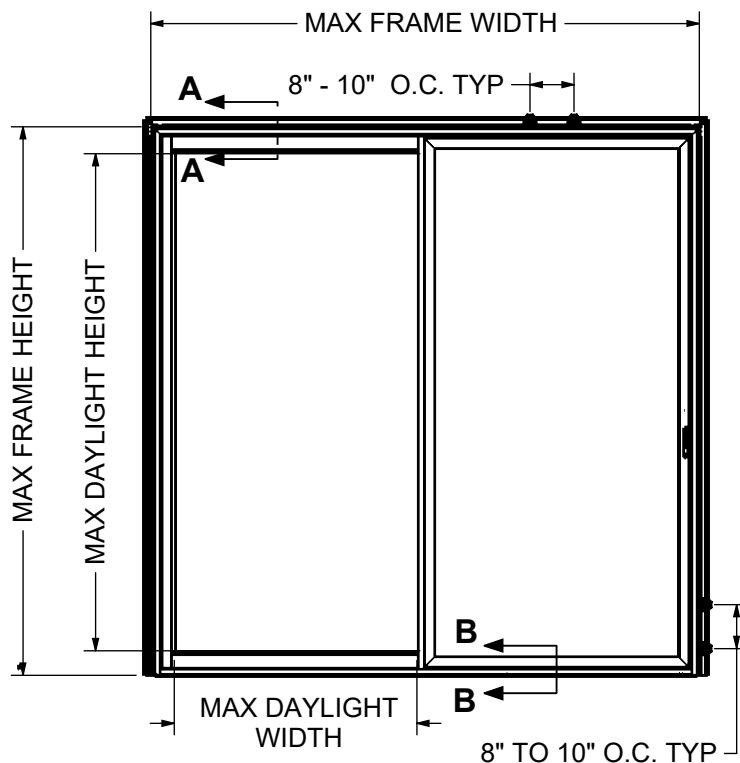

#6 X (1-5/8") NON-CORROSIVE
SCREW(S) 8"-10" O.C. THRU NAILING
FIN INTO BUCK AROUND ENTIRE
PERIMETER TYP. MINIMUM 1-1/2"
EMBEDMENT

USE SILICONE SEALANT
AROUND ENTIRE
PERIMETER BETWEEN
NAILING FIN & WOOD BUCK
BY OTHERS TYP.

.750 MIN EDGE
DISTANCE TYP.

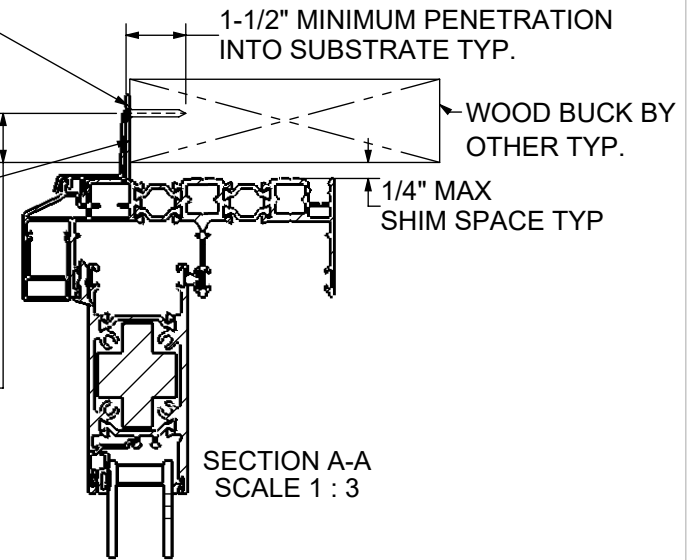


SECTION A-A
SCALE 1 : 3

ASD01 SLIDING PATIO DOOR FLUSH INTERLOCK NAILING FIN INSTALLATION

2 IN SILL RISER

2.5 IN SILL RISER

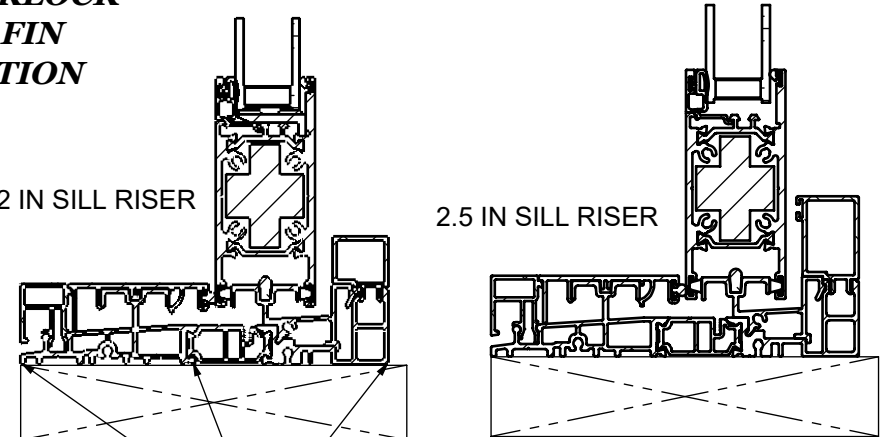

SECTION B-B
SCALE 1 : 3

ADD 3 ROWS OF SEALANT FULL WIDTH OF THE
DOOR AT SPECIFIED AREAS TYP. DETAIL
TYPICAL FOR ALL SILL RISER TYPES.

GENERAL NOTE(S):

- THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - AAMA/WDMA/CSA 101/I.S.2/A440-22
- THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE DOOR(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.
- FASTENERS, ANCHORS, AND CONNECTORS SHALL COMPLY WITH THE CORROSION RESISTANCE REQUIREMENTS OF THE 2026 FLORIDA BUILDING CODE, SECTION 1711, BASED ON EXPOSURE CONDITIONS AND PROXIMITY TO A SALTWATER SHORELINE AND NOT ALL THE ONES SHOWN HERE NECESSARILY APPLY.

PELLA CORPORATION

102 MAIN STREET, PELLA, IOWA 50219

DRAWN:

ENGR.:

DATE CREATED:

2/4/2026

RL

CLASS

FILE NAME:

ECO:

ASD01

TOLERANCES UNLESS
OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE:

ASD01, SPD 2-WIDE FBC INSTALLATION INSTRUCTIONS,
FLUSH INTERLOCK



PAGE

1 OF 2

DRAWING NUMBER

45-45250

REV

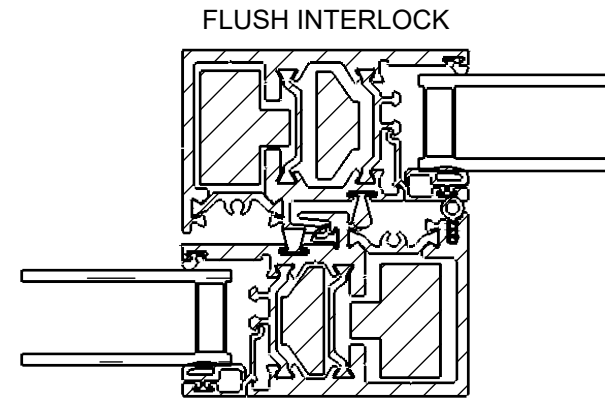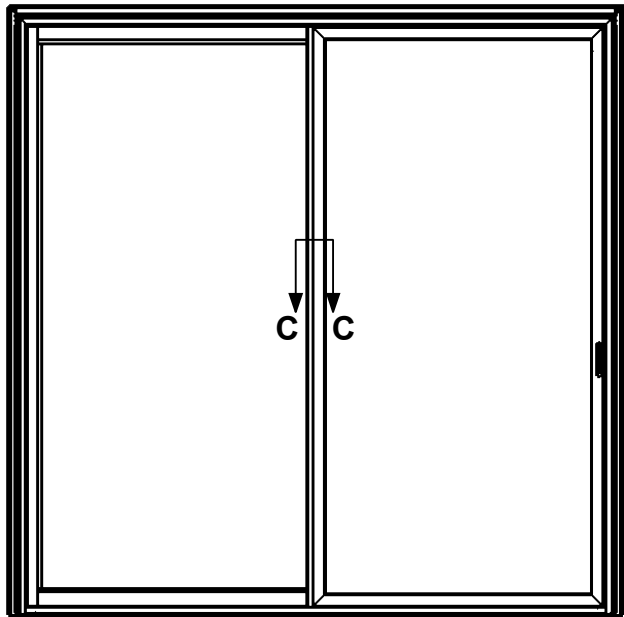

SECTION C-C
SCALE 1 : 2

DESCRIPTION	MAX FRAME SIZE		MAX DAYLIGHT OPENING		DESIGN PRESSURE (PSI)	FRAME MATERIAL
	WIDTH (IN)	HEIGHT (IN)	WIDTH (IN)	HEIGHT (IN)		
ASD01, 2-WIDE FLUSH INTERLOCK, 2.5" RISER	95.25	95.5	41.851	86.101	+40/-40	ALUMINUM
ASD01, 2-WIDE FLUSH INTERLOCK, 2" RISER, LIMITED WATER-DP20	95.25	95.5	41.851	86.101	+40/-40	ALUMINUM
ASD01, 2-WIDE FLUSH INTERLOCK, 2.5" RISER	143.25	119.5	65.851	110.101	+15/-15	ALUMINUM
ASD01, 2-WIDE FLUSH INTERLOCK, 2" RISER	143.25	119.5	65.851	110.101	+15/-15	ALUMINUM

PELLA CORPORATION
102 MAIN STREET, PELLA, IOWA 50219

DRAWN:

ENGR.:

DATE CREATED:

2/4/2026

RL

CLASS

FILE NAME:

ECO:

ASD01

TOLERANCES UNLESS
OTHERWISE NOTED
.X = ± X.X
.XX = ± X.XX
.XXX = ± X.XXX
ANGLES = ± X.X°
UNITS ARE IN INCHES

TITLE:

ASD01, SPD 2-WIDE FBC INSTALLATION INSTRUCTIONS,
FLUSH INTERLOCK

PAGE

2 OF 2

DRAWING NUMBER

45-45250

REV