

HILLPOINTE LLC, DBA PROPONENTS LLC

PRO PU SHIPLAP SIDING

(NON-HVHZ)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - ASTM E330-14(21)
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X WOOD AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. SIDING MATERIAL: POLYURETHANE
6. INSTALLATION OF SIDING ACCESSORIES SHALL BE DONE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE AND THE MANUFACTURER'S INSTRUCTIONS.
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND DESIGN RATING
2	TYPICAL ELEVATION
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	INSTALLATION NOTES AND ANCHOR TABLE

DESIGN RATING	
DESIGN PRESSURE	MISSILE IMPACT
+/-43 PSF	N/A



HILLPOINTE LLC, DBA PROPONENTS LLC
8820 MACON HIGHWAY, BUILDING 300
ATHENS, GA 30606
PH: (407) 752-9004

TITLE:
PRO PU SHIPLAP SIDING
(NON-HVHZ)

GENERAL NOTES & DESIGN RATING

PREPARED BY:

BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.02.10 19:39:21 -05'00'

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL48025

DATE:
01.24.2026

DWG. BY:
DI

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
HPT004

SHEET:
1





Diagram showing the elevation view of a wall section. Vertical reinforcement bars are indicated by a circle with 'E/4' inside. The maximum spacing between bars is labeled as '16" MAX. O.C.'.

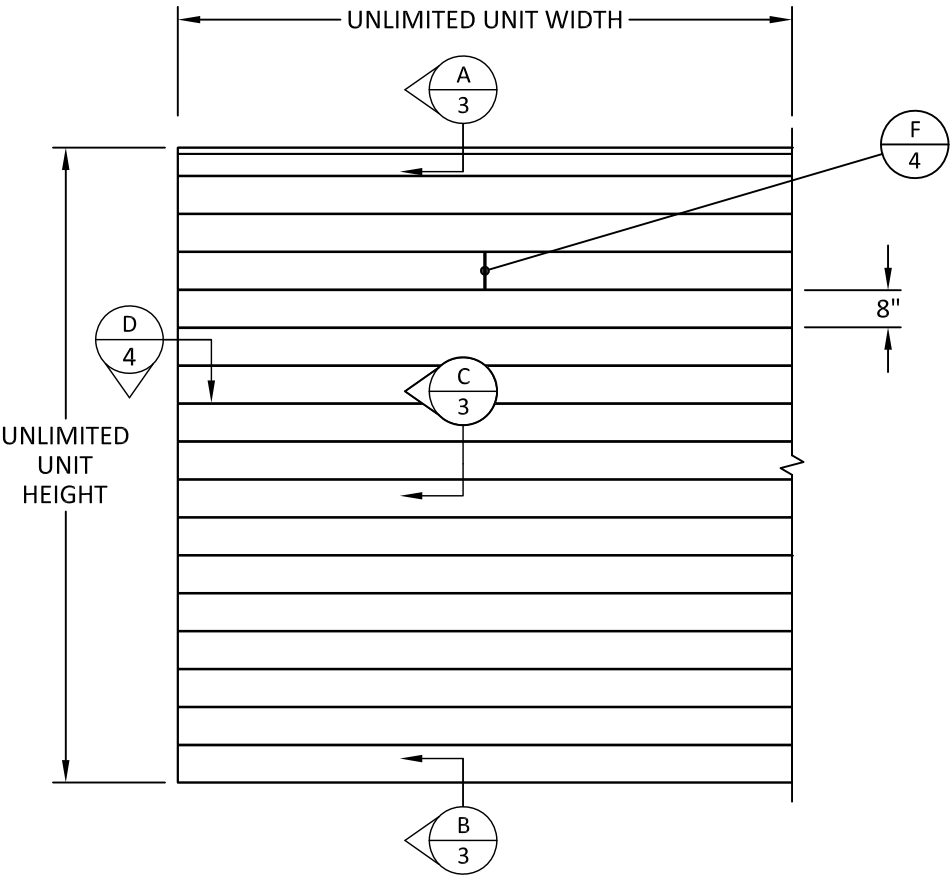

TYPICAL ELEVATION

TITLE:

PRO PU SHIPLAP SIDING
(NON-HVHZ)

TYPICAL ELEVATION


PREPARED BY:

 BUILDING DROPS

BUILDING DROPS, INC.
1300 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8878
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

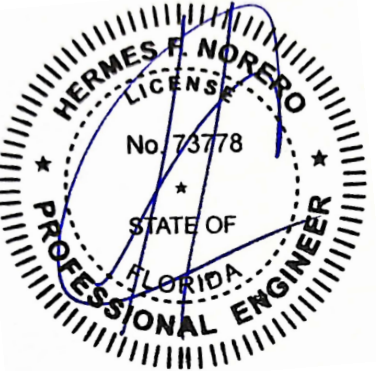

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48025**

DATE: 01.24.2026


DWG. BY: DI	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: HPT004

SHEET: 2


c:\users\d\aniwata\building_drops\inc\building_drops\landing - common\projects\hillpointe, llc\lbc-25-0953.1 - submittal - pu lap siding\dwgs\hpt004.dwg 2/9/2026 12:48 PM

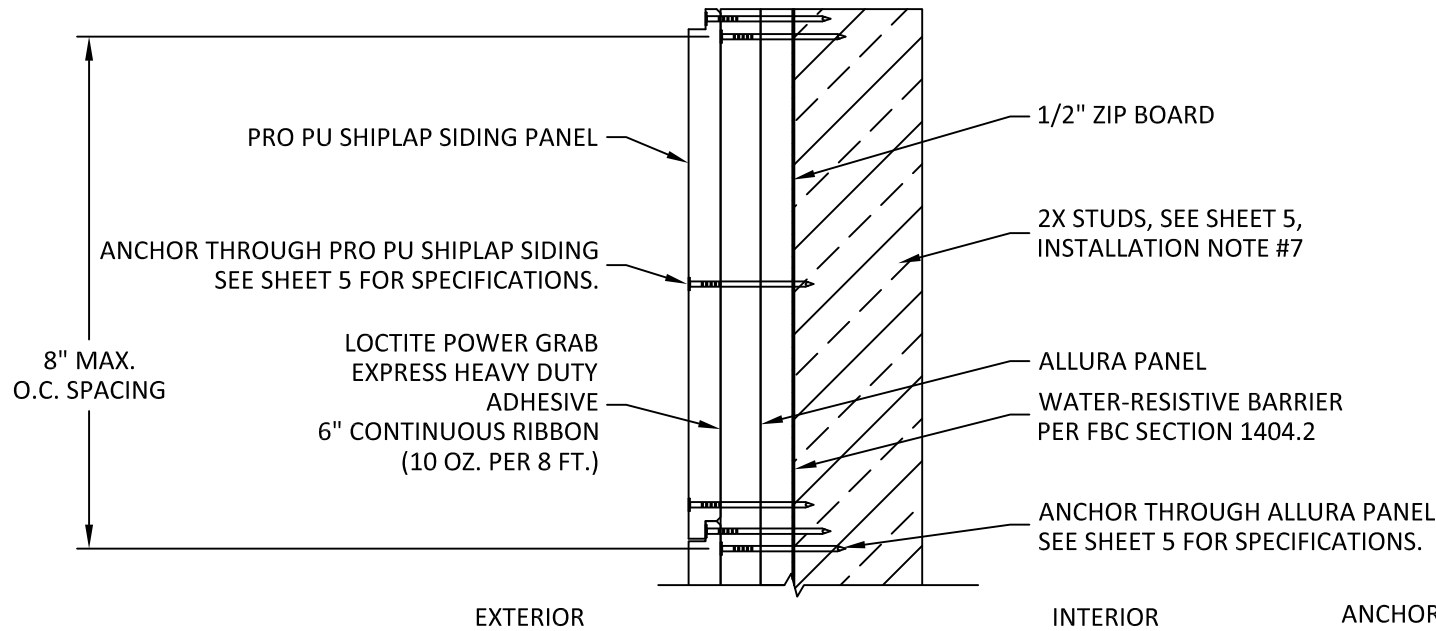

A
3 VERTICAL SECTION
SIDING TOP

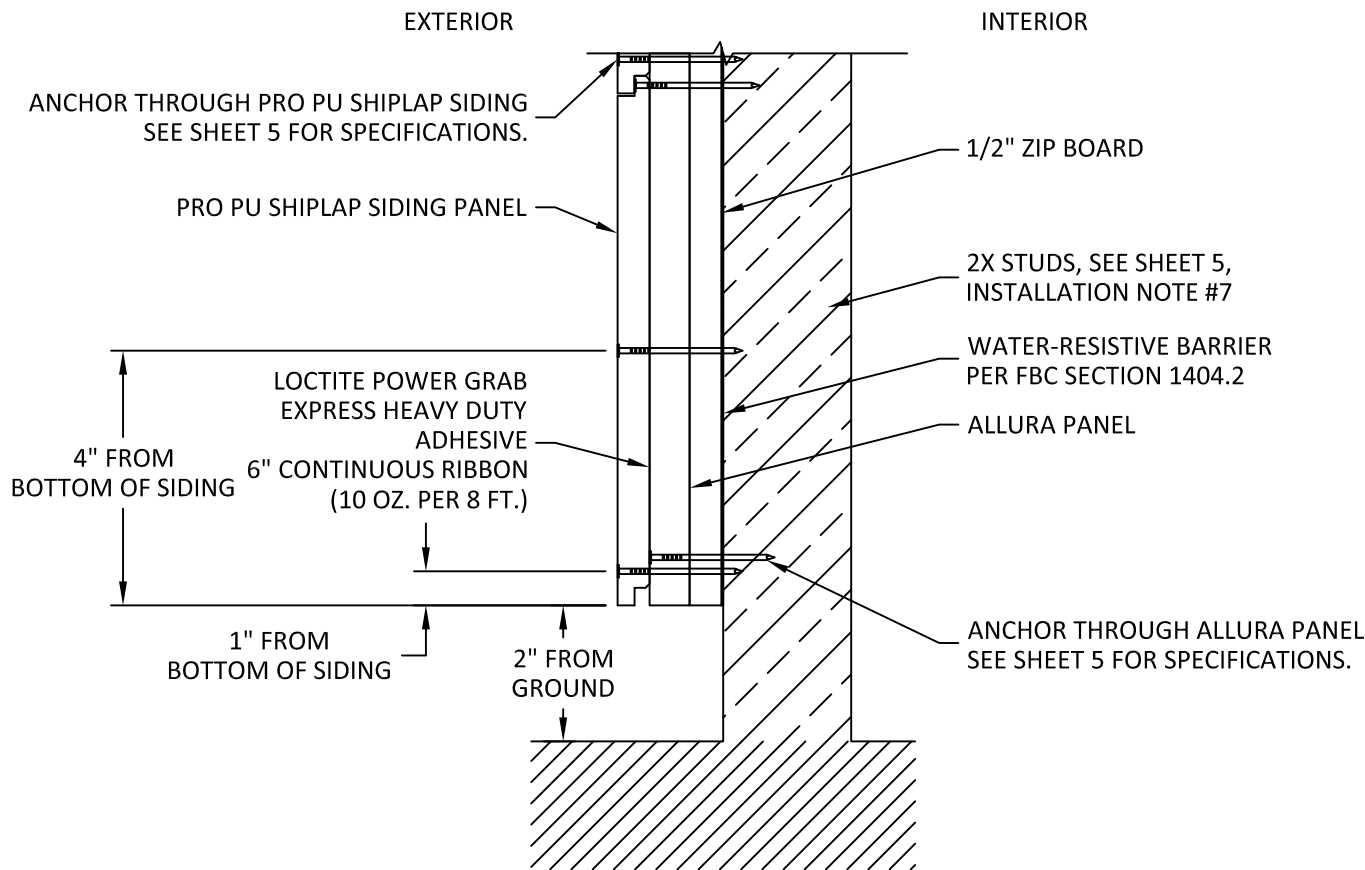

B
3 VERTICAL SECTION
SIDING BOTTOM

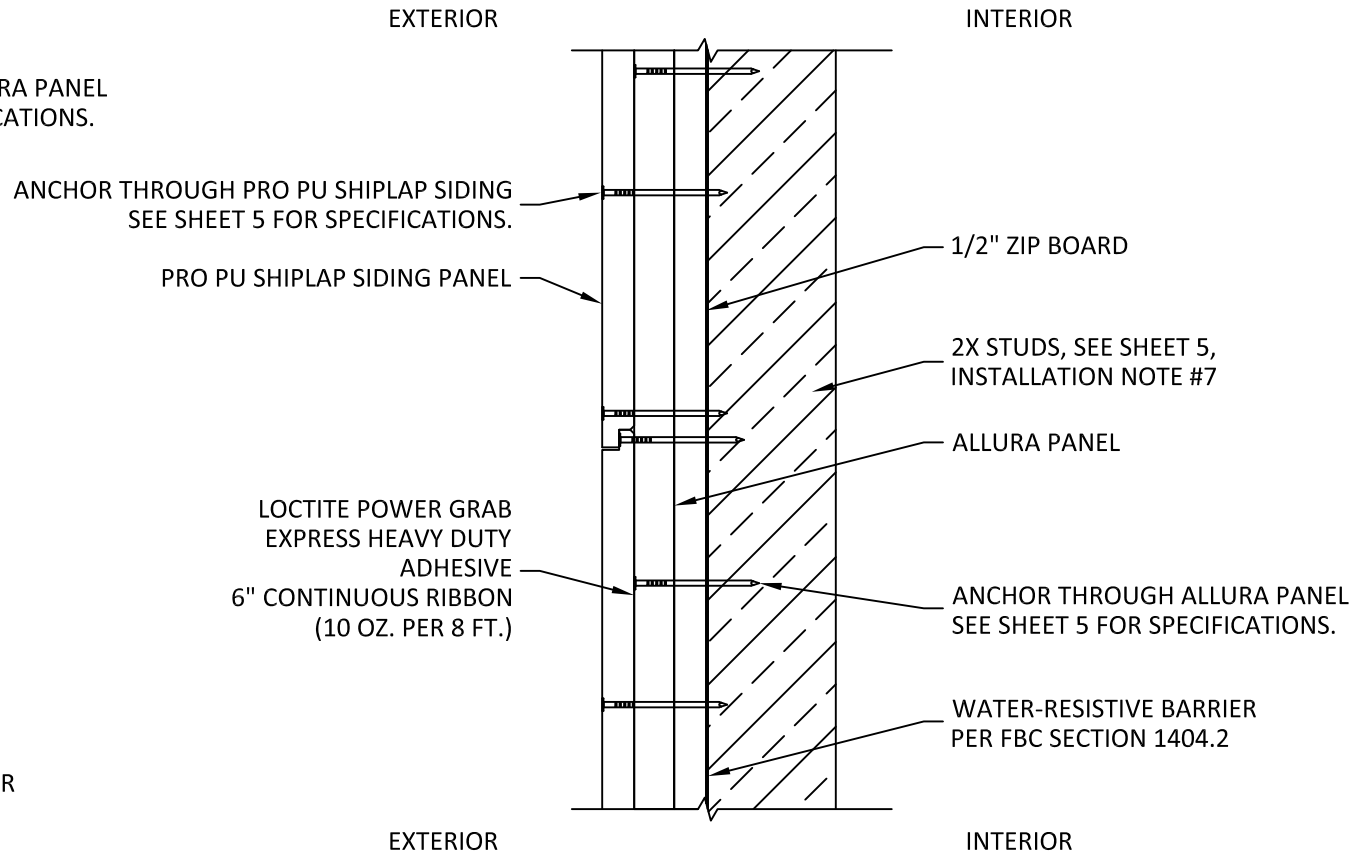

C
3 VERTICAL SECTION
INTERMEDIATE SIDING



HILLPOINTE LLC, DBA PROPONENTS LLC
8820 MACON HIGHWAY, BUILDING 300
ATHENS, GA 30606
PH: (407) 752-9004

TITLE: PRO PU SHIPLAP SIDING
(NON-HVHZ)

VERTICAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48025**

DATE: **01.24.2026**

DWG. BY:
DI

CHK. BY:
HFN



SCALE: **NTS**

DWG. #: **HPT004**

SHEET:

3

c:\users\d\aniwata\building_drops, inc\building_drops, inc\common\projects\hillpointe, llc\lbc-25-0953.1 - submittal - pu lap siding.dwg\hpt004.dwg 2/9/2026 12:48 PM

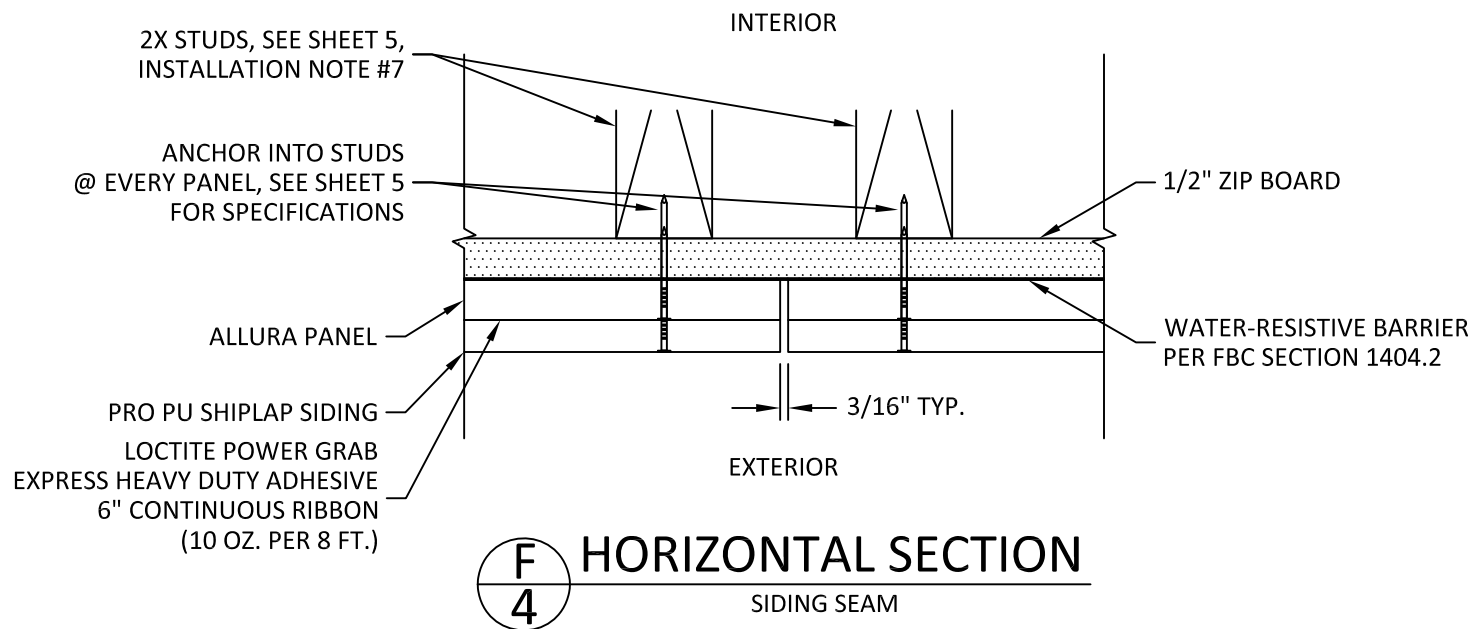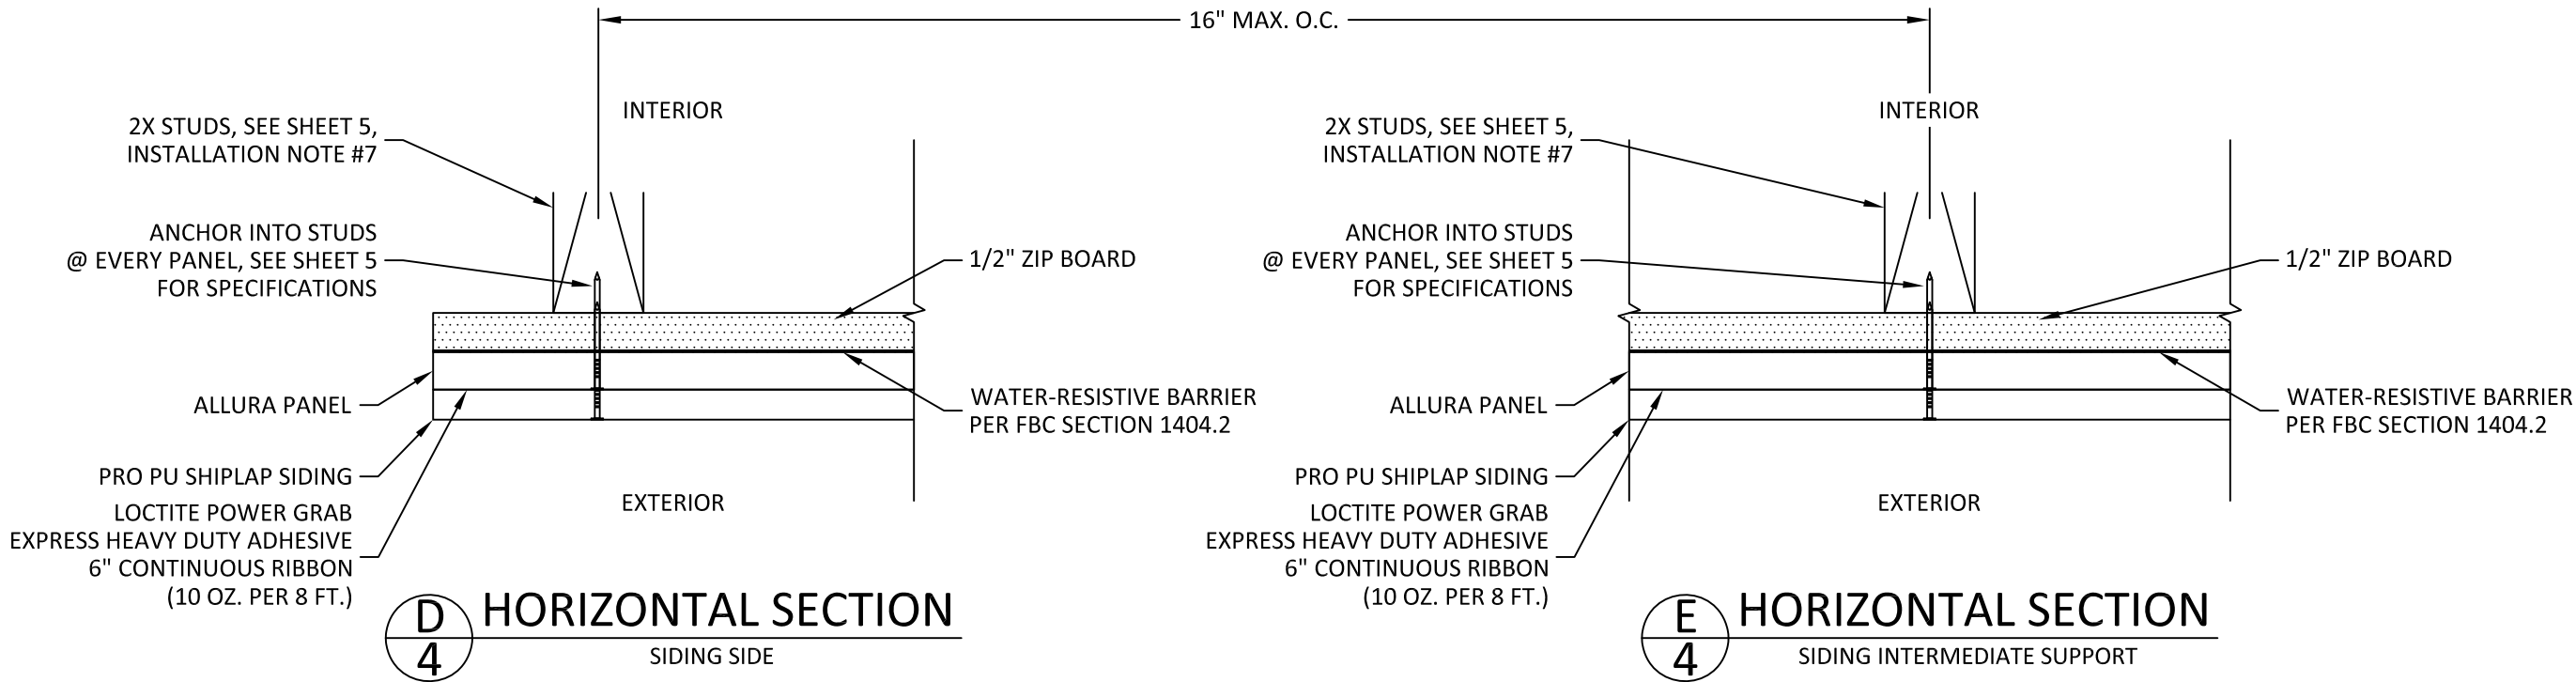

HILLPOINTE LLC, DBA PROPONENTS LLC
8820 MACON HIGHWAY, BUILDING 300
ATHENS, GA 30606
PH: (407) 752-9004

TITLE:
PRO PU SHIPLAP SIDING
(NON-HVHZ)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48025**

DATE: **01.24.2026**

DWG. BY: **DI** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **HPT004**

SHEET: **4**

c:\users\d\aniwata\building drops - common\projects\hillpointe - common\building drops\landing - common\projects\hillpointe - common\building drops\hpt004.dwg 2/9/2026 12:48 PM

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
5. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
6. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
7. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. 1/2" ZIP BOARD SUPPORTED BY 2X WOOD STUDS OR 2X6 METAL STUDS, EACH AT 16" O.C.

A.a. WOOD STUDS - MINIMUM SPECIFIC GRAVITY OF 0.55.

A.b. STEEL STUDS - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 49 MILS (18 GAUGE).

A.c. ALUMINUM STUDS - 1/8" MINIMUM THICKNESS (6063-T5).

ANCHOR SCHEDULE				
LOCATION	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH PRO PU SHIPLAP SIDING TO SUBSTRATE	WOOD: MIN. S.G. = 0.55	#8 WOOD SCREWS	1-1/2"	1/2"
		16 GA. TRIM NAILS		
	STEEL: MIN. 18 GA. MIN. Fy = 33 ksi	#8 GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
	WOOD: MIN. S.G. = 0.55	#8 WOOD SCREWS	1-1/2"	1/2"
		6d RING SHANK NAILS		
THROUGH ALLURA PANEL TO SUBSTRATE	STEEL: MIN. 18 GA. MIN. Fy = 33 ksi	#8 GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			



HILLPOINTE LLC, DBA PROPONENTS LLC
8820 MACON HIGHWAY, BUILDING 300
ATHENS, GA 30606
PH: (407) 752-9004

TITLE:
PRO PU SHIPLAP SIDING
(NON-HVHZ)
INSTALLATION NOTES &
ANCHOR TABLE

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL48025**

DATE: **01.24.2026**

DWG. BY:
DI

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **HPT004**

SHEET:
5