

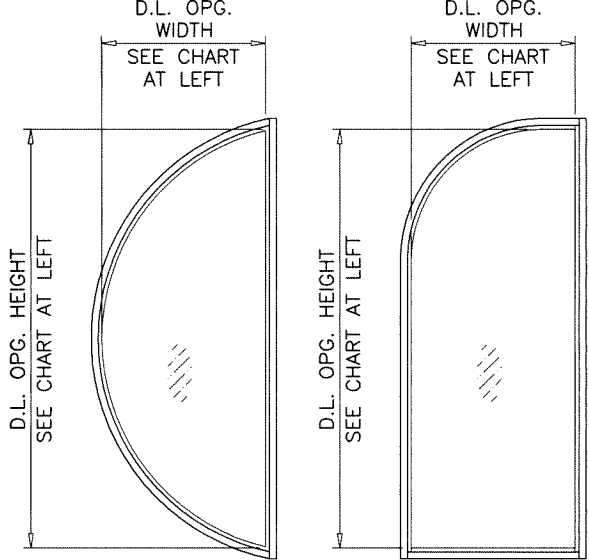
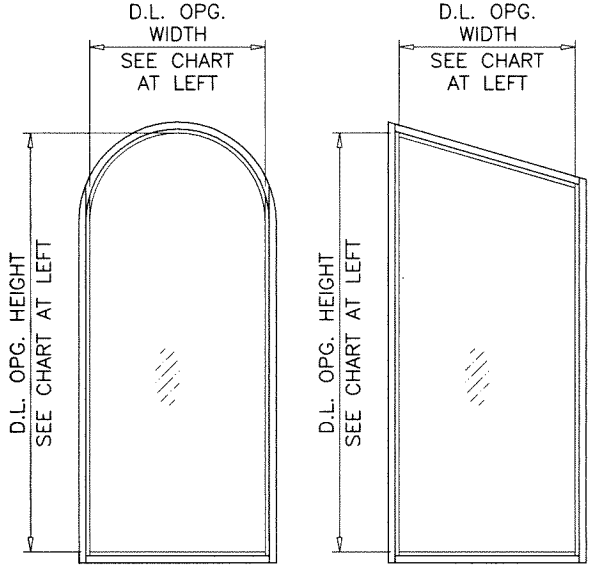


GLASS LOAD CAPACITY - PSF			
NOMINAL DIMS.		GLASS TYPES 'A' & 'Ai'	
D.L.O. WIDTH	D.L.O. HEIGHT	EXT.(+)	INT.(-)
32-3/8"	92-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
50-3/8"		75.0	75.2
56-3/8"		75.0	75.2
62-3/8"		68.4	68.4
68-3/8"		62.7	62.7
32-3/8"	104-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
50-3/8"		75.0	75.2
56-3/8"		75.0	75.2
62-3/8"		68.4	68.4
68-3/8"		62.7	62.7
32-3/8"	116-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
50-3/8"		75.0	75.2
56-3/8"		75.0	75.2
62-3/8"		68.4	68.4
68-3/8"		62.7	62.7
32-3/8"	128-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
50-3/8"		75.0	75.2
56-3/8"		75.0	75.2
32-3/8"	140-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
50-3/8"		75.0	75.2
56-3/8"		75.0	75.2
32-3/8"	152-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
50-3/8"		75.0	75.2
56-3/8"		75.0	75.2
32-3/8"	164-3/8"	75.0	75.2
38-3/8"		75.0	75.2
44-3/8"		75.0	75.2
56-3/8"		75.0	75.2


INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

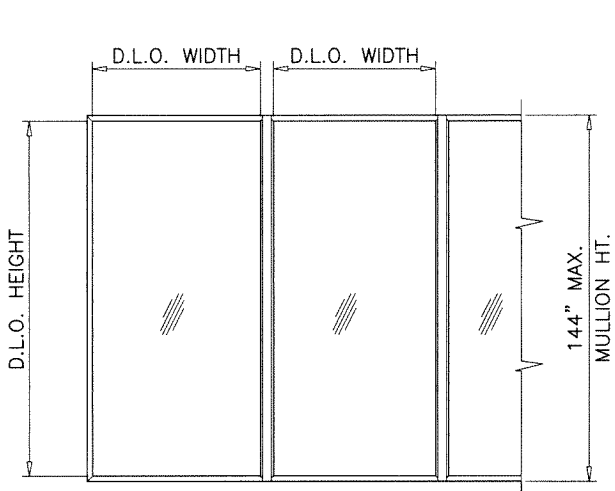

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN ABOVE AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES. SINGLE LITES MAY BE INSTALLED VERTICALLY AS SHOWN ABOVE OR HORIZONTALLY.

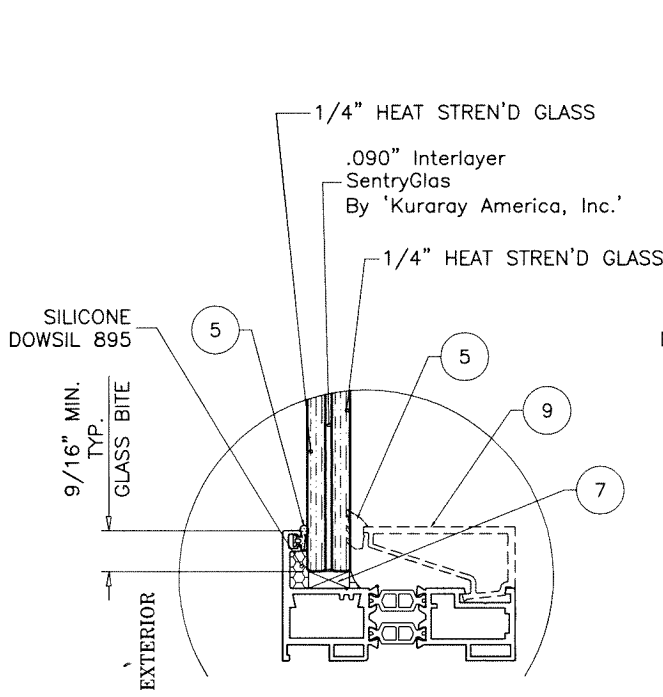

GLASS TYPE 'A'
9/16" OVERALL LAM. GLASS

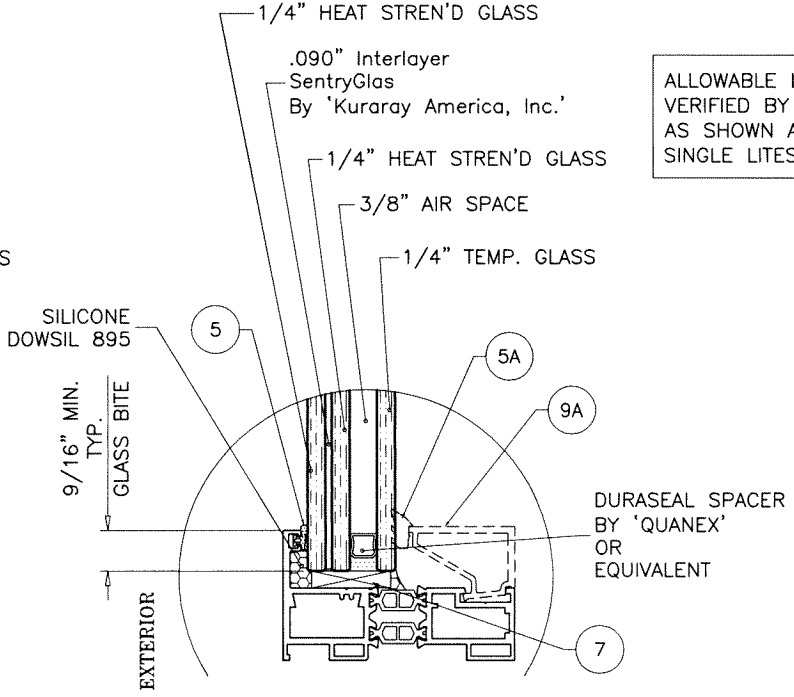


GLASS TYPE 'Ai'
1-1/8" OVERALL LAM. INSUL. GLASS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

GLAZING OPTIONS

GLASS
FL #48036

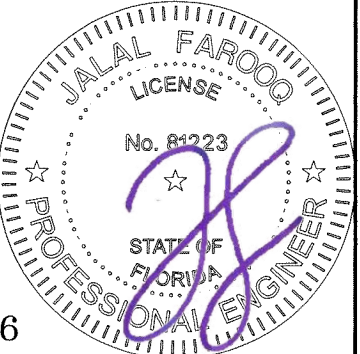

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
www.korus-usa.com

revisions:	no	date	by	description

date: 05-10-25

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:


drawing no.
25-53F

sheet 2 of 13

MULLION ANCHOR LOAD CAPACITY - PSF							
EXT.(+) & INT.(-)							
NOMINAL DIMS.		ANCHOR TYPES					
WIDTH (W)	FRAME HEIGHT	A	B	C	D	E	F
36"	96"	75.2	69.0	75.2	75.2	75.2	75.2
42"		75.2	61.5	75.2	75.2	75.2	75.2
48"		75.2	56.0	75.2	68.7	75.2	75.2
54"		75.2	52.0	75.2	63.7	75.2	75.2
60"		75.2	48.9	75.2	59.9	75.2	75.2
66"		75.2	46.6	75.2	57.1	75.2	75.2
72"		75.2	44.8	75.2	54.9	75.2	75.2
36"	108"	75.2	59.8	75.2	73.2	75.2	75.2
42"		75.2	53.0	75.2	64.9	75.2	75.2
48"		75.2	48.0	75.2	58.9	75.2	75.2
54"		75.2	44.3	75.2	54.3	75.2	75.2
60"		75.2	41.4	75.2	50.7	75.2	75.2
66"		75.2	39.1	75.2	47.9	75.2	75.2
72"		75.2	37.4	75.2	45.8	75.2	75.2
36"	120"	75.2	52.7	75.2	64.6	75.2	75.2
42"		75.2	46.6	75.2	57.1	75.2	75.2
48"		75.2	42.0	75.2	51.5	75.2	75.2
54"		75.2	38.5	75.2	47.3	75.2	75.2
60"		75.2	35.9	75.2	43.9	75.2	75.2
66"		75.2	33.7	75.2	41.3	75.2	75.2
72"		75.2	32.0	75.2	39.2	75.2	75.2
36"	132"	75.2	47.2	75.2	57.8	75.2	75.2
42"		75.2	41.5	75.2	50.9	75.2	75.2
48"		75.2	37.4	75.2	45.8	75.2	75.2
54"		75.2	34.2	75.2	41.9	75.2	75.2
60"		75.2	31.6	75.2	38.8	75.2	75.2
36"	144"	75.2	42.7	75.2	52.3	75.2	75.2
42"		75.2	37.5	75.2	45.9	75.2	75.2
48"		75.2	33.6	75.2	41.2	75.2	75.2
54"		75.2	30.7	75.2	37.6	73.6	75.2
60"		75.2	28.3	75.2	34.7	68.0	75.2

SEE SHEET 11 FOR ANCHOR TYPES 'A', 'B' AND 'C'
SEE SHEET 12 FOR ANCHOR TYPES 'D', 'E' AND 'F'


INTERPOLATION BETWEEN WIDTHS OR HEIGHTS ALLOWED.

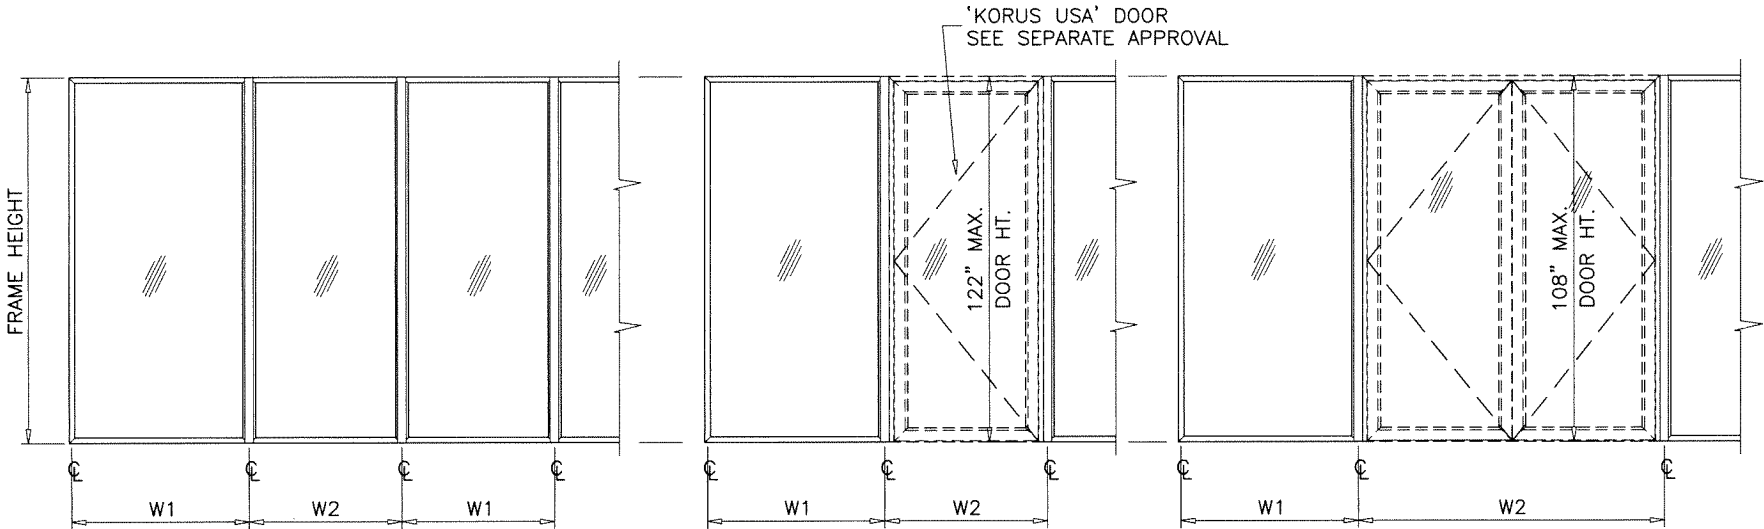

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

$$\text{WIDTH (W)} = \frac{W1}{2} + \frac{W2}{4}$$

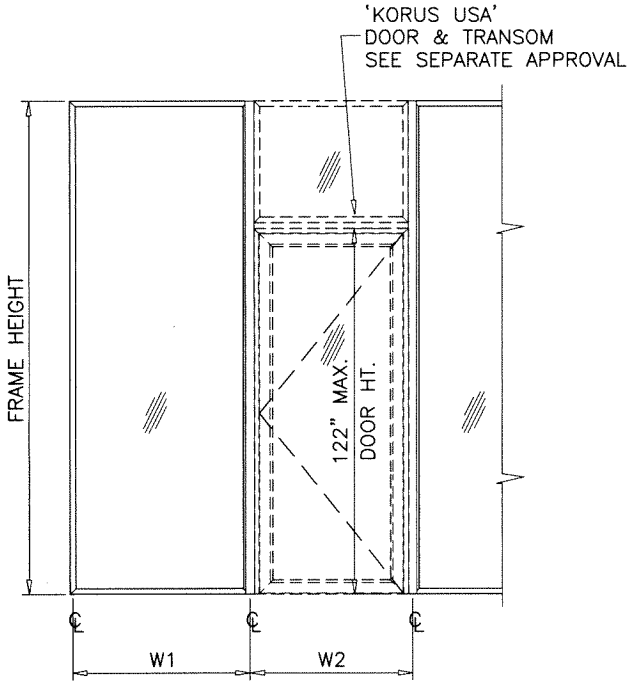

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

Sealed: 2/11/2026



MULLION ANCHORS

FL #48036

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
www.korus-usa.com

revisions:
no date by description

date: 05-10-25
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:



drawing no.
25-53F
sheet 4 of 13

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

af c

COMP-ANL\25-53F-KU

DOOR MULLION LOAD CAPACITY - PSF					
NOMINAL DIMS.				MULL 'DM1'	MULL 'DM2'
WIDTH (W2) INCHES	WIDTH (W1) INCHES	DDOR HEIGHT INCHES	FRAME HEIGHT INCHES	EXT.(+) INT.(-)	EXT.(+) INT.(-)
100-13/16	36	84	107-13/16	75.2	75.2
	42			75.2	75.2
	48			75.2	75.2
	54			75.2	75.2
	60-5/8			74.2	75.2
	36	96		75.2	75.2
	42			75.2	75.2
	48			75.2	75.2
	54			75.2	75.2
	60-5/8			75.2	75.2
	36	84	120	69.3	75.2
	42			66.2	75.2
	48			63.4	75.2
	54			60.8	75.2
	60-5/8			58.2	75.2
	36	96		74.6	75.2
	42			71.0	75.2
	48			67.7	75.2
	54			64.8	75.2
	60-5/8			61.8	75.2
	36	107-13/16	75.2	75.2	
	42		75.2	75.2	
	48		75.2	75.2	
	54		75.2	75.2	
	60-5/8		68.5	75.2	
	36	84	132	55.4	75.2
	42			53.0	75.2
	48			50.8	75.2
	54			48.8	75.1
	60-5/8			46.8	71.9
	36	96		57.9	75.2
	42			55.3	75.2
	48			52.9	75.2
	54			50.7	75.2
	60-5/8			48.4	74.5
	36	107-13/16	62.7	75.2	
	42		59.6	75.2	
	48		56.8	75.2	
	54		54.3	75.2	
	60-5/8		51.7	75.2	
	36	84	144-1/8	45.7	70.2
	42			43.7	67.3
	48			42.0	64.5
	54			40.3	62.0
	60-5/8			38.7	59.4
	36	96		46.8	71.9
	42			44.7	68.7
	48			42.8	65.9
	54			41.1	63.2
	60-5/8			39.4	60.5
	36	107-13/16	49.2	75.2	
	42		46.9	72.1	
	48		44.8	68.9	
	54		42.9	66.0	
	60-5/8		41.0	63.1	

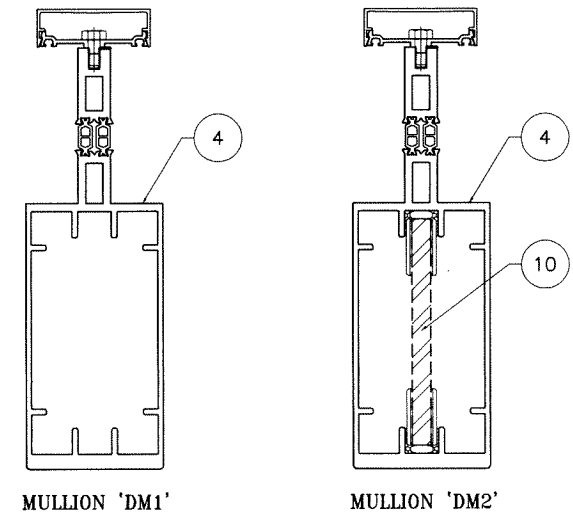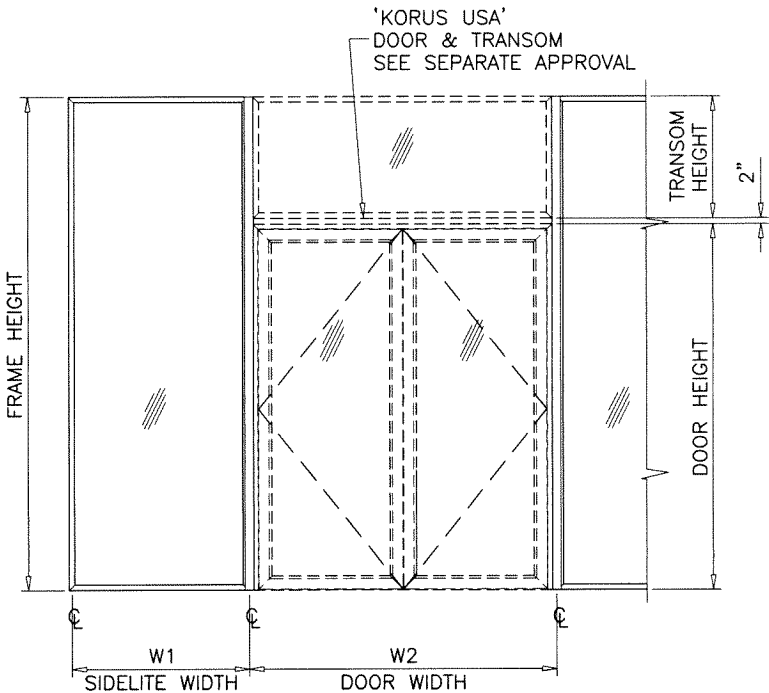

Ix IN^4	Sx IN^3
18.475	4.902

	Ix IN^4	Sx IN^3
ALUMINUM	18.475	4.902
STEEL	3.460	1.465
TOTAL		
Ix ALUM + Ix STL X 2.9	28.410	

Sealed: 2/11/2026



DOOR MULLION

FL #48036

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
www.korus-usa.com

revisions:


no	date	by	description

date: 05-10-25
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no. **25-53F**
sheet 5 of 13

DOOR MULLION ANCHOR LOAD CAPACITY – PSF EXT.(+) & INT.(–)									
NOMINAL DIMS.				ANCHOR TYPES					
WIDTH (W2) INCHES	WIDTH (W1) INCHES	DOOR HEIGHT INCHES	FRAME HEIGHT INCHES	A	B	C	D	E	F
100–13/16	36	84	107–13/16	75.2	28.4	75.2	34.8	68.2	75.2
	42			75.2	27.1	75.2	33.2	65.1	75.2
	48			75.2	25.9	75.2	31.8	62.3	73.7
	54			73.1	24.8	75.2	30.4	59.7	70.6
	60–5/8			69.9	23.8	75.2	29.1	57.0	67.5
	36	96		75.2	27.2	75.2	33.3	65.3	75.2
	42			75.2	26.0	75.2	31.9	62.5	73.9
	48			73.3	24.9	75.2	30.5	59.9	70.8
	54			70.4	23.9	75.2	29.3	57.4	67.9
	60–5/8			67.4	22.9	75.2	28.1	55.0	65.0
	36	84	120	75.2	26.5	75.2	32.5	63.7	75.2
	42			74.4	25.3	75.2	31.0	60.7	71.8
	48			71.1	24.1	75.2	29.6	58.0	68.6
	54			68.0	23.1	75.2	28.3	55.5	65.6
	60–5/8			64.9	22.1	75.2	27.0	53.0	62.7
	36	96		75.0	25.5	75.2	31.2	61.2	72.3
	42			71.6	24.3	75.2	29.8	58.4	69.1
	48			68.5	23.3	75.2	28.5	55.9	66.1
	54			65.6	22.3	75.2	27.3	53.6	63.3
	60–5/8			62.8	21.3	74.0	26.1	51.2	60.6
	36	107–13/16		71.9	24.4	75.2	29.9	58.7	69.4
	42			68.8	23.4	75.2	28.6	56.1	66.4
	48			65.9	22.4	75.2	27.5	53.8	63.6
	54			63.3	21.5	74.6	26.4	51.6	61.1
	60–5/8			60.6	20.6	71.5	25.2	49.5	58.5
	36	84	132	72.9	24.8	75.2	30.3	59.5	70.3
	42			69.4	23.6	75.2	28.9	56.6	67.0
	48			66.2	22.5	75.2	27.6	54.0	63.9
	54			63.3	21.5	74.6	26.3	51.6	61.1
	60–5/8			60.3	20.5	71.2	25.1	49.2	58.2
	36	96		70.2	23.8	75.2	29.2	57.3	67.7
	42			66.9	22.7	75.2	27.9	54.6	64.6
	48			63.9	21.7	75.2	26.6	52.2	61.7
	54			61.2	20.8	72.2	25.5	50.0	59.1
	60–5/8			58.5	19.9	68.9	24.3	47.7	56.4
	36	107–13/16		67.5	22.9	75.2	28.1	55.1	65.1
	42			64.5	21.9	75.2	26.8	52.6	62.2
	48			61.7	21.0	72.8	25.7	50.4	59.6
	54			59.2	20.1	69.8	24.6	48.3	57.1
	60–5/8			56.6	19.2	66.7	23.6	46.2	54.6
	36	84	144–1/8	68.3	23.2	70.2	28.4	55.7	65.9
	42			64.9	22.1	67.3	27.0	53.0	62.7
	48			61.9	21.0	64.5	25.8	50.5	59.7
	54			59.1	20.1	62.0	24.6	48.2	57.1
	60–5/8			56.3	19.1	59.4	23.5	46.0	54.4
	36	96		65.9	22.4	71.9	27.4	53.8	63.6
	42			62.8	21.3	68.7	26.1	51.2	60.6
	48			59.9	20.4	65.9	25.0	48.9	57.8
	54			57.3	19.5	63.2	23.9	46.8	55.3
	60–5/8			54.7	18.6	60.5	22.8	44.6	52.8
	36	107–13/16		63.6	21.6	74.9	26.5	51.9	61.3
	42			60.6	20.6	71.5	25.2	49.5	58.5
	48			58.0	19.7	68.4	24.1	47.3	55.9
	54			55.5	18.9	65.5	23.1	45.3	53.6
	60–5/8			53.1	18.0	62.6	22.1	43.3	51.2

SEE SHEET 11 FOR ANCHOR TYPES 'A', 'B' AND 'C'
SEE SHEET 12 FOR ANCHOR TYPES 'D', 'E' AND 'F'

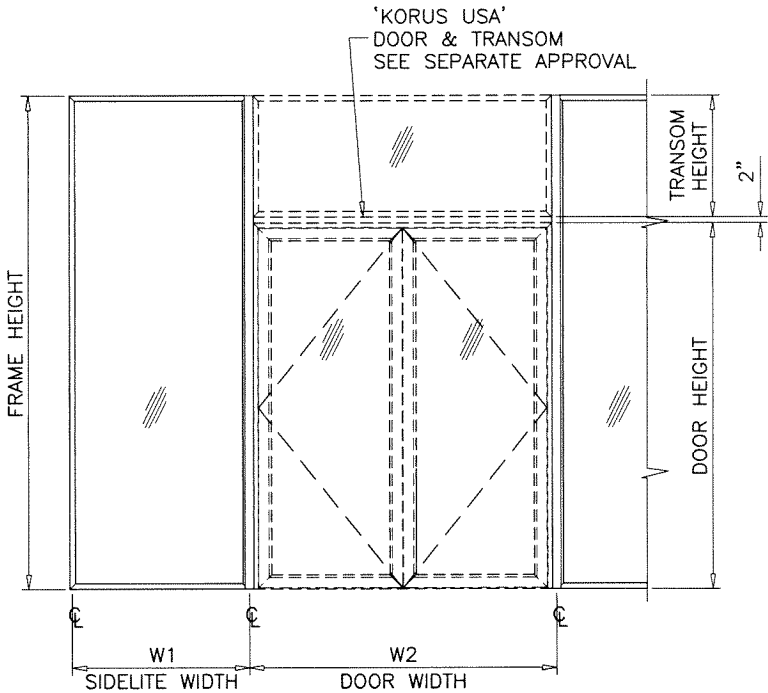

DOOR MULLION ANCHORS

Sealed: 2/11/2026



FL #48036

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)






Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
www.korus-usa.com

revisions:
no date by description

date: 05-10-25
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-53F

sheet 6 of 13

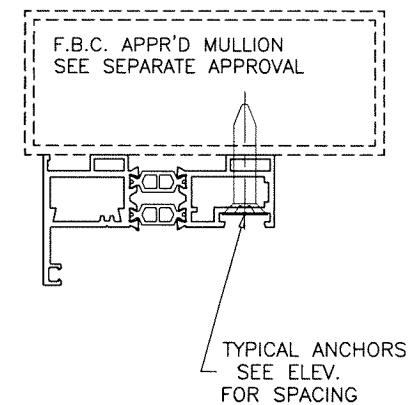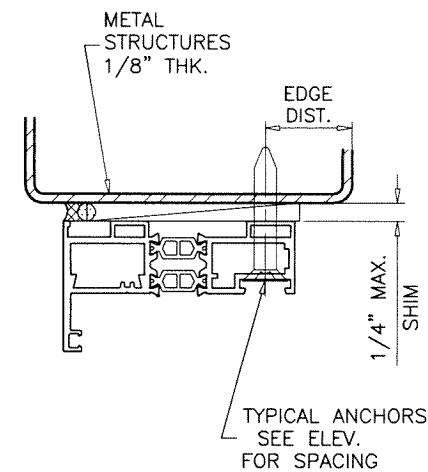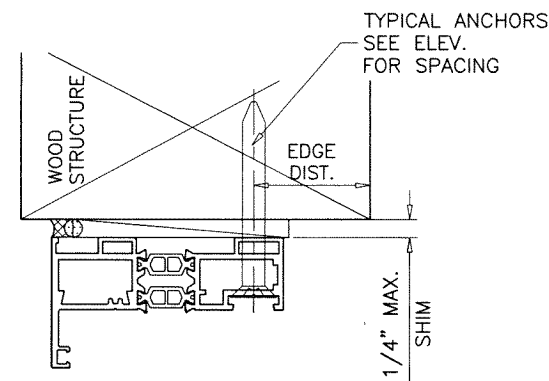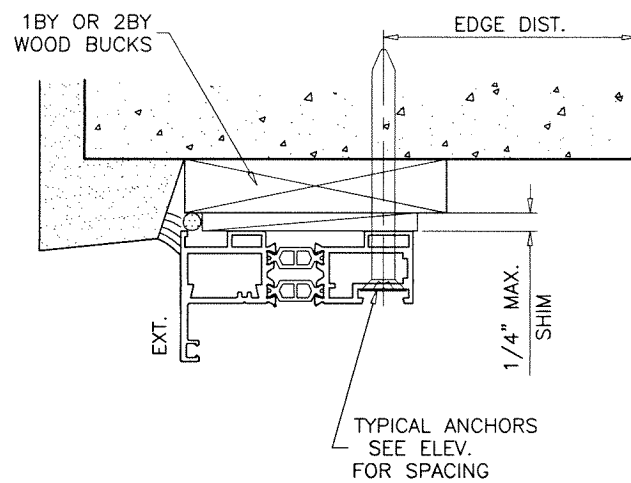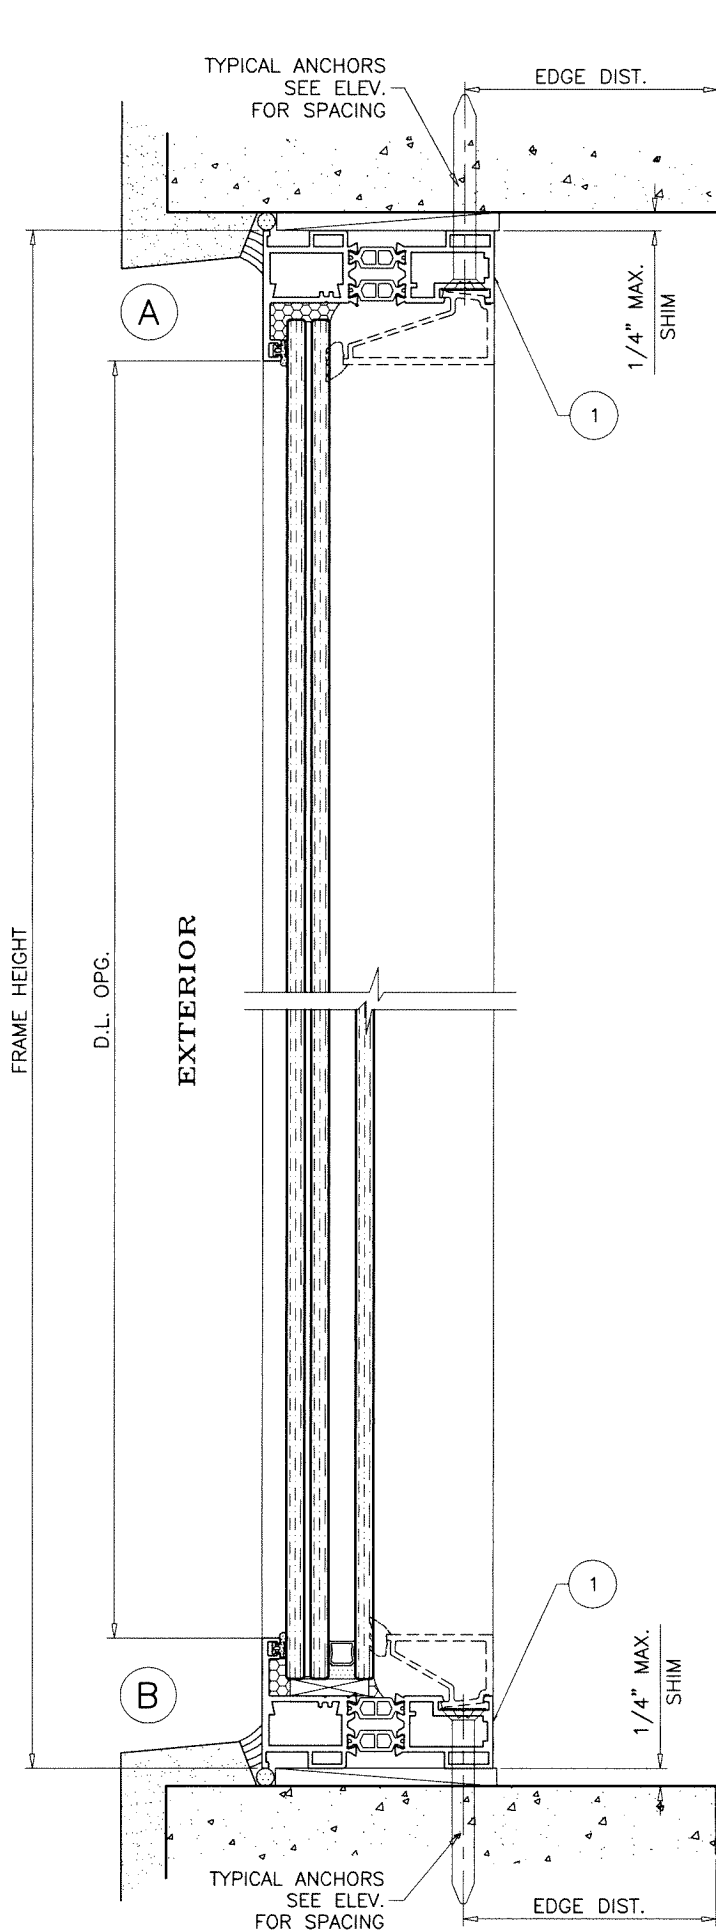

WOOD BUCKS AND METAL STRUCTURE NOT BY 'KORUS USA' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS AT FRAME: SEE ELEV. FOR SPACING

5/16" DIA. ULTRACON BY 'DEWALT' ($F_u=177$ KSI, $F_y=155$ KSI)
 INTO WOOD STRUCTURES

1-7/8" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY OR 2BY WOOD BUCKS INTO CONC. OR BLOCKS

1-1/2" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-1/2" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS

1-1/2" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-1/2" MIN. EMBED INTO BLOCKS (JAMBS)

5/16" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)

INTO F.B.C. APPROVED MULLIONS

OR

INTO METAL STRUCTURES (HEAD/SILL/JAMBS)

(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS

ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)

STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 3-1/8" MIN.

INTO WOOD BUCKS OR WOOD STRUCTURE = 1-1/4" MIN.


INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.

CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.

C-90 GROUT FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

Sealed: 2/11/2026

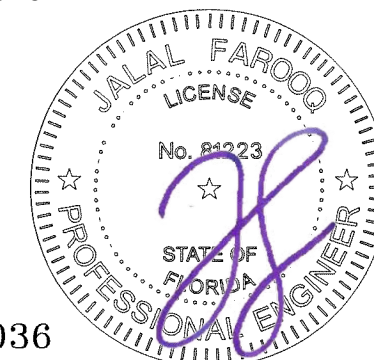

FL #48036

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100
 WWW.AFCENG.COM
 FBPE #3538
 COMP-ANL/25-53F-KU

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

Korus USA Corp.

8615 N.W. 64th Street, Bay #1

Miami, FL 33166

Tel. (305) 468-3234

www.korus-usa.com

revisions:

date: 05-10-25

scale: 3/8" = 1"





dr. by: TARIQ

chk. by:

drawing no.

25-53F

sheet 7 of 13

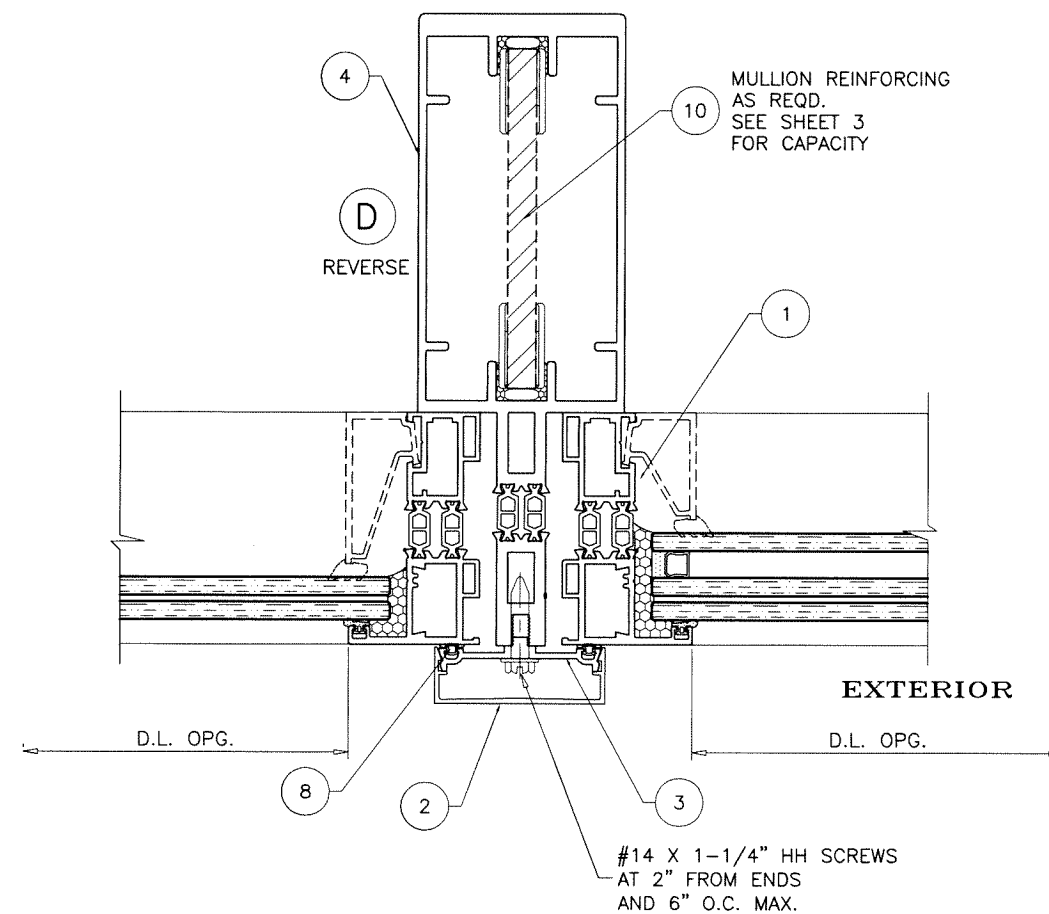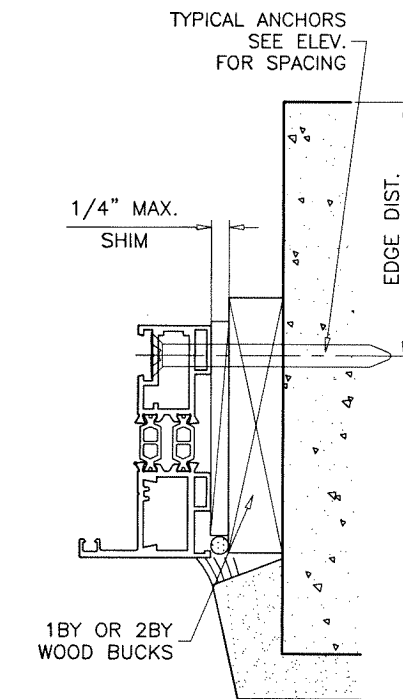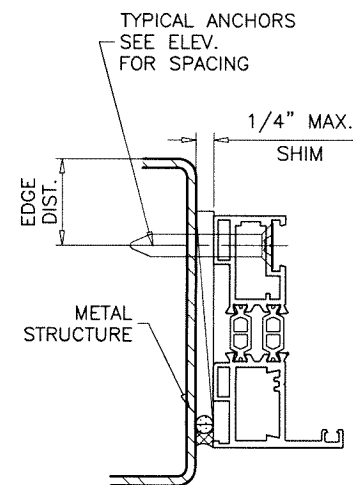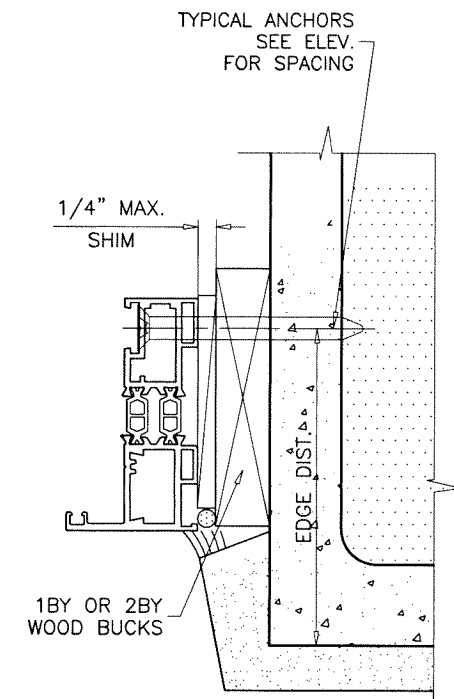

FL #48036

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FBPE #3538
WWW.AFCENG.COM
COMP-ANL\25-53F-KU

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)





Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL 33166
Tel. (305) 468-3234
www.korus.com

www.korus-usa.com

date: 05-10-25		no		date		by		description	
scale: 3/8" = 1"									
dr. by: TARIQ									
chk. by:									


drawing no. 25-53F

sheet 8 of 13

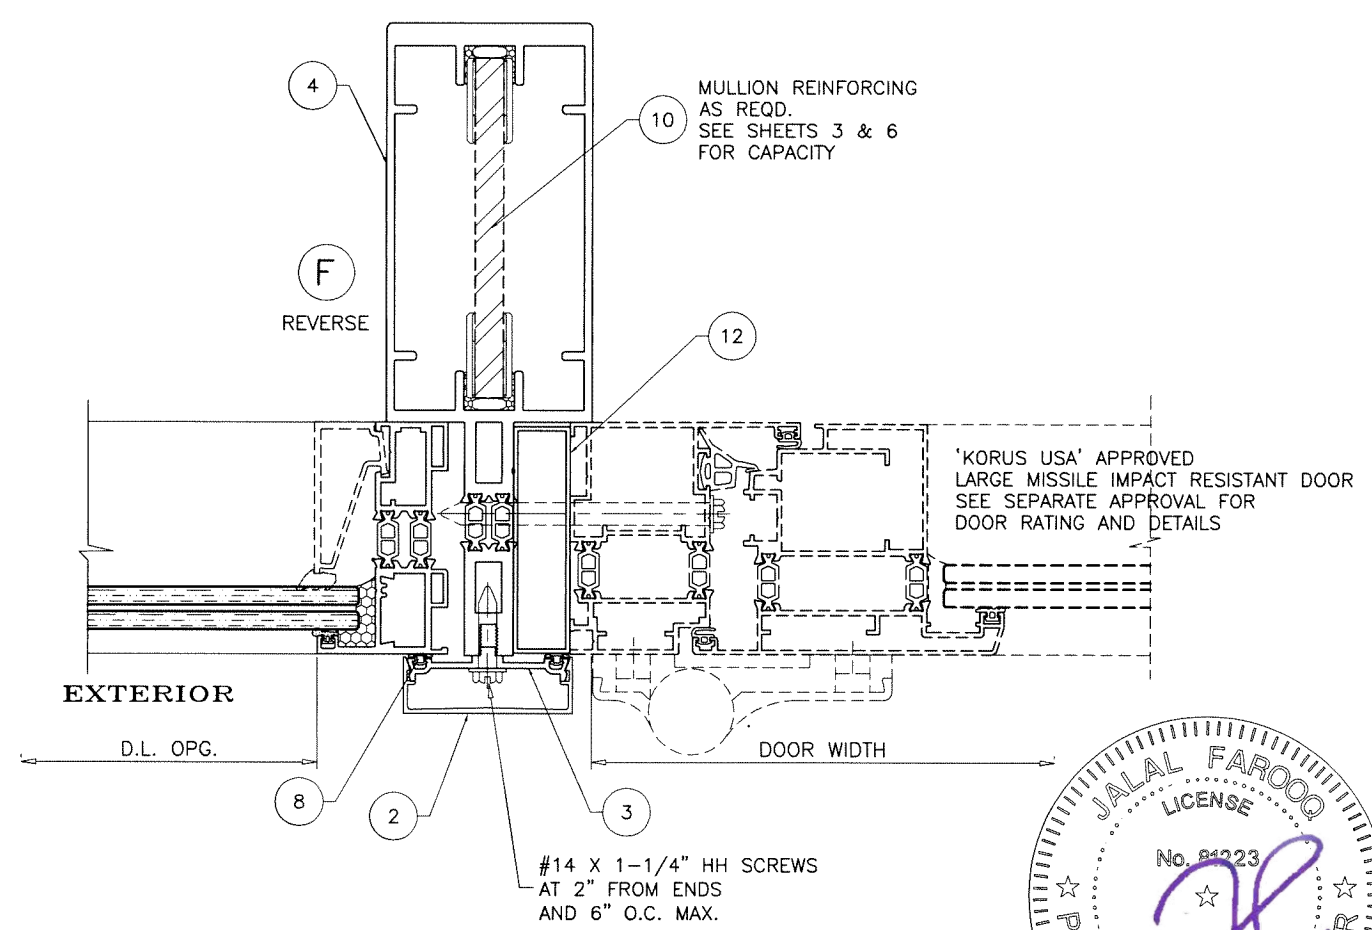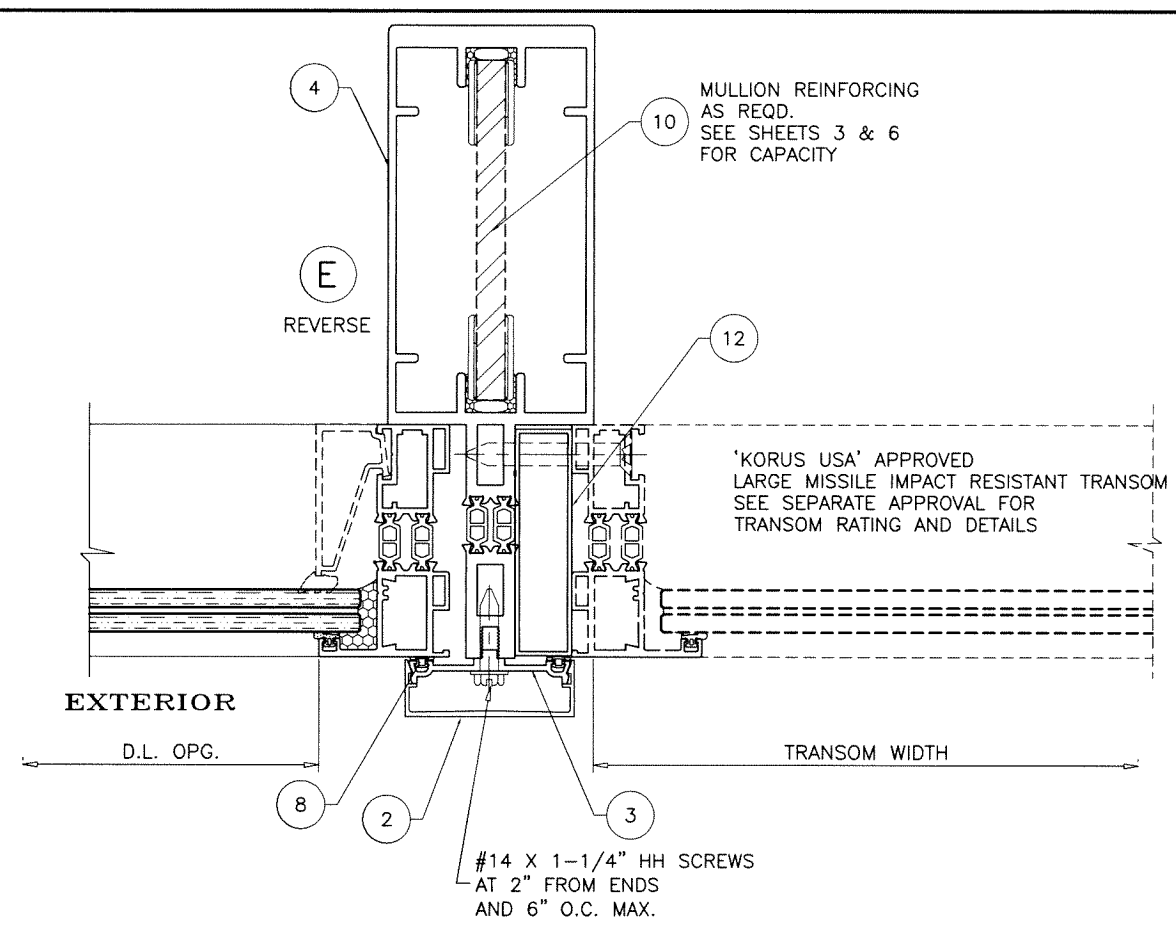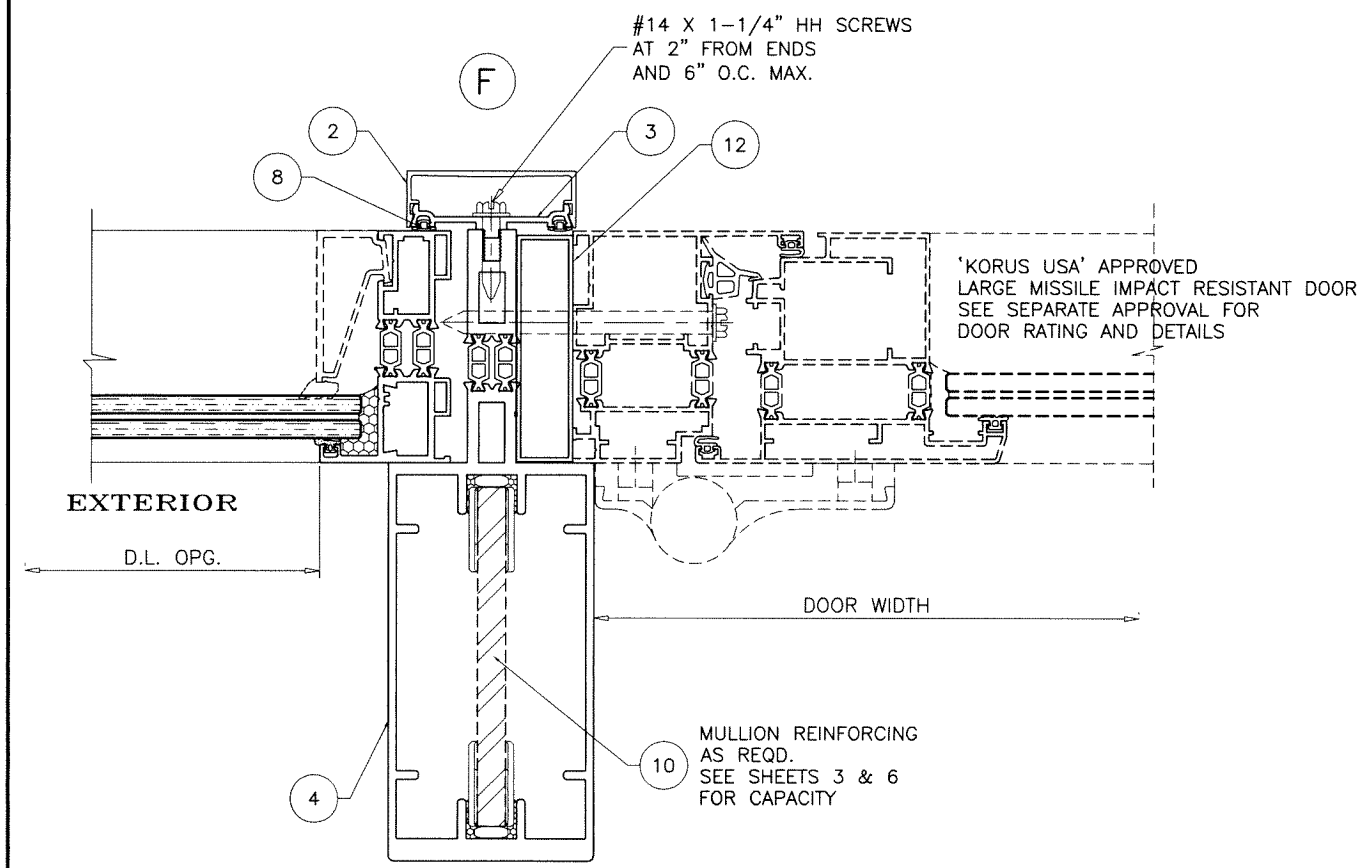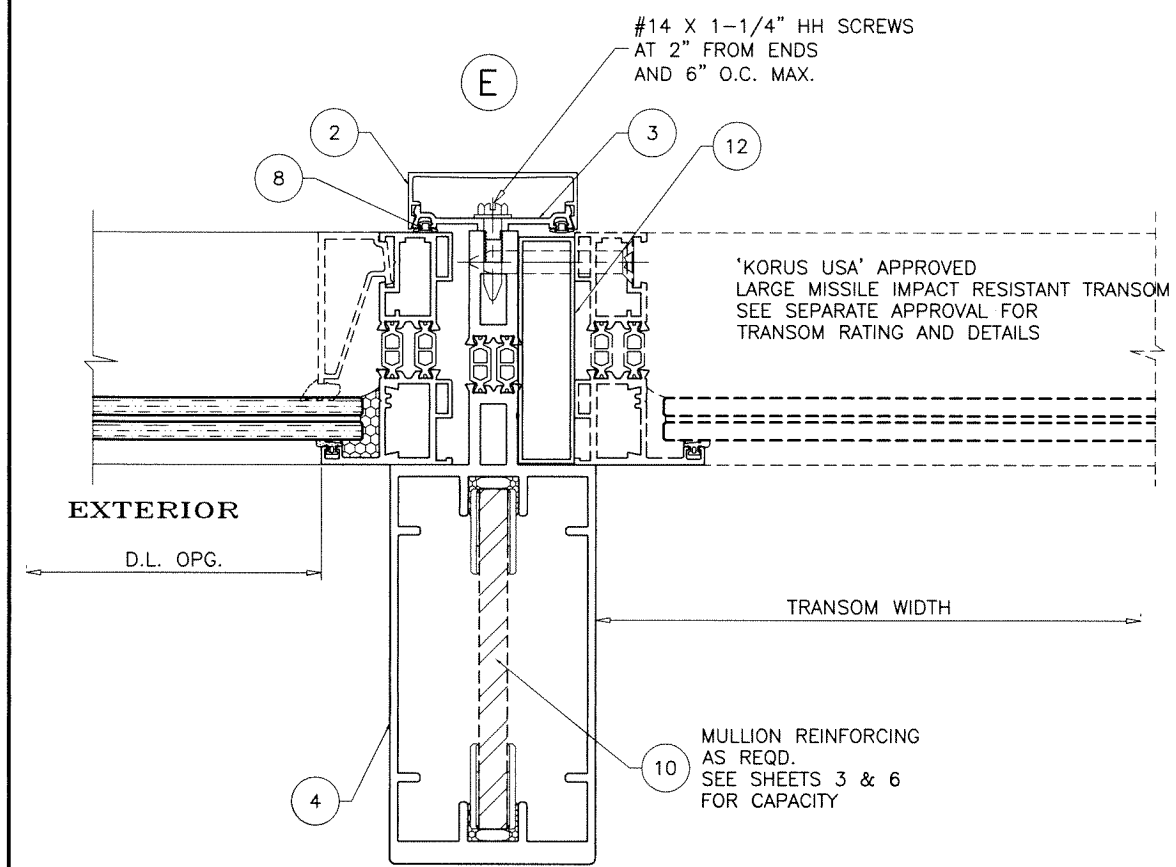

Sealed: 2/11/2026

FL #48036

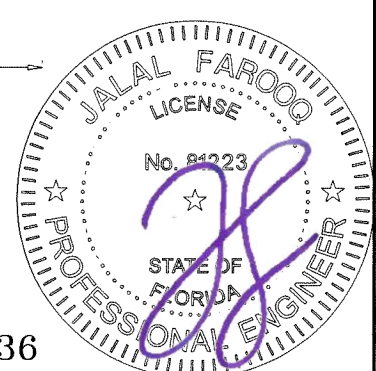

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

COMP-ANL\25-53F-KU

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
www.korus-usa.com

revisions:	
no	date by description

date: 05-10-25

scale: 3/8" = 1"

dr. by: TARIQ


chk. by:

drawing no.


25-53F

sheet 9 of 13

A
ALT.





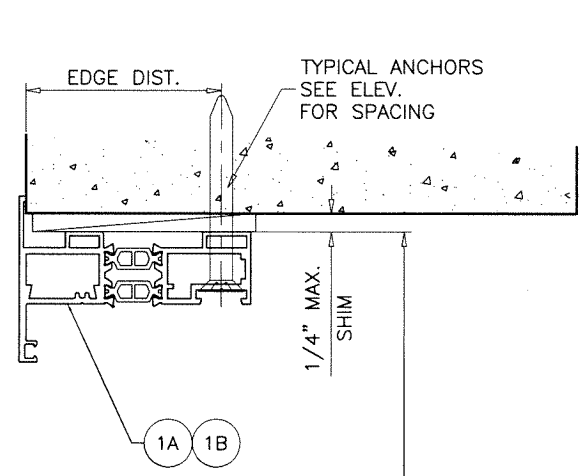


B
ALT.

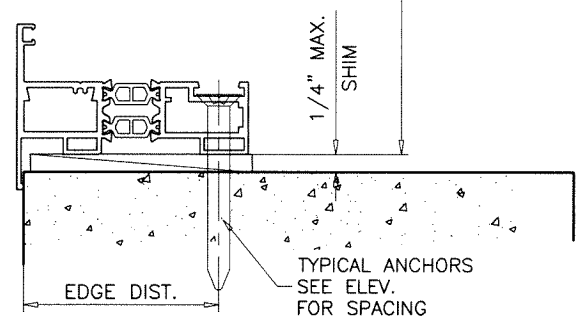


EXTERIOR

FRAME HEIGHT

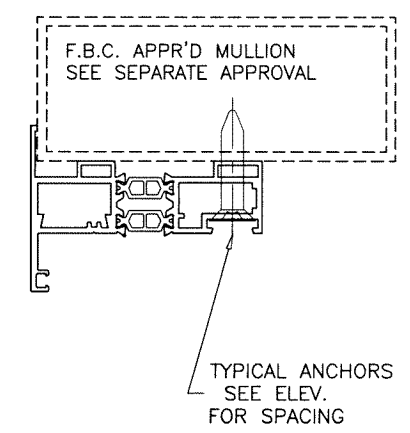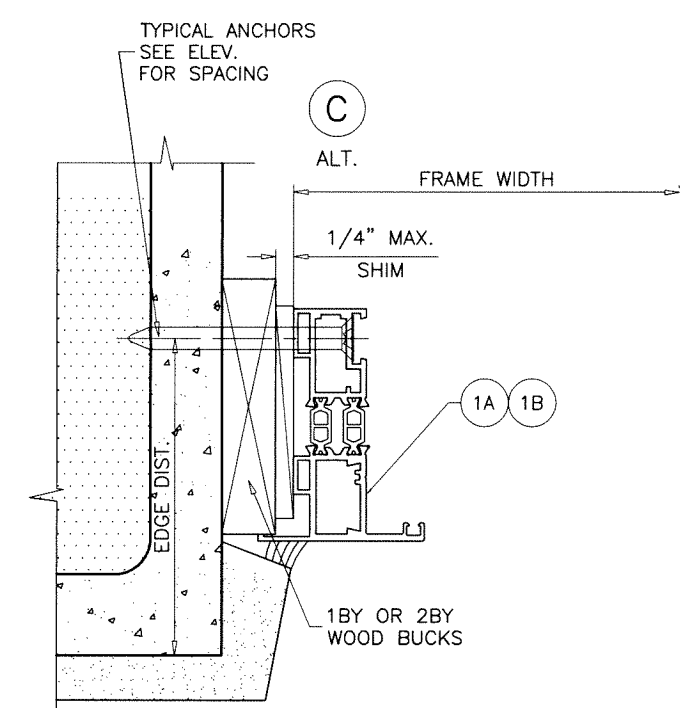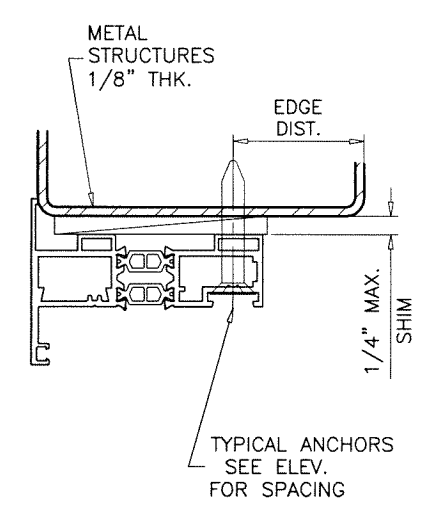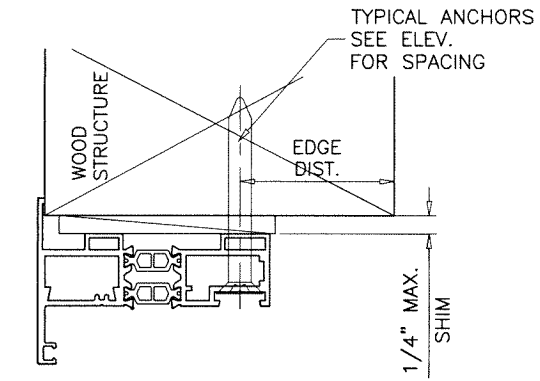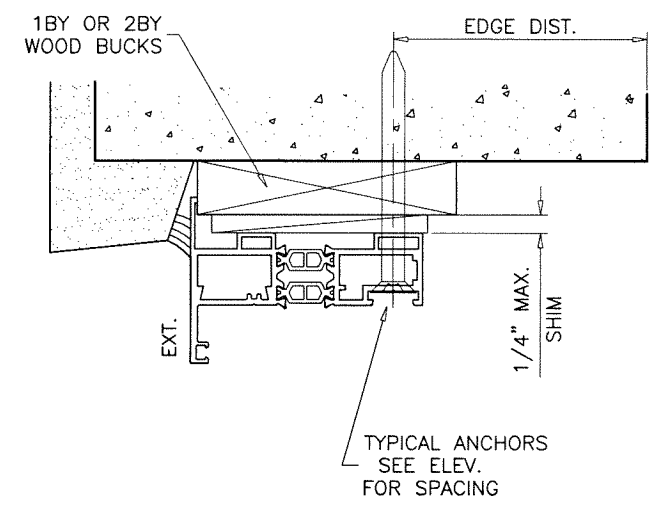

INSTALLATION DETAILS WITH FLANGE FRAMES
SEE SHEETS 7 & 8 FOR WINDOW WALL DETAILS

Sealed: 2/11/2026

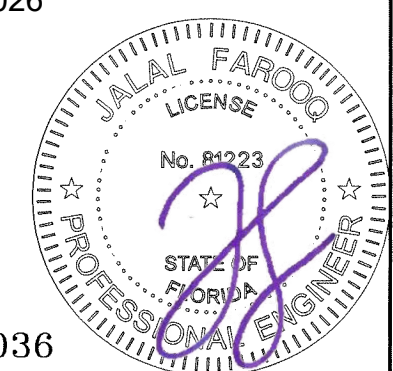

FL #48036

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
COMP-ANL\25-53F-KU

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
WWW.KORUS-USA.COM

revisions:	
no	date by description

date: 05-10-25

scale: 3/8" = 1"



dr. by: TARIQ

chk. by:


drawing no.

25-53F

sheet 10 of 13

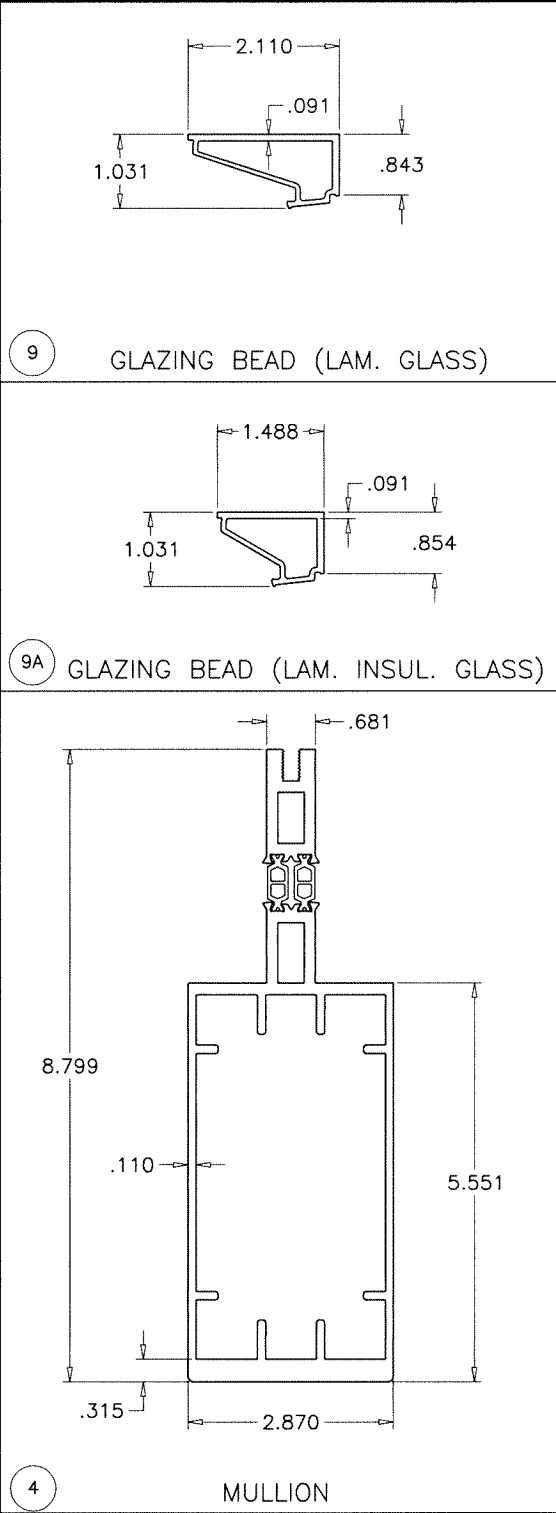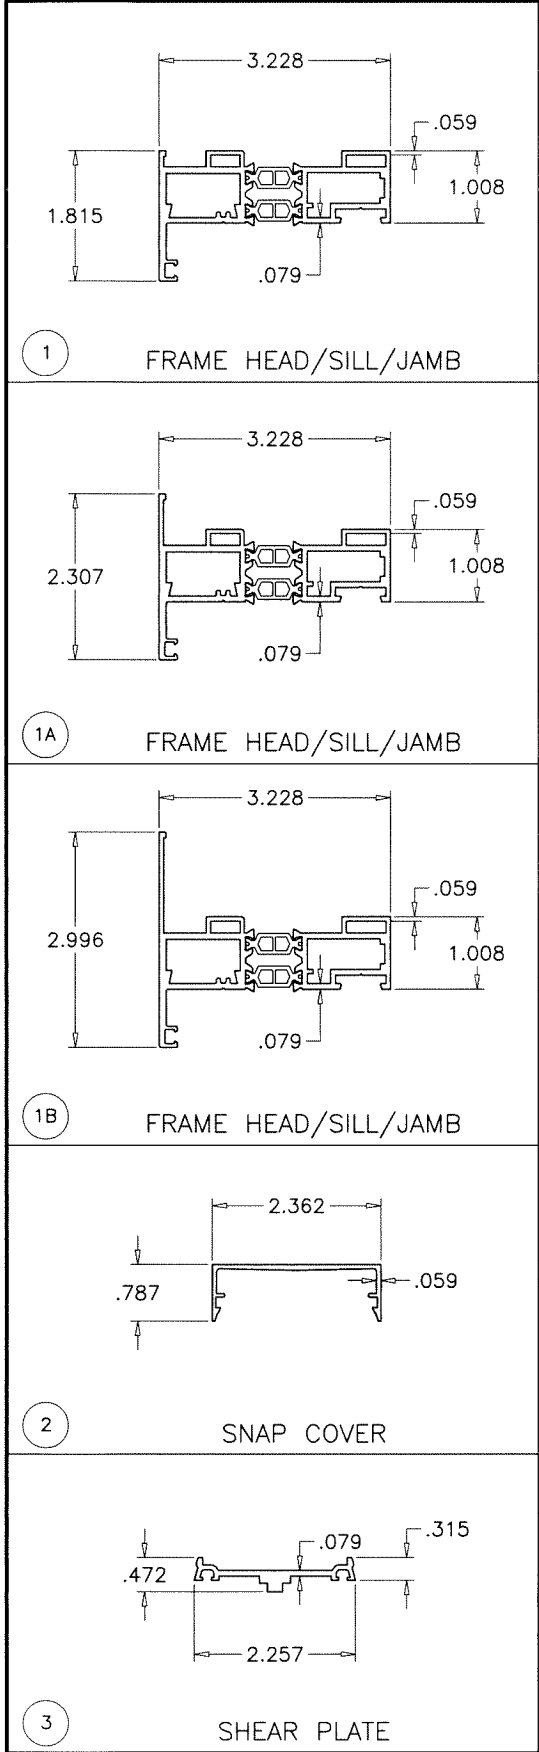


INSULBARS
MATERIAL = POLYAMIDE
TENSILE STRENGTH = 13031 PSI
RATE OF BURN = .752 IN./MIN.
SELF IGNITION TEMP. = 793° F
FLASH IGNITION TEMP. = 781°C
SMOKE DENSITY = 1.63

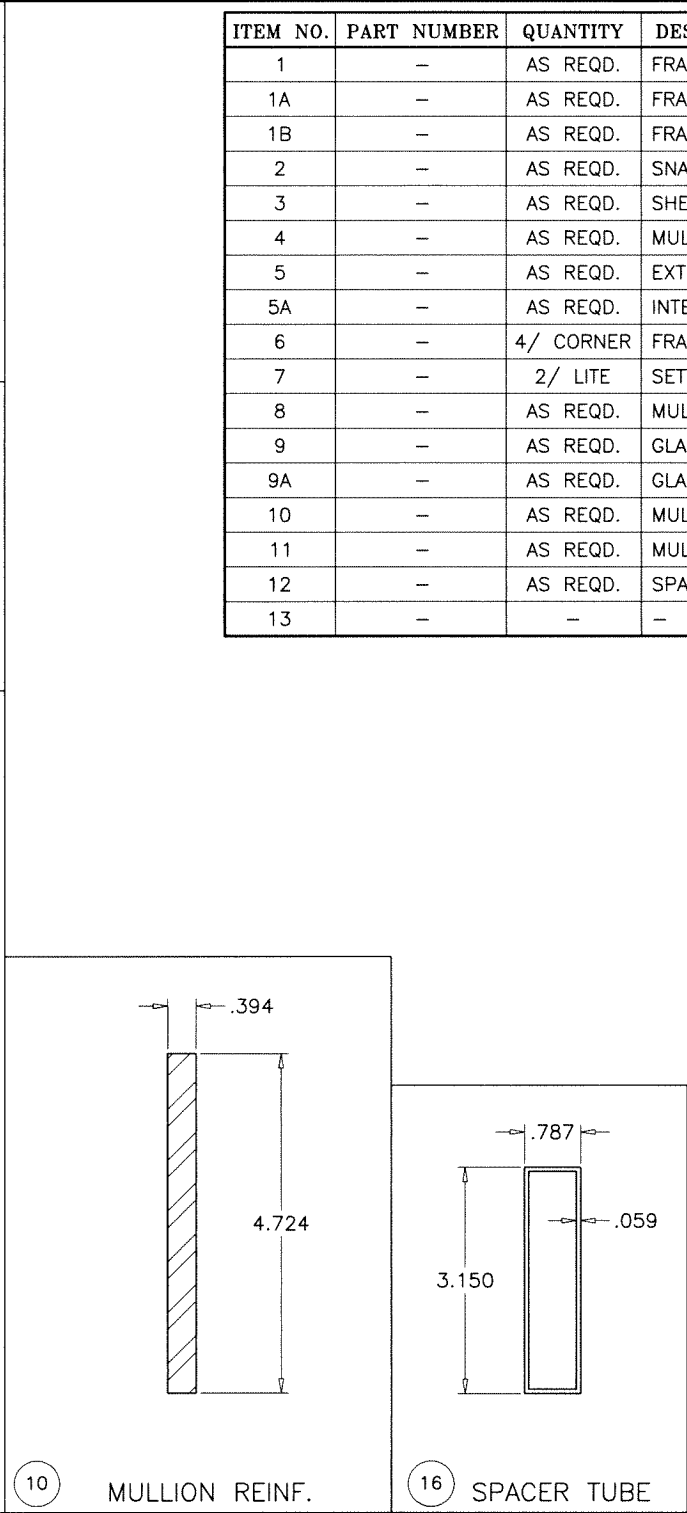

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	—	AS REQD.	FRAME HEAD/SILL/JAMB	6060-T5	—
1A	—	AS REQD.	FRAME HEAD/SILL/JAMB	6060-T5	—
1B	—	AS REQD.	FRAME HEAD/SILL/JAMB	6060-T5	—
2	—	AS REQD.	SNAP COVER	6060-T5	—
3	—	AS REQD.	SHEAR PLATE	6060-T5	—
4	—	AS REQD.	MULLION	6060-T5	—
5	—	AS REQD.	EXTERIOR GLAZING GASKET	EPDM	DUROMETER 55±5 SHORE A
5A	—	AS REQD.	INTERIOR GLAZING GASKET (OPTIONAL)	EPDM	DUROMETER 55±5 SHORE A
6	—	4/ CORNER	FRAME ASSEMBLY FASTENERS	ST. STEEL	PH SMS
7	—	2/ LITE	SETTING BLOCKS AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A
8	—	AS REQD.	MULLION GASKET	EPDM	DUROMETER 55±5 SHORE A
9	—	AS REQD.	GLAZING BEAD (LAM. GLASS) OPTIONAL	6060-T5	—
9A	—	AS REQD.	GLAZING BEAD (LAM. INSUL. GLASS) OPTIONAL	6060-T5	—
10	—	AS REQD.	MULLION REINFORCING	STEEL	A36, Fu MIN. = 58 KSI
11	—	AS REQD.	MULLION CLIP	STEEL	—
12	—	AS REQD.	SPACER TUBE	6060-T5	—
13	—	—	—	—	—

SEALANTS:
ALL FRAME JOINTS AND SEAMS SEALED WITH
GENERAL PURPOSE SILICONE SEALANT.

Sealed: 2/11/2026

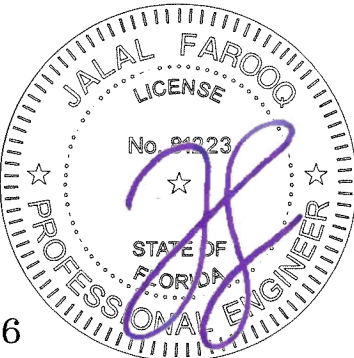

FL #48036

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

SERIES MILANO THERMAL ALUM WINDOW WALL SYS. (L.M.I.)

Korus USA Corp.
8615 N.W. 64th Street, Bay #1
Miami, FL. 33166
Tel. (305) 468-3234
www.korus-usa.com

revisions:
no. date by description

date: 05-10-25
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-53F
sheet 13 of 13