

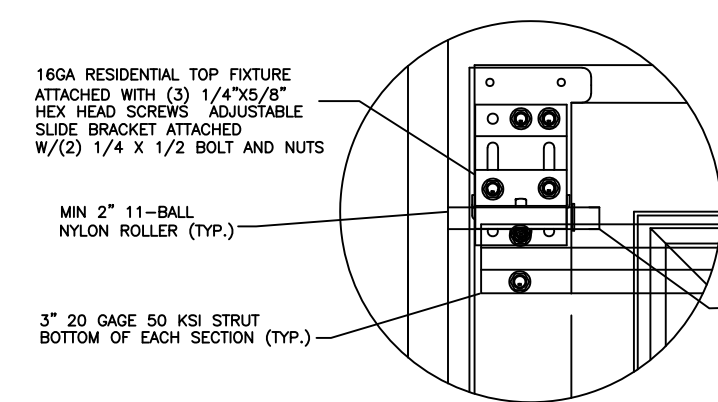
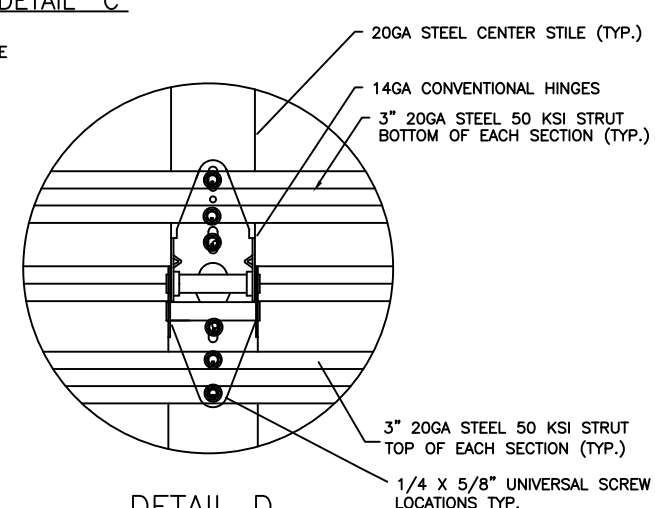
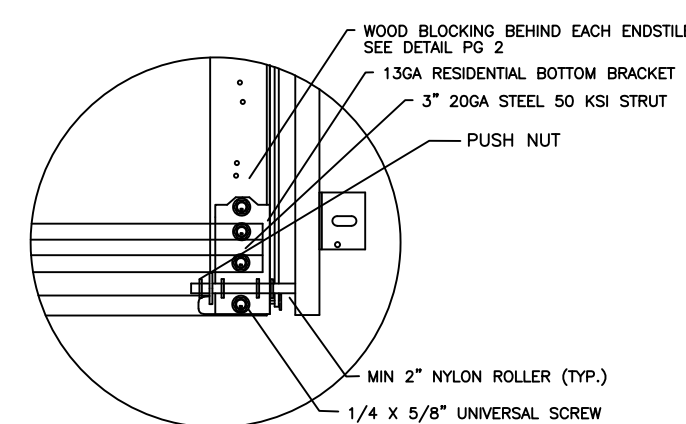
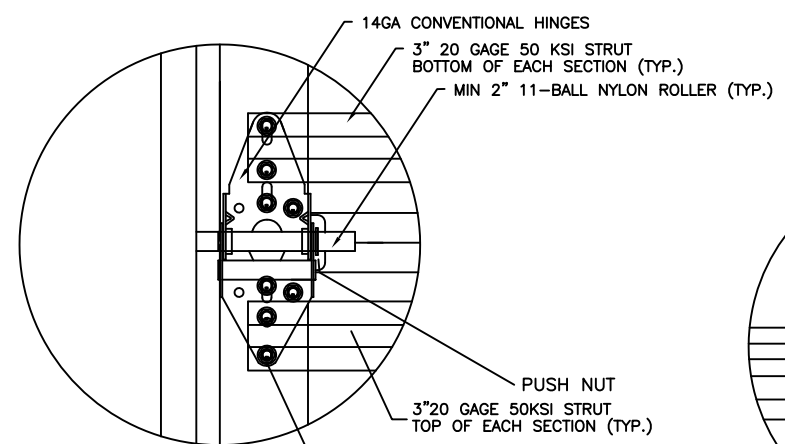
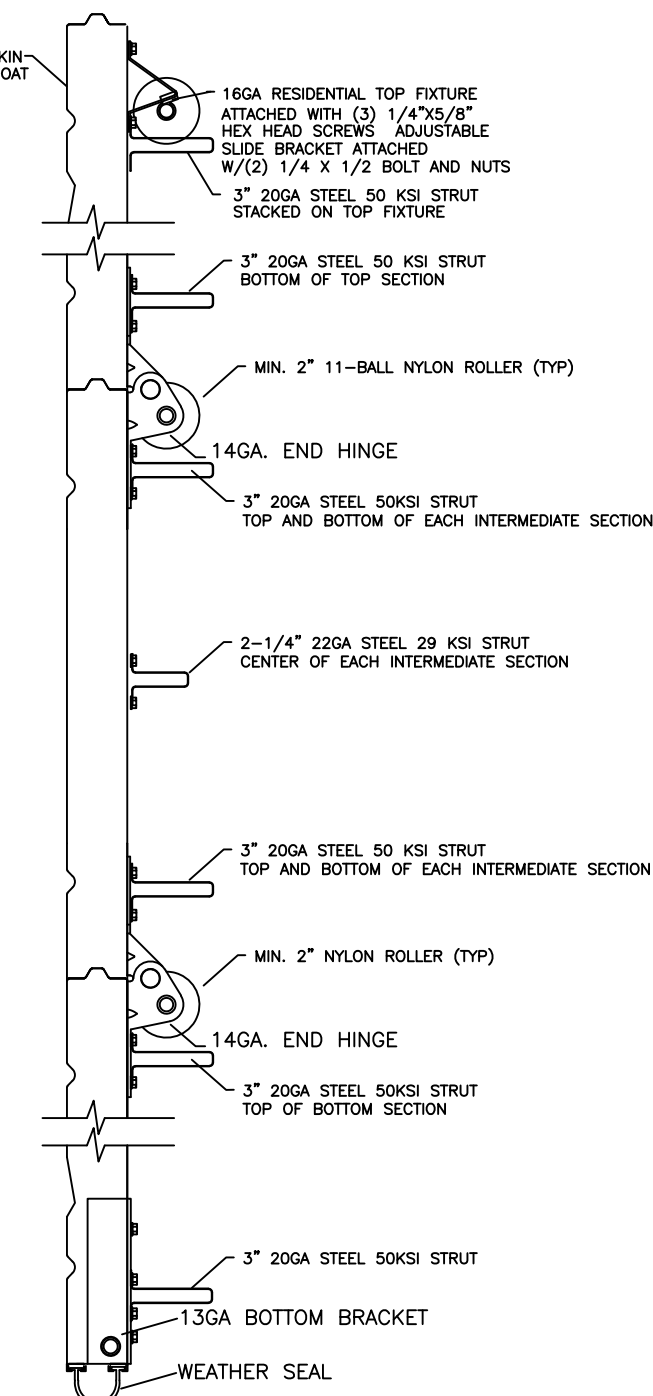


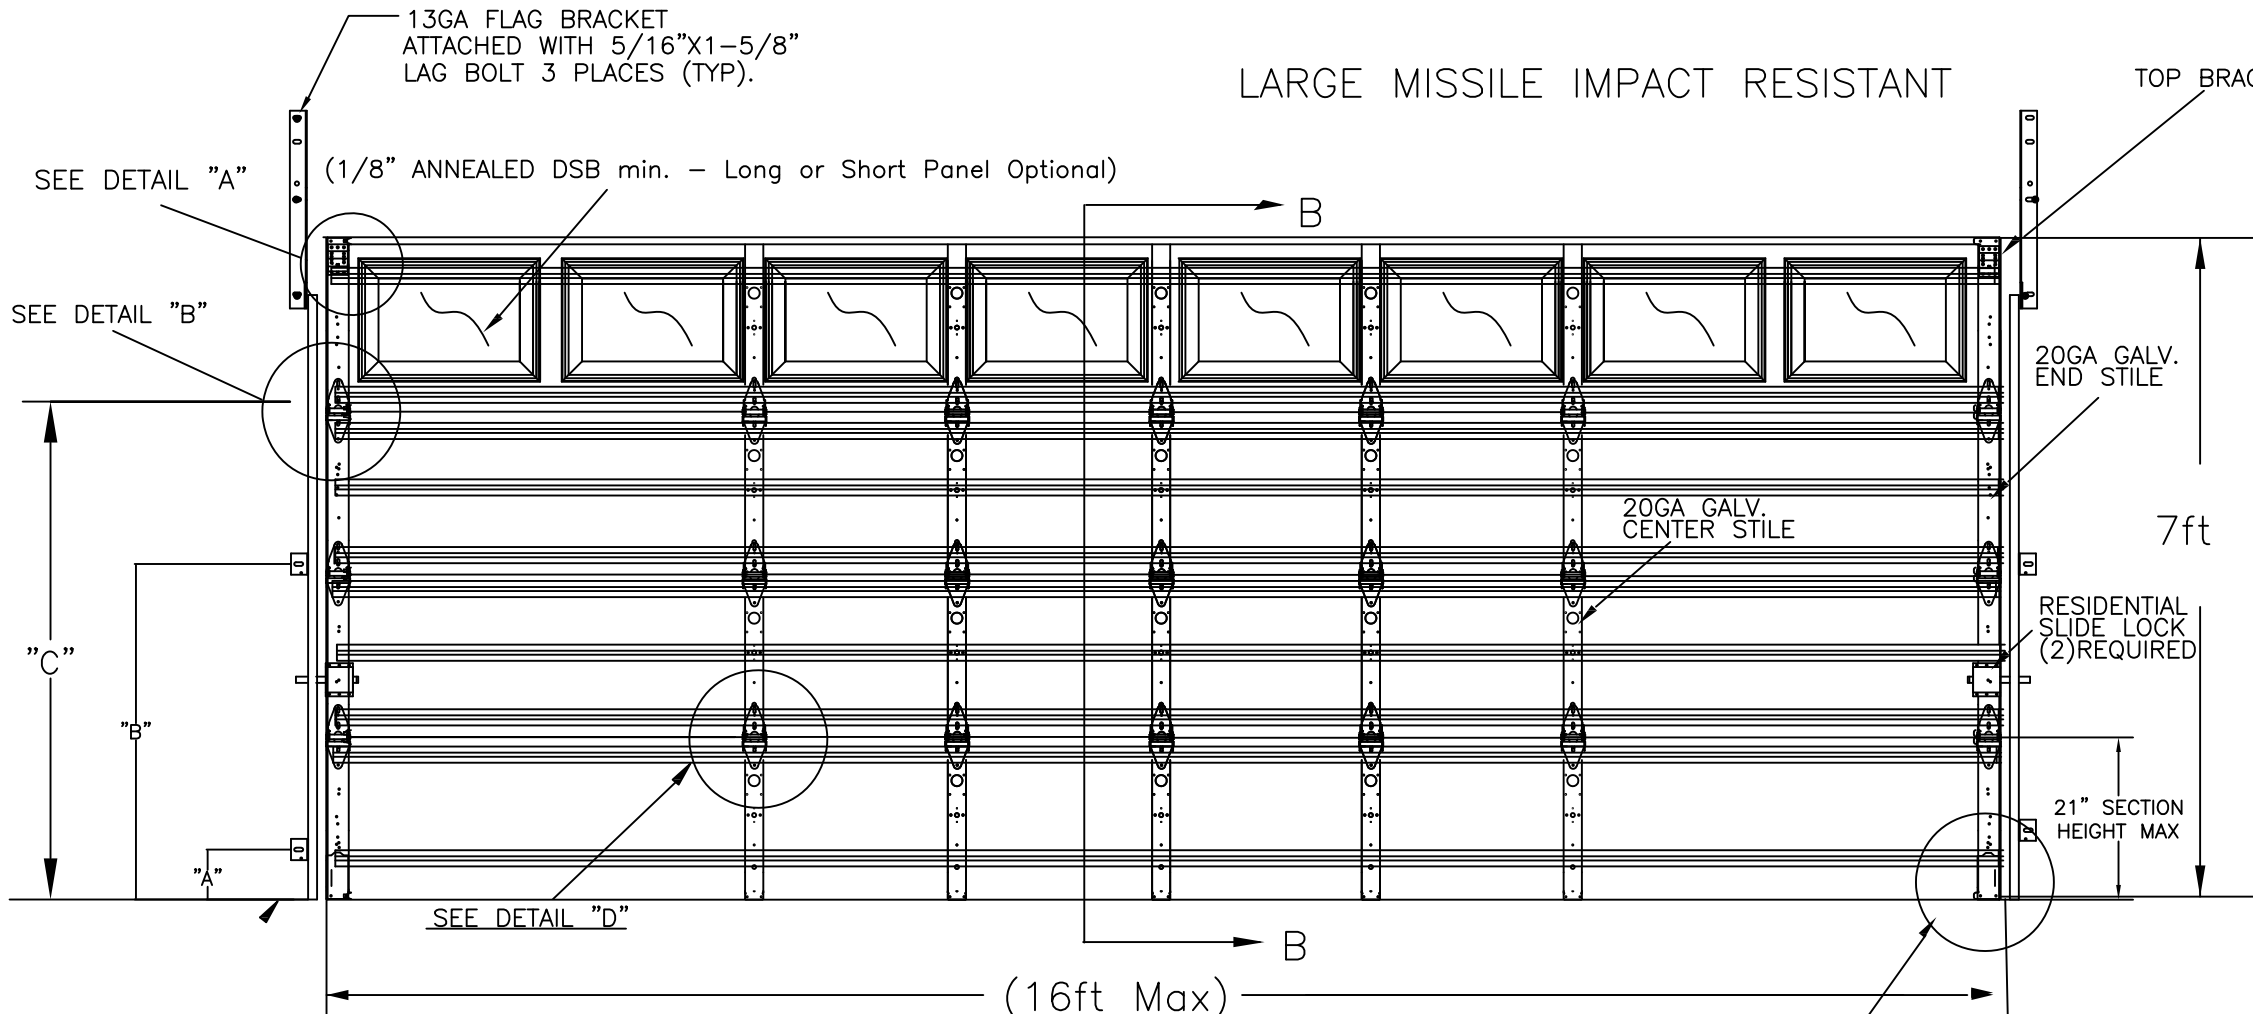

DETAIL B

Stalder Talley  
Talley Engineering Consulting,  
LLC  
300 N 11th St, Ponca City, OK  
74601  
FL PE # 100433  
Phone: (405) 829-0258  
Professional Engineer's Seal  
Affixed Solely to Confirm That  
the Door Configuration Shown  
Reflects the Unit That Passed  
DASMA 108-2017 Wind Load  
Testing

10/1/2026  
*Stalder Talley*

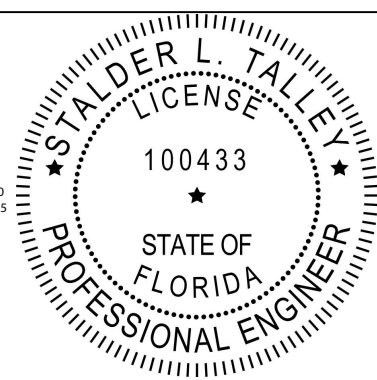

DESIGN PRESSURE +26.6/-29.6


TESTED PER THE APPLICABLE REQUIREMENTS OF:  
ANSI/DASMA 108-2017  
ANSI/DASMA 115-2017

COMPLIES WITH CURRENT FBC  
COMPLIES WITH IBC/IRC 2024 (TEXAS)


NOTE: THE DESIGN OF SUPPORTING  
STRUCTURAL ELEMENTS SHALL BE THE  
RESPONSIBILITY OF THE PROFESSIONAL OF RECORD  
FOR THE BUILDING OR STRUCTURE IN ACCORDANCE  
WITH CURRENT BUILDING CODES

|                                           |                     |           |          |
|-------------------------------------------|---------------------|-----------|----------|
|                                           |                     | REVISIONS |          |
|                                           |                     | FL CODE   | 9.26 BHG |
| TITLE                                     |                     |           |          |
| OB 2025B 16X7, +26.6/-29.6 PSF RATED DOOR |                     |           |          |
| DRAWING#                                  | N25-1607-26.6-3-IRG | DRAWN BY  | BHG      |
| SCALE                                     | N/A                 | SHEET     | 1 OF 4   |
|                                           |                     | DATE      | 1/13/26  |

LARGE MISSILE IMPACT RESISTANT

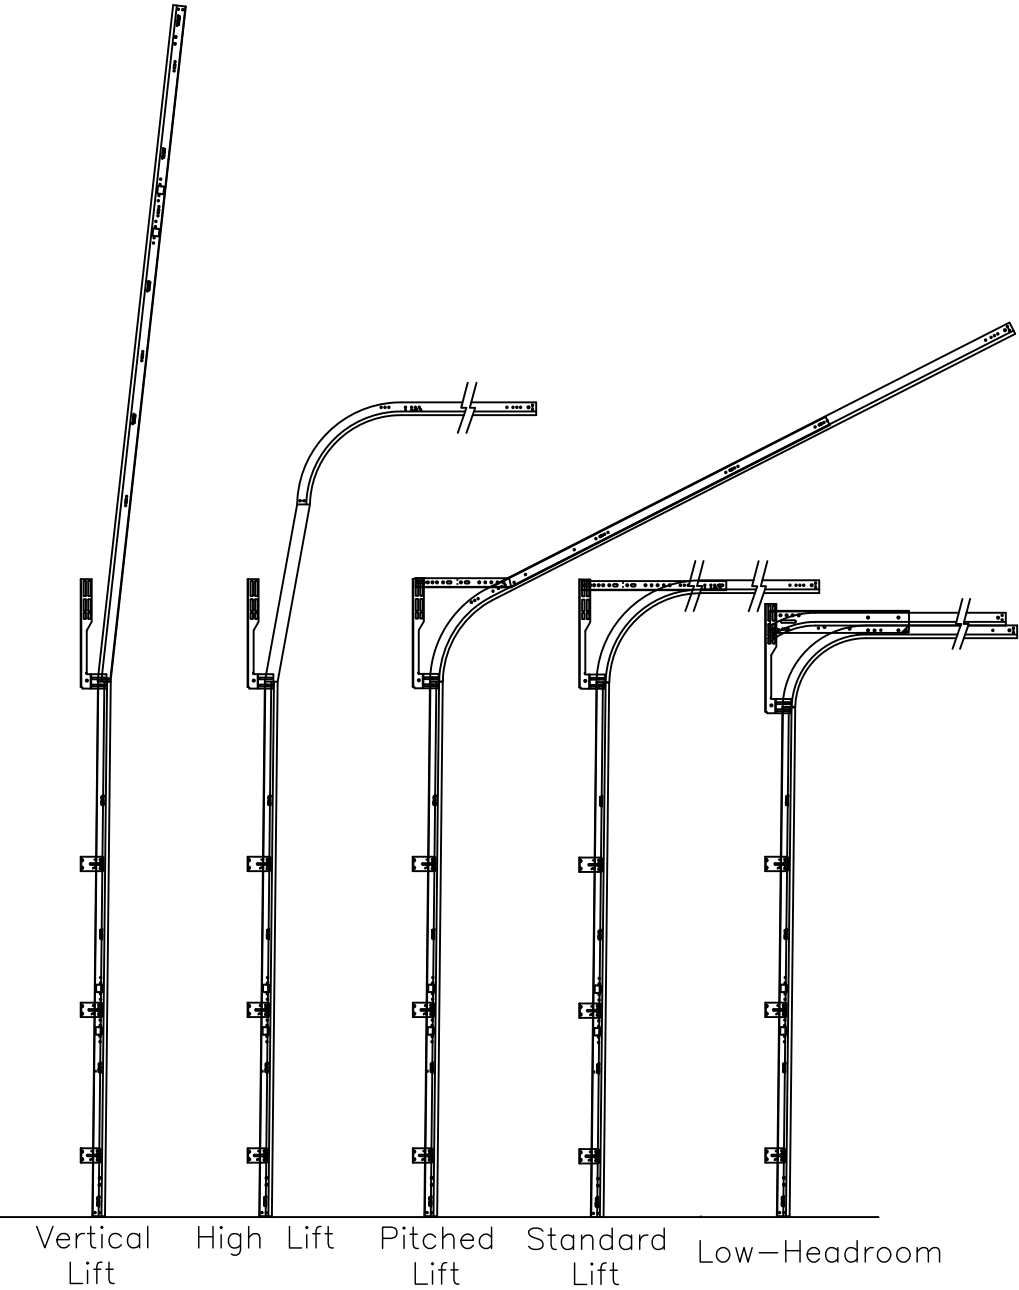



ALLOWABLE LIFT TYPES

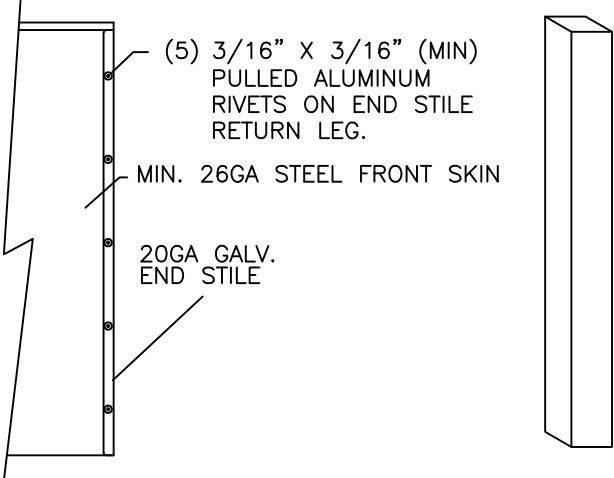

FRONT SKIN / END STILE / WOOD BLOCKING DETAIL

1-15/16" X 1-1/2" X 20-1/2" (21" SECTION)  
OR 1-15/16" X 1-1/2" X 17-1/2" (18" SECTION)  
WOOD BLOCKING (SPF OR SYP)  
No.2 or BETTER BEHIND EACH END STILE

10/1/2026  
*Stalder Talley*

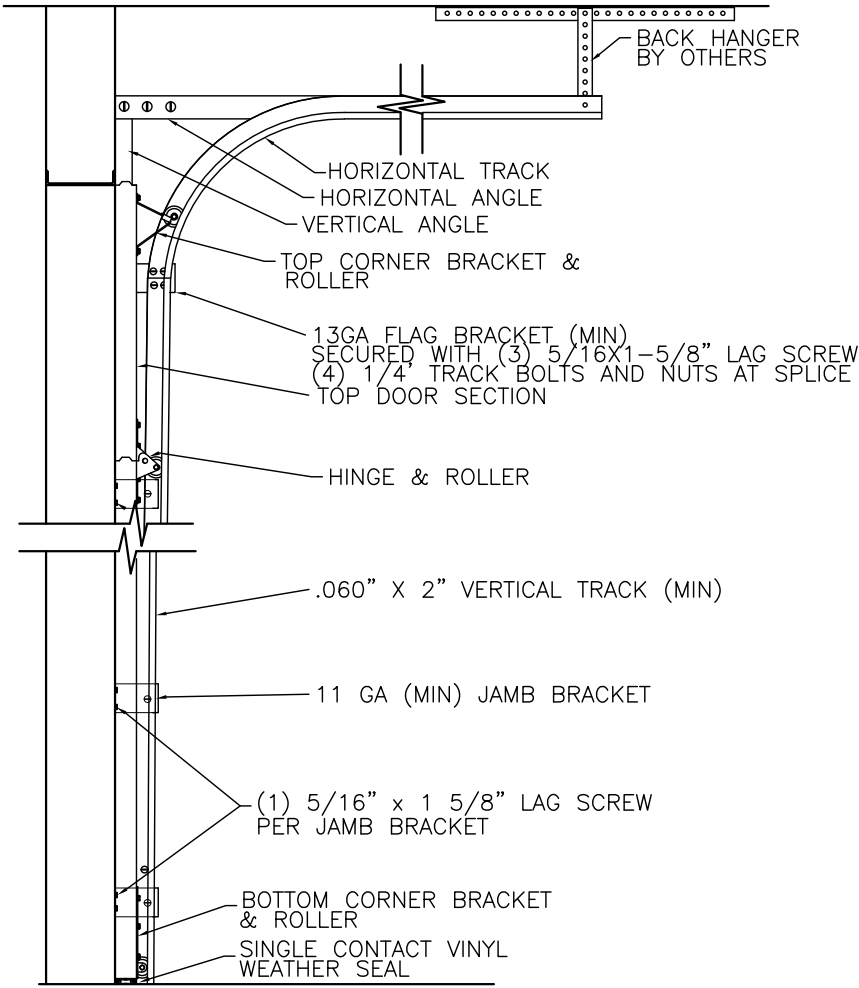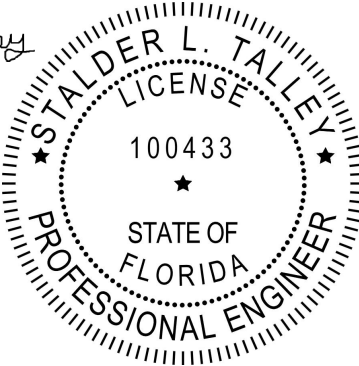

SECTION THRU OPNG.

Stalder Talley  
Talley Engineering Consulting,  
LLC  
300 N 11th St, Ponca City, OK  
74601  
FL PE # 100433  
Phone: (405) 829-0258  
Professional Engineer's Seal  
Affixed Solely to Confirm That  
the Door Configuration Shown  
Reflects the Unit That Passed  
DASMA 108-2017 Wind Load  
Testing

DESIGN PRESSURE +26.6/-29.6

TESTED PER THE APPLICABLE REQUIREMENTS OF:  
ANSI/DASMA 108-2017  
ANSI/DASMA 115-2017


COMPLIES WITH CURRENT FBC  
COMPLIES WITH IBC/IRC 2024 (TEXAS)

NOTE: THE DESIGN OF SUPPORTING  
STRUCTURAL ELEMENTS SHALL BE THE  
RESPONSIBILITY OF THE PROFESSIONAL OF RECORD  
FOR THE BUILDING OR STRUCTURE IN ACCORDANCE  
WITH CURRENT BUILDING CODES

Track Bracket Locations

| DOOR HEIGHT      | "A" | "B" | "C" | "D" |     |
|------------------|-----|-----|-----|-----|-----|
| 6'-6" thru 7'-0" | 4"  | 24" | 42" | 63" | ✗   |
| 7'-6"            | 4"  | 24" | 42" | 63" | ✗   |
| 7'-9" thru 8'-0" | 4"  | 24" | 42" | 63" | 78" |
| 8'-3" thru 9'-0" | 4"  | 24" | 42" | 63" | 78" |


NOTE: Bracket Locations Must be within 3"  
For Doors over 9' high one Jamb bracket per section  
must be added and positioned within 3" of the roller.

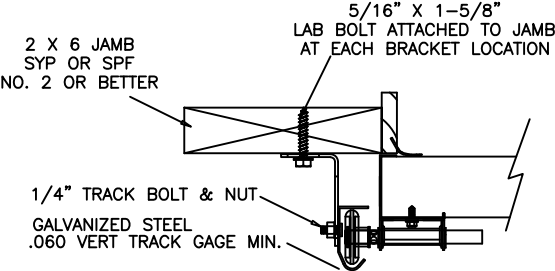

TRACK MOUNT DETAIL

WOOD JAMB ATTACHMENT TO STRUCTURE

2X6 VERTICAL JAMB ATTACHMENT TO WOOD STRUCTURE  
5/16" x 3" LAGS 6" FROM ENDS AND 24"  
24" O.C W/1-1/2" EMBEDMENT MIN.

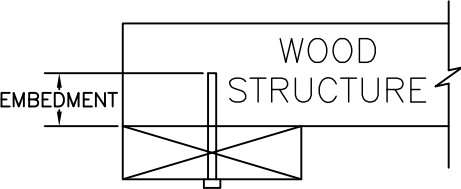

-LAGS MAY BE COUNTERSUNK  
-WOOD JAMB BY OTHERS

REVISIONS

| FL CODE | 9.26 | BHG |
|---------|------|-----|
|         |      |     |
|         |      |     |
|         |      |     |



TITLE  
OB 2025B 16X7, +26.6/-29.6 PSF RATED DOOR

DRAWING# N25-1607-26.6-3-IRG

SCALE - N/A

DRAWN BY BHG  
SHEET 2 OF 4  
DATE 1/13/26

CHART 2  
RATIONAL ANALYSIS

| DOOR WIDTH (in) | Positive PSF | Negative PSF |
|-----------------|--------------|--------------|
| 192             | 26.6         | 29.6         |
| 190             | 26.6         | 29.6         |
| 188             | 26.9         | 29.9         |
| 186             | 27.2         | 30.2         |
| 184             | 27.5         | 30.6         |
| 182             | 27.8         | 30.9         |
| 180             | 28.1         | 31.3         |
| 178             | 28.4         | 31.6         |
| 176             | 28.7         | 32.0         |
| 174             | 29.1         | 32.3         |
| 172             | 29.4         | 32.7         |
| 170             | 29.7         | 33.1         |
| 168             | 30.1         | 33.5         |
| 166             | 30.5         | 33.9         |
| 164             | 30.8         | 34.3         |
| 162             | 31.2         | 34.7         |
| 160             | 31.6         | 35.2         |
| 158             | 32.0         | 35.6         |
| 156             | 32.4         | 36.1         |
| 154             | 32.8         | 36.5         |
| 152             | 33.3         | 37.0         |
| 150             | 33.7         | 37.5         |
| 148             | 34.2         | 38.0         |
| 146             | 34.6         | 38.5         |
| 144             | 35.1         | 39.1         |
| 142             | 32.3         | 35.9         |
| 140             | 32.8         | 36.5         |
| 138             | 33.4         | 37.1         |
| 136             | 34.0         | 37.8         |
| 134             | 34.6         | 38.5         |
| 132             | 35.2         | 39.2         |
| 130             | 35.9         | 39.9         |
| 128             | 36.6         | 40.7         |
| 126             | 37.3         | 41.5         |
| 124             | 38.0         | 42.3         |
| 122             | 38.8         | 43.2         |
| 120             | 39.6         | 44.1         |
| 118             | 32.4         | 36.1         |
| 116             | 33.0         | 36.7         |
| 114             | 33.6         | 37.3         |
| 112             | 34.2         | 38.0         |
| 110             | 34.8         | 38.7         |

CHART 3  
STILE PLACEMENT

| DOOR WIDTH (in) | Stile 1 | Stile 2 | Stile 3 | Stile 4 | Stile 5 | Stile 6 |
|-----------------|---------|---------|---------|---------|---------|---------|
| 192             | 49.19   | 72.56   | 95.94   | 119.31  | 142.69  | N/A     |
| 190             | 48.19   | 71.56   | 94.94   | 118.31  | 141.69  | N/A     |
| 188             | 47.19   | 70.56   | 93.94   | 117.31  | 140.69  | N/A     |
| 186             | 34.50   | 57.88   | 81.25   | 104.63  | 128.00  | 151.38  |
| 184             | 33.50   | 56.88   | 80.25   | 103.63  | 127.00  | 150.38  |
| 182             | 32.50   | 55.88   | 79.25   | 102.63  | 126.00  | 149.38  |
| 180             | 31.50   | 54.88   | 78.25   | 101.63  | 125.00  | 148.38  |
| 178             | 30.50   | 53.88   | 77.25   | 100.63  | 124.00  | 147.38  |
| 176             | 29.50   | 52.88   | 76.25   | 99.63   | 123.00  | 146.38  |
| 174             | 28.50   | 51.88   | 75.25   | 98.63   | 122.00  | 145.38  |
| 172             | 27.50   | 50.88   | 74.25   | 97.63   | 121.00  | 144.38  |
| 170             | 26.50   | 49.88   | 73.25   | 96.63   | 120.00  | 143.38  |
| 168             | 25.50   | 48.88   | 72.25   | 95.63   | 119.00  | 142.38  |
| 166             | 24.50   | 47.88   | 71.25   | 94.63   | 118.00  | 141.38  |
| 164             | 35.19   | 58.56   | 81.94   | 105.31  | 128.69  | N/A     |
| 162             | 34.19   | 57.56   | 80.94   | 104.31  | 127.69  | N/A     |
| 160             | 33.19   | 56.56   | 79.94   | 103.31  | 126.69  | N/A     |
| 158             | 32.19   | 55.56   | 78.94   | 102.31  | 125.69  | N/A     |
| 156             | 31.19   | 54.56   | 77.94   | 101.31  | 124.69  | N/A     |
| 154             | 30.19   | 53.56   | 76.94   | 100.31  | 123.69  | N/A     |
| 152             | 29.19   | 52.56   | 75.94   | 99.31   | 122.69  | N/A     |
| 150             | 28.19   | 51.56   | 74.94   | 98.31   | 121.69  | N/A     |
| 148             | 27.19   | 50.56   | 73.94   | 97.31   | 120.69  | N/A     |
| 146             | 26.19   | 49.56   | 72.94   | 96.31   | 119.69  | N/A     |
| 144             | 25.19   | 48.56   | 71.94   | 95.31   | 118.69  | N/A     |
| 142             | 35.88   | 59.25   | 82.63   | 106.00  | N/A     | N/A     |
| 140             | 34.88   | 58.25   | 81.63   | 105.00  | N/A     | N/A     |
| 138             | 33.88   | 57.25   | 80.63   | 104.00  | N/A     | N/A     |
| 136             | 32.88   | 56.25   | 79.63   | 103.00  | N/A     | N/A     |
| 134             | 31.88   | 55.25   | 78.63   | 102.00  | N/A     | N/A     |
| 132             | 30.88   | 54.25   | 77.63   | 101.00  | N/A     | N/A     |
| 130             | 29.88   | 53.25   | 76.63   | 100.00  | N/A     | N/A     |
| 128             | 28.88   | 52.25   | 75.63   | 99.00   | N/A     | N/A     |
| 126             | 27.88   | 51.25   | 74.63   | 98.00   | N/A     | N/A     |
| 124             | 26.88   | 50.25   | 73.63   | 97.00   | N/A     | N/A     |
| 122             | 25.88   | 49.25   | 72.63   | 96.00   | N/A     | N/A     |
| 120             | 24.88   | 48.25   | 71.63   | 95.00   | N/A     | N/A     |
| 118             | 33.56   | 58.94   | 84.31   | N/A     | N/A     | N/A     |
| 116             | 32.56   | 57.94   | 83.31   | N/A     | N/A     | N/A     |
| 114             | 31.56   | 56.94   | 82.31   | N/A     | N/A     | N/A     |
| 112             | 30.56   | 55.94   | 81.31   | N/A     | N/A     | N/A     |
| 110             | 29.56   | 54.94   | 80.31   | N/A     | N/A     | N/A     |

CHART 4  
STRUT PLACEMENT

| 4 SECTION DOOR |    | 5 SECTION DOOR |    | 6 SECTION DOOR |    | 7 SECTION DOOR |     | 8 SECTION DOOR |     |     |    |    |
|----------------|----|----------------|----|----------------|----|----------------|-----|----------------|-----|-----|----|----|
|                |    |                |    |                |    |                |     | TOP            |     | 3"  |    |    |
|                |    |                |    |                |    |                |     | 3"             |     | 3"  |    |    |
|                |    |                |    |                |    | TOP            |     | 3"             | 7th |     | 3" |    |
|                |    |                |    |                |    | 3"             |     | 3"             |     | 3"  |    |    |
|                |    |                |    | TOP            |    | 3"             | 6th |                | 3"  | 6th |    | 3" |
|                |    |                |    |                |    | 3"             | 3"  |                | 3"  | 3"  |    | 3" |
|                |    | TOP            | 3" | 5th            |    | 3"             | 5th |                | 3"  |     |    |    |
|                |    |                | 3" | 3"             |    | 3"             | 3"  |                | 3"  |     |    |    |
| TOP            | 3" | 4th            | 3" | 4th            | 3" | 4th            | 3"  | 4th            | 3"  |     |    |    |
|                | 3" |                | 2" |                | 2" |                | 2"  |                | 2"  | 2"  |    |    |
| 3rd            | 3" | 3rd            | 3" | 3rd            | 3" | 3rd            | 3"  | 3rd            | 3"  |     |    |    |
|                | 2" |                | 2" |                | 2" |                | 2"  |                | 2"  | 2"  |    |    |
|                | 3" |                | 3" |                | 3" |                | 3"  |                | 3"  |     |    |    |
|                | 2" |                | 2" |                | 2" |                | 2"  |                | 2"  | 2"  |    |    |
| BOTTOM         | 3" | BOTTOM         | 3" | BOTTOM         | 3" | BOTTOM         | 3"  | BOTTOM         | 3"  |     |    |    |
|                | 3" |                | 3" |                | 3" |                | 3"  |                | 3"  | 3"  |    |    |

CHART 1  
APPLICABLE DOOR MODELS


| MODEL          |
|----------------|
| OB 2024        |
| OB 2025        |
| OB 2025B       |
| OB 2025-INLY   |
| OB 2025B-INLY  |
| OBI 2024       |
| OBI 2025       |
| OBI 2025B      |
| OBI 2025-INLY  |
| OBI 2025B-INLY |

NOMINAL SECTION THICKNESS 2"

LARGE MISSILE IMPACT RESISTANT

10/1/2026

Stalder Talley

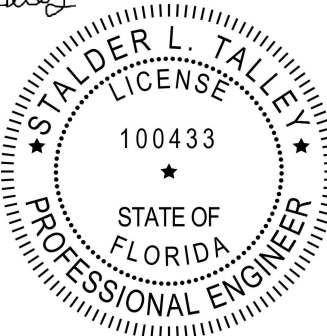


Stalder Talley  
Talley Engineering Consulting,  
LLC  
300 N 11th St, Ponca City, OK  
74601  
FL PE # 100433  
Phone: (405) 829-0258  
Professional Engineer's Seal  
Affixed Solely to Confirm That  
the Door Configuration Shown  
Reflects the Unit That Passed  
DASMA 108-2017 Wind Load  
Testing

DESIGN PRESSURE +26.6/-29.6  
TESTED PER THE APPLICABLE REQUIREMENTS OF:  
ANSI/DASMA 108-2017  
ANSI/DASMA 115-2017  
COMPLIES WITH CURRENT FBC  
COMPLIES WITH IBC/IRC 2024 (TEXAS)  
NOTE: THE DESIGN OF SUPPORTING  
STRUCTURAL ELEMENTS SHALL BE THE  
RESPONSIBILITY OF THE PROFESSIONAL OF RECORD  
FOR THE BUILDING OR STRUCTURE IN ACCORDANCE  
WITH CURRENT BUILDING CODES

|                                                    |           |              |     |
|----------------------------------------------------|-----------|--------------|-----|
|                                                    | REVISIONS |              |     |
|                                                    | FL CODE   | 9.26         | BHG |
|                                                    |           |              |     |
|                                                    |           |              |     |
| TITLE<br>OB 2025B 16X7, +26.6/-29.6 PSF RATED DOOR |           |              |     |
| DRAWING# N25-1607-26.6-3-IRG                       |           | DRAWN BY BHG |     |
| SCALE - N/A                                        |           | SHEET 3 OF 4 |     |
|                                                    |           | DATE 1/13/26 |     |

LARGE MISSILE IMPACT RESISTANT

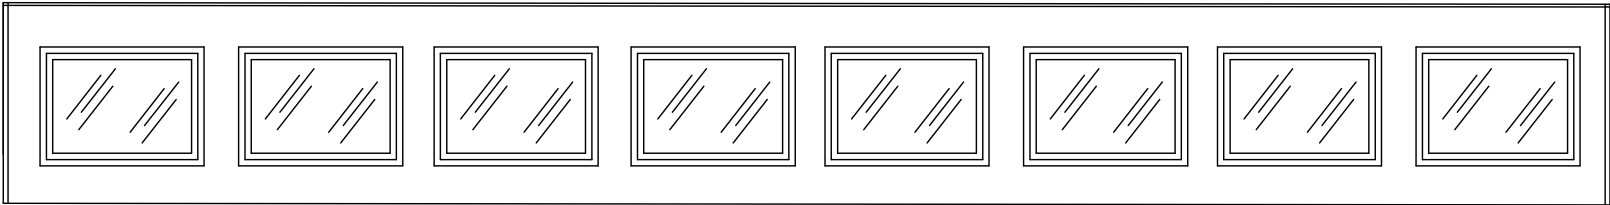



SHORT PANEL IMPACT GLAZING

GLAZING

- 1. UP TO (8) SHORT PANEL WINDOS PER SECTION
- 2. MAX (1) GLAZED SECTION PER DOOR
- 3. 1/4" TUFFAK POLYCARBONATE GLAZING BY PLASKOLITE
- 4. SCREW TOGETHER .055 6060 EXTRUDED ALUMINUM FRAMES SECURED WITH (10) #8X1" SCREWS (SHORT PANEL)
- 5. MAX DLO 16-3/4" X 10-3/8"

NOTES:


- 1. 4 SECTION HIGH DOOR SHOWN ( 7FT). TALLER DOOR CONFIGURATIONS MAY BE CONSTRUCTED UP TO A MAXIMUM OF 14' DOOR HEIGHT, USING THE SAME PANEL CONSTRUCTION AS SHOWN (MAXIMUM SECTION HEIGHT OF 21").
- 2. MINIMUM STEEL THICKNESS FOR SECTION IS 26 GA. (.0165").
- 3. TORSION SPRINGS OR EXTENSION SPRINGS AVAILABLE.
- 4. LOCK MUST BE ATTACHED AT EACH SIDE OF THE DOOR. CAM & BAR LOCKS OR AN OPENER MAY BE SUBSTITUTED.
- 5. THIS DOOR HAS BEEN TESTED FOR WIND-BORNE DEBRIS.
- 6. USE THIS DRAWING IN CONJUNCTION WITH INSTALLATION INSTRUCTIONS. WHERE THE DRAWING CONFLICTS WITH OTHER INSTALLATION INSTRUCTIONS, THIS DRAWING GOVERNS.
- 7. RATIONAL ANALYSIS APLIES ONLY TO MODELS LISTED IN CHART 1 CONSTRUCTED IN ACCORDANCE WITH THIS DRAWING.
- 8. VERTICAL JAMBS RECEIVE MAXIMUM DESIGN LOADS OF +212.8 LBS/FT AND -236.8 LBS/FT.
- 9. (1) 3" 20GA 50KSI STRUT REQUIRED AT THE TOP AND BOTTOM OF EACH SECTION AND (1) 2-1/4" 22GA 29KSI STRUT REQUIRED AT THE CENTER OF INTERMEDIATE SECTIONs.
- 10. OPTIONAL DROP-IN INSULATION ALLOWED.
- 11. STEEL DOOR AND STEEL HARDWARE WILL BE DESIGNED MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.

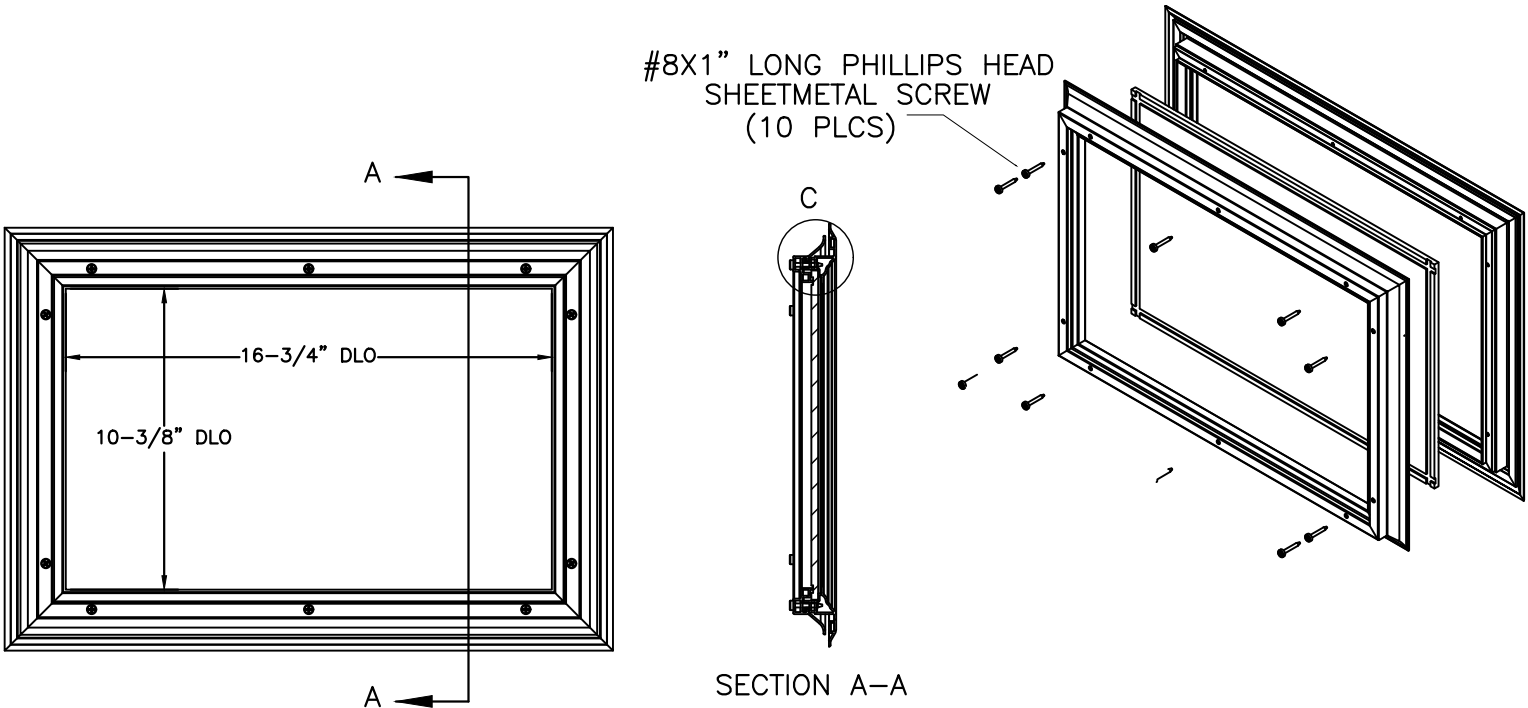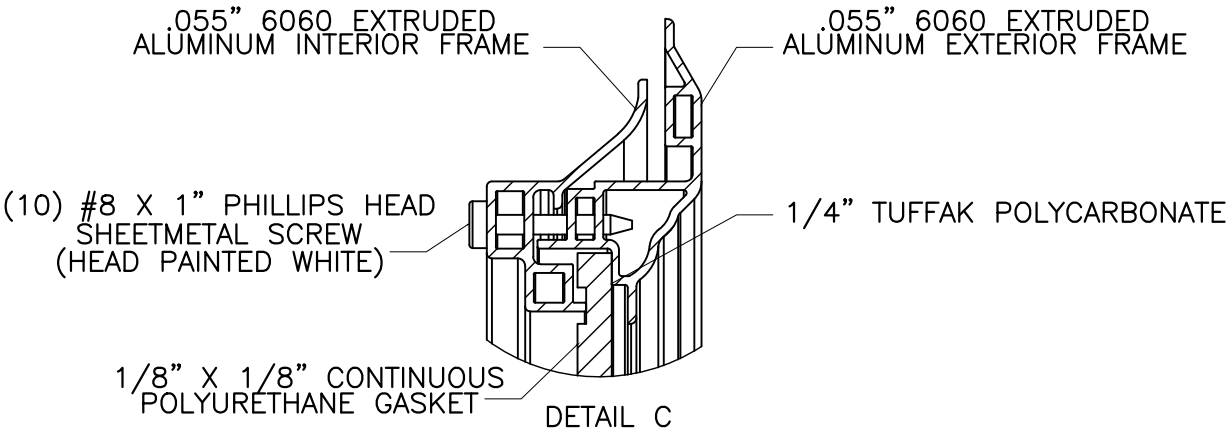

Stalder Talley  
Talley Engineering Consulting,  
LLC  
300 N 11th St, Ponca City, OK  
74601  
FL PE # 100433  
Phone: (405) 829-0258  
Professional Engineer's Seal  
Affixed Solely to Confirm That  
the Door Configuration Shown  
Reflects the Unit That Passed  
DASMA 108-2017 Wind Load  
Testing

10/1/2026

Stalder Talley

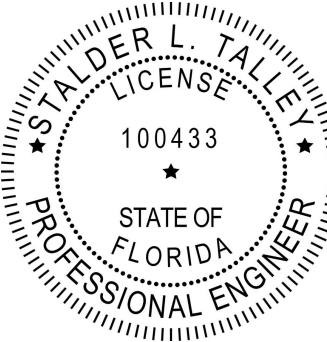

DESIGN PRESSURE +26.6/-29.6  
TESTED PER THE APPLICABLE REQUIREMENTS OF:  
ANSI/DASMA 108-2017  
ANSI/DASMA 115-2017  
COMPLIES WITH CURRENT FBC  
COMPLIES WITH IBC/IRC 2024 (TEXAS)  
NOTE: THE DESIGN OF SUPPORTING  
STRUCTURAL ELEMENTS SHALL BE THE  
RESPONSIBILITY OF THE PROFESSIONAL OF RECORD  
FOR THE BUILDING OR STRUCTURE IN ACCORDANCE  
WITH CURRENT BUILDING CODES



TITLE  
OB 2025B 16X7, +26.6/-29.6 PSF RATED DOOR

DRAWING# N25-1607-26.6-3-IRG  
SCALE - N/A

DRAWN BY BHG  
SHEET 4 OF 4  
DATE 1/13/26

REVISIONS

| FL CODE | 9.26 | BHG |
|---------|------|-----|
|         |      |     |
|         |      |     |
|         |      |     |