


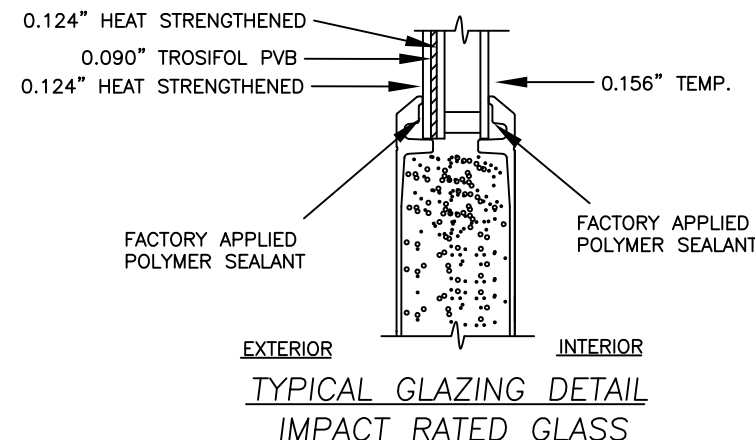
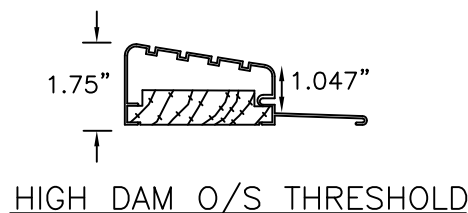
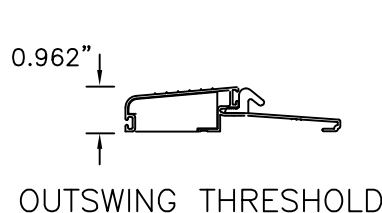
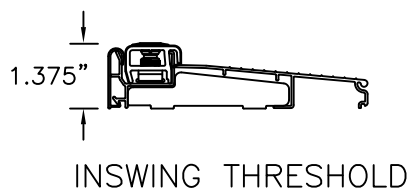
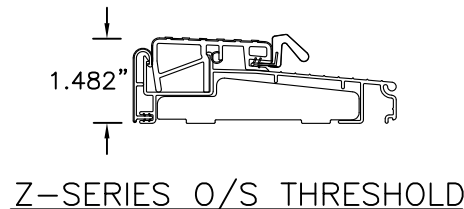
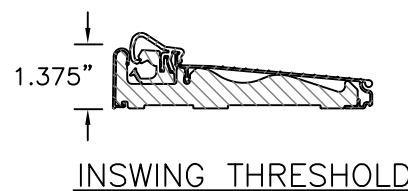
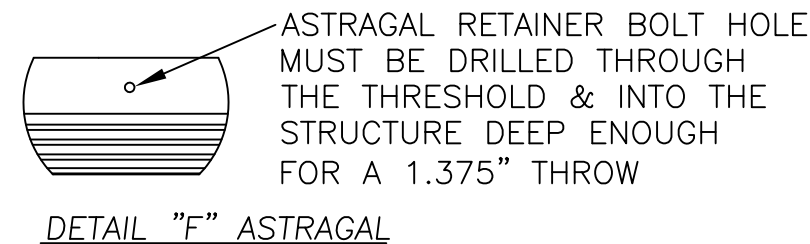
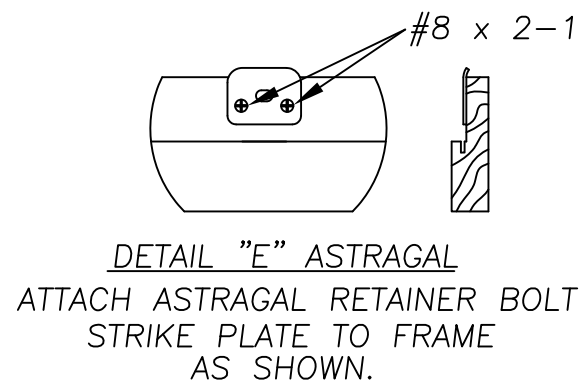


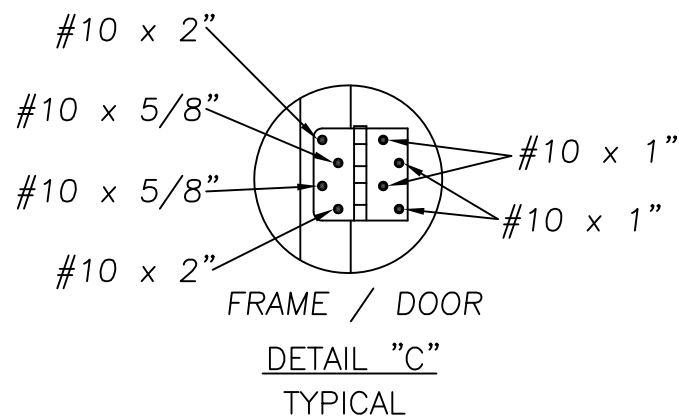

SHEET 1 OF 3

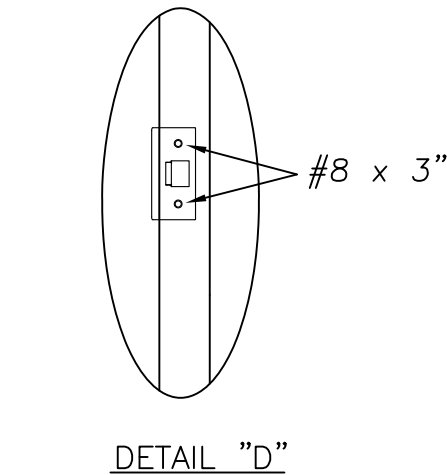


MAX GLASS SIZES COMPLY WITH ASTM E1300 FOR DESIGN PRESSURES LISTED ON PAGE 1

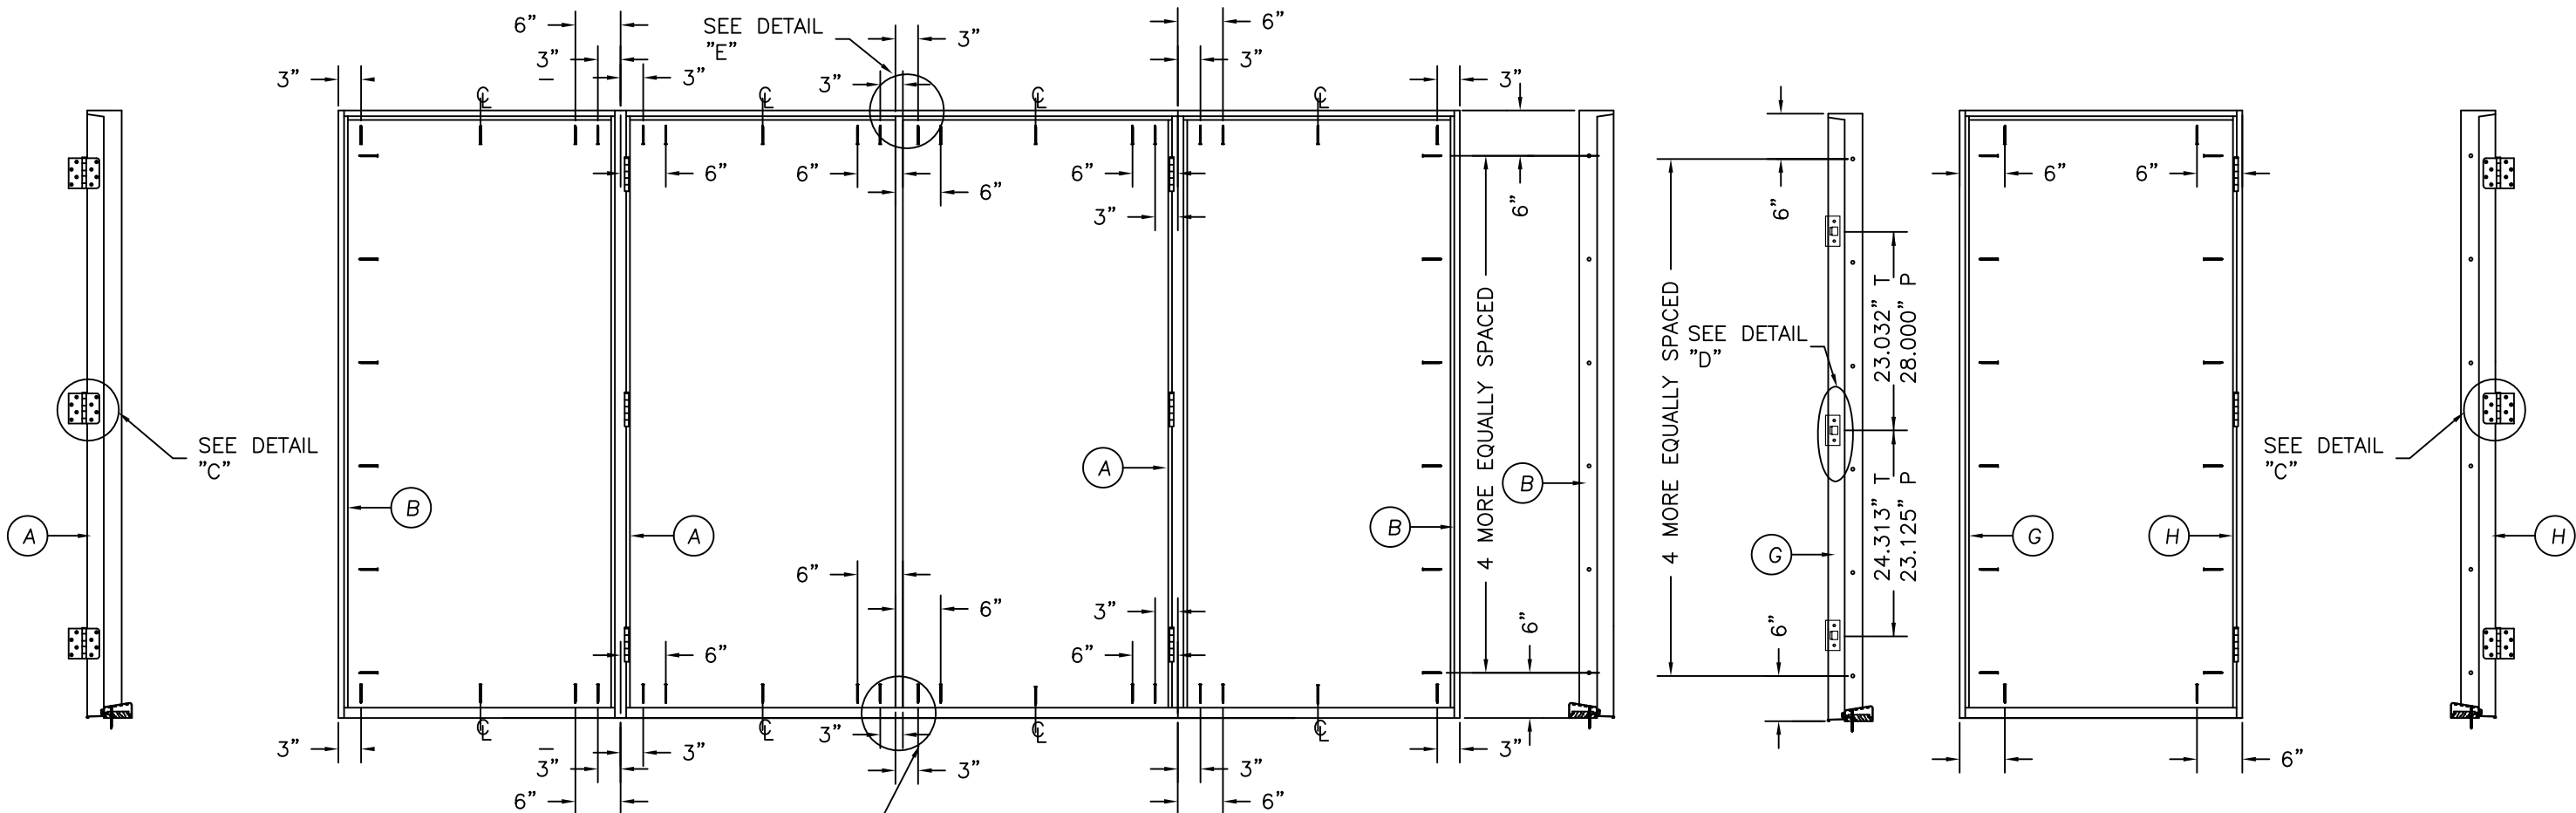

2/23/2026
Lucas A. Turner, FL PE #58201
2428 Old Natchez Trc Trl
Camden, TN 38320 | Ph. 941-380-1574

PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219	
PRODUCT: "EXTERIOR DOOR PRODUCT" 6'-8" FIBERGLASS GLAZED DOUBLE DOOR UNIT	PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS
NO.	DATE
BY	REVISIONS
DATE: 12/18/25	
SCALE: N.T.S.	
DWG. BY: SWS	
CHK. BY:	
DRAWING NO.:	
DWG-PL-FL0272-25	
SHEET 2	OF 3

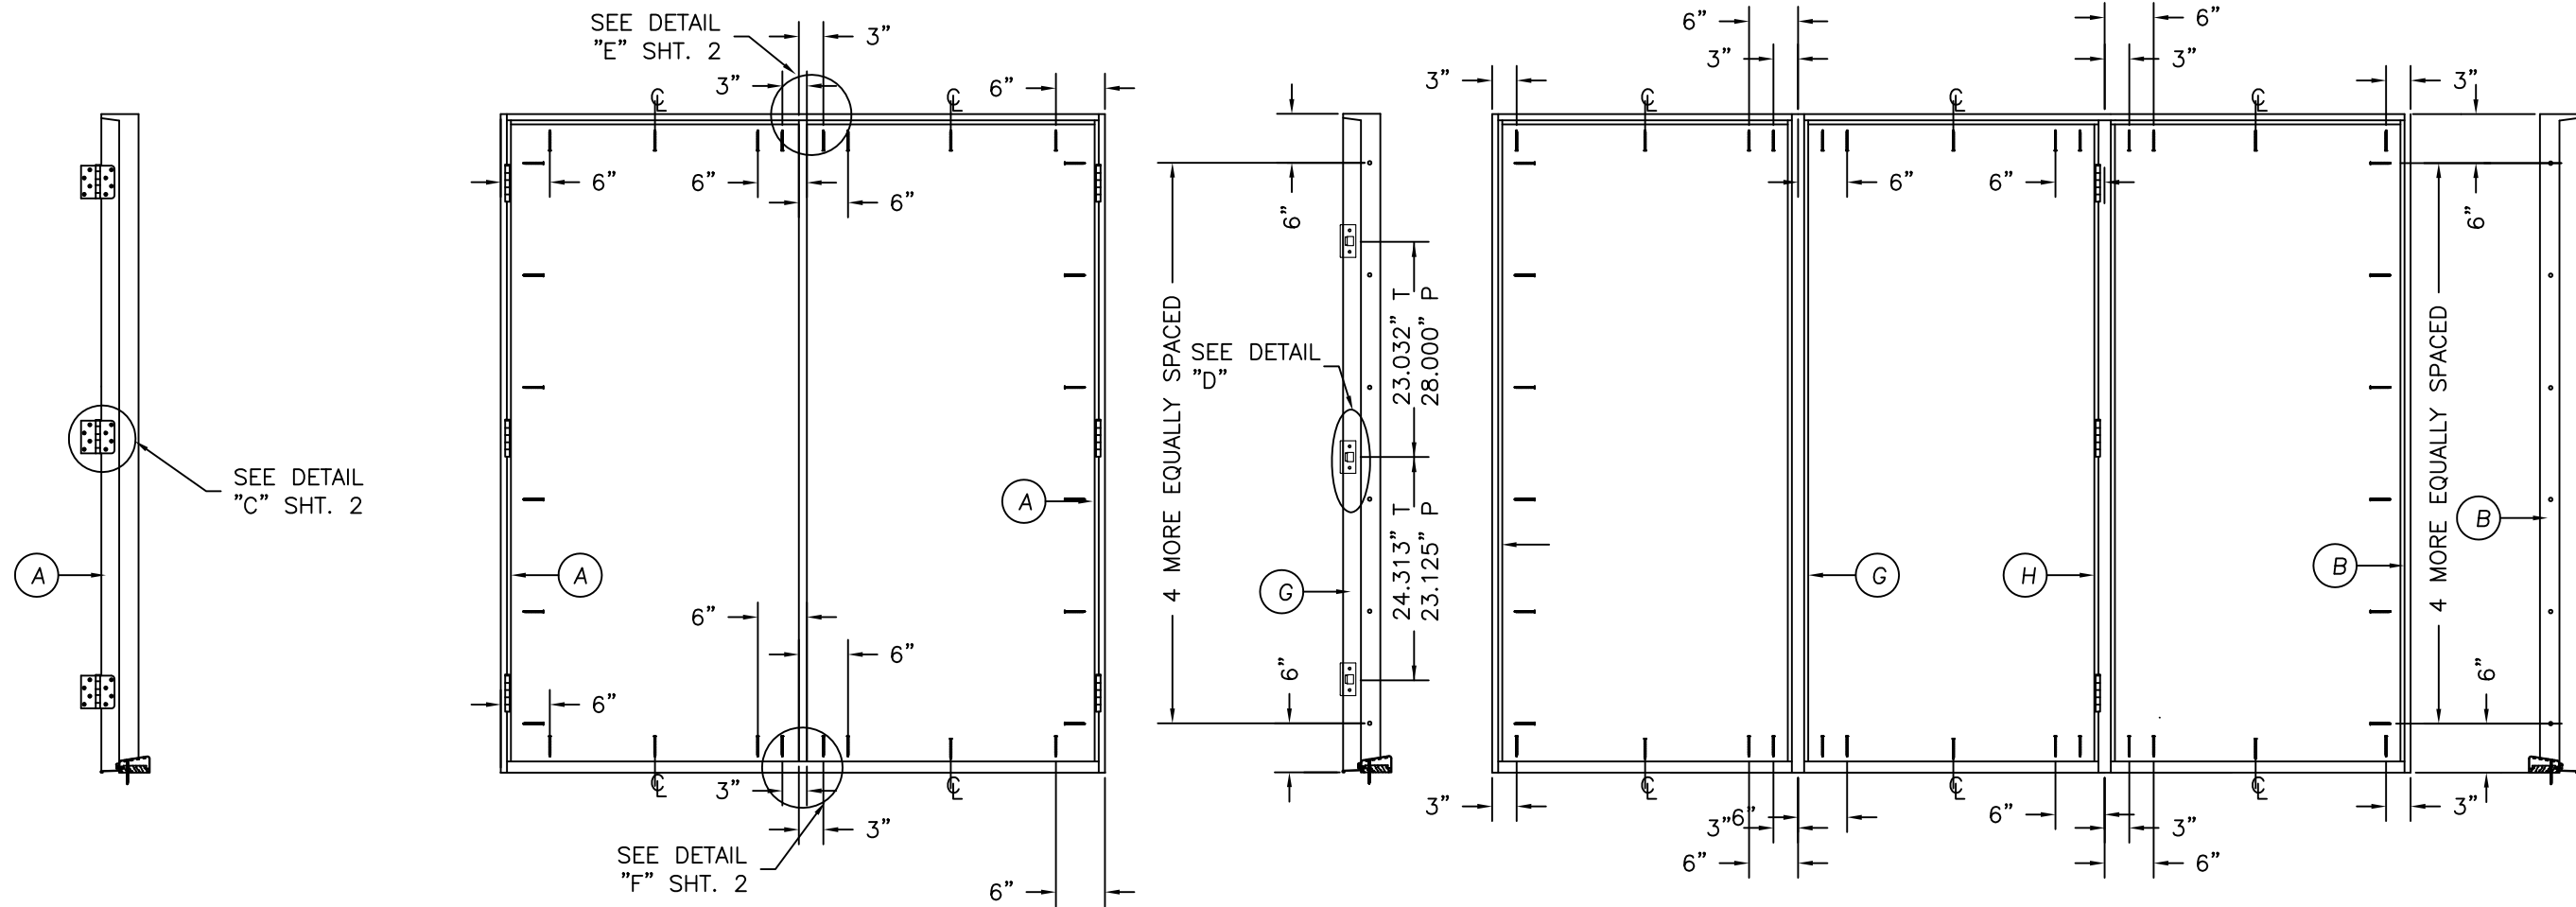

ATTACHMENT DETAIL

1. JAMB, HEAD, AND THRESHOLD ANCHOR OPTIONS INCLUDE:






#10 WOOD SCREWS WITH 3/4" MIN. EDGE DISTANCE AND MIN. EMBEDMENT OF 1-1/2" INTO SPRUCE-PINE-FIR (G=0.42) MIN. SUBSTRATE.

#10-16 TEKS SCREWS WITH MIN. EDGE DISTANCE OF 1/2" FOR ATTACHMENT TO 18 GAUGE (0.048") MIN. 33 KSI MIN. YIELD STEEL OR 1/8" MIN. 6063-T5 MIN. ALUMINUM. SCREWS MUST ACHIEVE FULL ENGAGEMENT TO METAL WALL WITH MIN. 3 THREADS BEYOND THE METAL WALL THICKNESS.

1/4" DEWALT ULTRA CON+ WITH 2-1/2" MIN. EDGE DISTANCE AND MIN. EMBEDMENT OF 1-1/4" TO SOLID CONCRETE (3050 PSI MIN.) OR CONCRETE BLOCK (ASTM C-90) UNCRACKED SUBSTRATES. ENSURE 3" MIN. ON-CENTER DISTANCE BETWEEN ANY TWO ULTRA CONS.




2. A PHYSICAL SHIM MUST BE PLACED IN SHIM SPACE AT EACH ANCHOR LOCATION WHERE A GAP OF 1/16" OR GREATER EXISTS.

3. IF USED, WOOD BUCKS BY OTHERS MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO STRUCTURE.

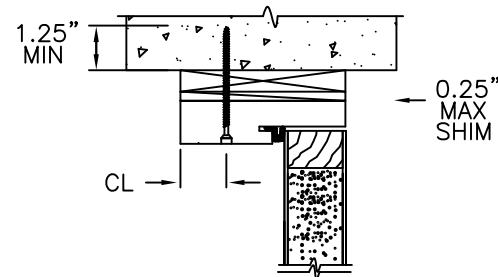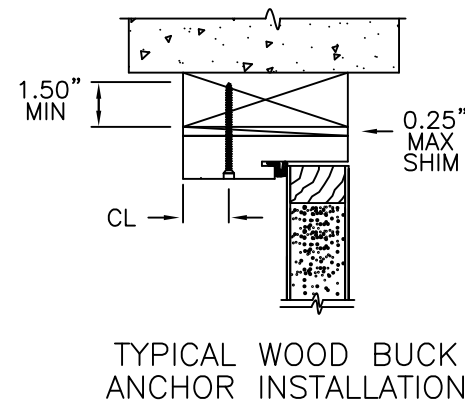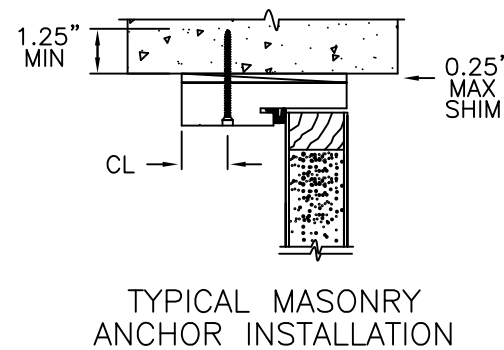

HARDWARE SCHEDULE

1.	ENDURA PANOLOCK OR TRILENNIUM MULTIPOINT LOCKING HARDWARE FACTORY INSTALLED.
2.	4" X 4" FULL MORTISE BUTT HINGES.

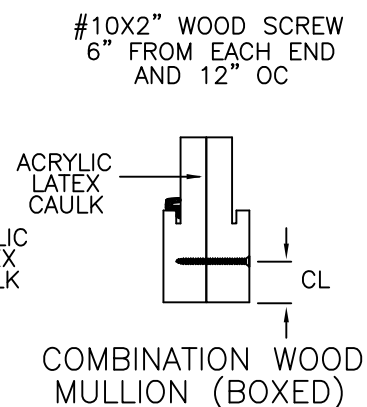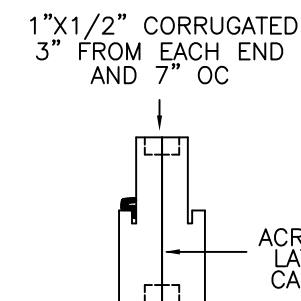

2/23/2026
 Lucas A. Turner, FL PE #58201
 2428 Old Natchez Trc Trl
 Camden, TN 38320 | Ph. 941-380-1574

PELLA CORPORATION
 102 MAIN STREET
 PELLA, IA 50219



PRODUCT:		PART OR ASSEMBLY:	
"EXTERIOR DOOR PRODUCT"		ANCHORING LOCATIONS & DETAILS	
6'-8" FIBERGLASS GLAZED DOUBLE DOOR UNIT			
		NO.	DATE
		BY	REVISIONS
DATE: 12/18/25			
SCALE: N.T.S.			
DWG. BY: SWS			
CHK. BY:			
DRAWING NO.:			
DWG-PL-FL0272-25			
SHEET 3 OF 3			