
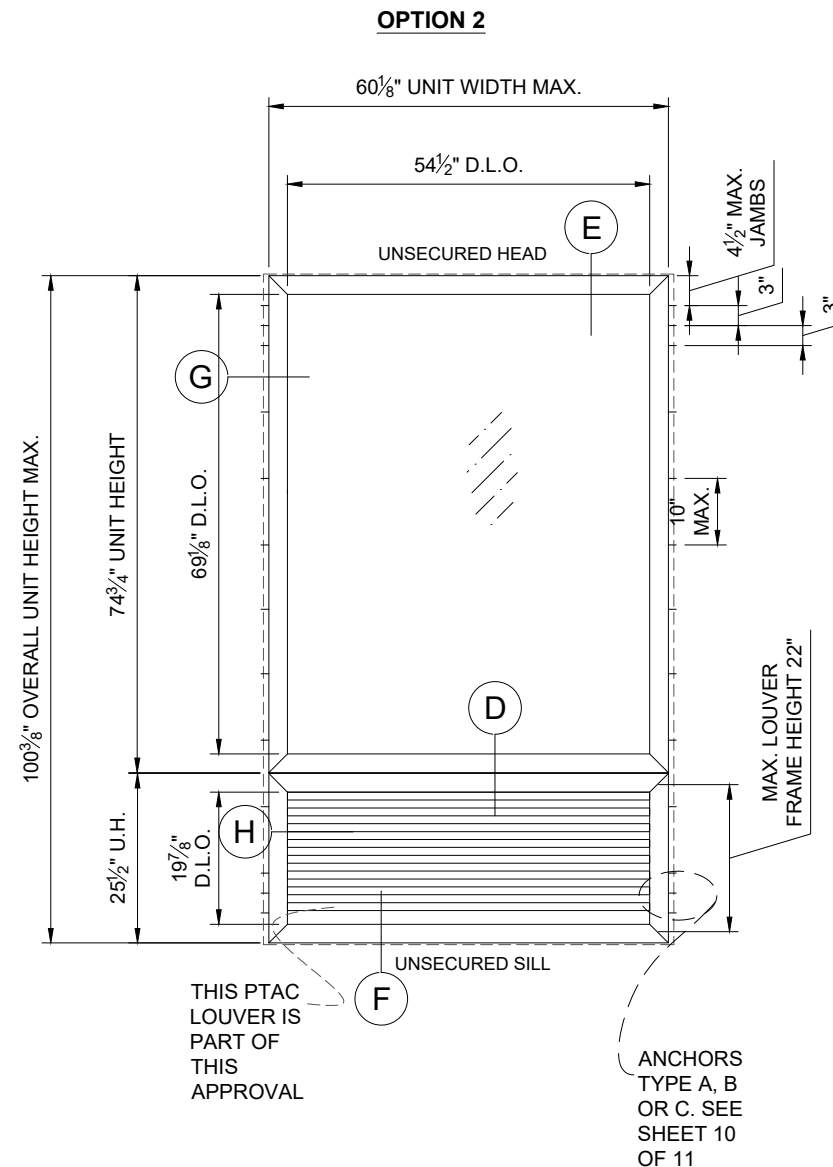


"HOTEL SERIES 325 PVC" WINDOW / PTAC LOUVER SYSTEM

NON-IMPACT • +45 / -60

FL # 48129.1

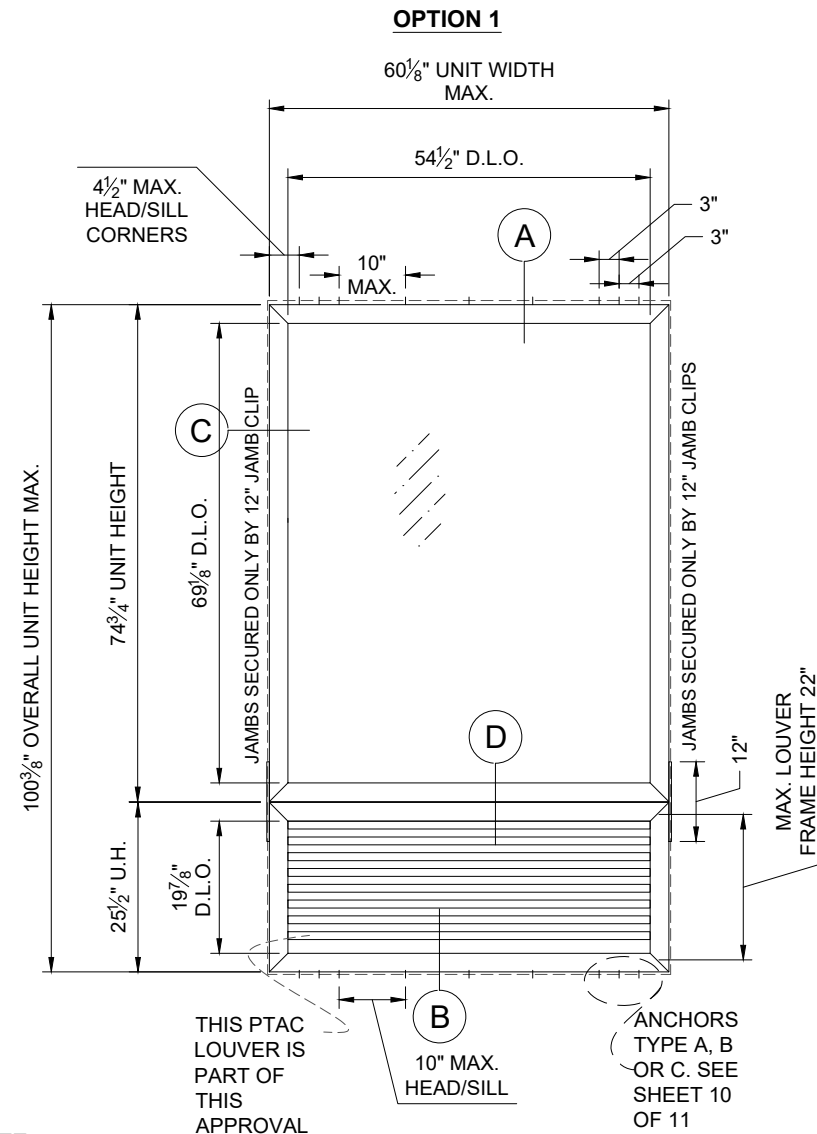

NOTE:
2026 FLORIDA BUILDING CODE IS BASED ON THE
2024 IBC WITH FLORIDA AMENDMENTS.

CODES / STANDARDS USED:

2026 FLORIDA BUILDING CODE (FBC), 9TH EDITION
ASTM E1300-16
ANSI/AWC NDS-2024 FOR WOOD CONSTRUCTION
ALUMINUM DESIGN MANUAL
AISI S100-16 (2020) SPECIFICATION FOR COLD-FORMED
STEEL STRUCTURAL MEMBERS

TESTS PERFORMED:

TAS 202	AIR INFILTRATION, WATER PENETRATION, STRUCTURAL
ASTM E283	AIR INFILTRATION LEAKAGE
ASTM E331	WATER PENETRATION
ASTM E330	UNIFORM STATIC AIR PRESS. (STRUCTURAL)

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH
THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 9TH EDITION
(2026).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO
TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS,
ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND
WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE
DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN
DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS,
THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS
SHALL MEET THE REQUIREMENTS OF 2026 FLORIDA BLDG. CODE.



Lucas Turner
2026.10.14
18:49:03
-05'00'

REVISIONS:	NO.	DATE:	DESCRIPTION:
	1		
	2		
	3		
	4		
	5		

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLDNATCHEZ TRC. TRL
CAMDEN, TN 38320
941-380-1574
P.E. #58201

CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)


PRODUCT APPROVAL #:
FL # 48129.1

SCALE: NOTED
DATE: 11/14/2025
DWG NO: CHGL-PVC N.I.-2026

SHEET No:
01 OF 011



NOTE:

- LOUVERS SYSTEM IS TO BE INSTALLED IN A LOCATION WHERE THE ROOM BEHIND LOUVERS IS DESIGNED TO DRAIN WATER PENETRATING INTO THE ROOM AND THE ROOM WILL HOUSE WATER RESISTANT/WATER PROOF EQUIPMENT, COMPONENTS, OR SUPPLIES.
- DEFLECTORS ARE TO DIRECT INTAKES & EXHAUST FOR INSTALLED IN WINDOW SLEEVE BEYOND. THEY HAVE NO EFFECT ON STRUCTURAL INTEGRITY OF LOUVER DESIGN

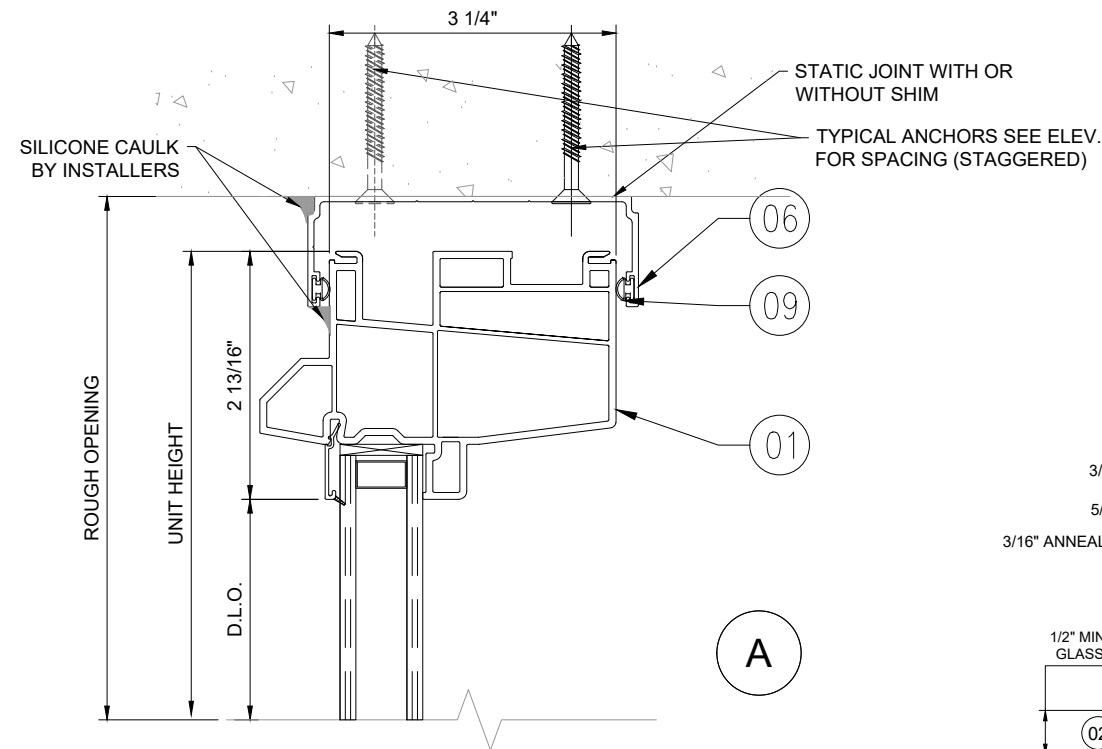


NOTE:
SHIM SPACE AT HEAD AND SILL CAN BE UP TO 1/4" WITHOUT REQUIRING ADDITIONAL ENGINEERING.

NOTE:
ALTERNATE SEALANT SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER FOR PROJECT SPECIFIC DESIGN CRITERIA BASED ON SEALANT MANUFACTURERS GUIDELINES.

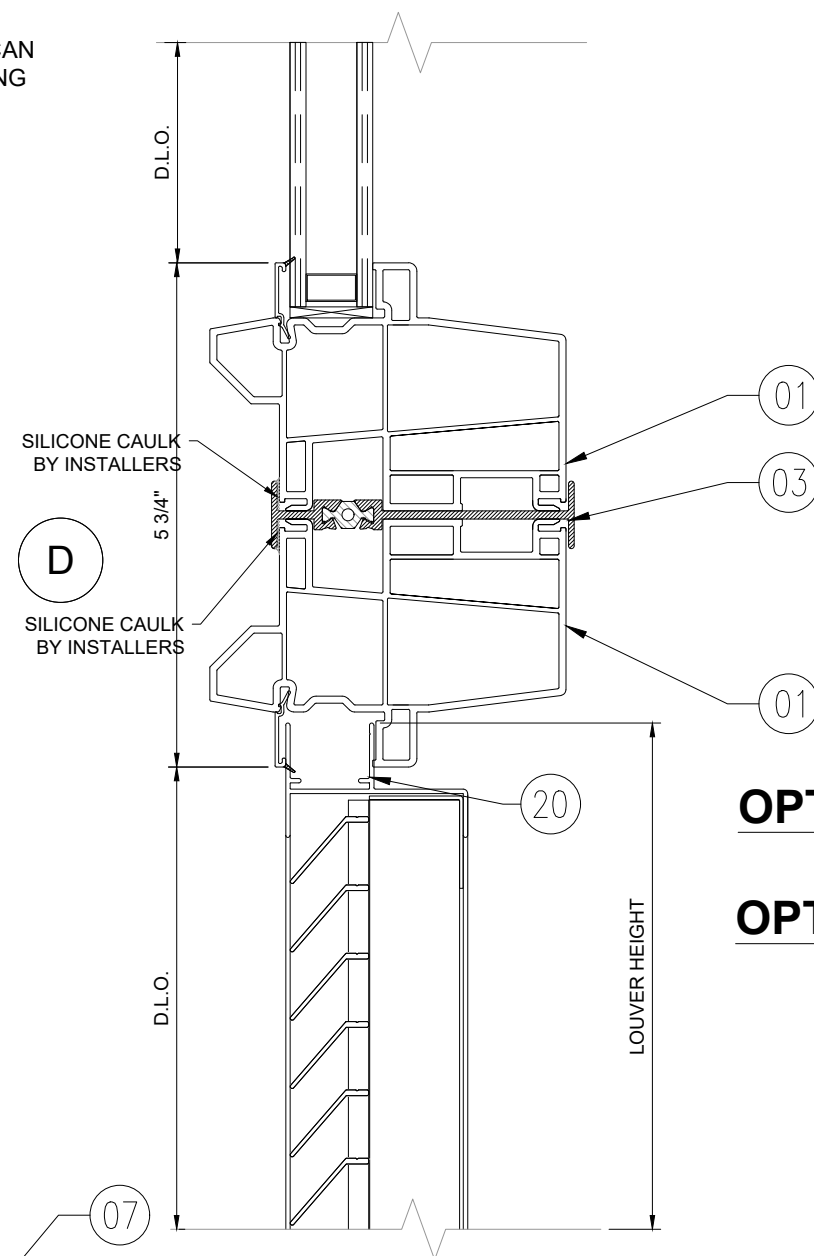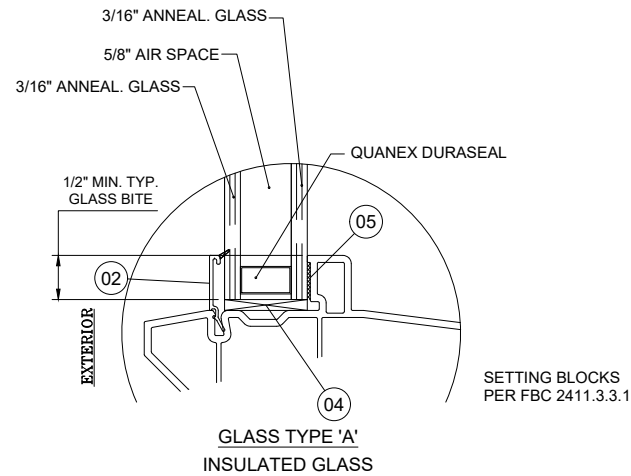

**OPTION 1
&
OPTION 2**



ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201


CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1

SCALE:
NOTED
DATE:
11/14/2025
DWG NO.
CHGL-PVC N.I.-2026


SHEET No:
02 OF 011

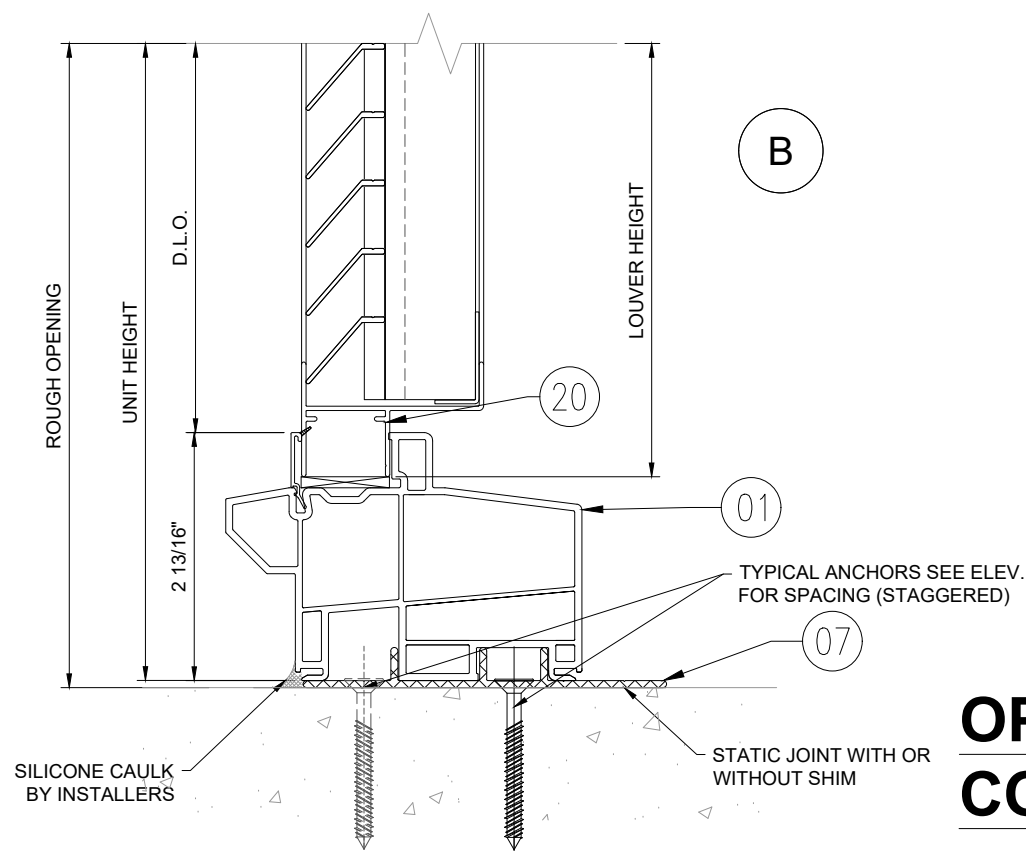


**OPTION 1
CONCRETE**

NOTE:
(4) ANCHORS SPACED 3" APART AT 12" JAMB CLIP



SILICONE SEALANT DOWSIL 790 OR EQUAL (SEE CHART)

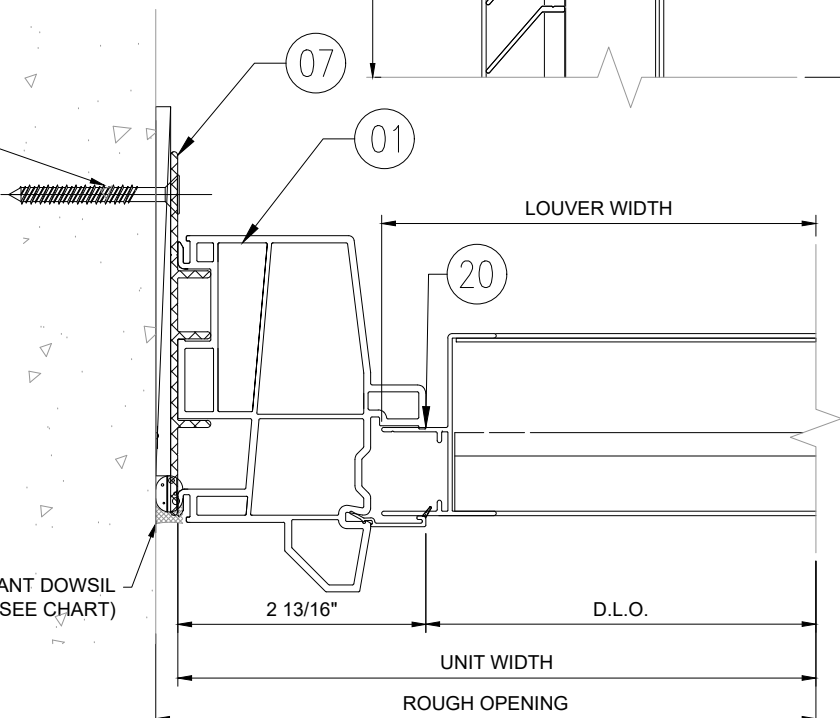

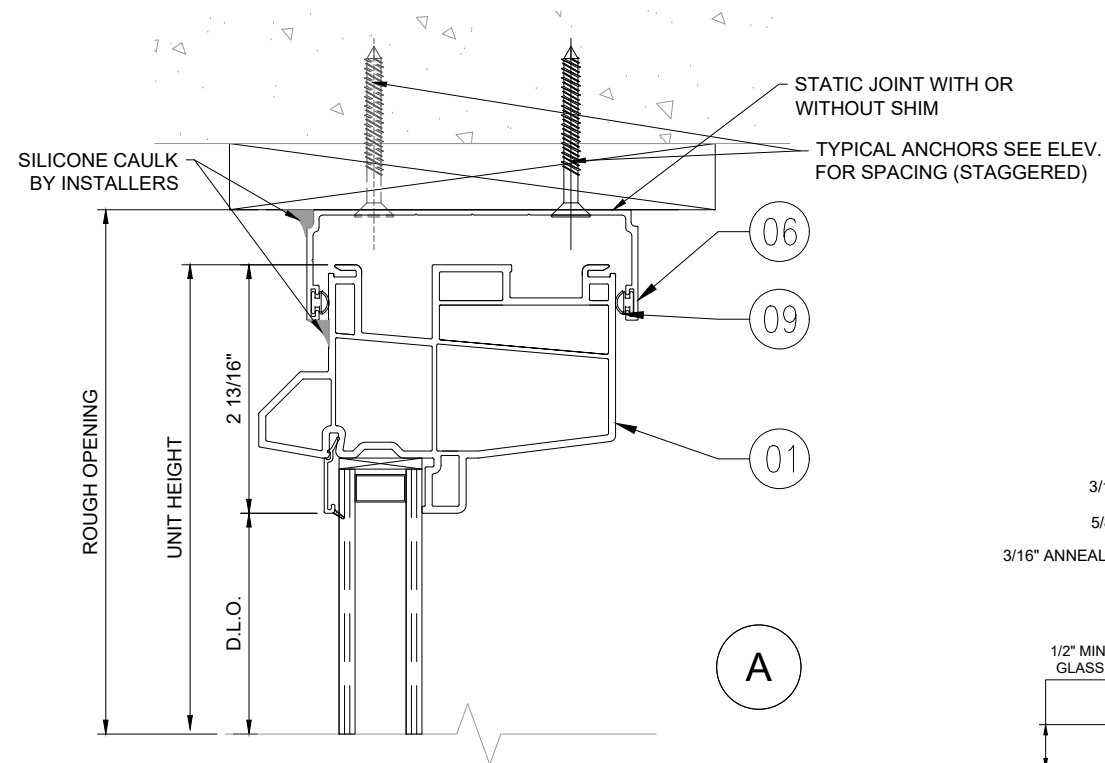


NOTE:
SHIM SPACE AT HEAD AND SILL CAN
BE UP TO 1/4" WITHOUT REQUIRING
ADDITIONAL ENGINEERING.

NOTE:
ALTERNATE SEALANT SHALL BE DESIGNED BY A
FLORIDA LICENSED ENGINEER FOR PROJECT
SPECIFIC DESIGN CRITERIA BASED ON SEALANT
MANUFACTURERS GUIDELINES.

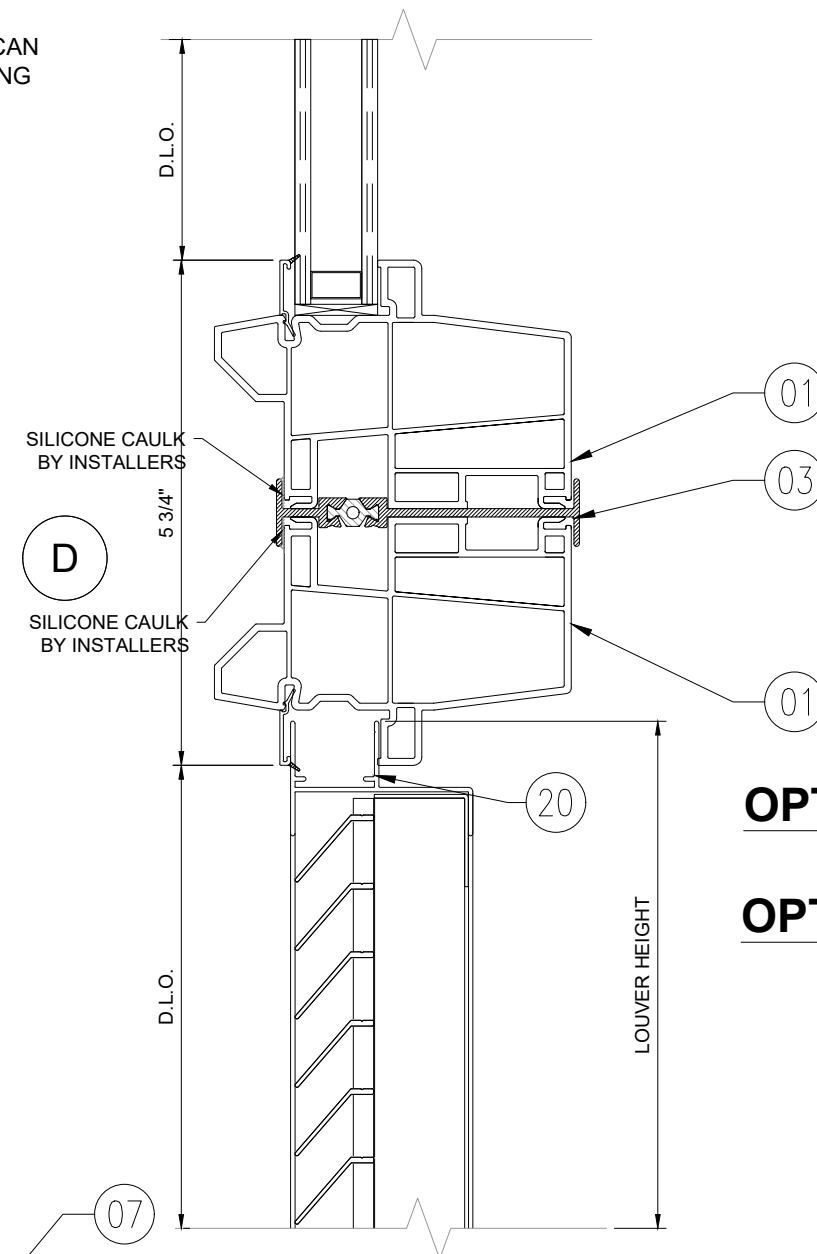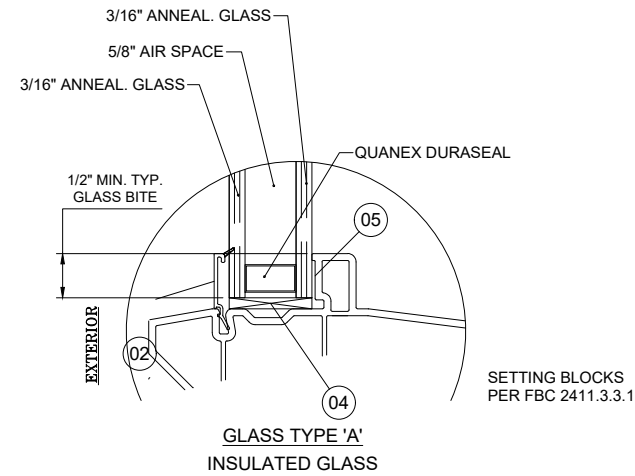

**OPTION 1
&
OPTION 2**



ENGINEER:
**TURNER ENGINEERING &
CONSULTING, INC.**
2428 OLD NATCHEZ TRC. TRL
CAUDEN, TN 38520
941-380-1574
P.E. #58201


CHAMPION GLASS
INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1


SCALE:
NOTED
DATE:
11/14/2025
DWG NO.
CHGL-PVC N.I.-2026


SHEET No:
03 OF 011

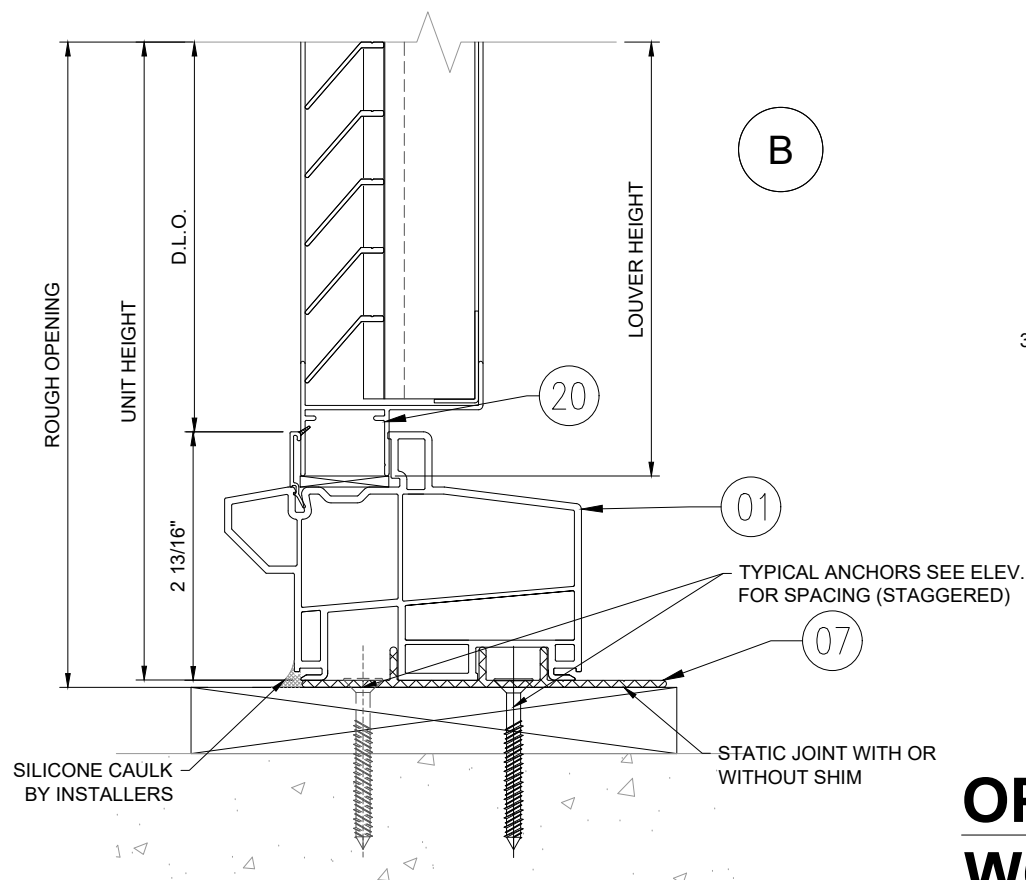

**OPTION 1
WOOD**



NOTE:
(4) ANCHORS SPACED
3" APART AT 12" JAMB CLIP

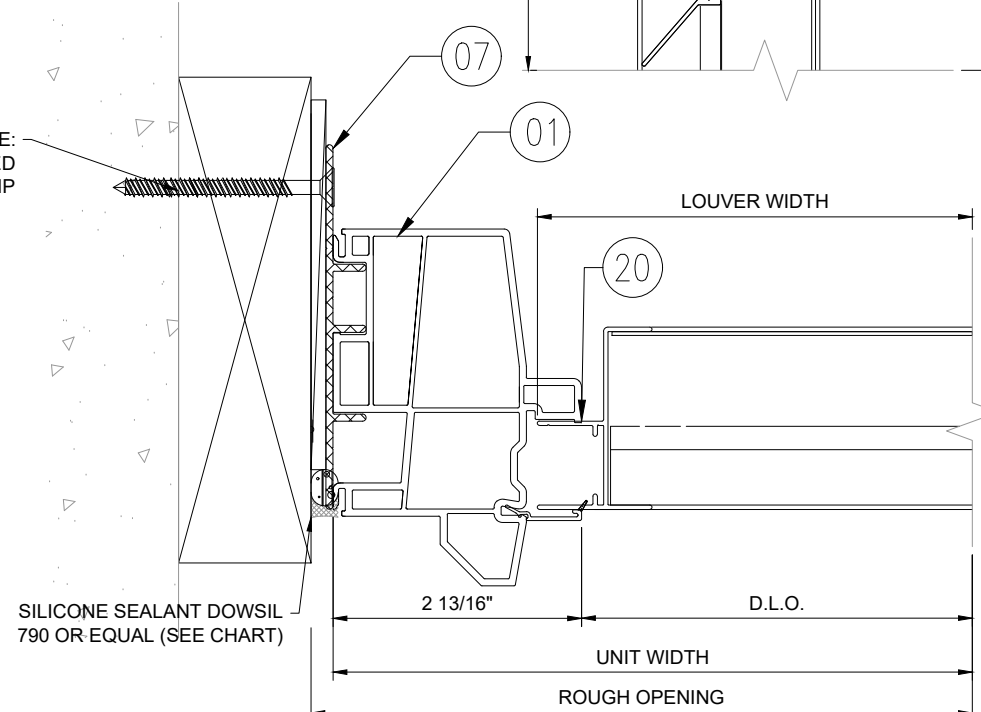

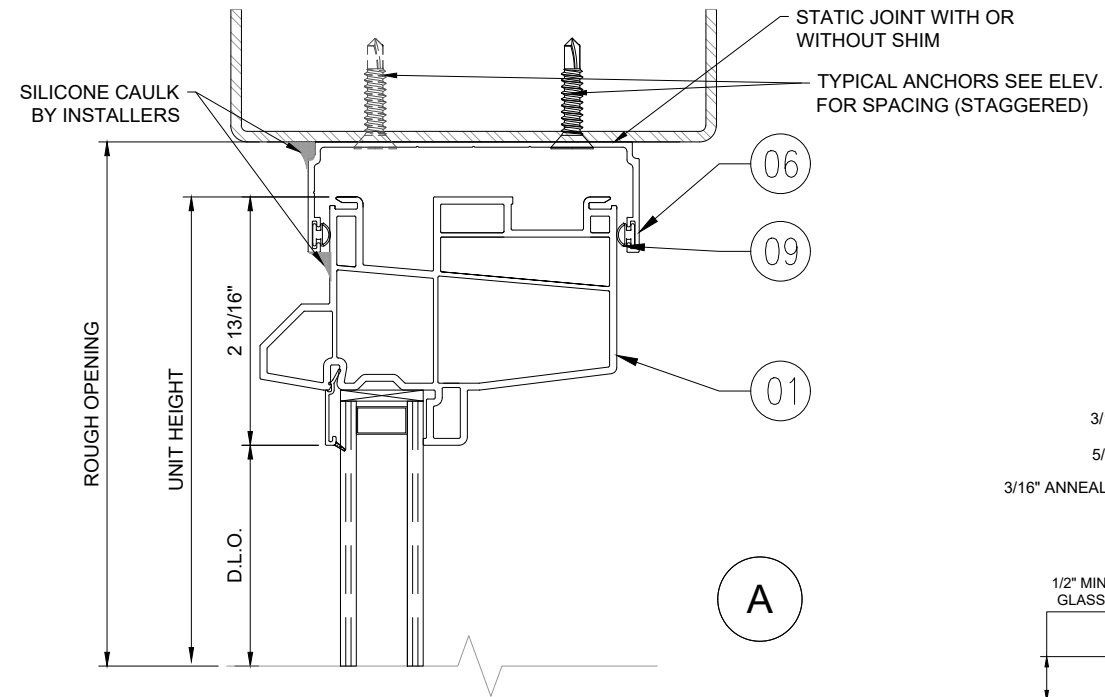


NOTE:
SHIM SPACE AT HEAD AND SILL CAN
BE UP TO 1/4" WITHOUT REQUIRING
ADDITIONAL ENGINEERING.

NOTE:
ALTERNATE SEALANT SHALL BE DESIGNED BY A
FLORIDA LICENSED ENGINEER FOR PROJECT
SPECIFIC DESIGN CRITERIA BASED ON SEALANT
MANUFACTURERS GUIDELINES.

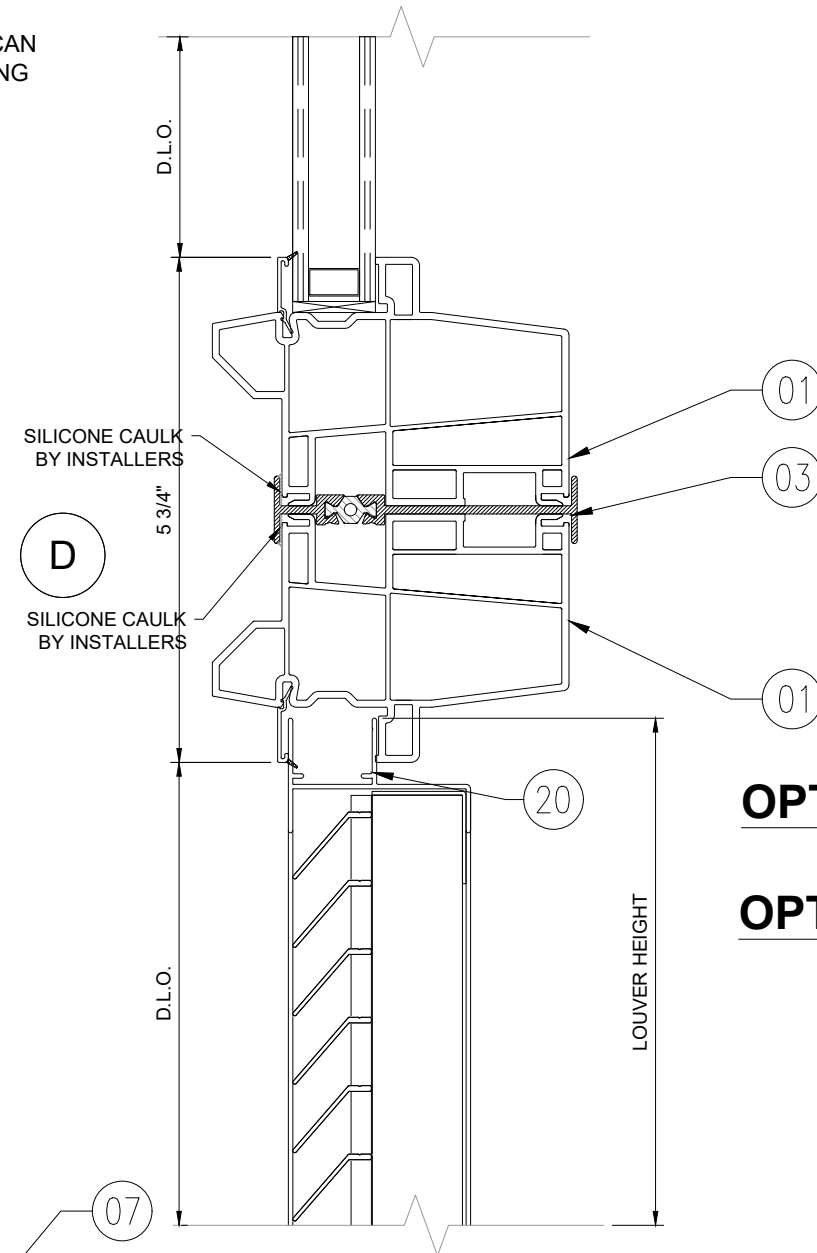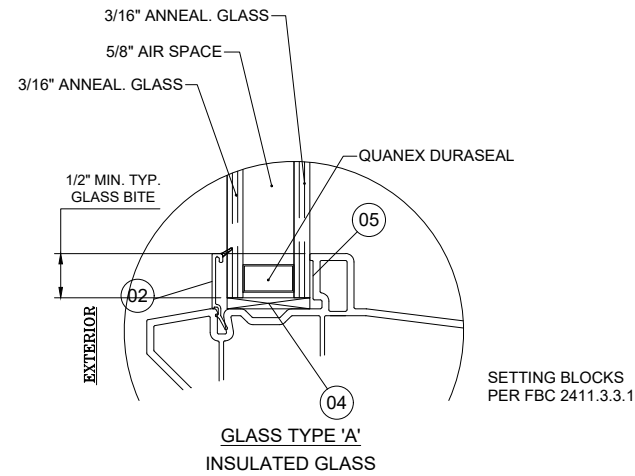

**OPTION 1
&
OPTION 2**



ENGINEER:
**TURNER ENGINEERING &
CONSULTING, INC.**
2428 OLD NATCHEZ TRC. TRL
CAUDEN TN 38520
941-380-1574
P.E. #58201


CHAMPION GLASS
INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1

SCALE:
NOTED
DATE:
11/14/2025
DWG NO.
CHGL-PVC N.I.-2026


SHEET No:
04 OF 011


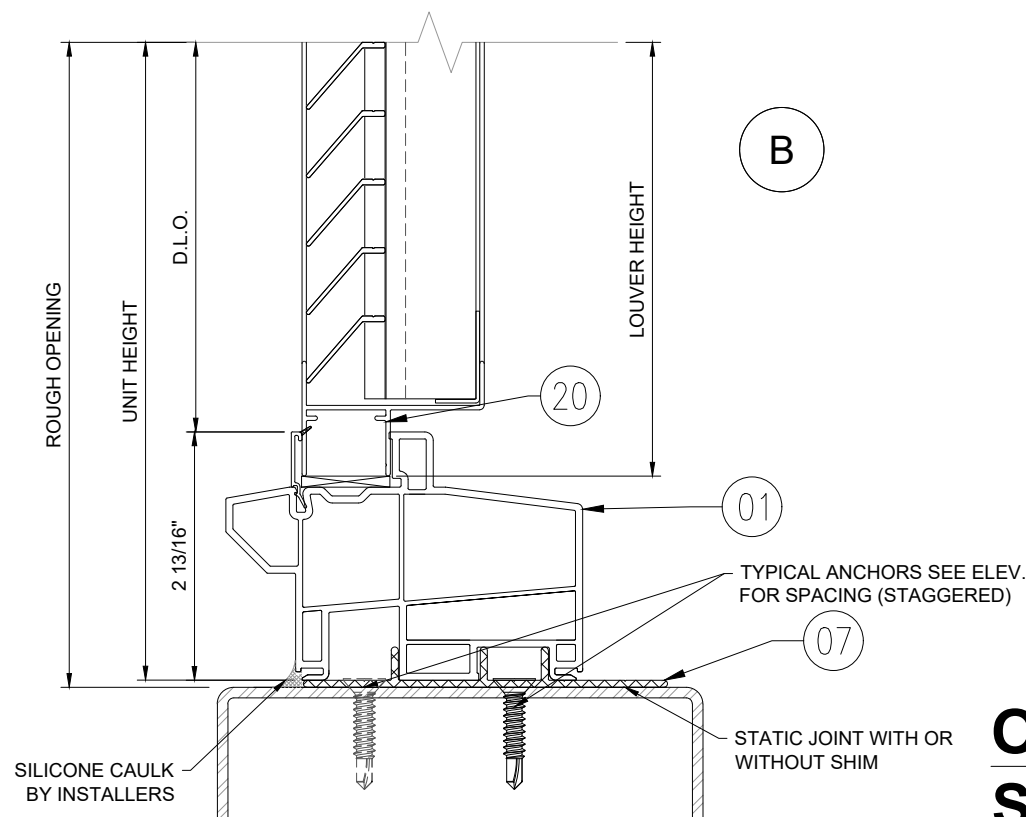


NOTE:
(4) ANCHORS SPACED
3" APART AT 12" JAMB CLIP



SILICONE SEALANT DOWSIL
790 OR EQUAL (SEE CHART)

**OPTION 1
STEEL**

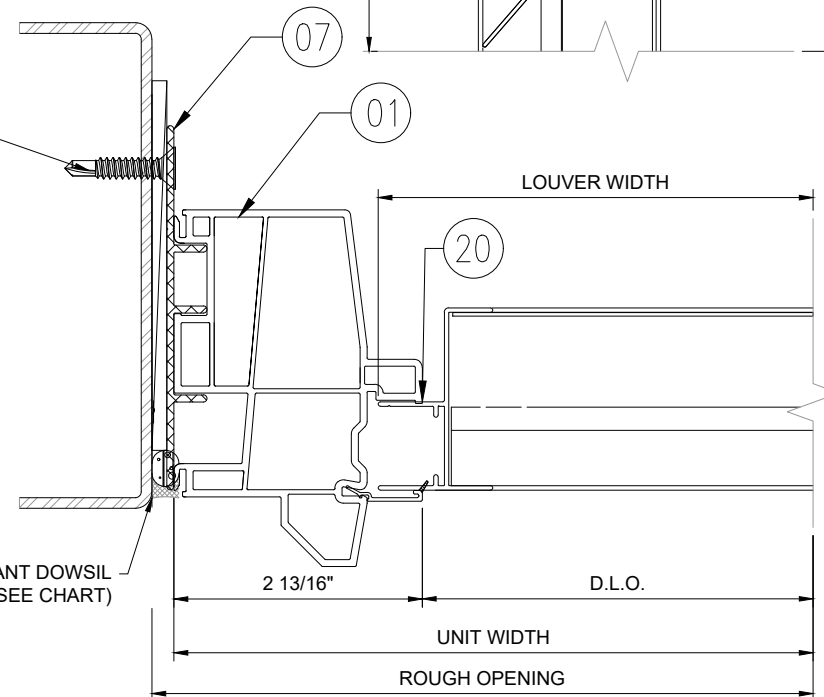

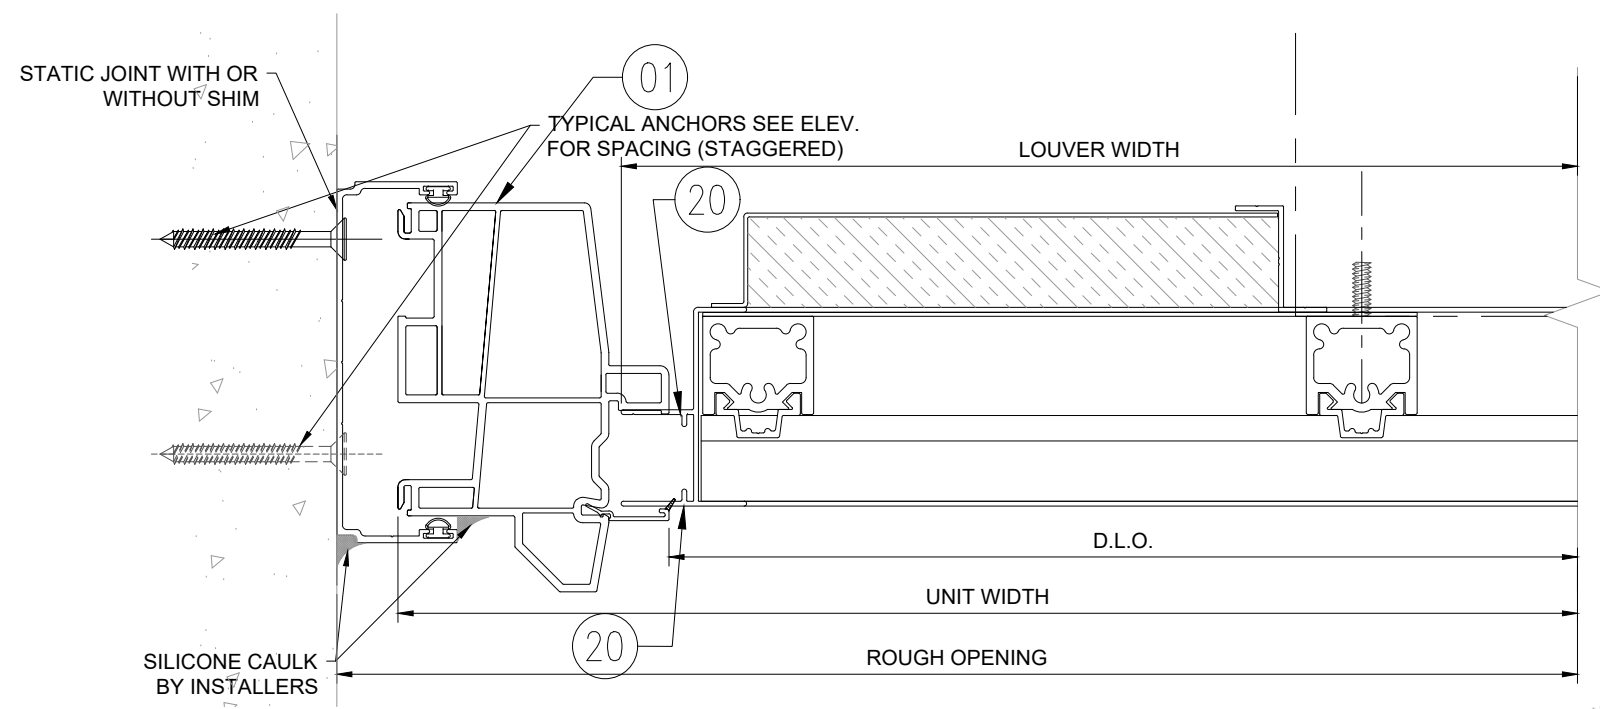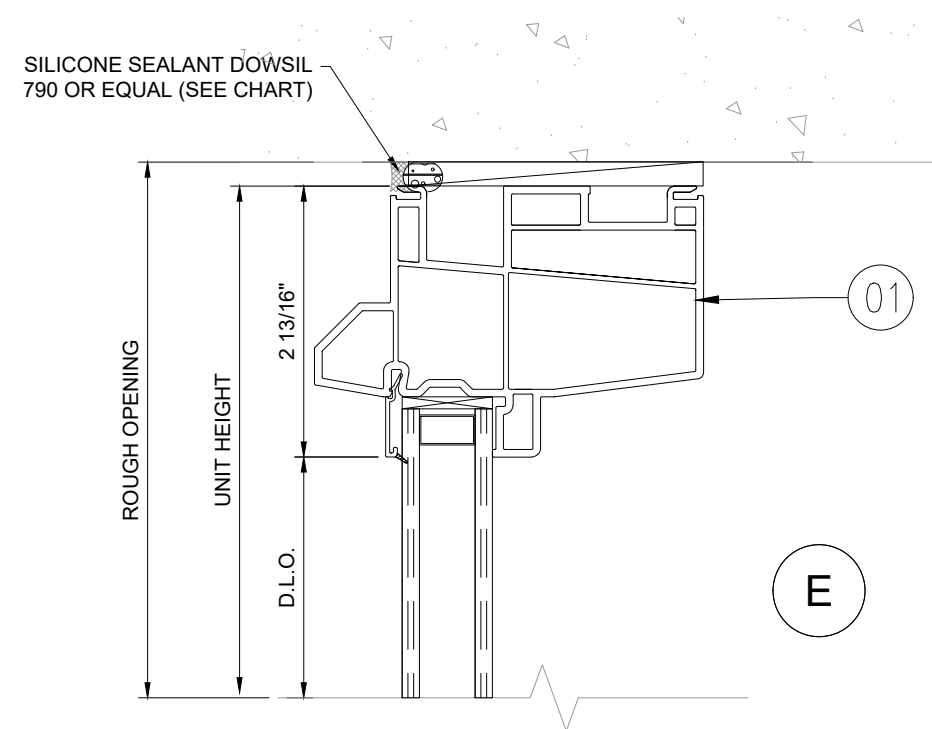

NOTE:
SHIM SPACE AT HEAD AND SILL CAN
BE UP TO 1/4" WITHOUT REQUIRING
ADDITIONAL ENGINEERING.

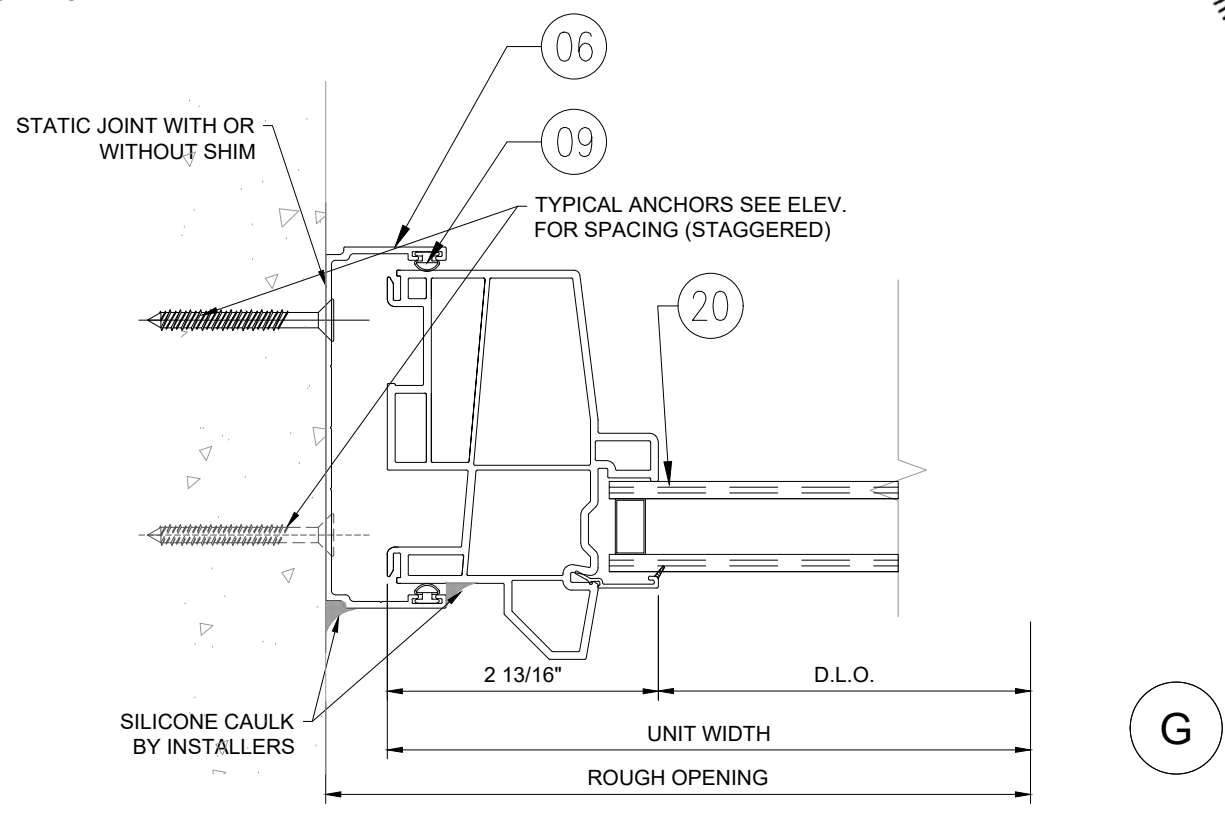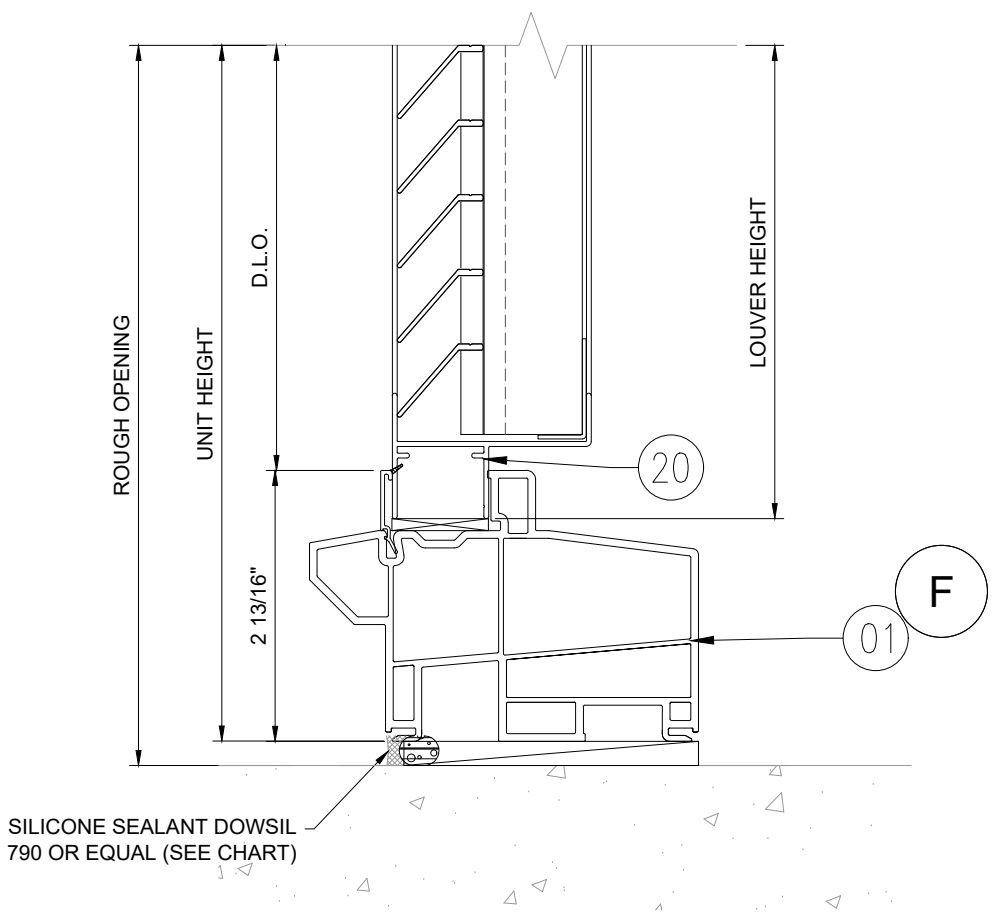

OPTION 2 CONCRETE



REVISIONS	NO.	DATE	DESCRIPTION
	1		
	2		
	3		
	4		
	5		

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201



CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)



PRODUCT APPROVAL #:
FL # 48129.1

SCALE:
NOTED
DATE:
11/14/2025
DWG NO.
CHGL-PVC N.I.-2026

SHEET No:
05 OF 011

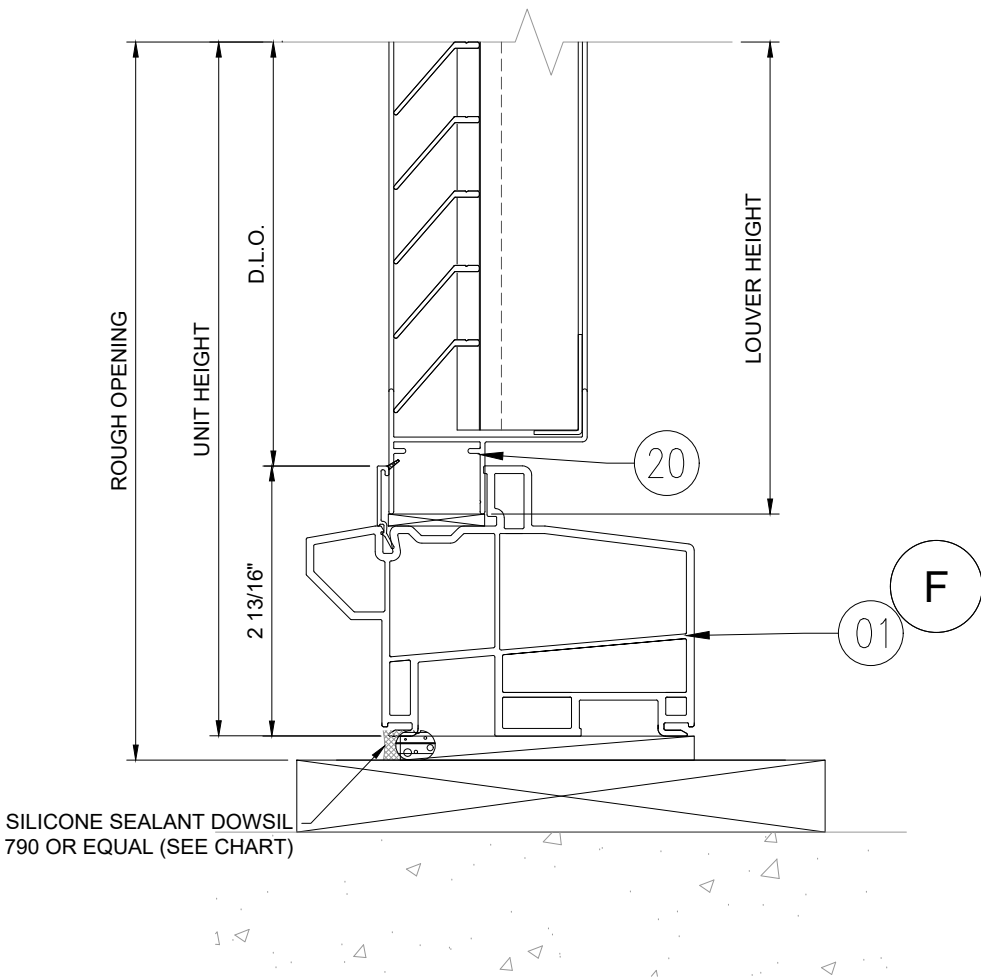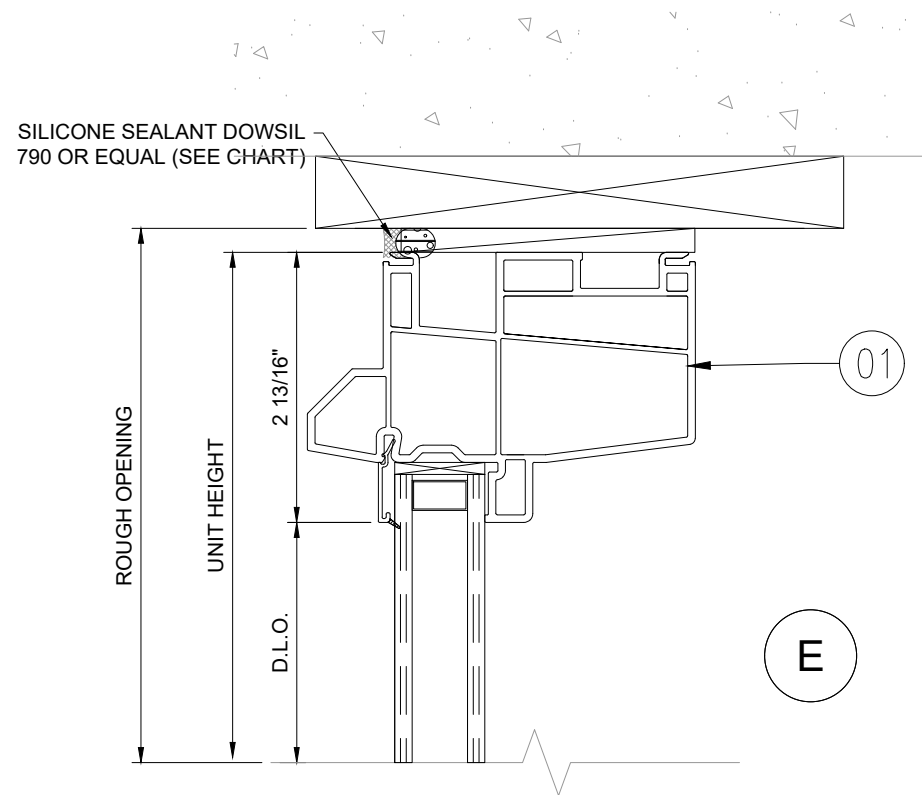

NOTE:
SHIM SPACE AT HEAD AND SILL CAN
BE UP TO 1/4" WITHOUT REQUIRING
ADDITIONAL ENGINEERING.

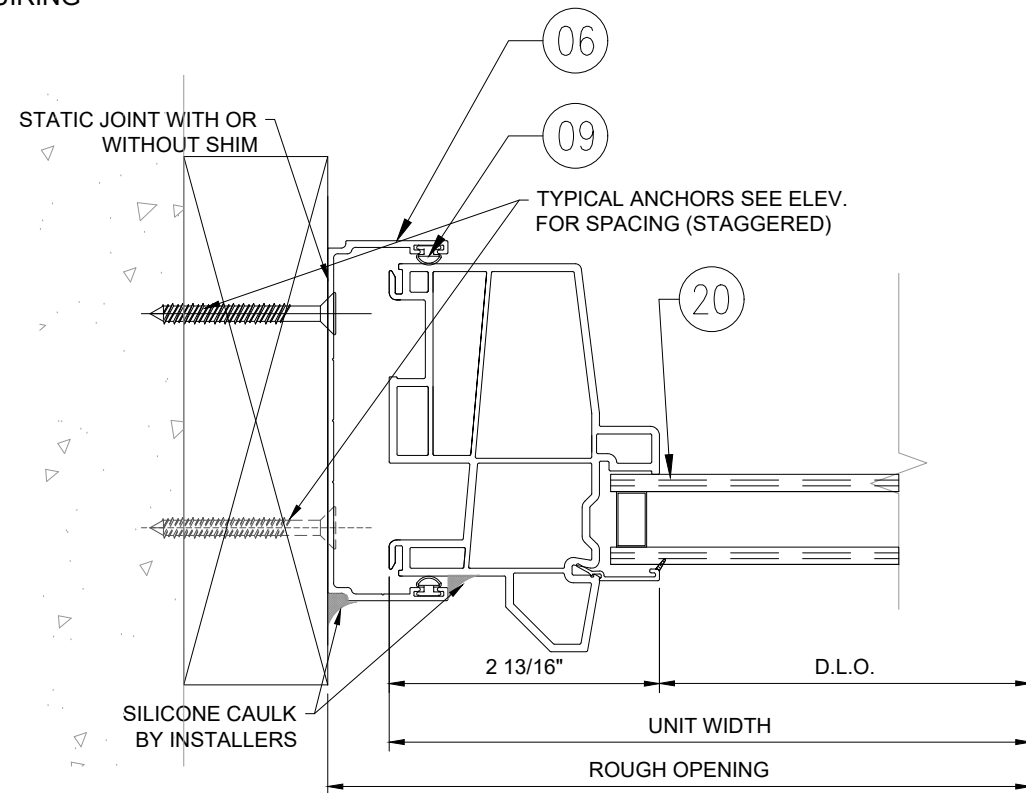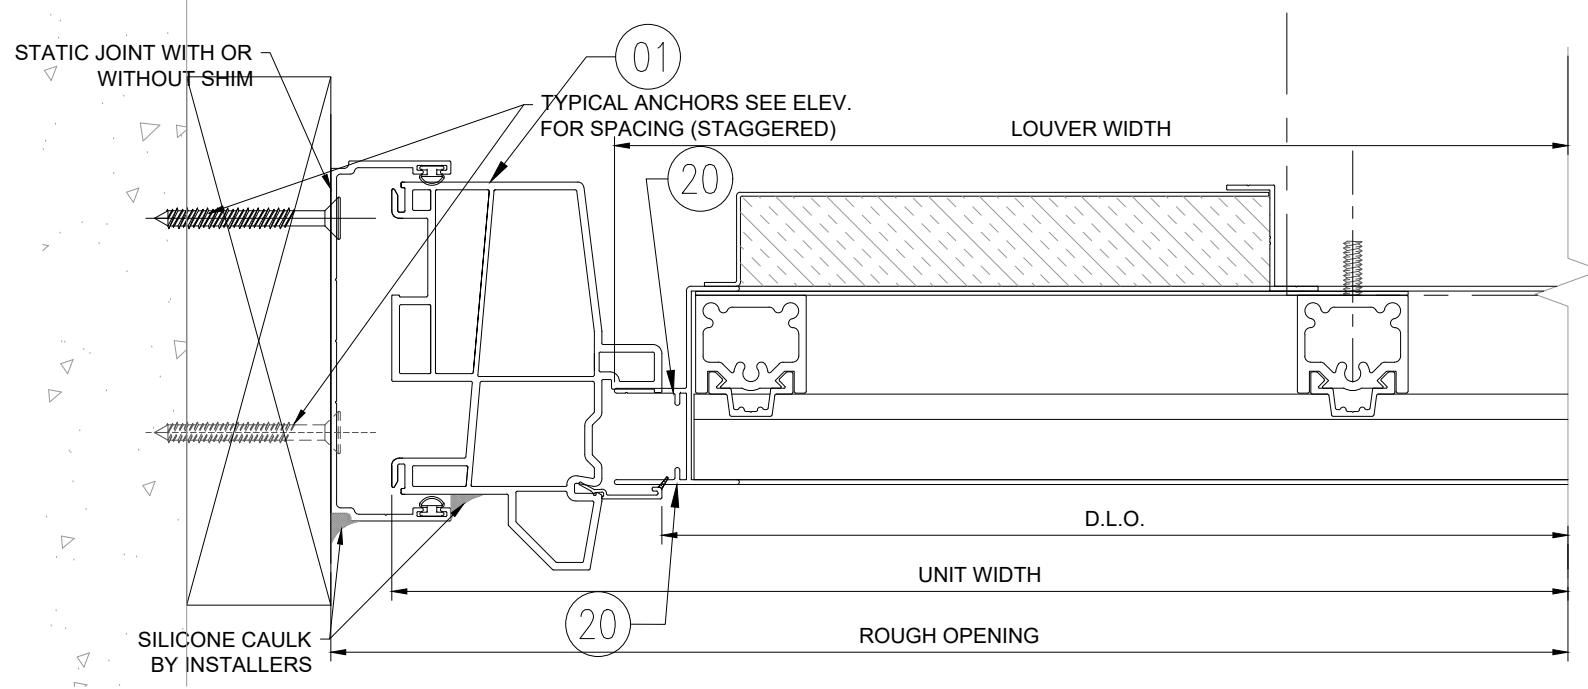

OPTION 2 WOOD

REVISIONS	NO.	DATE	DESCRIPTION
	1		
	2		
	3		
	4		
	5		

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201




CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)


PRODUCT APPROVAL #:
FL # 48129.1

SCALE:
NOTED
DATE:
11/14/2025
DWG NO.
CHGL-PVC N.I.-2026

SHEET No:
06 OF 011

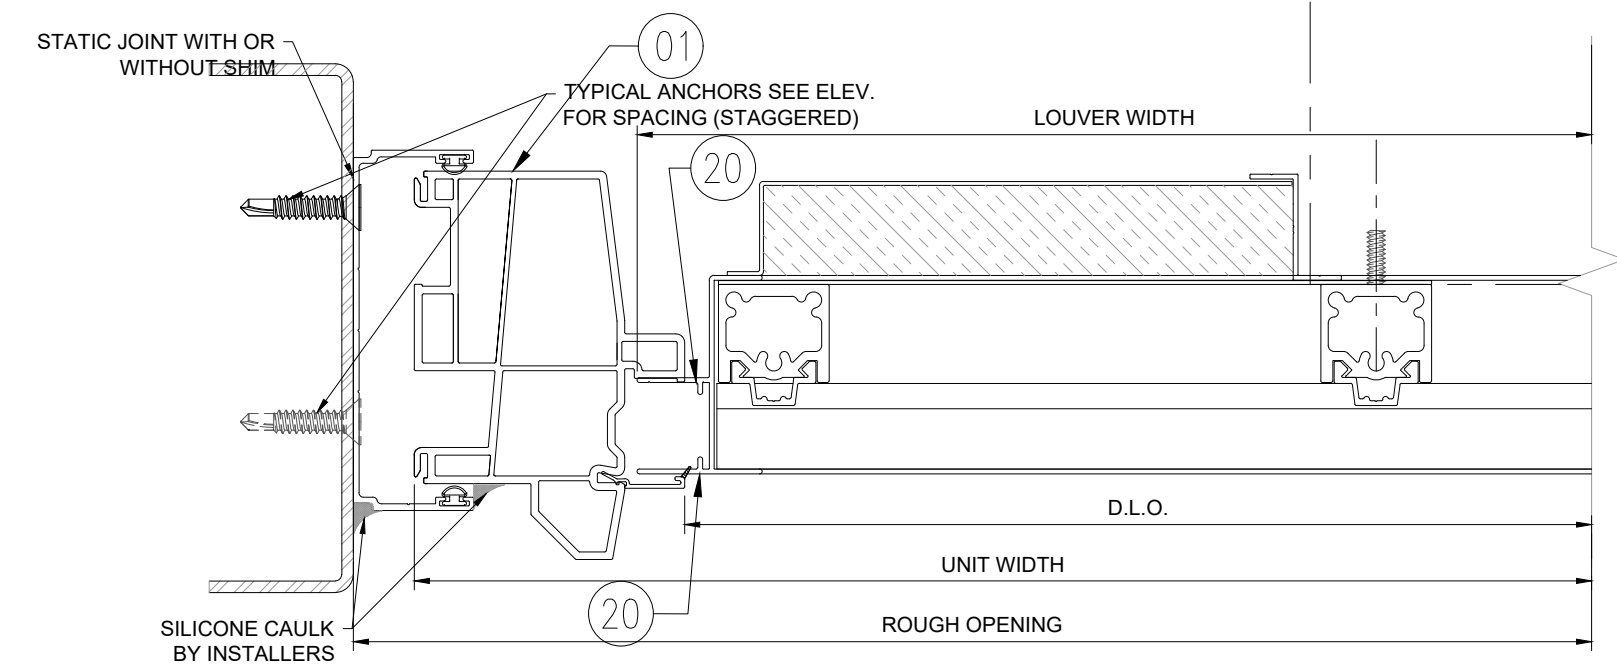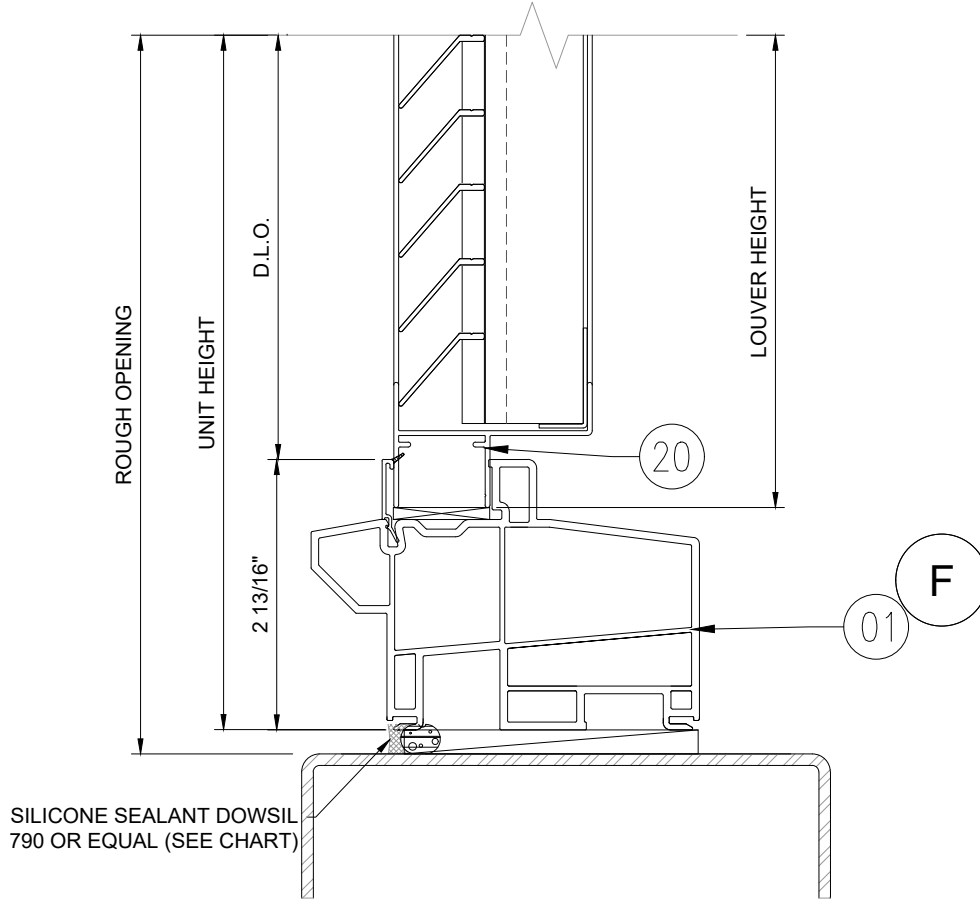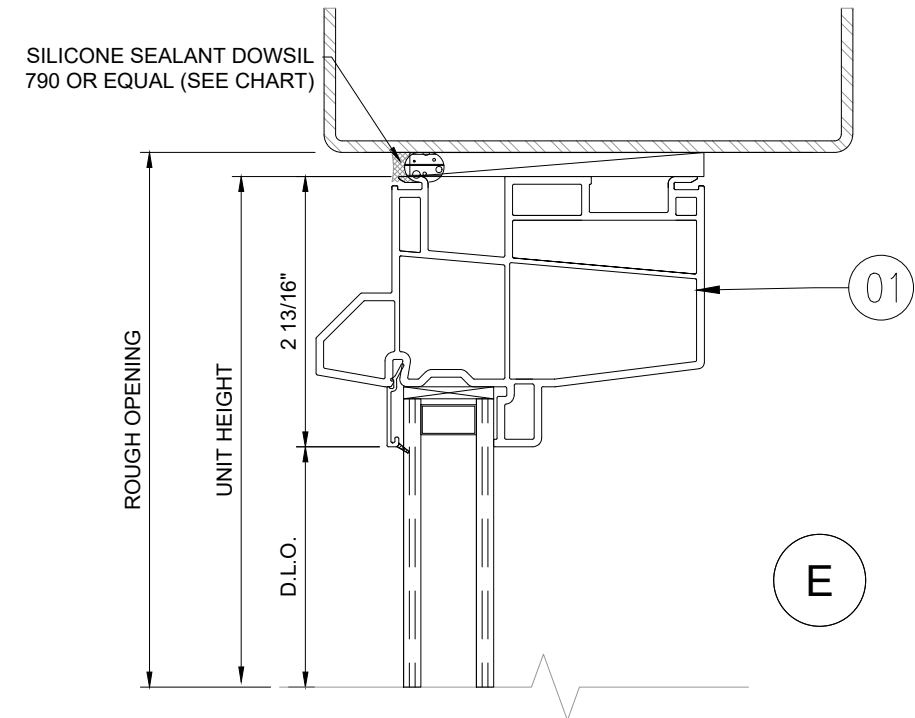

NOTE:
SHIM SPACE AT HEAD AND SILL CAN
BE UP TO 1/4" WITHOUT REQUIRING
ADDITIONAL ENGINEERING.

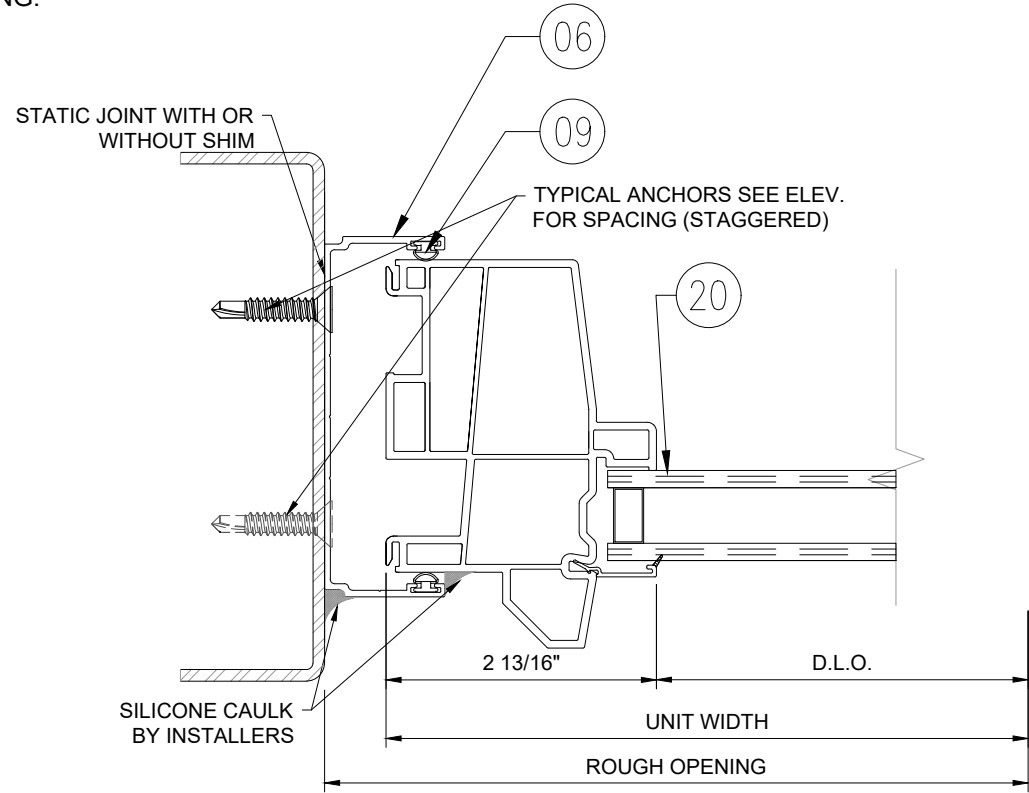

OPTION 2 STEEL



REVISIONS:	NO.	DATE	DESCRIPTION
	1		
	2		
	3		
	4		
	5		

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201

CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET


PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1

SCALE: NOTED
DATE: 11/14/2025
DWG NO: CHGL-PVC N.I.-2026

SHEET No:
07 OF 011

NOTE:
SHIM SPACE AT HEAD AND SILL CAN
BE UP TO 1/4" WITHOUT REQUIRING
ADDITIONAL ENGINEERING.

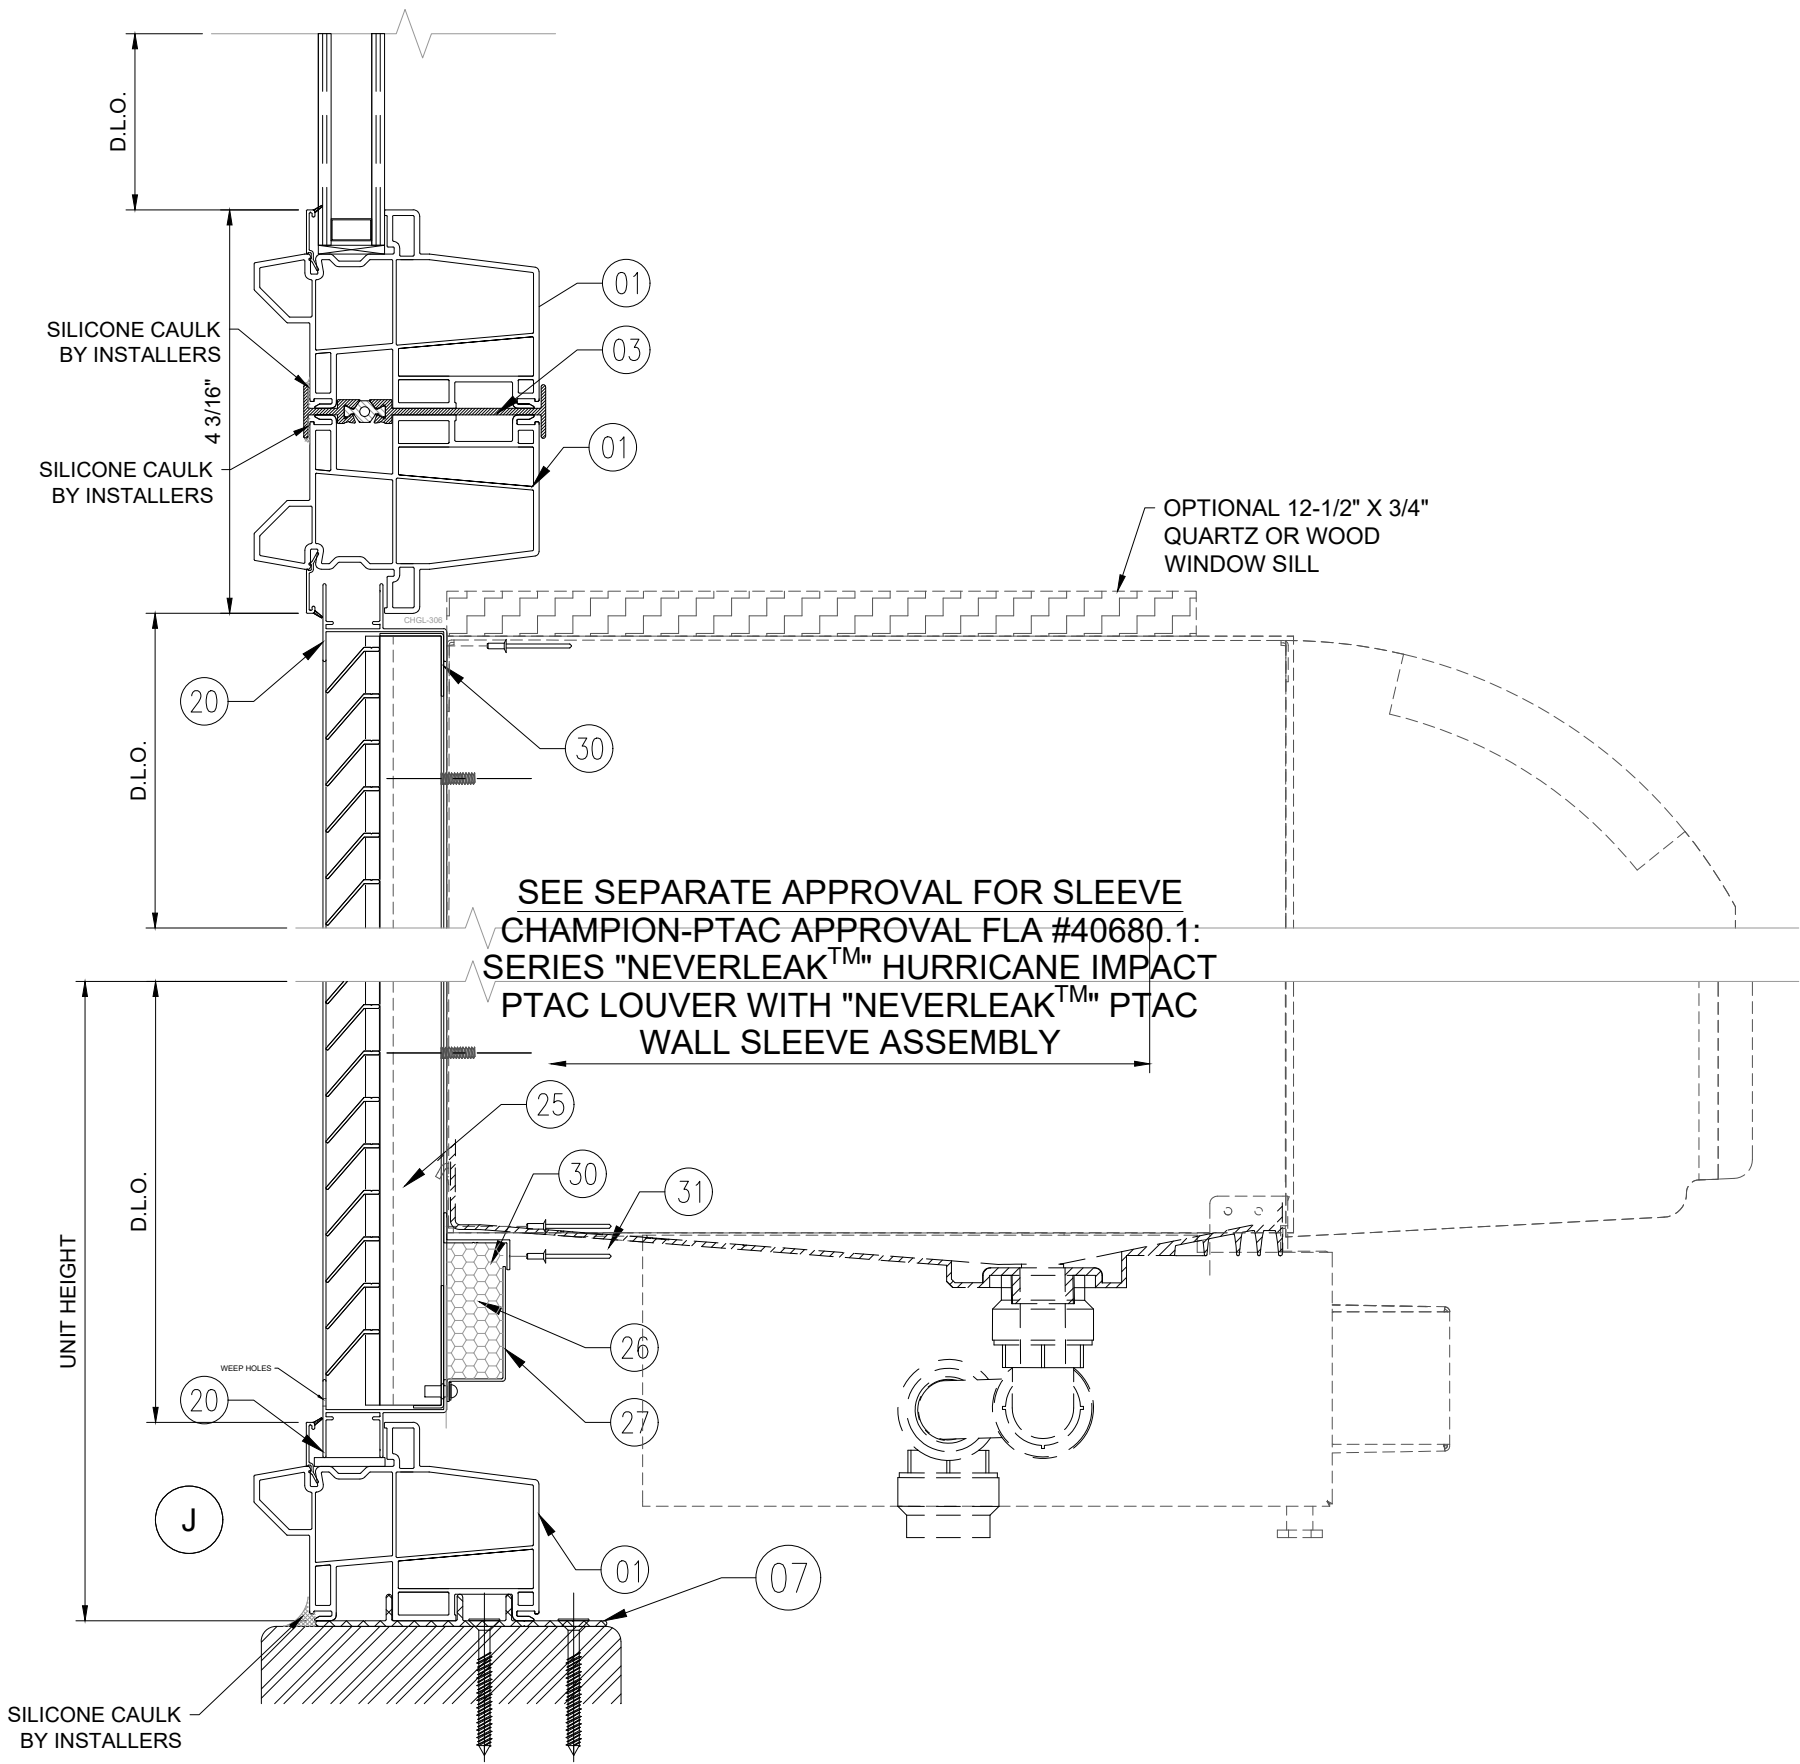

REVISIONS:	NO.	DATE:	DESCRIPTION:
	1		
	2		
	3		
	4		
	5		

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRC.
CAUDEN TN 38520
941-380-1574
P.E. #58201



CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1


SCALE:
NOTED
DATE:
11/14/2025
DWG NO.
CHGL-PVC N.I.-2026

SHEET No:
08 OF 011

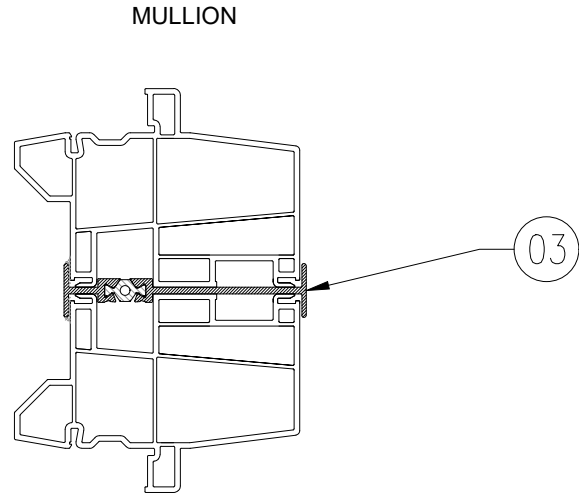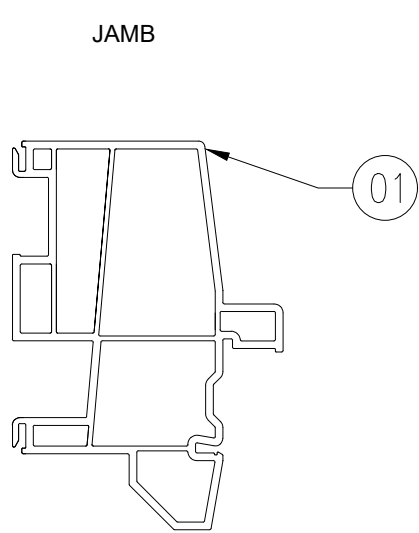

JAMB LOAD CAPACITY - PSF EXT. (+) & INT. (-)			
NOMINAL DIMS		LOAD CAPACITY	
WIDTH (W)	FRAME HEIGHT	(+) PSF	(-) PSF
30"	72"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0
30"	84"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0
30"	96"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0
30"	100 3/8"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0

MULLION LOAD CAPACITY - PSF EXT. (+) & INT. (-)			
NOMINAL DIMS		LOAD CAPACITY	
WIDTH (W)	FRAME HEIGHT	(+) PSF	(-) PSF
30"	72"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0
30"	84"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0
30"	96"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0
30"	100 3/8"	45.0	60.0
36"		45.0	60.0
42"		45.0	60.0
48"		45.0	60.0
54"		45.0	60.0
60"		45.0	60.0



REVISIONS:		DESCRIPTION:
NO.	DATE:	

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201

CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET


PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1

SCALE: NOTED
DATE: 11/14/2025
DWG NO: CHGL-PVC N.I.-2026

SHEET No:
09 OF 011

ANCHOR LOAD CAPACITY - PSF					
EXT. (+) & INT. (-)					
NOMINAL DIMS		ANCHOR TYPES			
WIDTH (W)	FRAME HEIGHT	'A2'	'AA2'	'B2'	'C2'
30"	72"	60.0	60.0	60.0	60.0
36"		60.0	60.0	60.0	60.0
42"		60.0	60.0	60.0	60.0
48"		60.0	60.0	60.0	60.0
54"		60.0	60.0	60.0	60.0
60"		60.0	60.0	60.0	60.0
30"	78"	60.0	60.0	60.0	60.0
36"		60.0	60.0	60.0	60.0
42"		60.0	60.0	60.0	60.0
48"		60.0	60.0	60.0	60.0
54"		60.0	60.0	60.0	60.0
60"		60.0	60.0	60.0	60.0
30"	84"	60.0	60.0	60.0	60.0
36"		60.0	60.0	60.0	60.0
42"		60.0	60.0	60.0	60.0
48"		60.0	60.0	60.0	60.0
54"		60.0	60.0	60.0	60.0
60"		60.0	60.0	60.0	60.0
30"	90"	60.0	60.0	60.0	60.0
36"		60.0	60.0	60.0	60.0
42"		60.0	60.0	60.0	60.0
48"		60.0	60.0	60.0	60.0
54"		60.0	60.0	60.0	60.0
60"		60.0	60.0	60.0	60.0
30"	96"	60.0	60.0	60.0	60.0
36"		60.0	60.0	60.0	60.0
42"		60.0	60.0	60.0	60.0
48"		60.0	60.0	60.0	60.0
54"		60.0	60.0	60.0	60.0
60"		60.0	60.0	60.0	60.0
30"	100 3/8"	60.0	60.0	60.0	60.0
36"		60.0	60.0	60.0	60.0
42"		60.0	60.0	60.0	60.0
48"		60.0	60.0	60.0	60.0
54"		60.0	60.0	60.0	60.0
60"		60.0	60.0	60.0	60.0

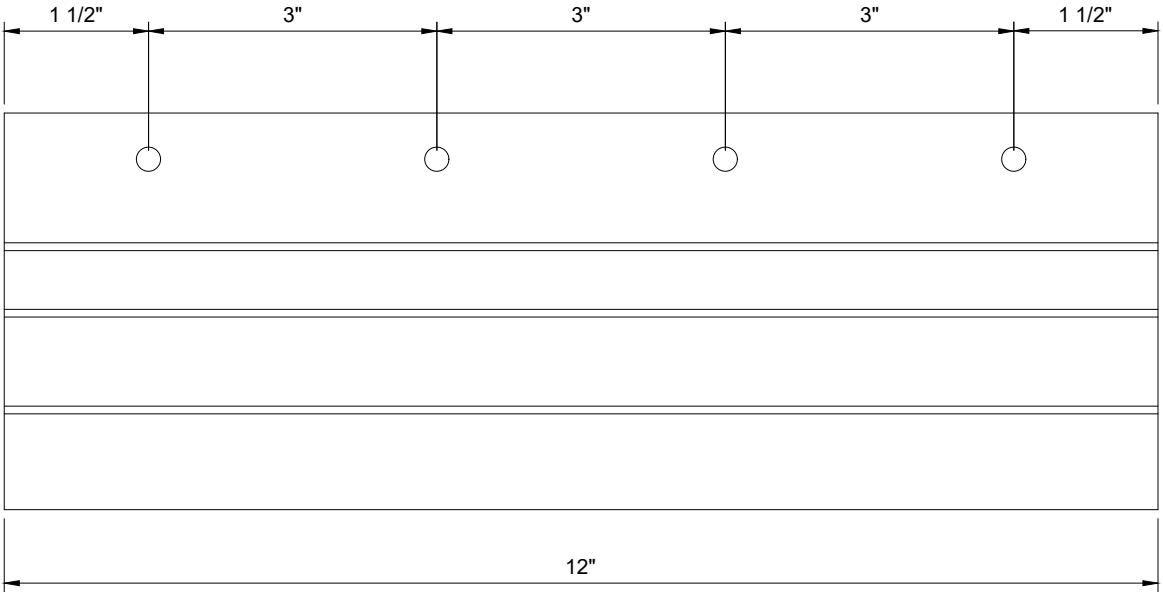




JAMB CLIP

NOTE:
FASTENERS ON INSTALLATIONS WITHIN 3000 FT. OF THE COASTLINE MUST MEET SECTION 1711 OF THE 9th EDITION FLORIDA BUILDING CODE (FBC).

SEE EVALUATION REPORT FOR ADDITIONAL INFORMATION.

NOTE:
ALTERNATE ANCHOR TYPES/ CONDITIONS SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER FOR PROJECT SPECIFIC DESIGN CRITERIA BASED ON SEALANT MANUFACTURERS' TECHNICAL DATA.

WOOD BUCKS AND METAL STRUCTURES, NOT BY CHAMPION GLASS, MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE. FRAME BITE INSIDE RECEPTORS MIN. 7/16".

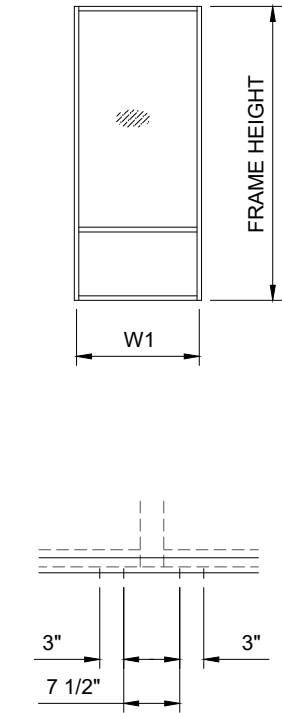

REVISIONS:	NO.	DATE	DESCRIPTION:
	1		
	2		
	3		
	4		
	5		

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201

CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1

SCALE: NOTED
DATE: 11/14/2025
DWG NO: CHGL-PVC N.I.-2026

SHEET No:
10 OF 011

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' 1/4" DEWALT ULTRAACON+ INTO 2BY WOOD BUCKS OR WOOD STRUCTURES (NO. 2 SOUTHERN YELLOW PINE) 1-1/2" MIN. PENETRATION INTO WOOD

TYPE 'AA' 1/4" DEWALT ULTRAACON+ DIRECTLY INTO CBS (GROUT FILLED OR HOLLOW) 1-3/4" MIN. EMBEDMENT OR THRU 1BY WOOD BUCKS INTO CBS 1-1/4" MIN. EMBED INTO HOLLOW BLOCK 1-3/4" MIN. EMBED INTO GROUT FILLED BLOCK

TYPE 'B' 1/4" DEWALT ULTRAACON+ DIRECTLY INTO 3000 PSI MIN. CONCRETE 1-3/4" MIN. EMBED INTO CONC. OR THRU 1BY WOOD BUCKS INTO CONC. 1-3/4" MIN. EMBED INTO CONCRETE

TYPE 'C' #14 SMS OR 1/4" SELF DRILLING SCREWS INTO METAL STRUCTURES (STEEL OR ALUMINUM) MIN. (3) THREADS THROUGH METAL THICKNESS STEEL : 18 GA MIN. ALUMINUM : .080" THICK, 6063-T6 MIN.



TYPICAL ANCHOR EDGE DISTANCE INTO CONCRETE AND MASONRY = 2-1/2" MIN. INTO WOOD STRUCTURE = 1" MIN. INTO METAL STRUCTURE = 1/2" MIN.

BILL OF MATERIALS				
NO.	NO.	DESCRIPTION	MATERIAL	MANUFACTURER
01	CG-V01	FRAME	PVC	CHAMPION GLASS
02	CG-V03	GLAZING BEAD 1"	PVC	CHAMPION GLASS
03	CHGL-322TB	HORIZONTAL MULLION	ALLOY 6063-T6	CHAMPION GLASS
04	-	SETTING BLOCKS	EPDM	.125 X 1.25 X 4
05	-	GLAZING SILICONE	DOWSIL CWS	DOW CORNING
06	CHGL-300	HEAD RECEPTOR (PATENT # 11,414,914 B2)	ALLOY 6063-T6	CHAMPION GLASS
07	CHGL-459	SILL RECEIVER (PATENT # 11,414,914 B2)	ALLOY 6063-T6	CHAMPION GLASS
08	-	-	-	-
09	-	RECEPTOR VINYL	TPV_PROPYLENE	MELTPOINT
10	-	DOWSIL INSTAGLAZE	-	-
11	-	HORIZONTAL MULL PVC	ALLOY 6063-T5	CHAMPION GLASS
12	-			
13	-			
14	-			
15	-			
16	-			
17	-			

NOTE:
THE RECEPTORS AND INSTALLATION PROCESS IS COVERED UNDER THE PATENT #11,414,914 B2

BILL OF MATERIALS			
NO.	DESCRIPTION	MATERIAL	MANUFACTURER
20	GLAZING LOUVER	ALUM 6063-T5	CHAMPION PTAC
21	BRACE BAR	ALUM 6063-T5	CHAMPION PTAC
22	BRACE BAR SPLINE	ALUM 6063-T5	CHAMPION PTAC
23	LOUVER BLADE	ALUM 6063-T5	CHAMPION PTAC
24	CORNER ANGLE	ALUM 6063-T5	CHAMPION PTAC
25	FRONT BLANK-OFF (OPTIONAL)	MIN. 0.04" THK FORMED ALUM.	-
26	INSULATION (OPTIONAL)	1" THK TOUGHGARD 2 TEXTILE DUCT LINER	CERTAINTeED
27	REAR BLANK-OFF (OPTIONAL)	MIN. 0.04" THK FORMED ALUM.	-
28	T-FLASHING	MIN. 0.04" THK FORMED ALUM.	-
29	L-ANGLE	MIN. 0.04" THK FORMED ALUM.	-
30	Z-ANGLE	MIN. 0.04" THK FORMED ALUM.	-
31	1/8 " POP-RIVET (AS42CE)	ALUMINUM/STEEL	-
32			
33			
34			
35			
36			

NOTE:
FOAM, ITEM #26, SHALL COMPLY WITH MINIMUM REQUIREMENTS OF HVHZ SECTION 2612 OF FLORIDA BUILDING CODE (ASTM D1929 & ASTM E84) AND/OR APPROVED UNDER CURRENT NOA.

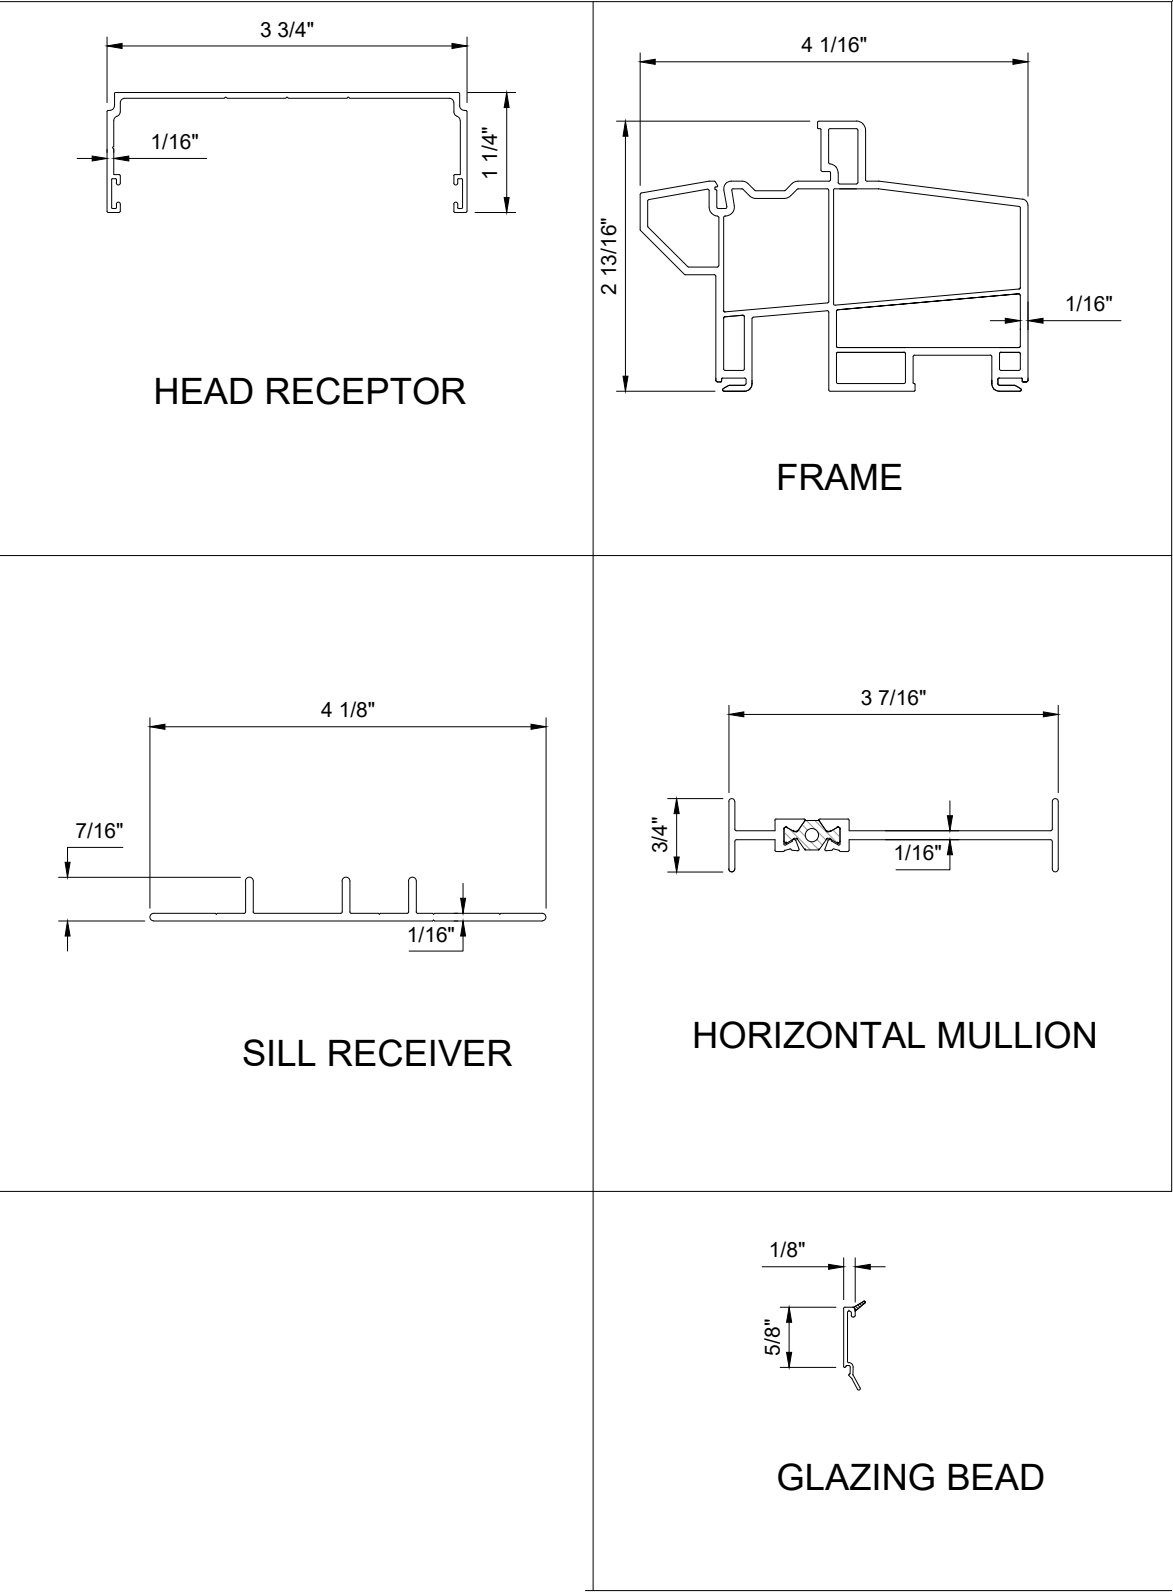

REVISIONS:		DESCRIPTION:	
NO.	DATE		
1			
2			
3			
4			
5			

ENGINEER:
TURNER ENGINEERING & CONSULTING, INC.
2428 OLD NATCHEZ TRC. TRL
CAMDEN TN 38320
941-380-1574
P.E. #58201

CHAMPION GLASS INC
4720 NW 15TH AVENUE, UNIT 4A,
FT. LAUDERDALE, FL. 33309
954-564-3435 · CHAMPION-GLASS.NET

PRODUCT:
"HOTEL SERIES 325PVC"
WINDOW / PTAC LOUVER SYSTEM
(NON-IMPACT)

PRODUCT APPROVAL #:
FL # 48129.1

SCALE: NOTED
DATE: 11/14/2025
DWG NO: CHGL-PVC N.I.-2026

SHEET No:
11 OF 011