


c:\Users\julianarodriguez\building\_drops, inc\building\_drops\landing - documents\common\projects\drutex, s.a\fb-c25-0250 - fbc submittal - iglo edge products\dwgs\title & turn\title & turn - w23\drut071.dwg 5/22/2026 8:48 AM

# DRUTEX S.A.

## IGLO EDGE TILT & TURN WINDOW (WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - AAMA/WDMA/CSA 101/I.S.2/A440-17
  - ASTM E1886-19
  - ASTM E1996-20
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS.
7. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IN IMPACT RESISTANCE IN WIND ZONE 4.
8. WINDOW FRAME MATERIAL: uPVC
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.
10. CUSTOM SIZES AVAILABLE UPON REQUEST. CUSTOM DESIGN PRESSURE WILL BE ASSIGNED EQUAL TO NEXT LARGER STANDARD SIZE.

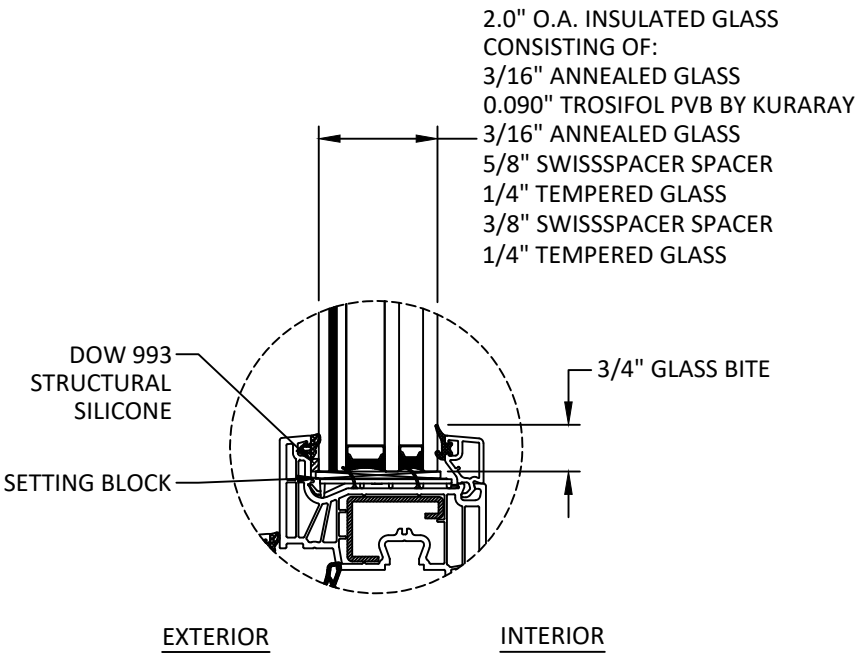

GLAZING DETAIL 1

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

| TABLE OF CONTENTS |                                                       |
|-------------------|-------------------------------------------------------|
| SHEET             | SHEET DESCRIPTION                                     |
| 1                 | GENERAL NOTES & GLAZING DETAIL                        |
| 2                 | ELEVATION & DESIGN PRESSURE TABLE                     |
| 3                 | ANCHOR LAYOUT                                         |
| 4                 | VERTICAL SECTIONS                                     |
| 5                 | HORIZONTAL SECTIONS                                   |
| 6                 | ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES |

| DESIGN PRESSURE RATING (PSF) |                      |              |                 |                                |
|------------------------------|----------------------|--------------|-----------------|--------------------------------|
| CONFIGURATION                | WIDTH (IN.)          | HEIGHT (IN.) | DESIGN PRESSURE | MISSILE IMPACT RATING          |
| X                            | SEE TABLE ON SHEET 2 |              |                 | LARGE AND SMALL MISSILE IMPACT |



LEBORSKA 31, 77-100  
BYTOW, POLAND  
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO EDGE TILT & TURN WINDOW (WZ3) (IMPACT) GENERAL NOTES & GLAZING DETAIL


PREPARED BY: BUILDING DROPS, INC.  
1900 NE MIAMI COURT, STE. 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.  
Reason: I am approving this document  
Date: 2026.05.20 16:39:18 -0400

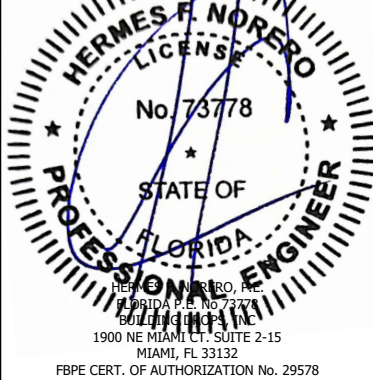

FL #: FL48218

DATE: 05.20.2026


DWG. BY: JR CHK. BY: HFN

SCALE: NTS

DWG. #: DRU071

SHEET: 1 OF 6

c:\users\julianarodriguez\building\_drops, inc\building\_drops\_building\_drops, inc\documents\common\projects\drutex, s.a\bc-25-0250 - fbx submittal - iglo edge products\dwgs\tilt & turn\tilt & turn - wz3\dr071.dwg 5/22/2026 8:48 AM

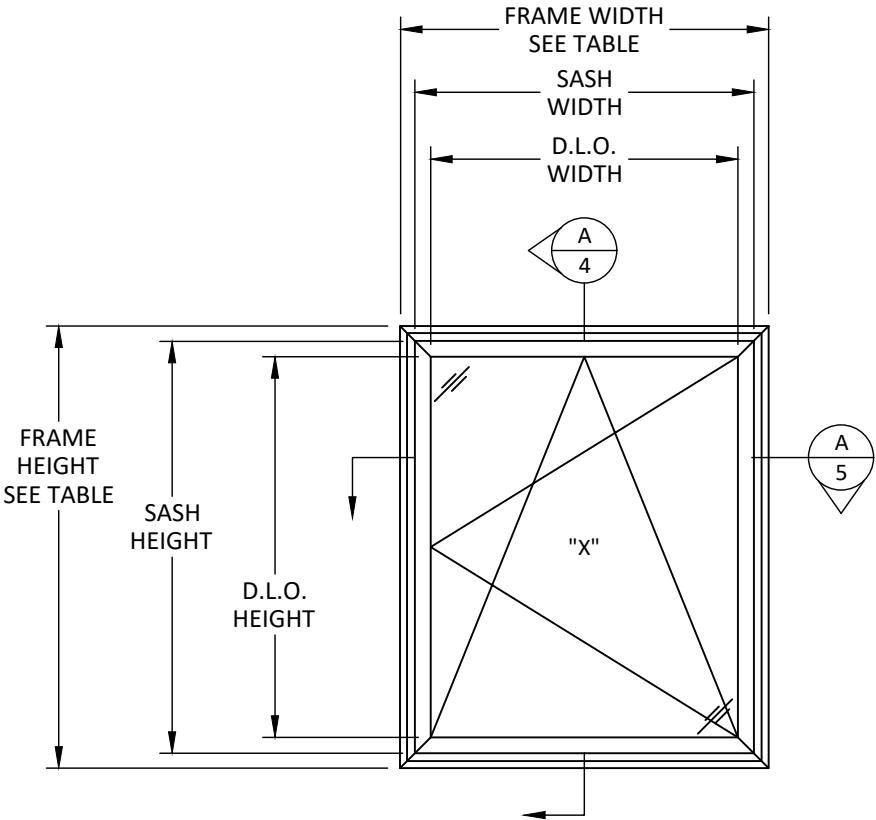

**ELEVATION**  
TILT & TURN WINDOW

SASH HEIGHT = FRAME HEIGHT - 3.02"  
SASH WIDTH = FRAME WIDTH - 3.03"  
D.L.O. HEIGHT = FRAME HEIGHT - 8.97"  
D.L.O. WIDTH = FRAME WIDTH - 8.98"

| DESIGN PRESSURE CHART (PSF) |                    |          |          |
|-----------------------------|--------------------|----------|----------|
| FRAME WIDTH (IN.)           | FRAME HEIGHT (IN.) | EXT. (+) | INT. (-) |
| 30                          | 48                 | 70.00    | 70.00    |
|                             | 54                 | 70.00    | 70.00    |
|                             | 60                 | 70.00    | 70.00    |
|                             | 66                 | 70.00    | 70.00    |
|                             | 72                 | 70.00    | 70.00    |
|                             | 78                 | 70.00    | 70.00    |
|                             | 84                 | 70.00    | 70.00    |
|                             | 90                 | 67.54    | 67.54    |
|                             | 96                 | 55.57    | 55.57    |
|                             | 102                | 46.28    | 46.28    |
|                             | 108                | 38.95    | 38.95    |
|                             | 114                | 33.09    | 33.09    |
|                             | 120                | 28.35    | 28.35    |
|                             | 126                | 24.48    | 24.48    |
|                             | 132                | 21.28    | 21.28    |
| 36                          | 138                | 18.61    | 18.61    |
|                             | 144                | 16.38    | 16.38    |
|                             | 48                 | 70.00    | 70.00    |
|                             | 54                 | 70.00    | 70.00    |
|                             | 60                 | 70.00    | 70.00    |
|                             | 66                 | 70.00    | 70.00    |
|                             | 72                 | 70.00    | 70.00    |
|                             | 78                 | 70.00    | 70.00    |
|                             | 84                 | 69.73    | 69.73    |
|                             | 90                 | 56.56    | 56.56    |
|                             | 96                 | 46.51    | 46.51    |
|                             | 102                | 38.71    | 38.71    |
|                             | 108                | 32.57    | 32.57    |
|                             | 114                | 27.66    | 27.66    |
|                             | 120                | 23.69    | 23.69    |
| 42                          | 48                 | 70.00    | 70.00    |
|                             | 54                 | 70.00    | 70.00    |
|                             | 60                 | 70.00    | 70.00    |
|                             | 66                 | 70.00    | 70.00    |
|                             | 72                 | 70.00    | 70.00    |
|                             | 78                 | 70.00    | 70.00    |
|                             | 84                 | 60.17    | 60.17    |
|                             | 90                 | 48.76    | 48.76    |
|                             | 96                 | 40.07    | 40.07    |
|                             | 102                | 33.33    | 33.33    |

| DESIGN PRESSURE CHART (PSF) |                    |          |          |
|-----------------------------|--------------------|----------|----------|
| FRAME WIDTH (IN.)           | FRAME HEIGHT (IN.) | EXT. (+) | INT. (-) |
| 48                          | 48                 | 70.00    | 70.00    |
|                             | 54                 | 70.00    | 70.00    |
|                             | 60                 | 70.00    | 70.00    |
|                             | 66                 | 70.00    | 70.00    |
|                             | 72                 | 70.00    | 70.00    |
|                             | 78                 | 66.62    | 66.62    |
|                             | 84                 | 53.06    | 53.06    |
|                             | 90                 | 42.96    | 42.96    |
|                             | 96                 | 35.42    | 35.42    |
| 54                          | 102                | 29.01    | 29.01    |
|                             | 108                | 24.14    | 24.14    |
|                             | 114                | 20.14    | 20.14    |
|                             | 120                | 16.88    | 16.88    |
|                             | 126                | 14.21    | 14.21    |
|                             | 132                | 11.99    | 11.99    |
|                             | 138                | 10.18    | 10.18    |
| 60                          | 144                | 8.75     | 8.75     |
|                             | 48                 | 70.00    | 70.00    |
|                             | 54                 | 70.00    | 70.00    |
|                             | 60                 | 70.00    | 70.00    |
|                             | 66                 | 70.00    | 70.00    |
|                             | 72                 | 70.00    | 70.00    |
| 66                          | 78                 | 59.83    | 59.83    |
|                             | 84                 | 48.67    | 48.67    |
|                             | 90                 | 39.38    | 39.38    |
| 72                          | 96                 | 31.50    | 31.50    |
|                             | 102                | 25.00    | 25.00    |
|                             | 108                | 19.61    | 19.61    |
| 78                          | 114                | 15.19    | 15.19    |
|                             | 120                | 11.61    | 11.61    |
|                             | 126                | 8.96     | 8.96     |
| 84                          | 132                | 6.88     | 6.88     |
|                             | 138                | 5.21     | 5.21     |
|                             | 144                | 3.93     | 3.93     |
| 90                          | 150                | 3.00     | 3.00     |
|                             | 156                | 2.25     | 2.25     |
|                             | 162                | 1.67     | 1.67     |



LEBORSKA 31, 77-100  
BYTOW, POLAND  
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO EDGE TILT & TURN  
WINDOW  
(WZ3) (IMPACT)  
ELEVATION &  
DESIGN PRESSURE TABLE

PREPARED BY:  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, STE. 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL48218**

DATE: **05.20.2026**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **DRU071**

SHEET:

**2**

OF 6

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\drutex, s.a\bc-25-0250 - fbx submittal - iglo edge products\dwgs\tilt & turn\tilt & turn - wz3\dru071.dwg 5/22/2026 8:48 AM

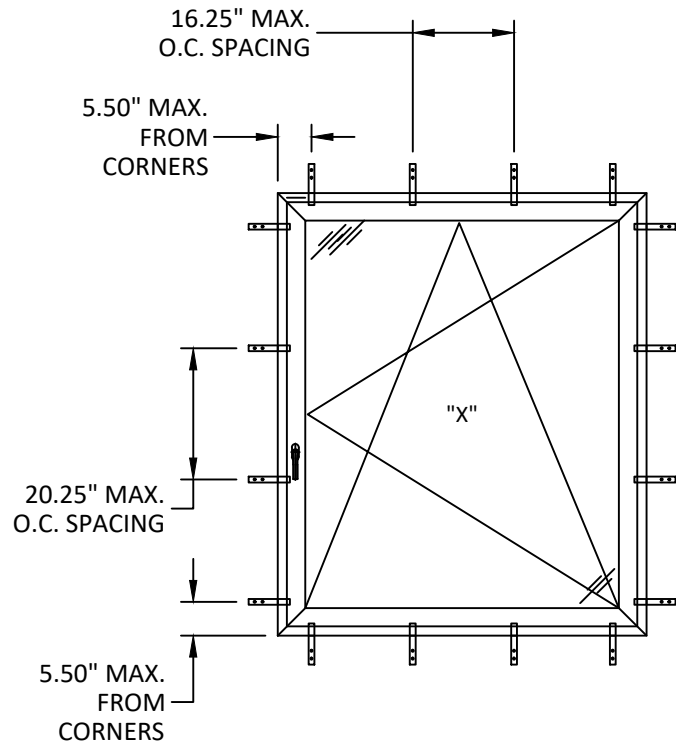

ANCHOR LAYOUT  
TILT & TURN WINDOW - STRAP  
INSTALLATION

NOTE: TWO (2) INSTALLATION ANCHORS  
PER STRAP LOCATION.



LEBORSKA 31, 77-100  
BYTOW, POLAND  
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: IGLO EDGE TILT & TURN  
WINDOW  
(WZ3) (IMPACT)  
ANCHOR LAYOUT

PREPARED BY:  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, STE. 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

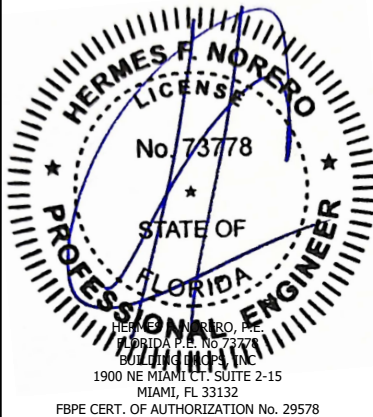

FL #: FL48218

DATE: 05.20.2026

DWG. BY: JR  
CHK. BY: HFN

SCALE: NTS


DWG. #: DRU071

SHEET:

3

OF 6

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\drutex, s.a\bc-25-0250 - fbc submittal - iglo edge products\dwgs\tilt & turn\tilt & turn - w3\dr071.dwg 5/22/2026 8:48 AM

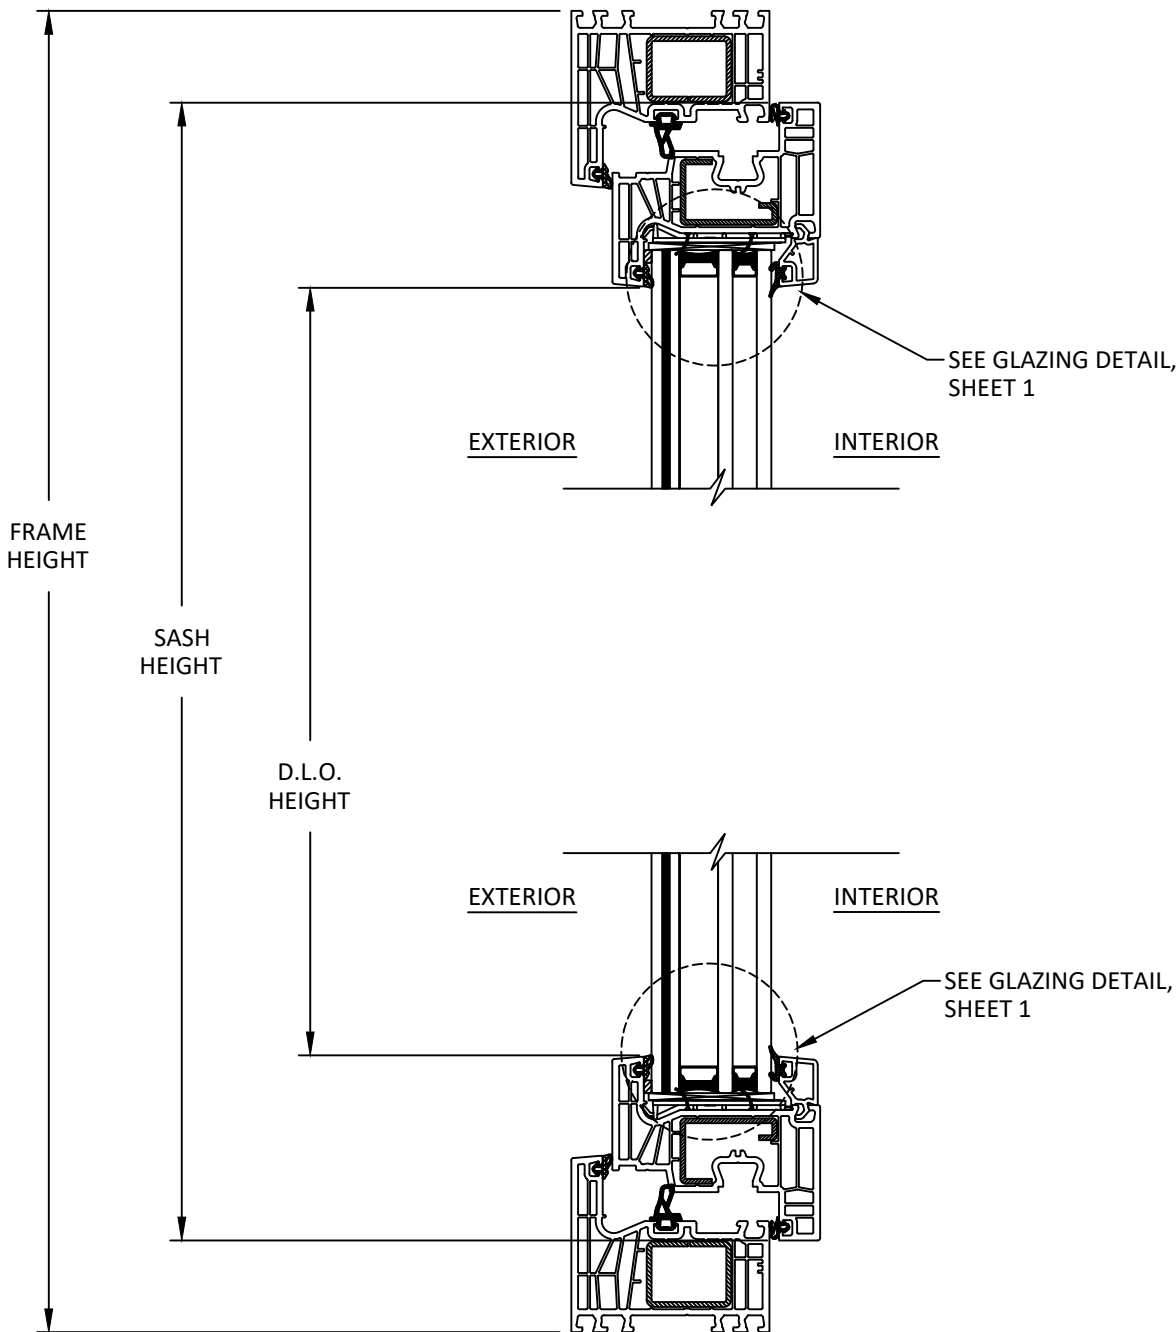

**A**  
**4** **VERTICAL SECTION**  
TYP. HEAD AND SILL DETAIL



LEBORSKA 31, 77-100  
BYTOW, POLAND  
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: IGLO EDGE TILT & TURN  
WINDOW  
(WZ3) (IMPACT)  
VERTICAL SECTIONS

PREPARED BY:  
**BUILDING DROPS, INC.**  
1900 NE MIAMI COURT, STE. 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

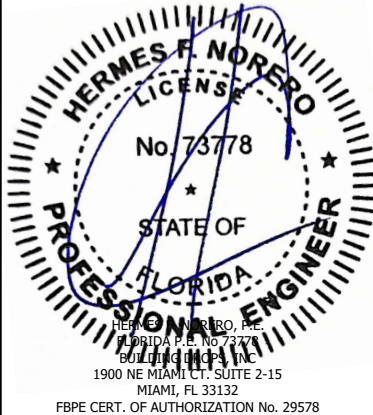

FL #: **FL48218**

DATE: **05.20.2026**


DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **DRU071**

SHEET:  
**4**  
OF 6

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\drutex, s.a\bc-25-0250 - fbx submittal - iglo edge products\dwgs\tilt & turn\tilt & turn - w23\dr071.dwg 5/22/2026 8:48 AM

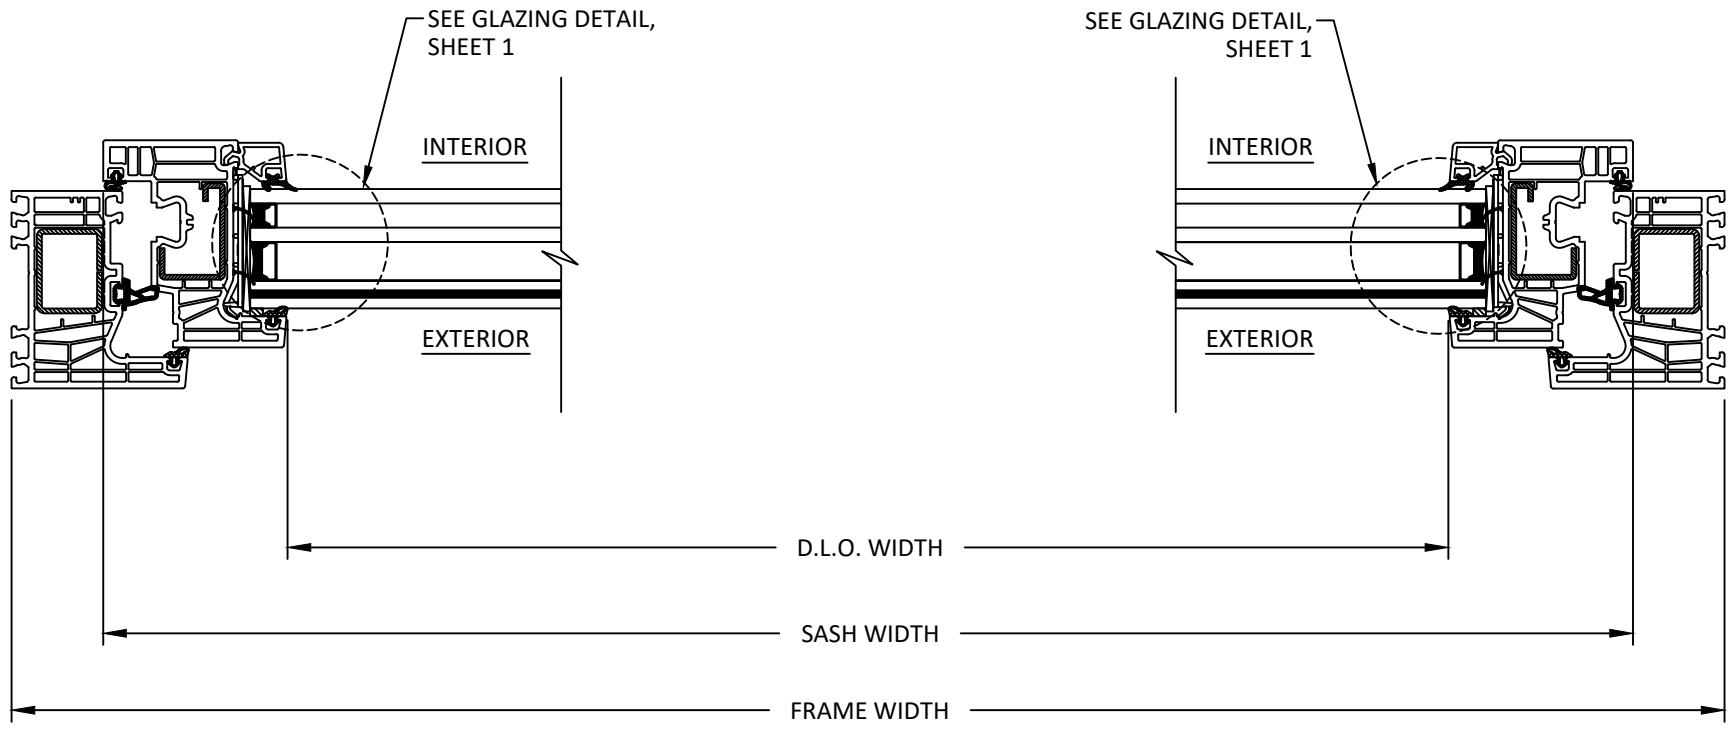

**A**  
**5** **HORIZONTAL SECTION**  
TYP. JAMB DETAIL



LEBORSKA 31, 77-100  
BYTOW, POLAND  
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: IGLO EDGE TILT & TURN  
WINDOW  
(WZ3) (IMPACT)  
HORIZONTAL SECTIONS

PREPARED BY:  
**BUILDING DROPS, INC.**  
1900 NE MIAMI COURT, STE. 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

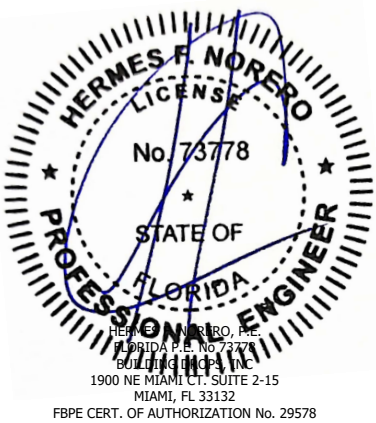

FL #: **FL48218**

DATE: **05.20.2026**


|                       |                        |
|-----------------------|------------------------|
| DWG. BY:<br><b>JR</b> | CHK. BY:<br><b>HFN</b> |
|-----------------------|------------------------|

SCALE: **NTS**

DWG. #: **DRU071**

SHEET:  
**5**  
OF 6

c:\users\julianarodriguez\building\_drops, inc\building\_drops landing - documents\common\projects\drutex, sa\bc-25-0250 - fbc submittal - iglo edge products\dwgs\tilt & turn\tilt & turn - w23\dr0071.dwg 5/22/2026 8:48 AM

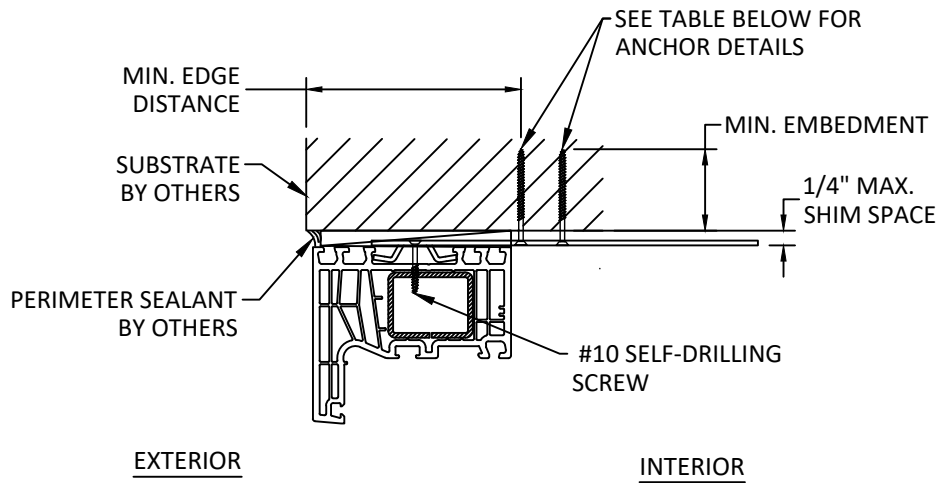

**A**  
**6**

**VERTICAL SECTION**  
HEAD - STRAP INSTALLATION  
JAMB & SILL SIMILAR

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF  $\pm 1/2$  INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

| ANCHOR SCHEDULE |                                                                        |                         |                                            |                    |
|-----------------|------------------------------------------------------------------------|-------------------------|--------------------------------------------|--------------------|
| METHOD          | SUBSTRATE                                                              | ANCHOR SCHEDULE         | MIN EMBEDMENT                              | MIN. EDGE DISTANCE |
| STRAP           | WOOD: MIN. SG = 0.55                                                   | #10 WOOD SCREW          | 1.50"                                      | 0.75"              |
|                 | METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI<br>ALUMINUM: 1/8" MIN., 6063-T5 | #10 SELF-DRILLING SCREW | 3 THREADS MIN PENETRATION BEYOND STRUCTURE | 0.50"              |
|                 | CONCRETE: f'c=3000PSI                                                  | 3/16" ITW TAPCON        | 1.25"                                      | 2.00"              |
|                 | MASONRY: CMU per ASTM C90 MIN. 2000 PSI                                |                         | 1.00"                                      |                    |



LEBORSKA 31, 77-100  
BYTOW, POLAND  
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: IGLO EDGE TILT & TURN  
WINDOW  
(WZ3) (IMPACT)  
ANCHOR DETAILS, ANCHOR  
SCHEDULE, &  
INSTALLATION NOTES

PREPARED BY:  
**BUILDING DROPS, INC.**  
1900 NE MIAMI COURT, STE. 2-15  
MIAMI, FL 33132  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

**BD**  
BUILDING DROPS

| REMARKS | BY | DATE |
|---------|----|------|
|         |    |      |
|         |    |      |
|         |    |      |
|         |    |      |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

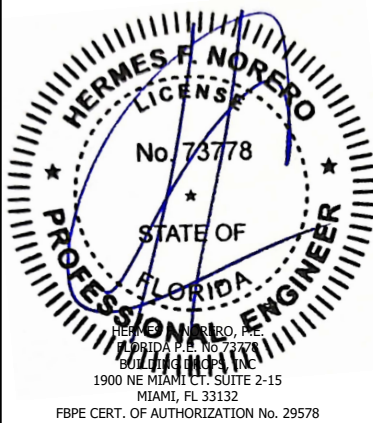

FL #: **FL48218**

DATE: **05.20.2026**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **DRU071**

SHEET:

**6**

OF 6