


ROBINSON WINDOW AND DOOR LLC

SERIES KODIAK 200 VINYL SINGLE HUNG WINDOW (NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

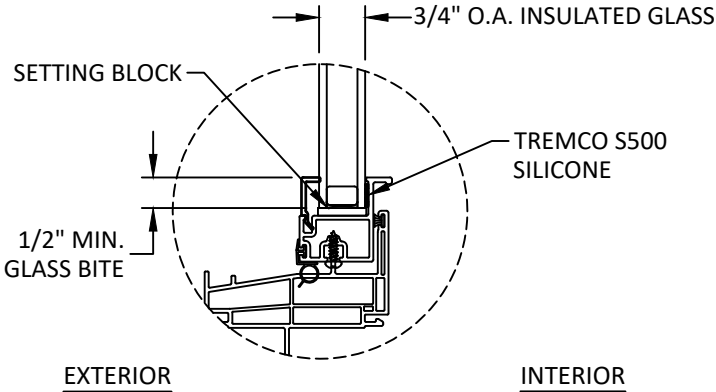

GLAZING DETAIL 1

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, DESIGN PRESSURE TABLE, & GLAZING DETAIL
2	ELEVATION
3	ANCHOR LAYOUT
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES

DESIGN PRESSURE RATING (PSF)				
WIDTH (IN.)	HEIGHT (IN.)	CONFIGURATION	DESIGN PRESSURE	MISSILE IMPACT RATING
47.50"	83.50"	O/X	+/- 50 PSF	NON-IMPACT

- GLAZING NOTES:
- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.



ROBINSON WINDOW AND DOOR LLC
13780 BENCHMARK DR.,
FARMERS BRANCH, TX 75234
PH: (972) 807-3002

TITLE: SERIES KODIAK 200 VINYL SINGLE HUNG WINDOW (NON-HVHZ) (NON-IMPACT)

GENERAL NOTES, DESIGN PRESSURE TABLE, & GLAZING DETAIL

PREPARED BY:

BUILDING DROPS, INC.


1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.06.01 20:02:48 -0400

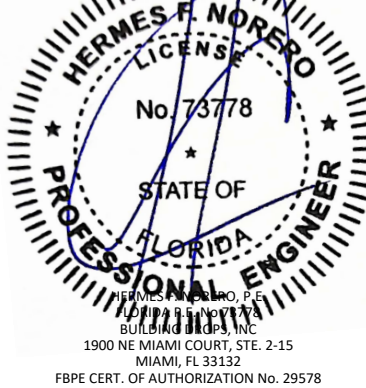

FL #:

FL48237

DATE:

05.06.2026

DWG. BY:

JR

CHK. BY:

HFN

SCALE:

NTS

DWG. #:


RWL002

SHEET:

1

OF 6

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\robinson window and door ltc\bc-26-0421 - series kodiak vinyl impact window products - method 1a\dwgstrw002.dwg 6/1/2026 4:27 PM

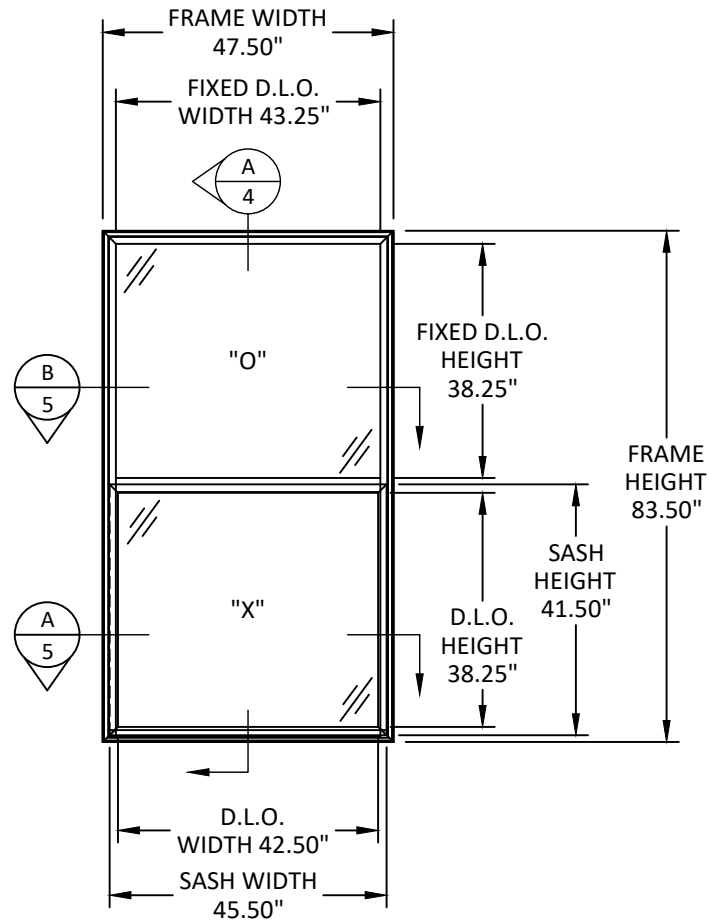

ELEVATION
O/X SINGLE HUNG WINDOW



ROBINSON WINDOW AND DOOR LLC
13780 BENCHMARK DR.,
FARMERS BRANCH, TX 75234
PH: (972) 807-3002

TITLE: SERIES KODIAK 200 VINYL SINGLE
HUNG WINDOW (NON-HVHZ)
(NON-IMPACT)

ELEVATION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

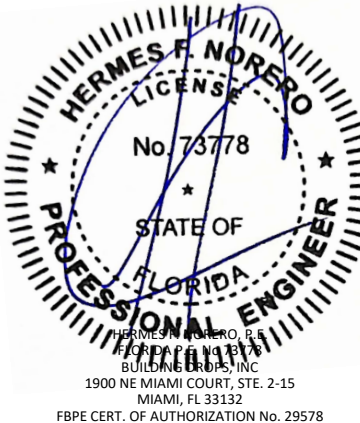

FL #: FL48237

DATE: 05.06.2026

DWG. BY: JR

CHK. BY: HFN

SCALE: NTS


DWG. #: RWL002

SHEET:

2

OF 6

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\robinson window and door ltc\bc-26-0421 - series kodiak vinyl impact window products - method 1a\dwg\trw002.dwg 6/1/2026 4:27 PM

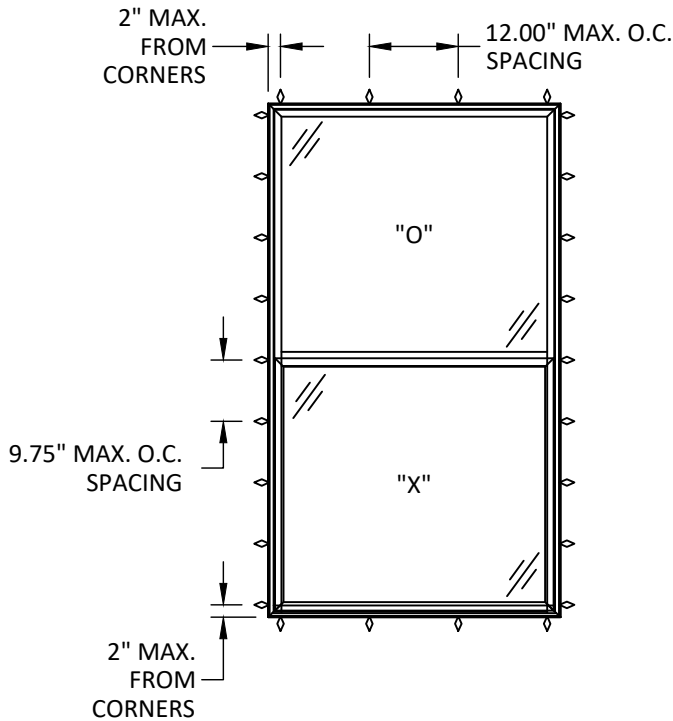

ANCHOR LAYOUT
O/X SINGLE HUNG WINDOW
NAIL FIN INSTALLATION



ROBINSON WINDOW AND DOOR LLC
13780 BENCHMARK DR.,
FARMERS BRANCH, TX 75234
PH: (972) 807-3002

TITLE: SERIES KODIAK 200 VINYL SINGLE
HUNG WINDOW (NON-HVHZ)
(NON-IMPACT)

ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

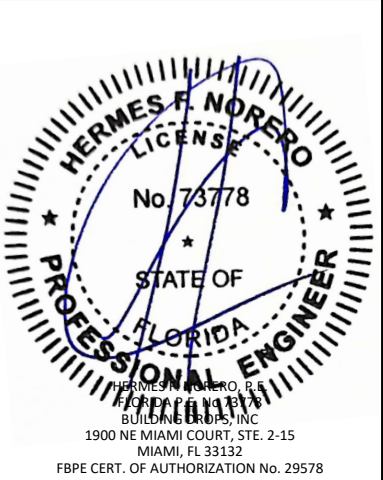

FL #: **FL48237**

DATE: **05.06.2026**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **RWL002**

SHEET:

3

OF 6

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\robinson window and door ltc\bc-26-0421 - series kodiak vinyl impact window products - method 1a\dwgstrw002.dwg 6/1/2026 4:27 PM

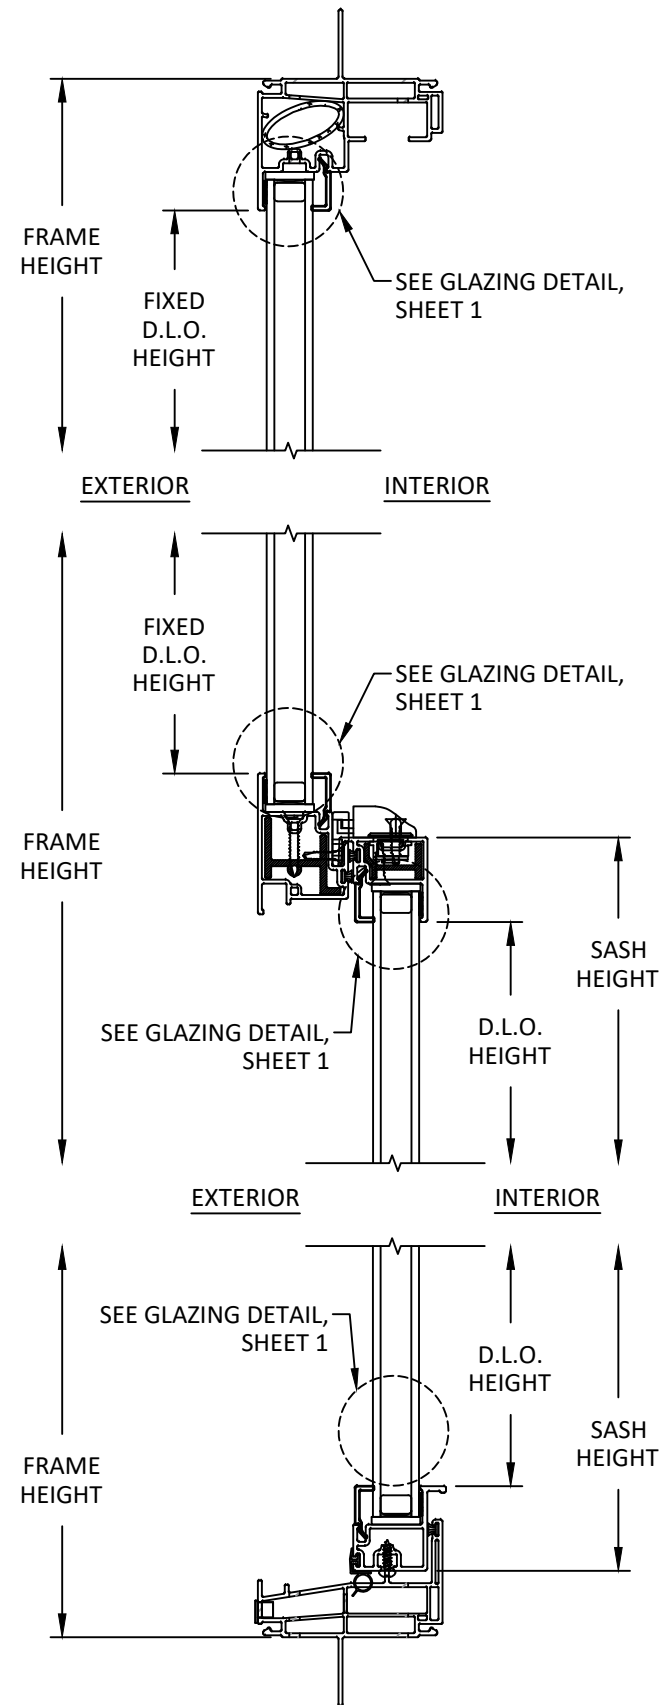

A
4 **VERTICAL SECTION**
HEAD, MEETING RAIL, & SILL



ROBINSON WINDOW AND DOOR LLC
13780 BENCHMARK DR.,
FARMERS BRANCH, TX 75234
PH: (972) 807-3002

TITLE: SERIES KODIAK 200 VINYL SINGLE
HUNG WINDOW (NON-HVHZ)
(NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL48237**

DATE: **05.06.2026**


DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **RWL002**

SHEET:

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\robinson window and door ltc\bc-26-0421 - series kodiak vinyl impact window products - method 1a\dwg\strw002.dwg 6/1/2026 4:27 PM

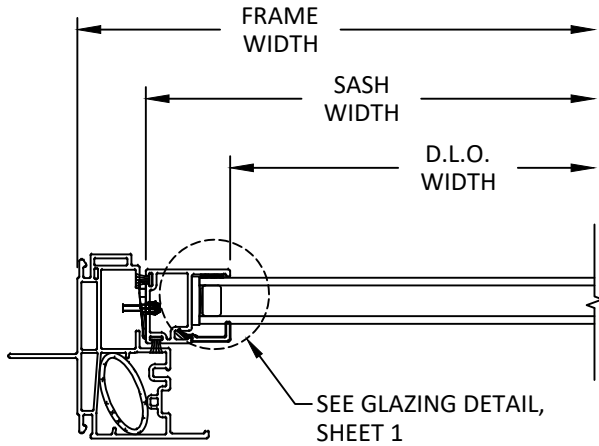


INTERIOR

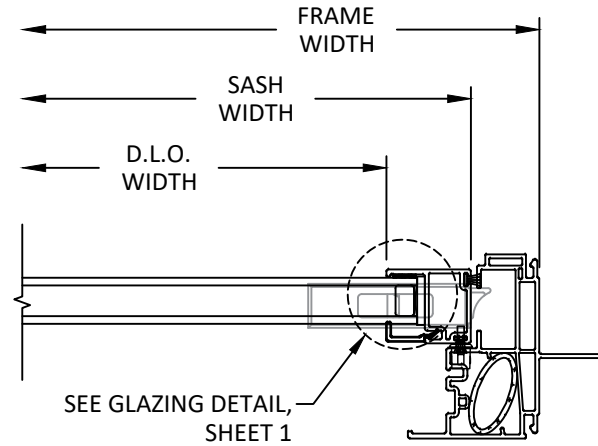


EXTERIOR

A
5 HORIZONTAL SECTION
OPERABLE JAMBS

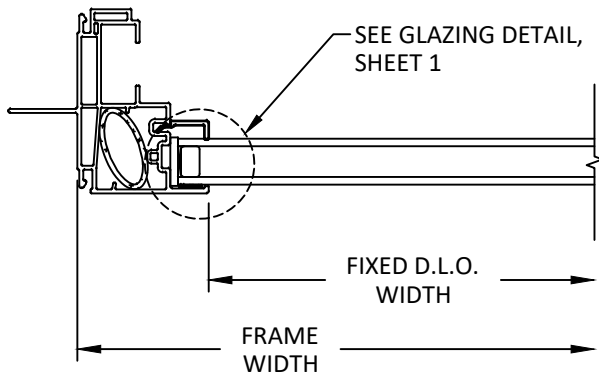

INTERIOR

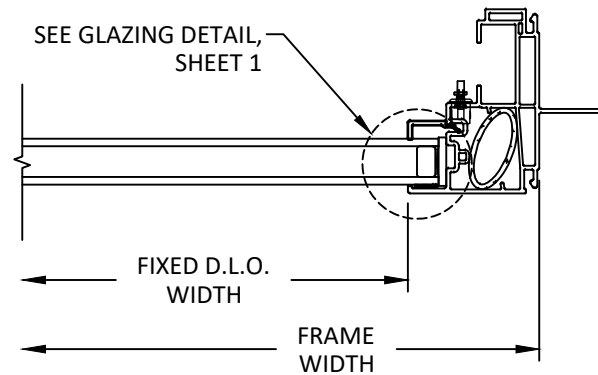

EXTERIOR

B
5 HORIZONTAL SECTION
FIXED JAMBS



ROBINSON WINDOW AND DOOR LLC
13780 BENCHMARK DR.,
FARMERS BRANCH, TX 75234
PH: (972) 807-3002

TITLE: SERIES KODIAK 200 VINYL SINGLE
HUNG WINDOW (NON-HVHZ)
(NON-IMPACT)

HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

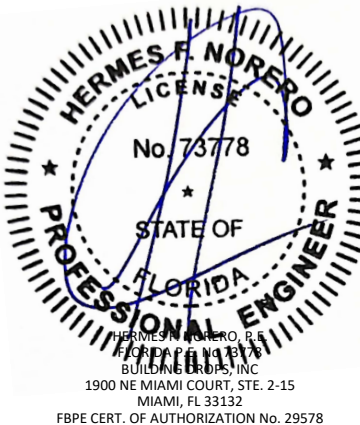

FL #:	FL48237
DATE:	05.06.2026
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWL002
SHEET:	5

c:\users\julianarodriguez\building drops, inc\building drops landing - documents\common\projects\robinson window and door\c:\bc-26-0421 - series kodiak vinyl impact window products - method 1a\dwgstrw002.dwg 6/1/2026 4:27 PM

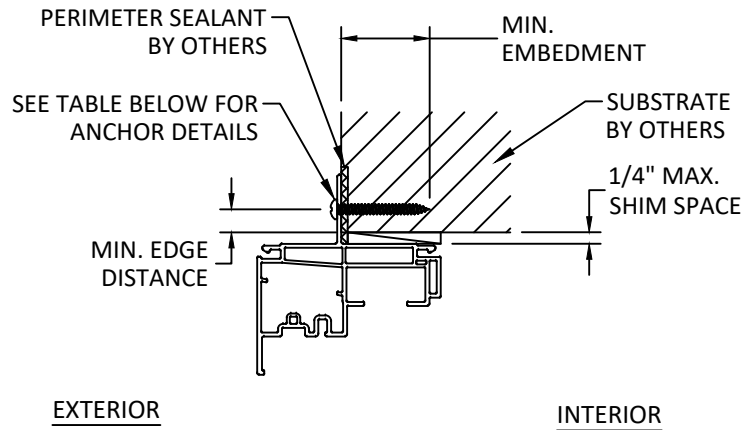

A
6 **VERTICAL SECTION**
HEAD - NAIL FIN INSTALLATION
JAMB & SILL SIMILAR

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR NAIL FIN INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.50"	0.75"
	METAL: 16 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	1/4" SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"



ROBINSON WINDOW AND DOOR LLC
13780 BENCHMARK DR.,
FARMERS BRANCH, TX 75234
PH: (972) 807-3002

TITLE: SERIES KODIAK 200 VINYL SINGLE
HUNG WINDOW (NON-HVHZ)
(NON-IMPACT)
ANCHOR DETAILS,
ANCHOR SCHEDULE, &
INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL48237**

DATE: **05.06.2026**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **RWL002**

SHEET:

6

OF 6