

SNAPNRACK FLORIDA BUILDING CODE TEST REPORT

SCOPE OF WORK

TAS 100(A)-23, ASTM E2140-01(23), AND D7147-21 TESTING ON OMNISHIELD™ FLASHING

REPORT NUMBER

T6065.01-301-18 (R0)

TEST DATE(S)

05/04/26 – 05/20/26

ISSUE DATE

05/21/26

LABORATORY CERTIFICATION NO.

24-0501.06


PAGES

34

DOCUMENT CONTROL NUMBER

RT-R-AMER-Test-7808 (08/21/25)

© 2019 INTERTEK

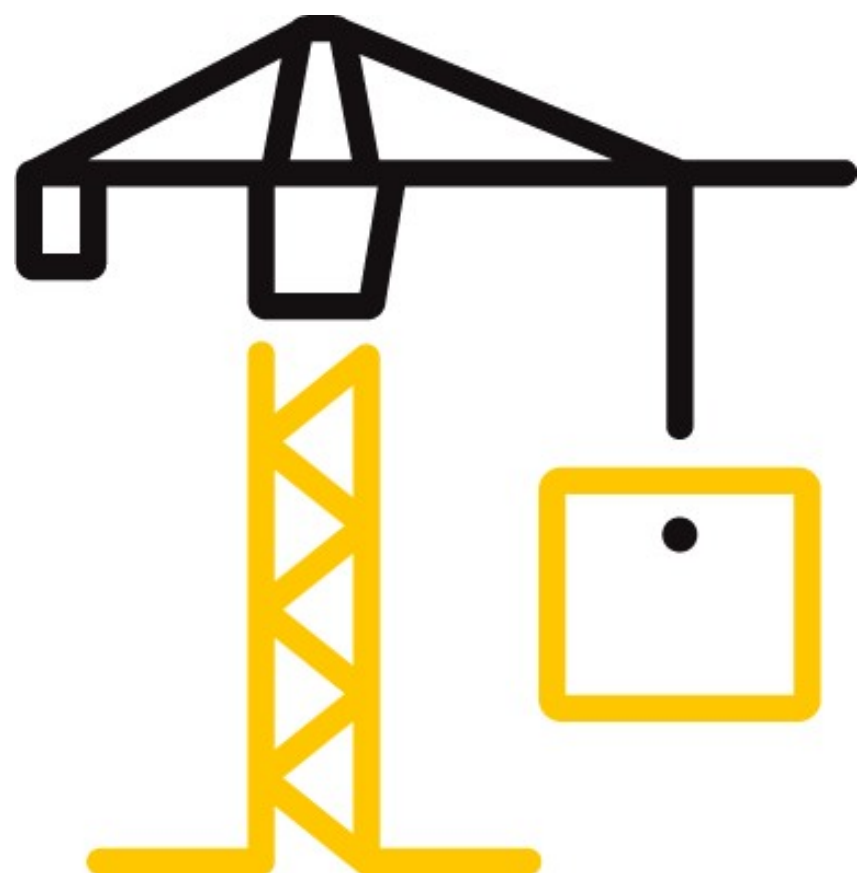

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

REPORT ISSUED TO

SNAPNRACK

775 Fiero Lane

Suite 200

San Luis Obispo, California 93401

SECTION 1

SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by SnapNrack to perform TAS 100(A), ASTM E2140, and ASTM D7147 testing in accordance with Florida Building Code requirements on OmniShield™, Flashing. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at the Intertek B&C test facility in Fresno, California.



For INTERTEK B&C:

COMPLETED BY:

Jarod Hardman

TITLE:

Senior Project Lead

SIGNATURE:


Digitally Signed by: Jarod Hardman

DATE:

05/21/26

REVIEWED BY:

Tyler Westerling, P.E.

TITLE:

Operations Manager

SIGNATURE:


Digitally Signed by: Tyler Westerling

DATE:

05/21/26

JSH:ms

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR SNAPNRACK
Report No.: T6065.01-301-18 (R0)
Date: 05/21/26

SECTION 2
TEST METHOD(S)

The specimen was evaluated in accordance with the following:

- TAS 100 (A)-23**, *Test Procedure for Wind and Wind Driven Rain Resistance and/or Increased Windspeed Resistance of Soffit Ventilation Strip and Continuous or Intermittent Ventilation System Installed at the Ridge Area.*

ASTM E2140-01(23), *Standard Test Method for Water Penetration of Metal Roof Panel Systems by Static Water Pressure Head*

ASTM D7147-21, *Standard Specification for Testing and Establishing Allowable Loads of Joist Hangers*

SECTION 3
MATERIAL SOURCE

Test sample materials were provided by the client from Manufacturing Facility located at San Luis Obispo, California. Representative samples of the test specimen(s) will be retained by Intertek B&C for a minimum of five years from the test completion date.

SECTION 4
EQUIPMENT/CALIBRATION

Wolf Wind Machine No.: 65885 Calibration Due Date: 11/08/26	Load Cell No.: INT03311 Calibration Due Date: 07/21/26
Field Spray Rack No.: 63331 Calibration Due Date: 07/05/26	Linear Transducer No.: 63349 Calibration Due Date: 10/23/26
Conditions Sensor No.: INT04399 Calibration Due Date: 11/26/26	Mule No.: 005722 Calibration Due Date: 08/04/26

SECTION 5
LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Christopher Uchman	SnapNrack
Mike Watkins	SnapNrack
Nicholas Bean	Intertek B&C
Jarod Hardman	Intertek B&C



Total Quality. Assured.

2524 E. Jensen Ave
Fresno, California 93706

Telephone: 559-233-8705
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

SECTION 6

TEST SPECIMEN DESCRIPTION

Manufacturer: SnapNrack

Product Type: Flashing

Series/Model: OmniShield™

Roof Deck Description: An 8' 0" wide by 6' 0" long roof deck on a 1:12 slope was utilized. The roof deck consisted of #2 Spruce-Pine-Fir nominal 2x6 intermediate supports sheathed with APA 32/16 span rated 7/16" plywood sheathing. The intermediate supports were spaced 12" on center. The plywood was secured to the rafters with 8d common nails spaced 6" on center around the perimeter and 12" on center at the intermediate supports.

Underlayment, and Prepared Roof Covering Description: The underlayment consisted of a single layer of an ASTM D2626 coated base sheet with a 4-inch (102 mm) head lap. All fasteners securing the underlayment were staples. Test Specimen #1 roofing material consisted of self-adhered asphalt roofing. Test Specimen #2 consisted of self-adhered TPO roofing.

Conditioning: Each specimen was allowed to cure in direct sunlight for a minimum of 5 days prior to testing.

Roof Joist Specimen Installation: Omnibase™ was secured through roofing with two #14 x 2-1/4" lag screws with bonded washers. Sealant was applied around the perimeter of the Omnibase™ prior to the Omnishield™ assembly. Sealant was applied around the full circumference of the Omnishield™ assembly in three continuous rows to grooves of assembly prior to seating on roof. Stand off arm was then threaded onto Omnibase™ to secure assembly and perimeter of Omnishield to stand off arm was sealed. Sample sealant consisted of either ChemLink M1 RTV or Geocel 3500 RTV.

Field Specimen Installation: Omnibase™ was secured through roofing with six #14 x 2-1/4" lag screws with bonded washers. Sealant was applied around the perimeter of the Omnibase™ prior to the Omnishield™ assembly. Sealant was applied around the full circumference of the Omnishield™ assembly in three continuous rows to grooves of assembly prior to seating on roof. Stand off arm was then threaded onto Omnibase™ to secure assembly and perimeter of Omnishield™ to stand off arm was sealed. Sample sealant consisted of either ChemLink M1 RTV or Geocel 3500 RTV.

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

SECTION 7

TEST RESULTS

Protocol TAS 100(A)-23, *Test Procedure for Wind and Wind Driven Rain Resistance and/or Increased Windspeed Resistance of Soffit Ventilation Strip and Continuous or Intermittent Ventilation System Installed at the Ridge Area.*

Test Specimen #1

Test Date(s): 05/04/26

The temperature during testing was 16°C (61°F). The results are tabulated as follows:

Test Procedure: The wind speed intervals were conducted as follows:

Interval No.	Wind Speed (mph)	Time (min)	Water Spray
1	35	15	On
2	0	5	Off
3	70	15	On
4	0	5	Off
5	90	15	On
6	0	5	Off
7	110	5	On
8	0	5	Off

Test Results: The TAS 100(A) test results are as follows:

Wind Speed	Results
35 mph	0 oz.
70 mph	0 oz.
90 mph	0 oz.
110 mph	0 oz.

Result(s): Pass

Note 1: *Tested at a 1:12 roof pitch.*

Note 2: *Test specimen included a field and joist installation with either ChemLink M1 RTV or Geocell 3500 RTV sealant.*

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

Protocol TAS 100(A)-23, *Test Procedure for Wind and Wind Driven Rain Resistance and/or Increased Windspeed Resistance of Soffit Ventilation Strip and Continuous or Intermittent Ventilation System Installed at the Ridge Area.*

Test Specimen #2

Test Date(s): 05/14/26

The temperature during testing was 22°C (71°F). The results are tabulated as follows:

Test Procedure: The wind speed intervals were conducted as follows:

Interval No.	Wind Speed (mph)	Time (min)	Water Spray
1	35	15	On
2	0	5	Off
3	70	15	On
4	0	5	Off
5	90	15	On
6	0	5	Off
7	110	5	On
8	0	5	Off

Test Results: The TAS 100(A) test results are as follows:

Wind Speed	Results
35 mph	0 oz.
70 mph	0 oz.
90 mph	0 oz.
110 mph	0 oz.

Result(s): Pass

Note 3: *Tested at a 1:12 roof pitch.*

Note 4: *Test specimen included a field and joist installation with either ChemLink M1 RTV or Geocell 3500 RTV sealant.*

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)
Date: 05/21/26

Protocol ASTM E2140-01(23), *Standard Test Method for Water Penetration of Metal Roof Panel Systems by Static Water Pressure Head*

Test Specimen #1

Test Date(s): 05/15/26

The temperature during testing was 28°C (83°F). The results are tabulated as follows:

TITLE OF TEST	RESULTS	ALLOWED
Water Penetration, per ASTM E2140 at 6" water column	Pass	No leakage

Note 5: Water column level was maintained for a duration of 6 hours during inspection of penetrations for water leakage.

Note 6: Test specimen included a field and joist installation with either ChemLink M1 RTV or Geocell 3500 RTV sealant.

Test Specimen #2

Test Date(s): 05/15/26

The temperature during testing was 28°C (83°F). The results are tabulated as follows:

TITLE OF TEST	RESULTS	ALLOWED
Water Penetration, per ASTM E2140 at 6" water column	Pass	No leakage

Note 7: Water column level was maintained for a duration of 6 hours during inspection of penetrations for water leakage.

Note 8: Test specimen included a field and joist installation with either ChemLink M1 RTV or Geocell 3500 RTV sealant.

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

Protocol ASTM D7147-21, *Standard Specification for Testing and Establishing Allowable Loads of Joist Hangers*

Test Specimen #3-8

Test Date(s): 05/19/26 – 05/20/26

The temperature during testing was 20°C (68°F). The results are tabulated as follows:

SPECIMEN (Joist Anchor Condition)	Maximum Load (lbs)	Deflection at Max Load (inches)
3	950	0.32
4	1648	0.13
5	1000	0.09
6	1600	0.26
7	1254	0.35
8	2205	0.24
Average	1442.8	0.23

Note 9: Reference Graph 1-6 for deflection curve.

Test Specimen #9-14

Test Date(s): 05/19/26 – 05/20/26

The temperature during testing was 20°C (68°F). The results are tabulated as follows:

SPECIMEN (Field Anchor Condition)	Maximum Load (lbs)	Deflection at Max Load (inches)
9	650	0.12
10	641	0.33
11	590	0.05
12	671	0.14
13	608	0.08
14	654	0.12
Average	635.7	0.14

Note 10: Reference Graph 7-12 for deflection curve.

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

SECTION 8

CONCLUSION

The specimen(s) tested met the performance requirements set forth in the protocols.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends ten years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

SECTION 9

PHOTOGRAPHS



Photo No. 1

Typical OmniShield™ Install w/ ChemLink M1 on Asphalt Roofing



Photo No. 2

Typical OmniShield™ Install w/ Geocel 3500 on Asphalt Roofing

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26



Photo No. 3

Typical OmniShield™ Install w/ ChemLink M1 on TPO Roofing



Photo No. 4

Typical OmniShield™ Install w/ Geocel 3500 on TPO Roofing

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26



Photo No. 5
c



Photo No. 6
Joist/Field Install Submersion Testing of Geocel 3500/ChemLink M1 Installations on TPO

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26



Photo No. 7

Typical Pullout of OmniShield™ Assembly



Photo No. 8

Typical Field Condition Failure of OmniShield™ Assembly

TEST REPORT FOR SNAPNRACK
Report No.: T6065.01-301-18 (R0)
Date: 05/21/26



Photo No. 9
Typical Joist Condition Failure of OmniShield™ Assembly


TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)


Date: 05/21/26

SECTION 10

GRAPHS

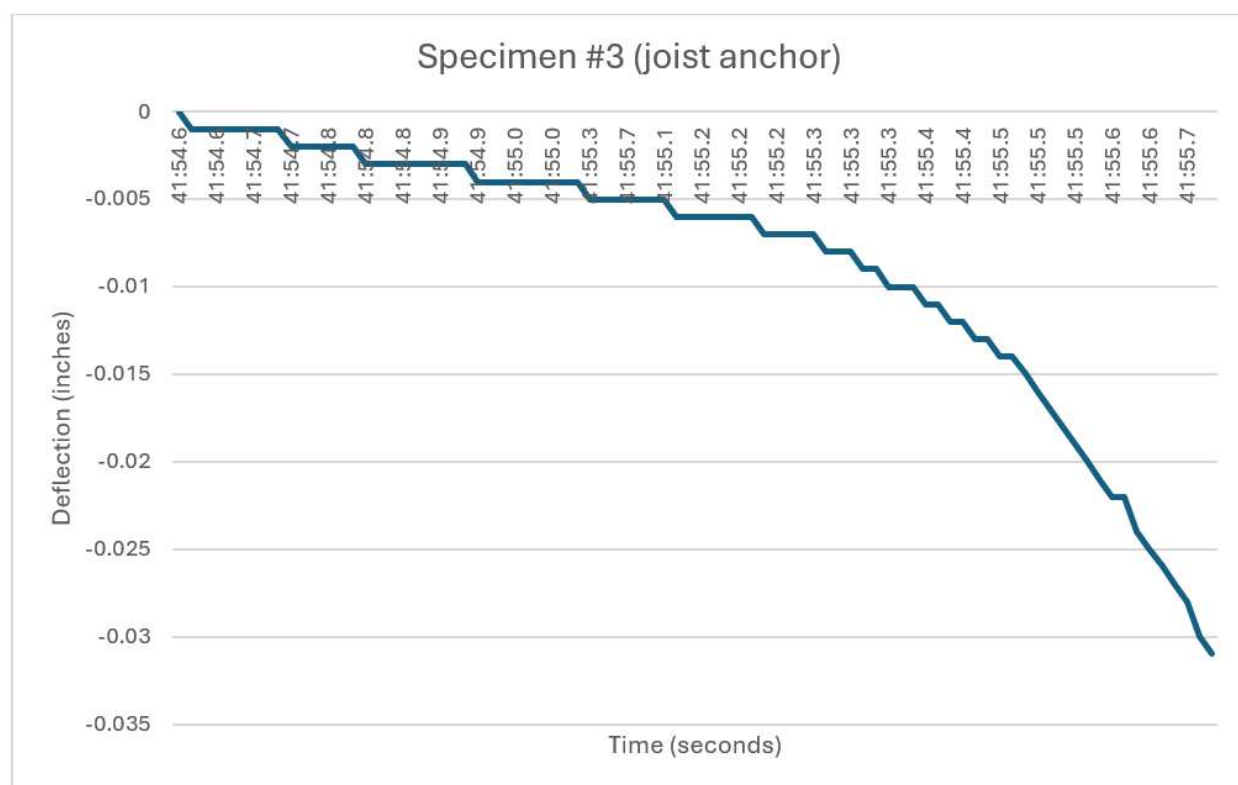

Graph #1
Test Specimen #3

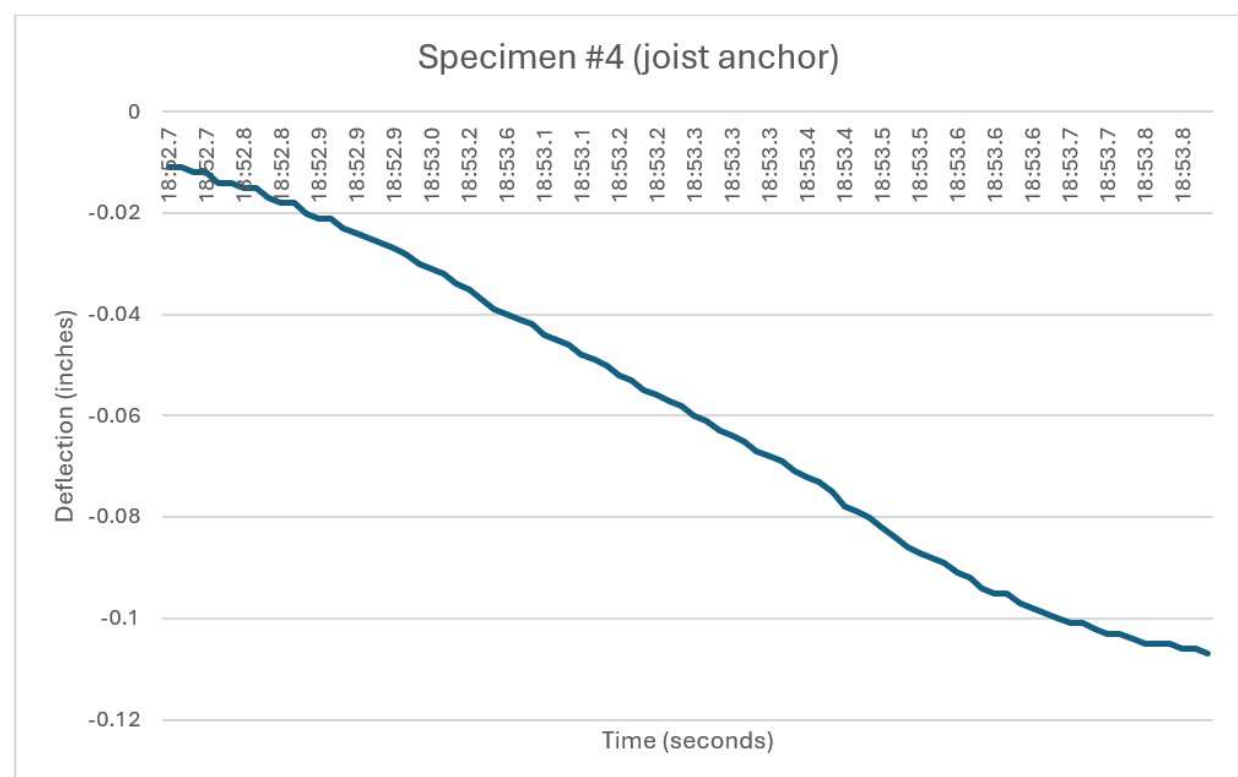

Graph #2
Test Specimen #4

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26



Graph #3
Test Specimen #5




Graph #4
Test Specimen #6

TEST REPORT FOR SNAPNRACK


Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

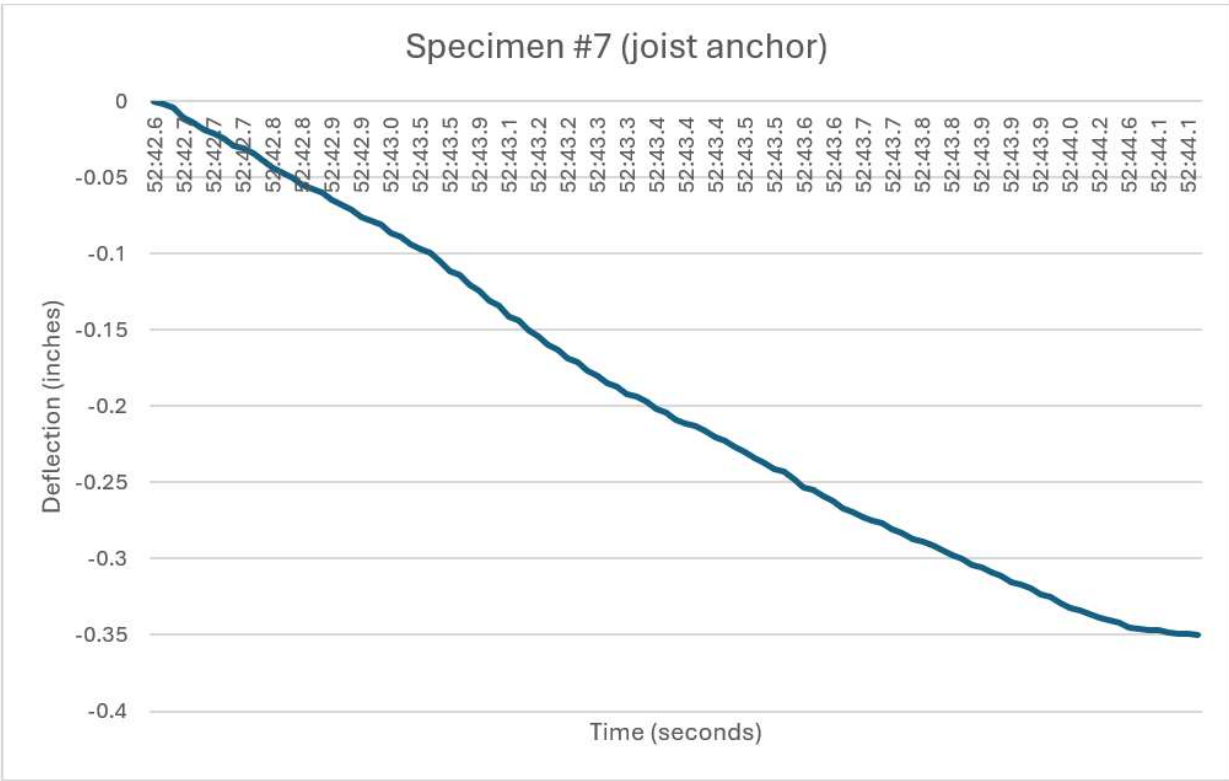

Graph #5

Test Specimen #7

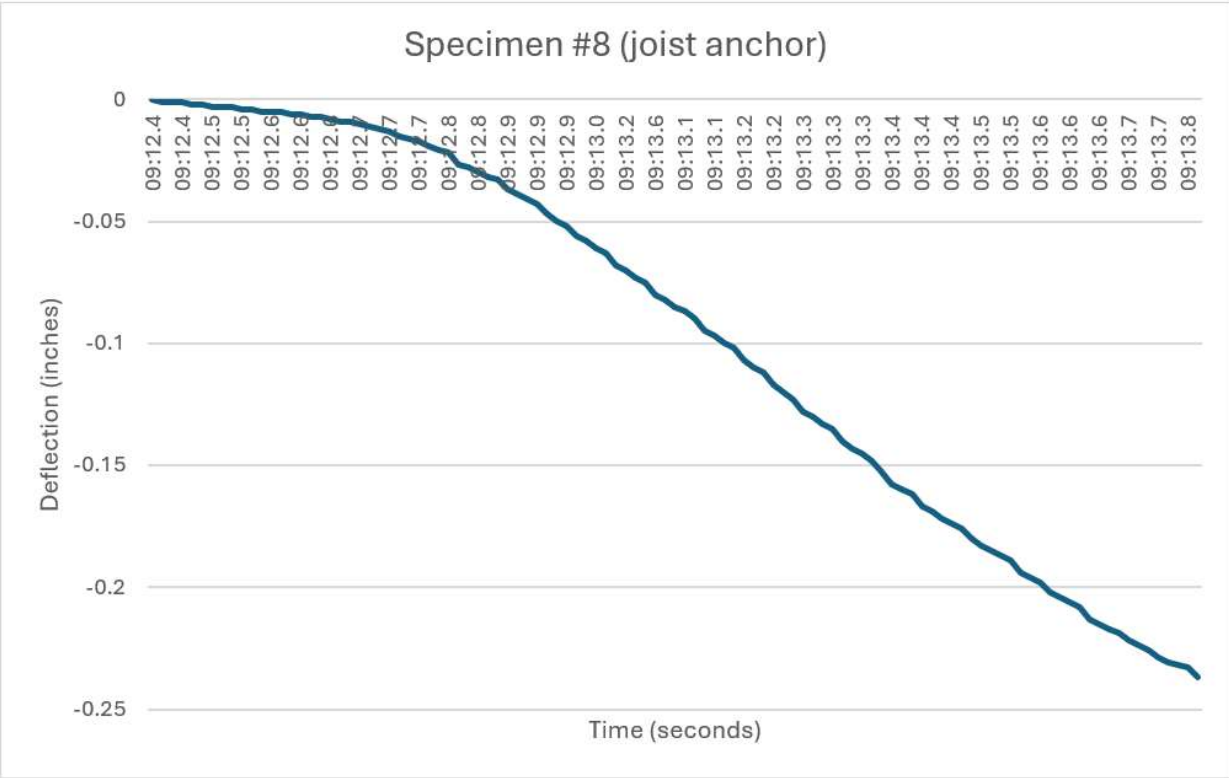


Graph #6

Test Specimen #8


TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

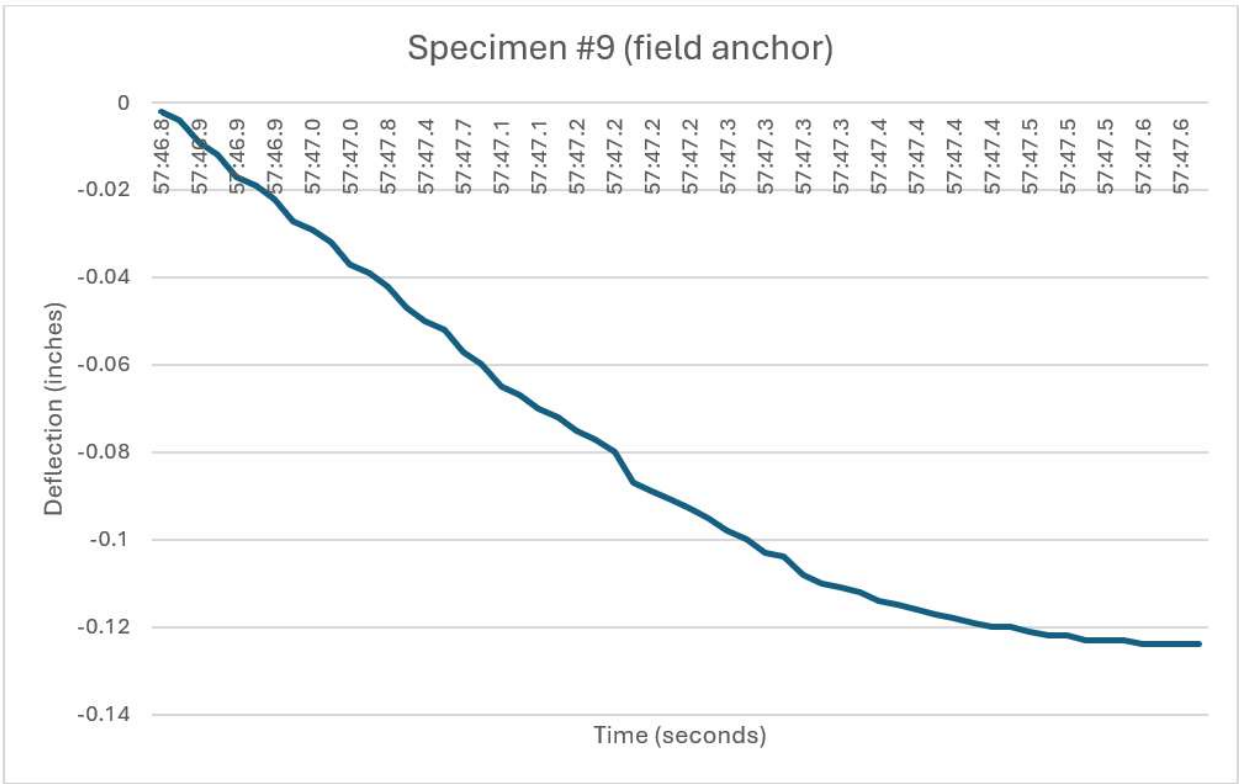

Graph #7
Test Specimen #9

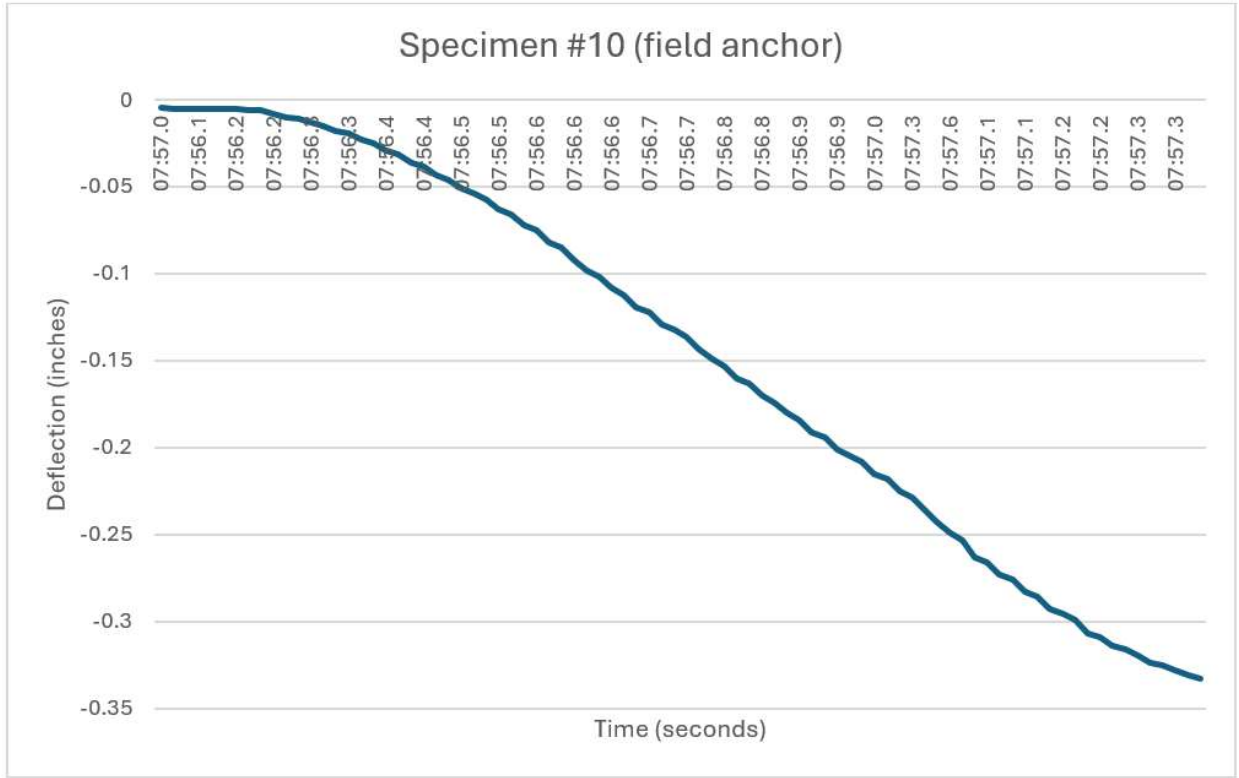


Graph #8
Test Specimen #10

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)


Date: 05/21/26

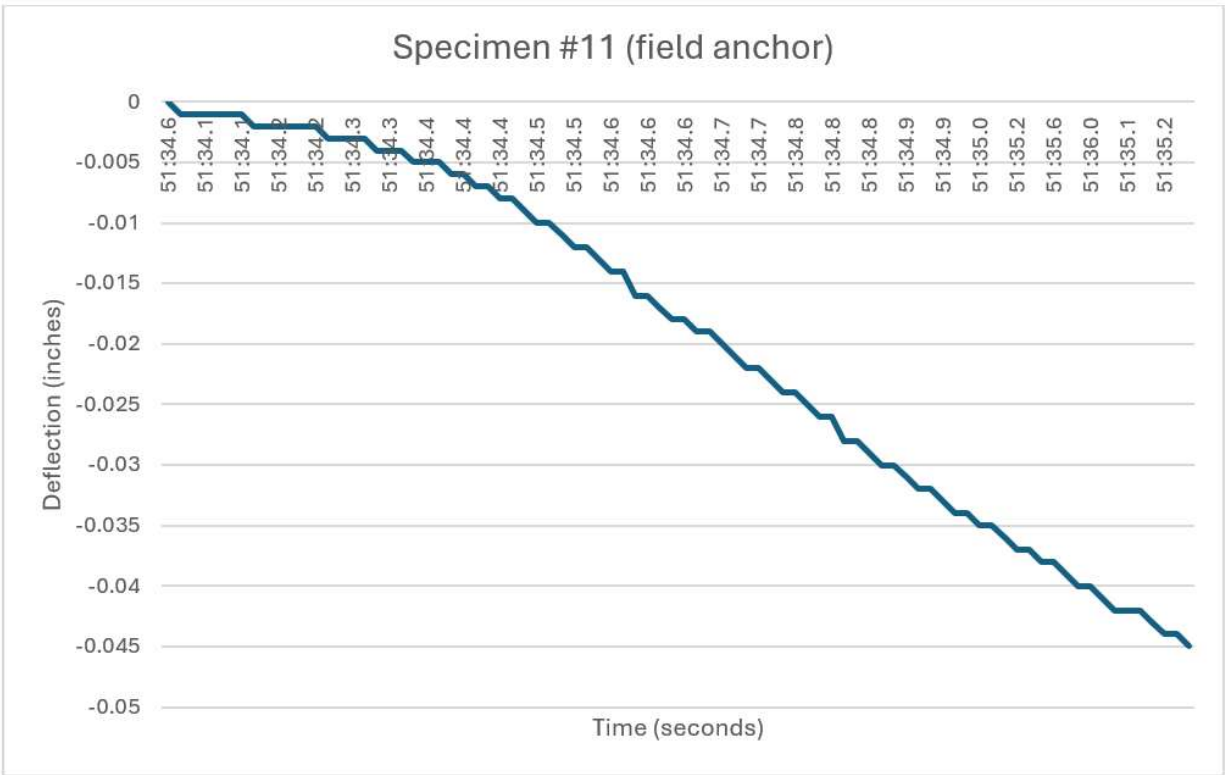

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

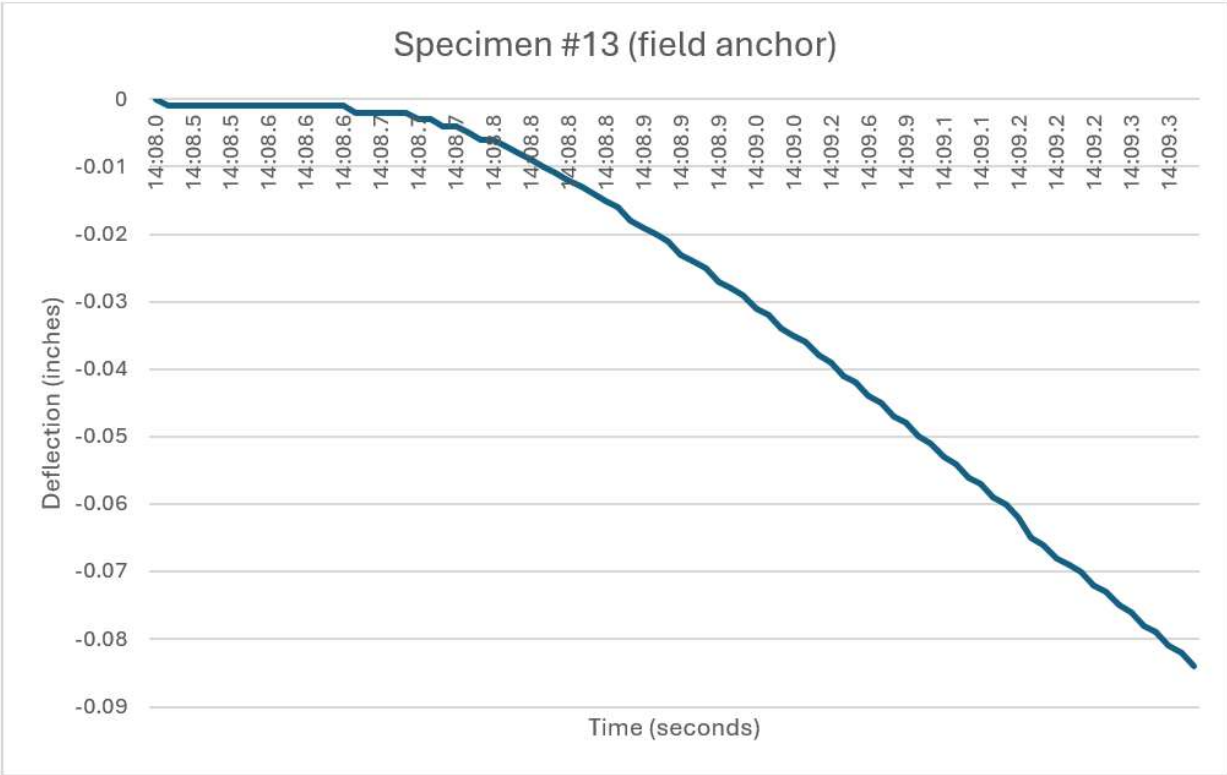

Graph #11
Test Specimen #13



Graph #12
Test Specimen #14



TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

SECTION 11

INSTALLATION INSTRUCTIONS

2524 E. Jensen Ave
Fresno, California 93706

Telephone: 559-233-8705
Facsimile: 717-764-4129
www.intertek.com/building

OmniShield™ Flashing Installation Manual

snapnrack.com

Materials Included

- OmniShield™


Required Tools

- Caulking gun
- Channel Lock Pliers

Installation Instructions

⚠ Important Note


Prior to applying roof sealant, verify that the sealant is compatible with the roof membrane that the OmniShield™ is being installed on.

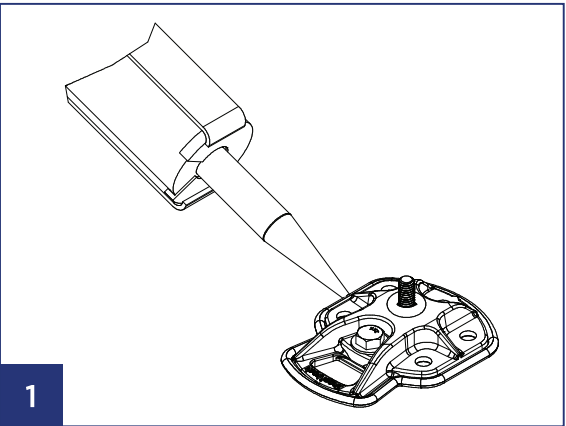


Apply a 1/4" bead of ChemLink M-1 roofing sealant to base of 5/16" threaded stud and to the entire perimeter of OmniBase™.

⚠ Install Note

Clean all smooth substrates with isopropyl or denatured alcohol a minimum of 2" all around OmniBase™. Brush away all gravel & loose granules to the same distance.

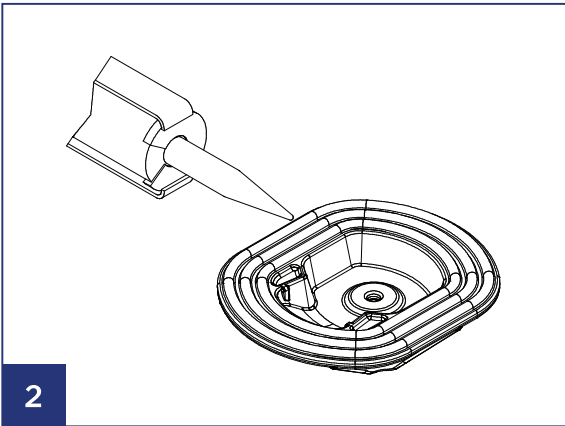


Apply a 1/4" bead of ChemLink M-1 roof sealant into all 3 of the grooves on the underside of OmniShield™. Sealant should be applied as raised beads approximately 1/8" higher than the underside surface of OmniShield™.

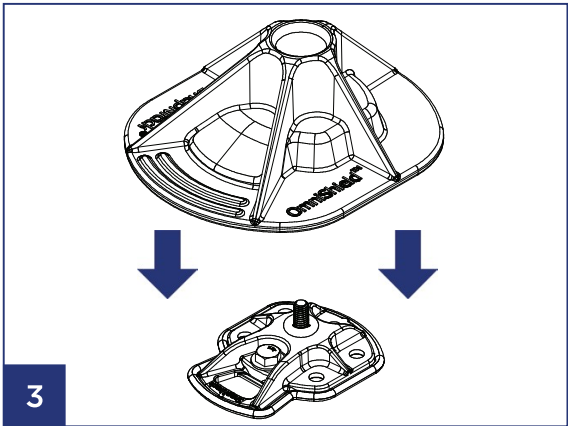

Install OmniShield™ on to roof over the OmniBase™, pressing firmly onto roof until sealant can be seen around the base of the OmniShield™.

⚠ Install Note


If roof sealant is not visible around perimeter of OmniShield™, lift the OmniShield™ off of roof, apply more sealant then reapply to roof.

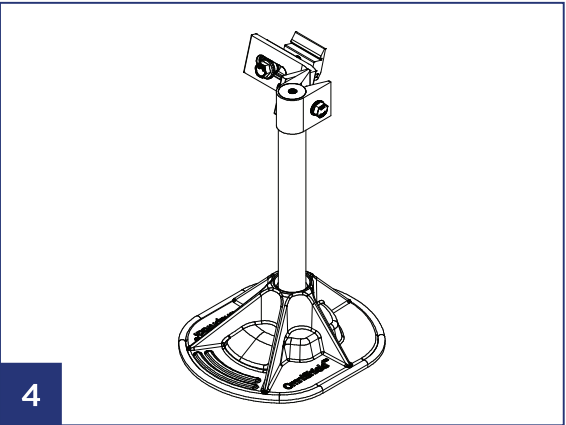


Install Tilt Standoff through the opening in the OmniShield™ and thread on to the 5/16" stud on the OmniBase™.

⚠ Install Note

Standoff shafts need to be tightened to base using channel lock pliers

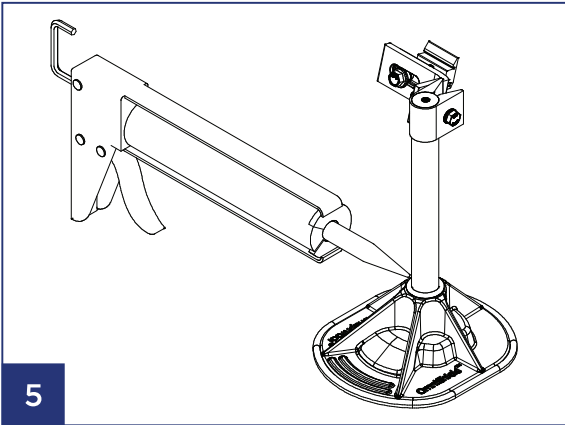

Apply a bead of roof sealant around the top opening of the OmniShield™ at Standoff penetration.

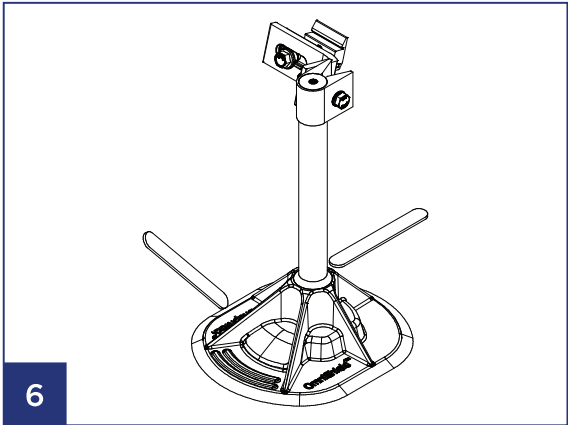

Smooth out the excess roof sealant at the base of the OmniShield™ and at the top opening.

877-732-2860

www.snapnrack.com

contact@snapnrack.com

The SnapNrack name and SnapNrack logo are the property of SnapNrack, Inc.
All information contained in this document are the property of SnapNrack, Inc.
©2023, SnapNrack, Inc. All rights reserved.



2524 E. Jensen Ave
Fresno, California 93706

Telephone: 559-233-8705
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)


Date: 05/21/26

SECTION 12

DRAWINGS


The test specimen drawings have been reviewed by Intertek B&C and are representative of the test specimen(s) reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.

DESCRIPTION: SNAPNRACK, TDS, ULTRA RAIL FLUSH-MOUNT KIT, OMNIBASE		DOC NUMBER: SNR-DC-01315		SnapNrack® SUNRUN INSTALLATION SERVICES INC. 225 BUSH STREET, SUITE 1400 • SAN FRANCISCO, CA 94104 USA PHONE (877) 732-2860 • CONTACT@SNAPNRACK.COM THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.
		DRAWN BY: M.AFFENTRANGER		
PART NUMBER(S): 242-10016, 242-10017, 242-10018		REV: C	DATE: 1/25/2023	
UNITS: IN, LB, DEG [MM, KG, DEG]	SHEET: 2:2			

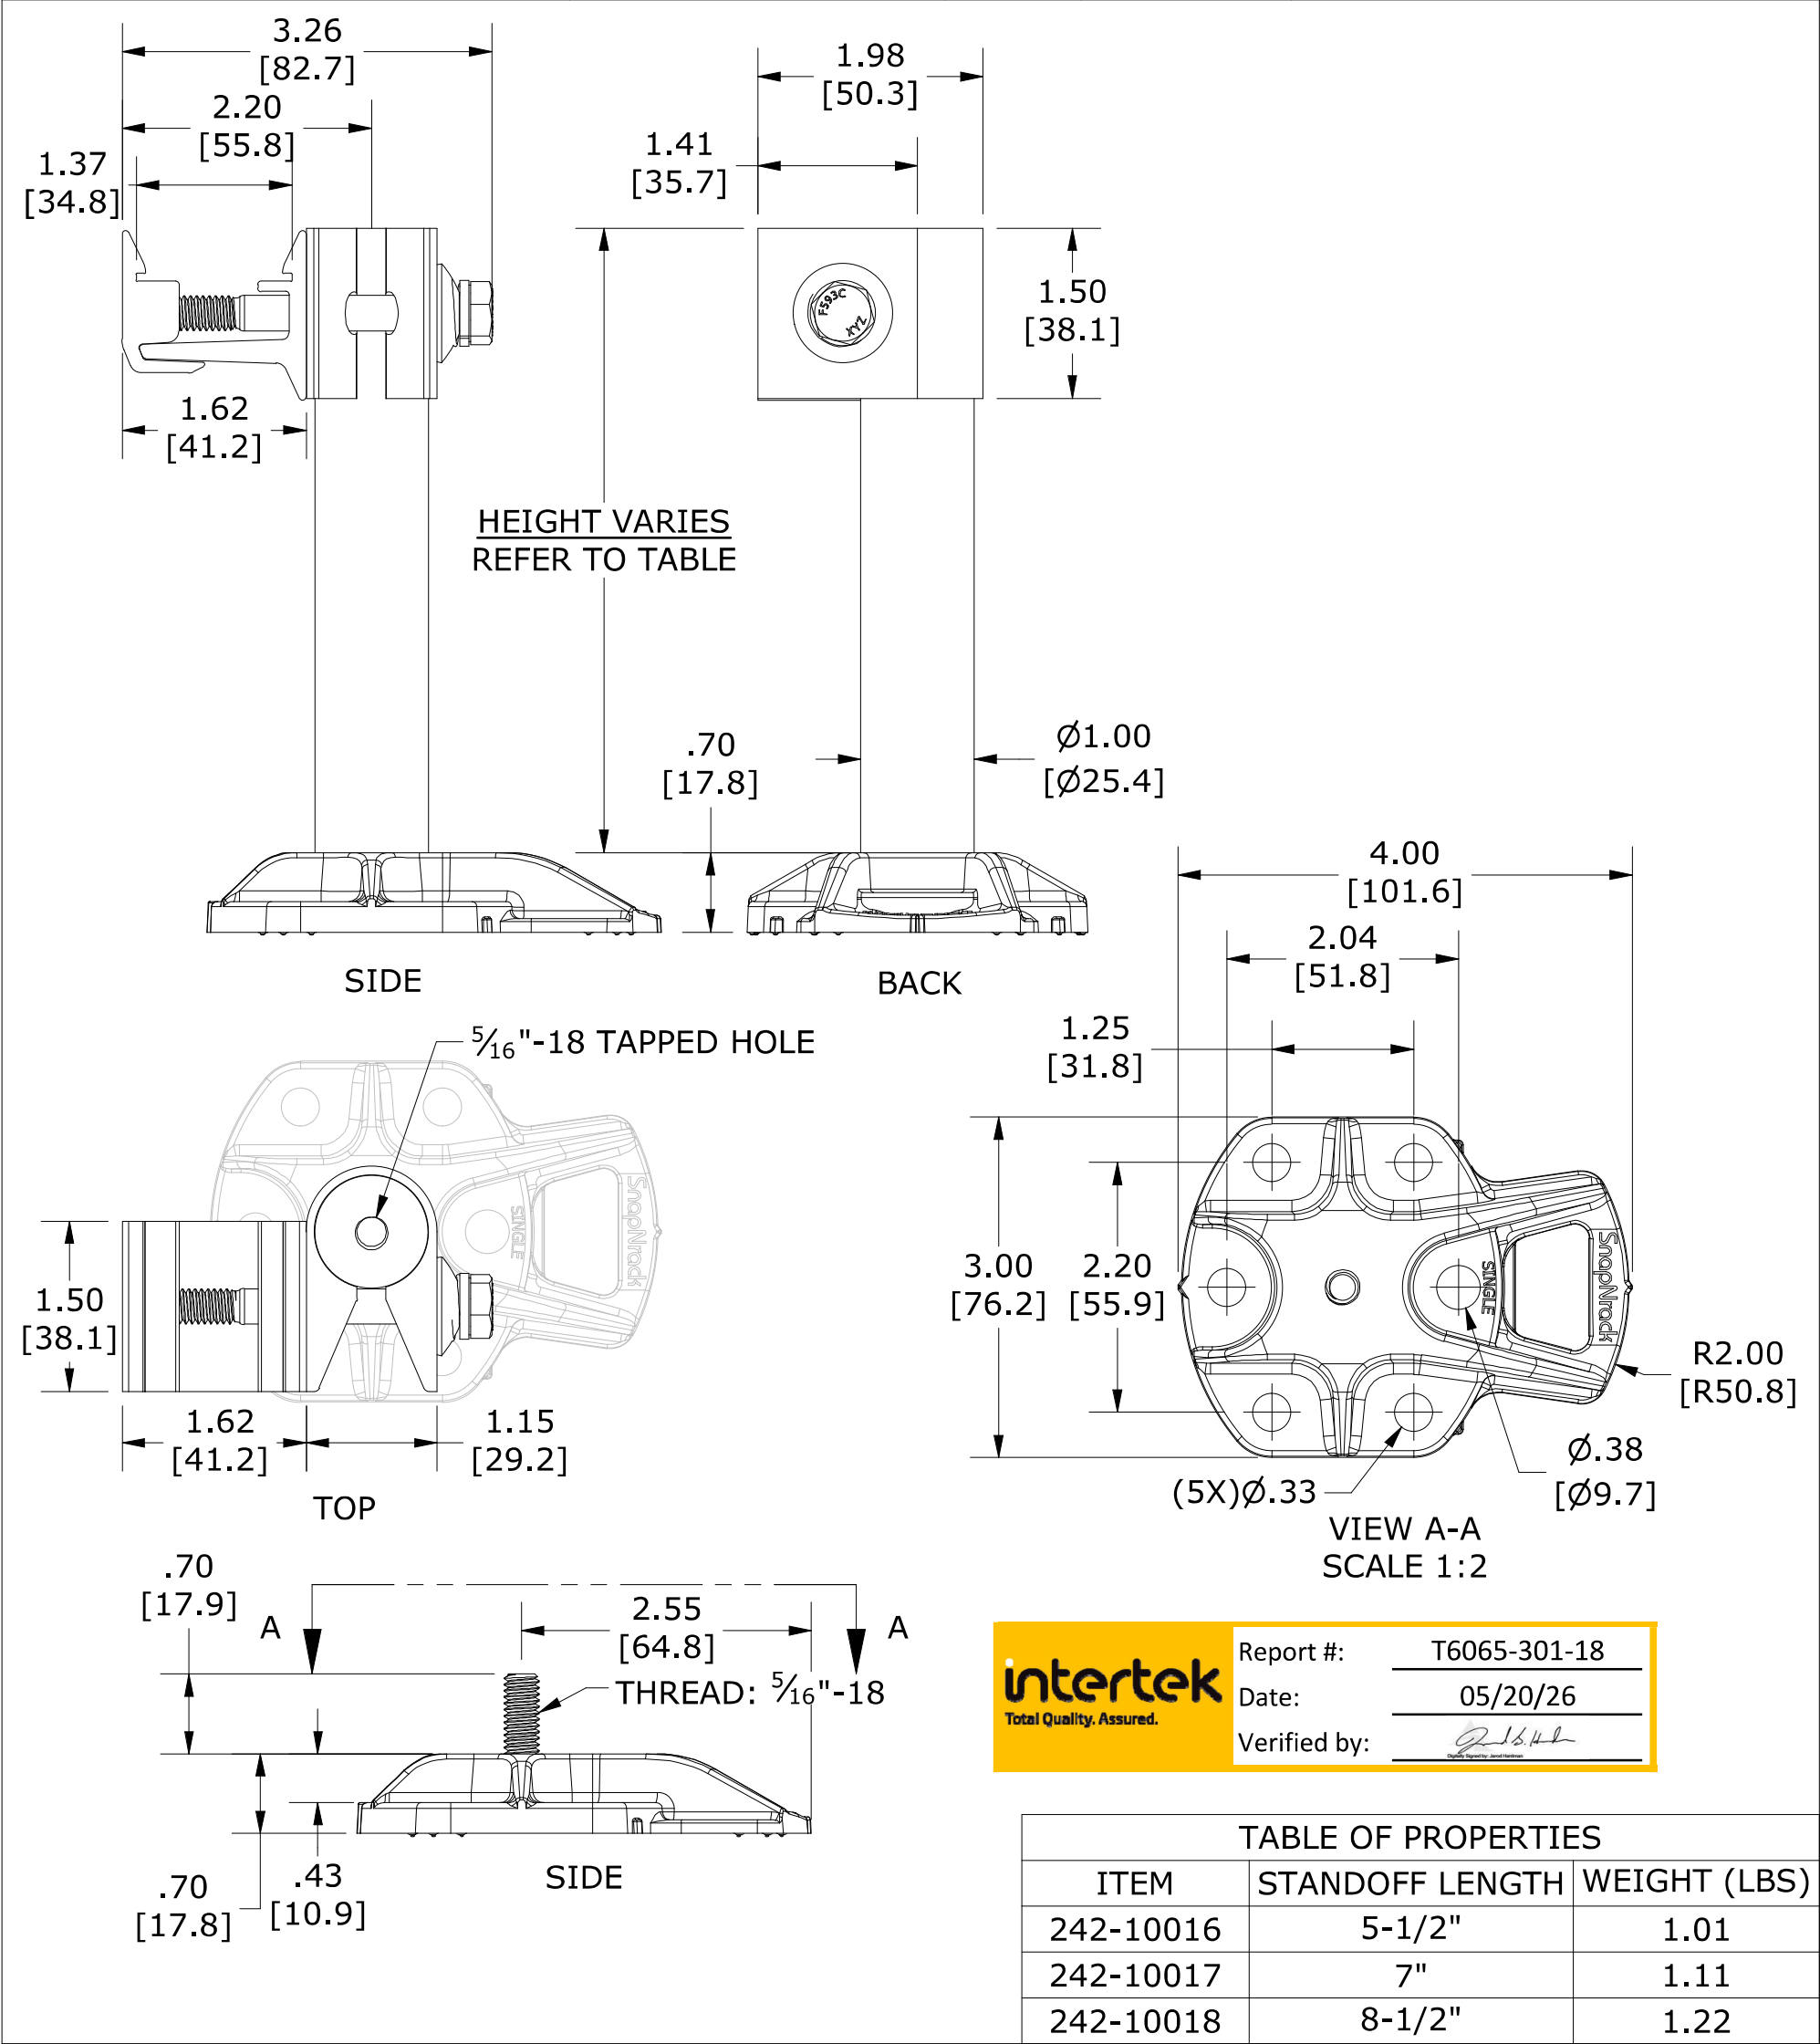

NOTES:

1. BASE (1) KITTED UNATTACHED FROM STANDOFF (2)

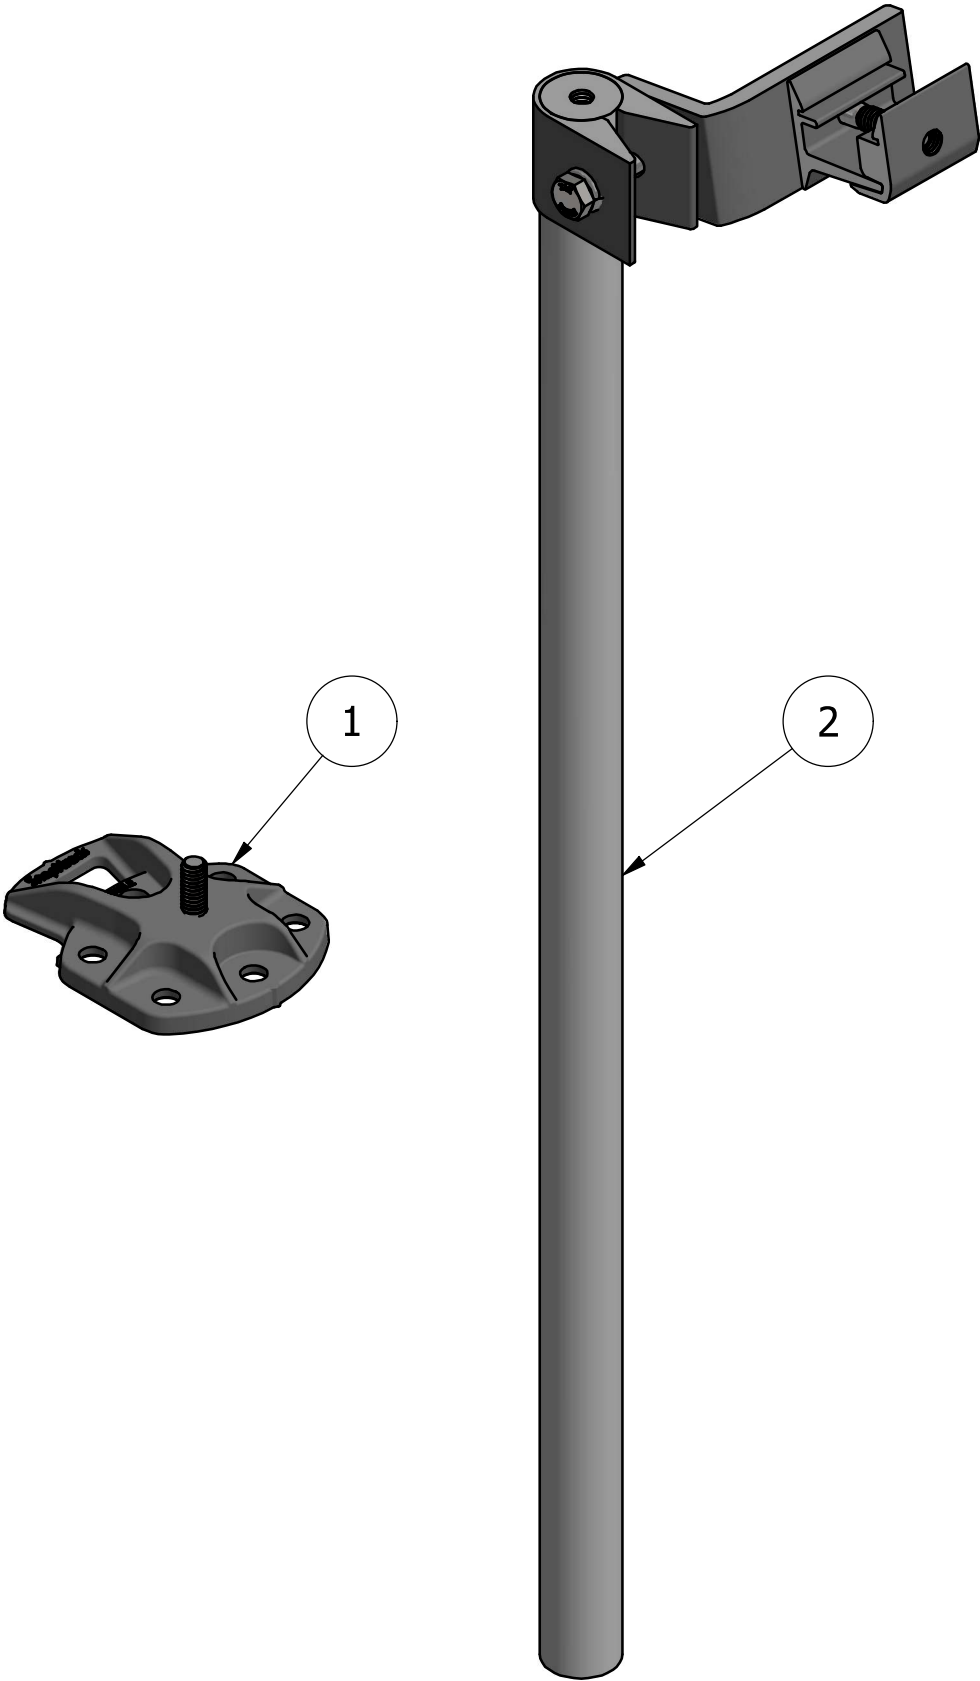

KITTED PARTS



Total Quality. Assured.

Report #: T6065-301-18

Date: 05/20/26

Verified by: 

PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	232-02544	SNAPNRACK, OMNIBASE
2	1	242-92109	SNAPNRACK, ULTRA RAIL TILT STANDOFF, 23IN (NO BASE)

PART WEIGHT:	UNITS:
2.476 lbmass	IN, LB, DEG [MM, KG, DEG]

DESCRIPTION:

SNAPNRACK, ULTRA RAIL TILT-MOUNT KIT, 23IN

DRAWN BY: M.AFFENTRANGER

APPROVED BY: W.ARBUCKLE

REVISION:

A	6/17/2021	NU001868	MJA
A	10/21/2021	NU002462	MJA
A	2/25/2022	NU003028	MKW

SnapNrack[™]

Solar Mounting Solutions

SUNRUN INSTALLATION SERVICES, INC.


PART NUMBER:	SCALE:	REV:
242-10022	DNS	A

225 BUSH STREET, SUITE 1400 • SAN FRANCISCO, CA 94104 USA
PHONE (877) 732-2860 • CONTACT@SNAPNRACK.COM

THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.

NOTES:

1. BASE (1) KITTED UNATTACHED FROM STANDOFF (2)

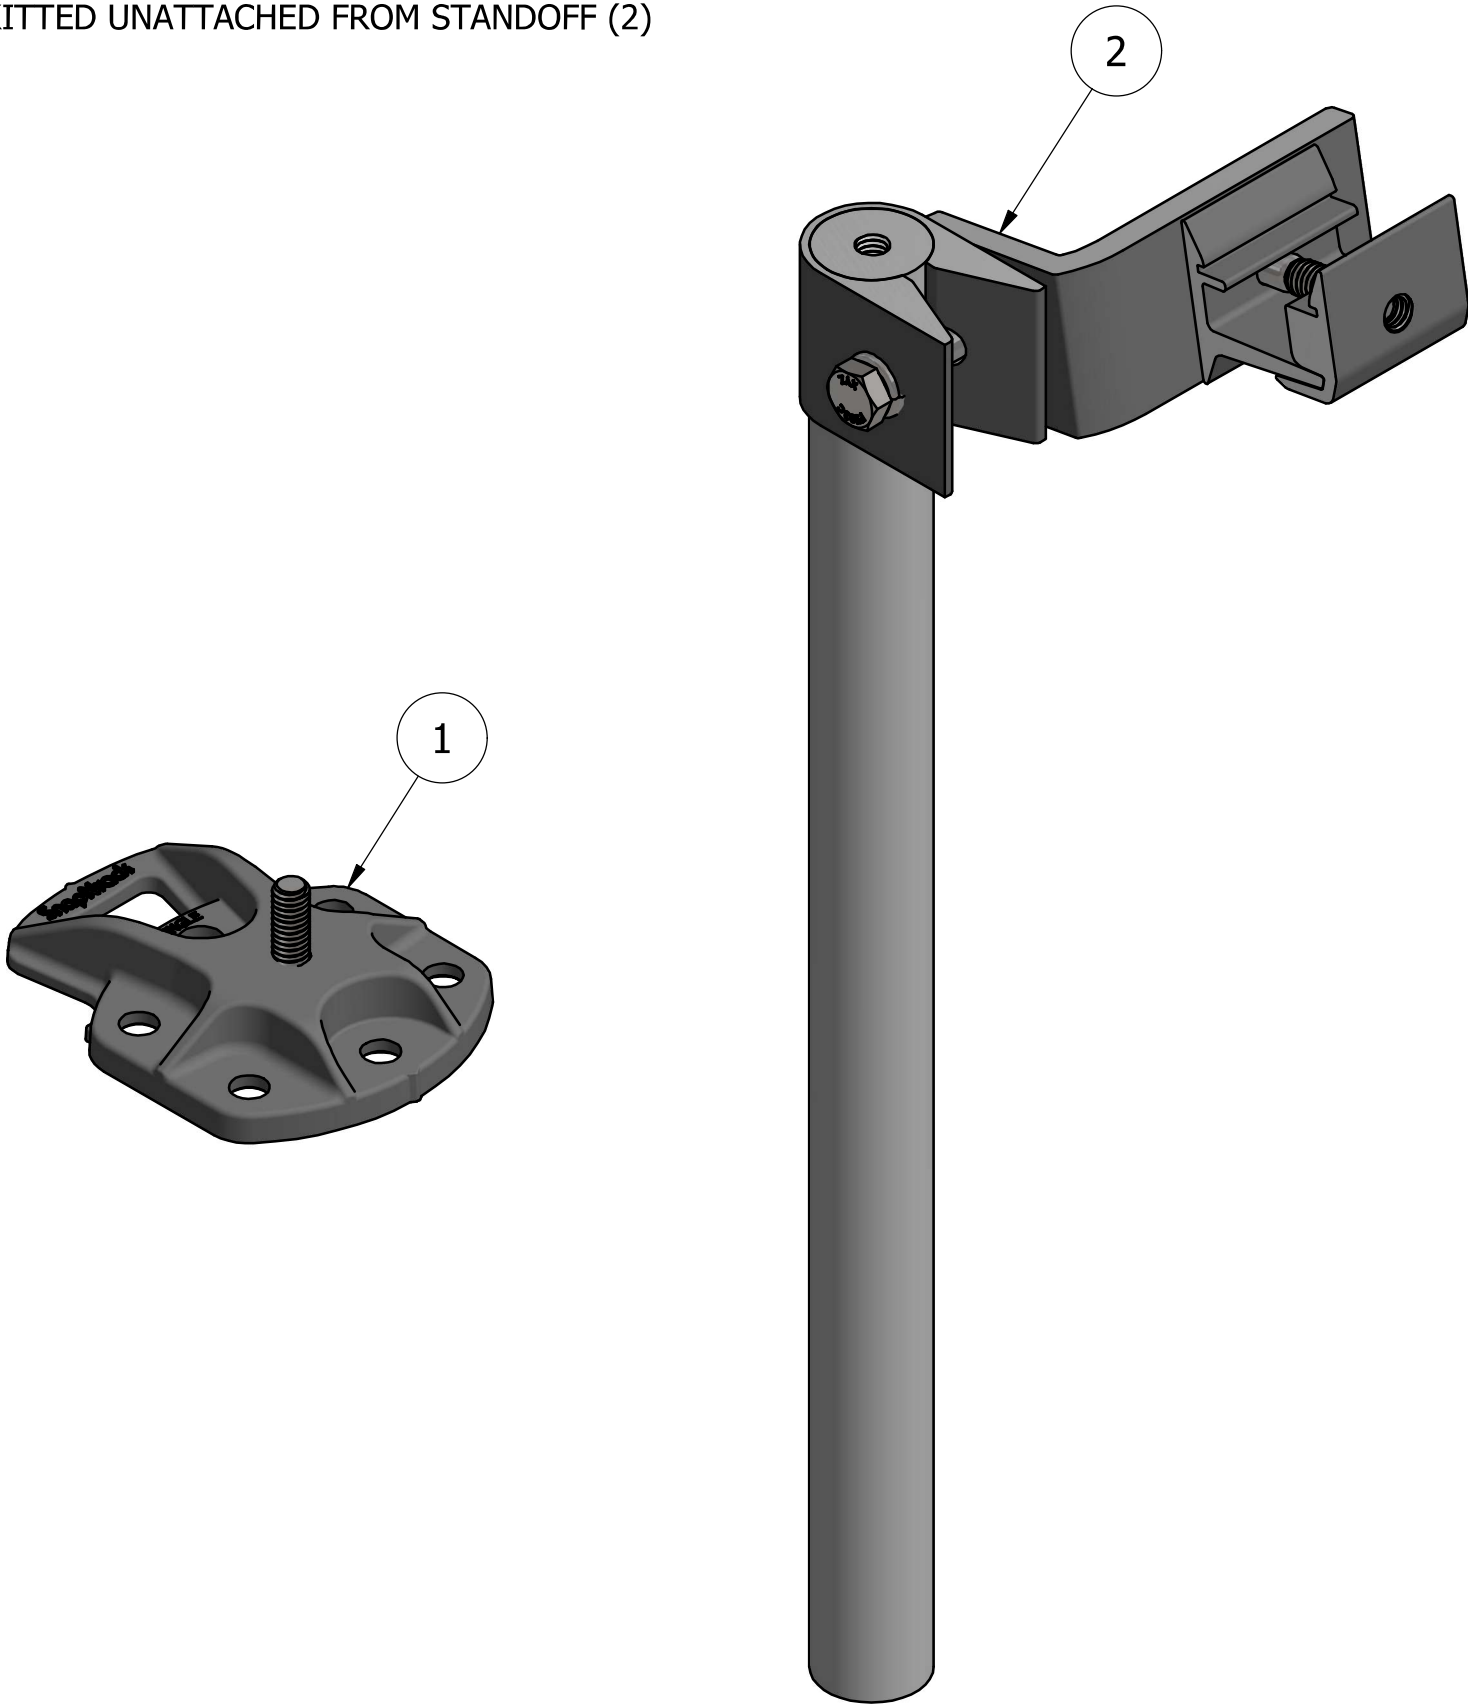

KITTED PARTS



Total Quality. Assured.

Report #: T6065-301-18

Date: 05/20/26

Verified by: 

PART WEIGHT:	UNITS:
1.833 lbmass	IN, LB, DEG [MM, KG, DEG]

DESCRIPTION:

SNAPNRACK, ULTRA RAIL TILT-MOUNT KIT, 14IN

PART NUMBER:	SCALE:	REV:
242-10021	DNS	A

PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	232-02544	SNAPNRACK, OMNIBASE
2	1	242-92108	SNAPNRACK, ULTRA RAIL TILT STANDOFF, 14IN (NO BASE)

DRAWN BY: <u>M.AFFENTRANGER</u>			
APPROVED BY: <u>W.ARBUCKLE</u>			
REVISION:			
A	<u>6/17/2021</u>	<u>NU001868</u>	<u>MJA</u>
A	<u>10/21/2021</u>	<u>NU002462</u>	<u>MJA</u>
A	<u>2/25/2022</u>	<u>NU003028</u>	<u>MKW</u>
—	—	—	—
—	—	—	—
—	—	—	—
—	—	—	—

SnapNrack™

Solar Mounting Solutions


SUNRUN INSTALLATION SERVICES, INC.

225 BUSH STREET, SUITE 1400 • SAN FRANCISCO, CA 94104 USA
PHONE (877) 732-2860 • CONTACT@SNAPNRACK.COM

THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY
REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE
WRITTEN CONSENT OF SUNRUN SOUTH LLC.

NOTES:

1. BASE (1) KITTED UNATTACHED FROM STANDOFF (2)

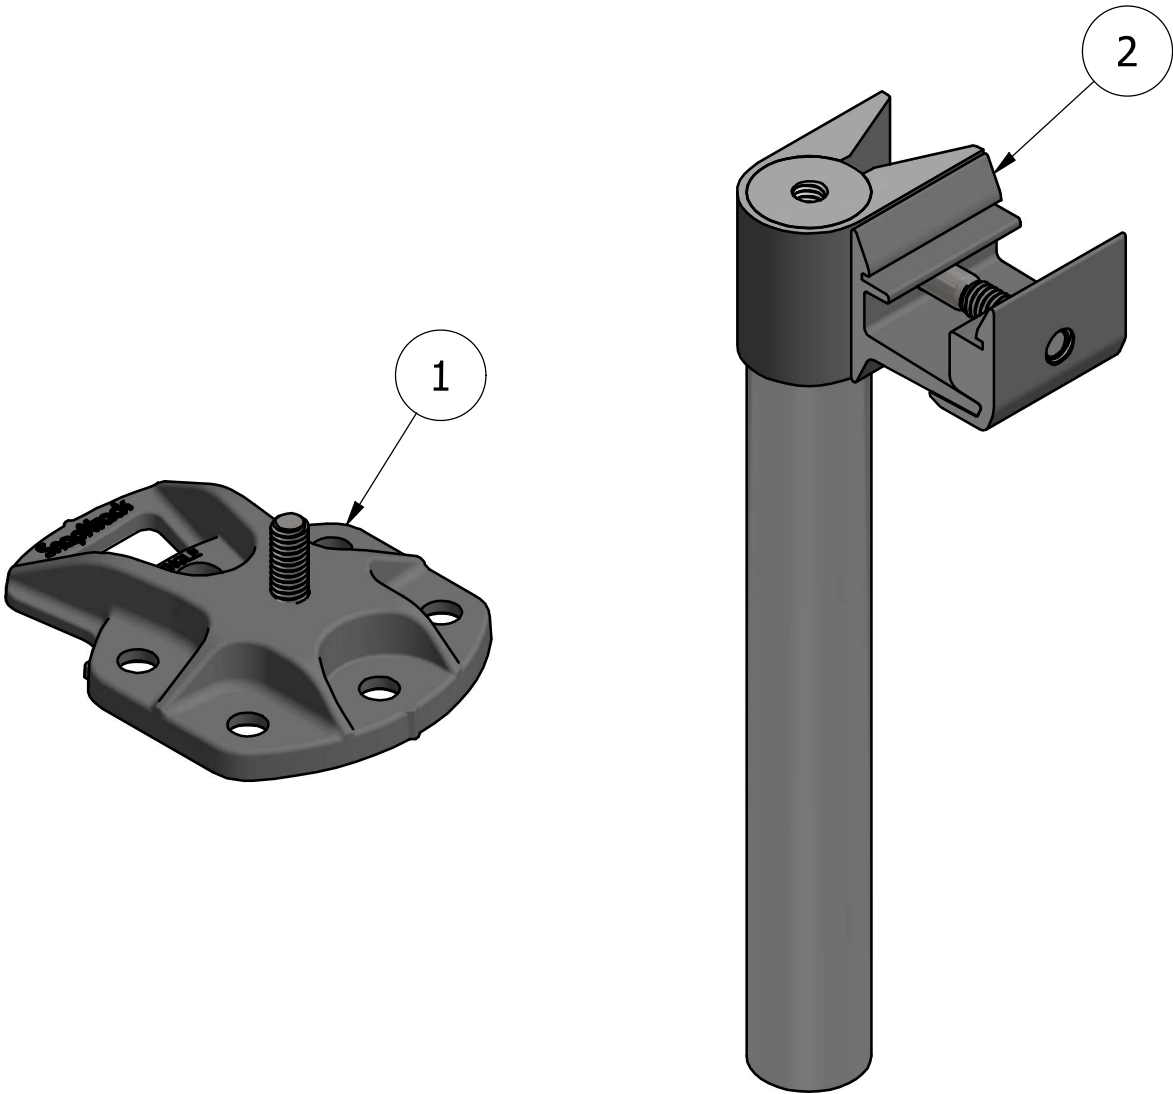

KITTED PARTS



Total Quality. Assured.

Report #: T6065-301-18

Date: 05/20/26

Verified by: 

PART WEIGHT:	UNITS:
1.221 lbmass	IN, LB, DEG [MM, KG, DEG]

DESCRIPTION:

SNAPNRACK, ULTRA RAIL FLUSH-MOUNT KIT, 8-1-2IN

PART NUMBER:	SCALE:	REV:
242-10018	DNS	A

PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	232-02544	SNAPNRACK, OMNIBASE
2	1	242-01259	SNAPNRACK, ULTRA RAIL FLUSH STANDOFF (NO BASE), 8-1-2IN
DRAWN BY:		M.AFFENTRANGER	
APPROVED BY:		W.ARBUCKLE	
REVISION:			
A	6/17/2021	NU001868	MJA
A	10/21/2021	NU002462	MJA
A	2/25/2022	NU003028	MKW
—	—	—	—
—	—	—	—
—	—	—	—
—	—	—	—

SnapNrack™

Solar Mounting Solutions

SUNRUN INSTALLATION SERVICES, INC.

225 BUSH STREET, SUITE 1400 • SAN FRANCISCO, CA 94104 USA
PHONE (877) 732-2860 • CONTACT@SNAPNRACK.COM

THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY
REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE
WRITTEN CONSENT OF SUNRUN SOUTH LLC.

- NOTES:
1. TOLERANCE STANDARD: JIS B 0403-CT5

2. CRITICALLY LOADED REGIONS NOTED, MINIMIZE POROSITY

3. EJECTOR PIN AND GATE LOCATIONS TO BE APPROVED PRIOR TO CUTTING CAVITIES

4. NO HANGING BURR AT PARTING LINES, GATES, SHUTOFFS, OR EJECTOR PINS

5. DEBURR WITH TRIM DIE UNLESS OTHERWISE NOTED

6. REFER TO 3D CAD MODEL WITH ASSOCIATED REVISION AND PART NUMBER FOR DIMENSIONS NOT SHOWN

7. USE PART SYMMETRY

8. CRITICAL DIMENSIONS IN **BOLD**

9. ALTERNATE MATERIALS MUST BE APPROVED BY SNAPNRACK ENGINEERING

intertek

Test Quality Assurance



Report #: T6065-301-18

Date: 05/20/26


Verified by: *[Signature]*




ISO

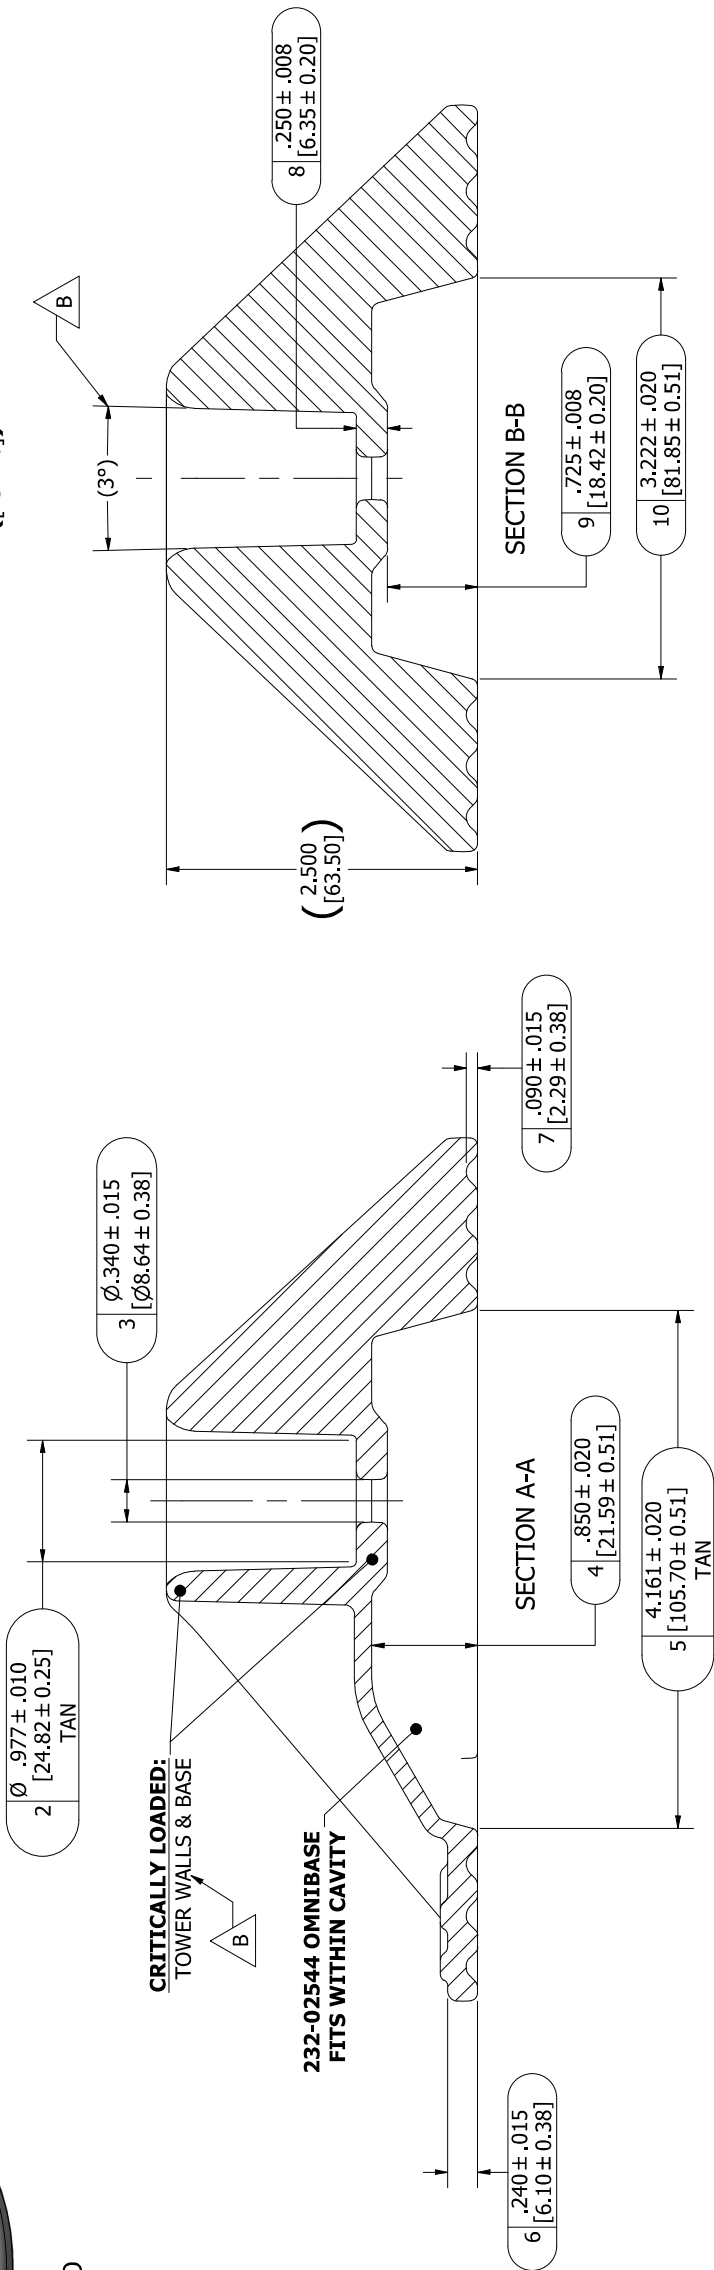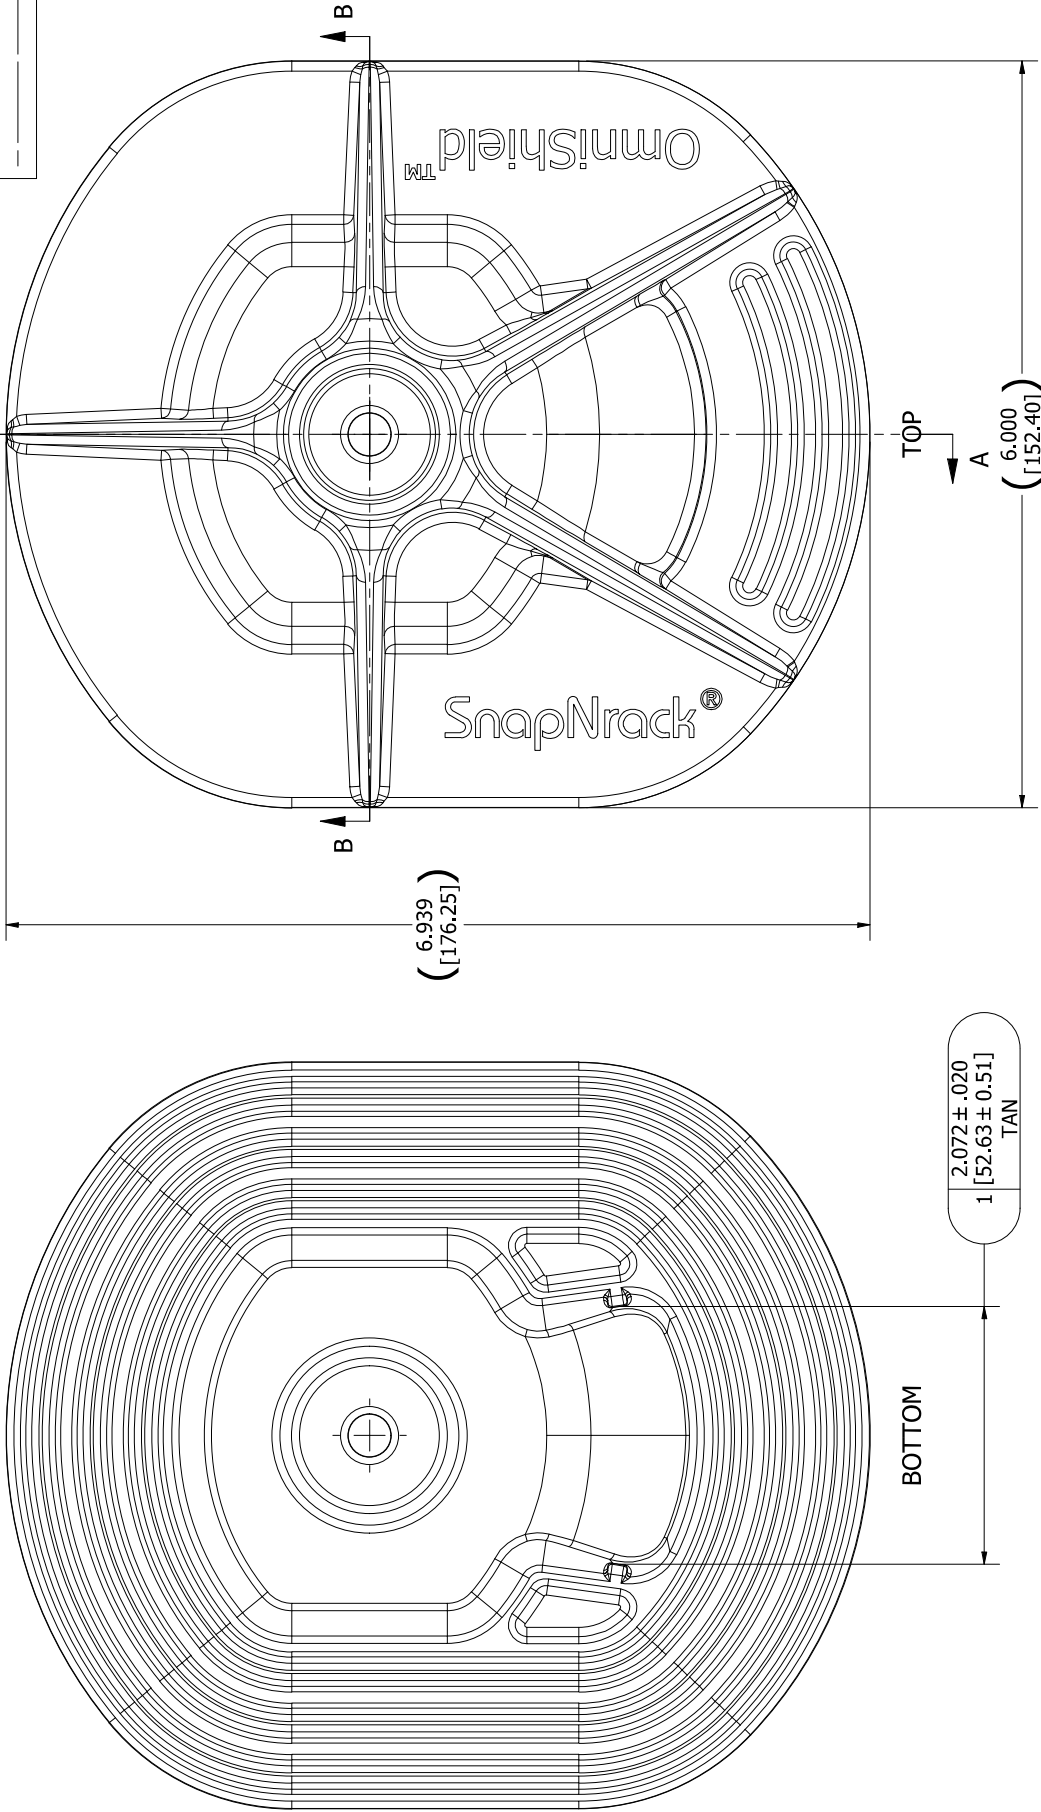


PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	232-02543	SNAPNRACK, OMNIBASE, CASTING
2	1	162-00120	BOLT, FLANGE, SERRATED, 5/16IN-18 X 1IN, SS

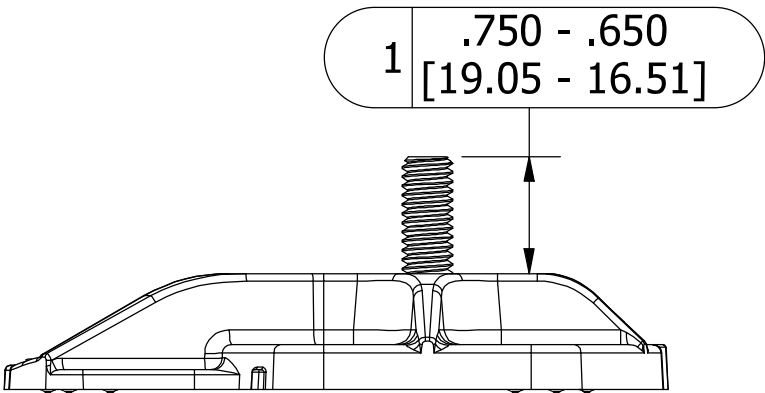


SIDE

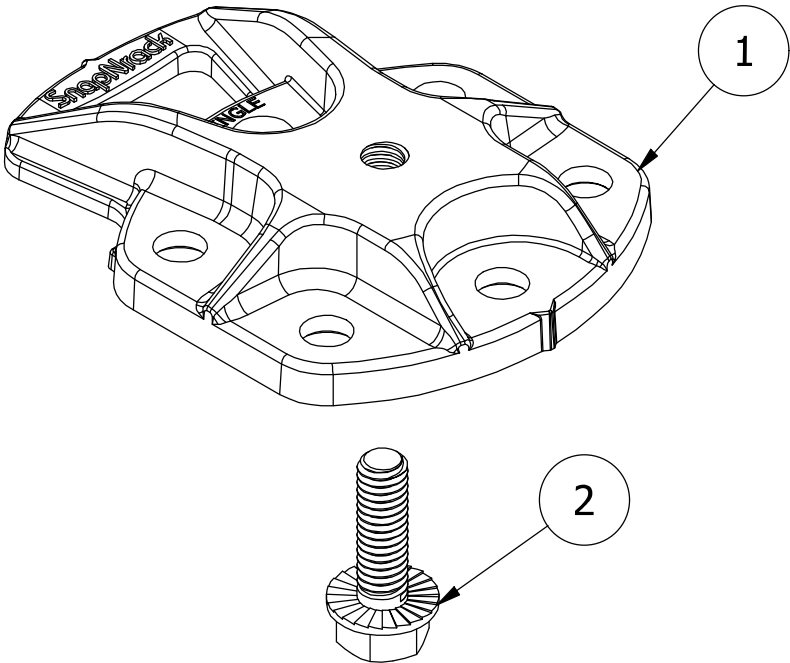

EXPLODED

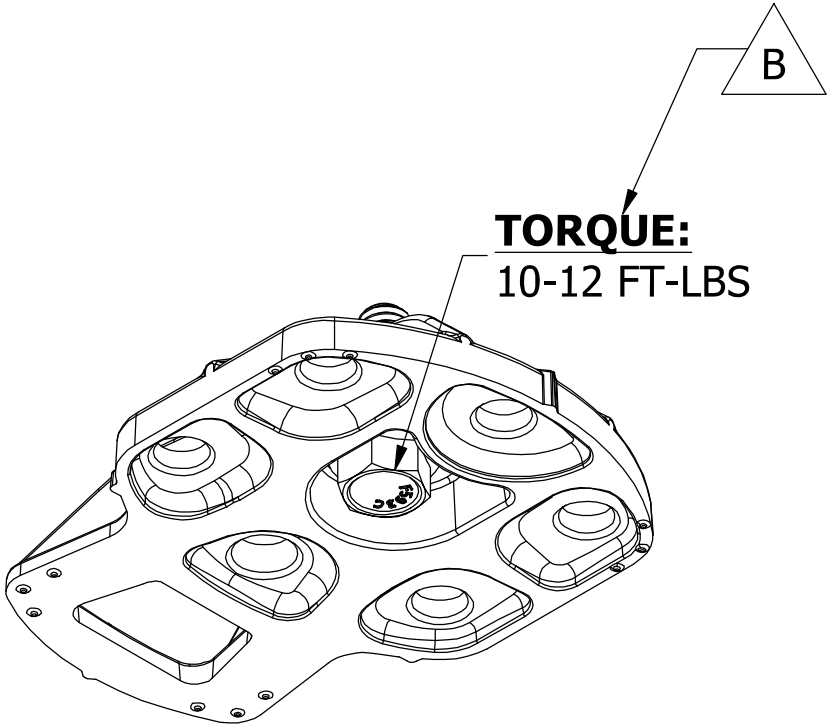

BOTTOM

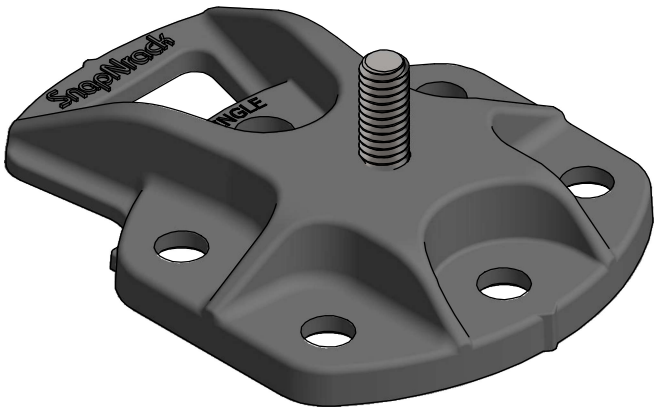

ISO

PART WEIGHT:	UNITS:
0.289 lbmass	IN, LB, DEG [MM, KG, DEG]

	Report #:	T6065-301-18
	Date:	05/20/26
	Verified by:	

DESCRIPTION: SNAPNRACK, OMNIBASE			DRAWN BY: <u>M.AFFENTRANGER</u>				SnapNrack™ Solar Mounting Solutions SUNRUN INSTALLATION SERVICES, INC. 225 BUSH STREET, SUITE 1400 • SAN FRANCISCO, CA 94104 USA PHONE (877) 732-2860 • CONTACT@SNAPNRACK.COM THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.
			APPROVED BY: <u>W.ARBUCKLE</u>				
PART NUMBER: 232-02544	SCALE: DNS	REV: B	REVISION:				
			A	<u>5/27/2021</u>	<u>NU001736</u>	<u>MJA</u>	
			B	<u>9/1/2021</u>	<u>NU002199</u>	<u>MJA</u>	
			—	—	—	—	
			—	—	—	—	

MANUFACTURE FROM 300-SERIES STAINLESS STEEL

FINISH: NATURAL

COATING: HEATBATH CORP. DURAWAX CUT 50% WITH WATER OR APPROVED EQUIVALENT CLEAR COMMERCIAL WAX EMULSION, .0005-.0010 THICK

APPLY COATING VIA DIP-SPIN PROCESS OR APPROVED EQUIVALENT

PART TO BE MANUFACTURED TO THE FOLLOWING STANDARDS:

MATERIAL PER ASTM F593C ALLOY GROUP 1, CONDITION CW
THREAD PER ASME B1.1
DIMENSIONS PER ASME 18.2.1



ROLL THREADS, DO NOT CUT

ALL DIMENSIONS IN INCHES UNLESS OTHERWISE STATED

DEBURR ROUGH EDGES

PART WEIGHT: 0.039 LBS


REVISION:
A 3/29/2016 NEW ITEM

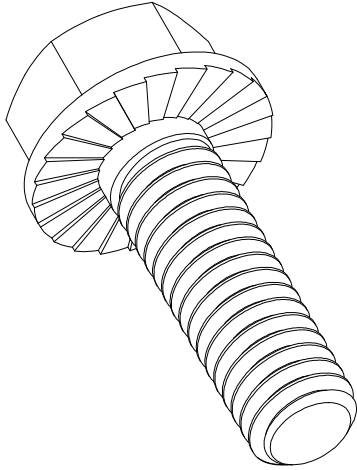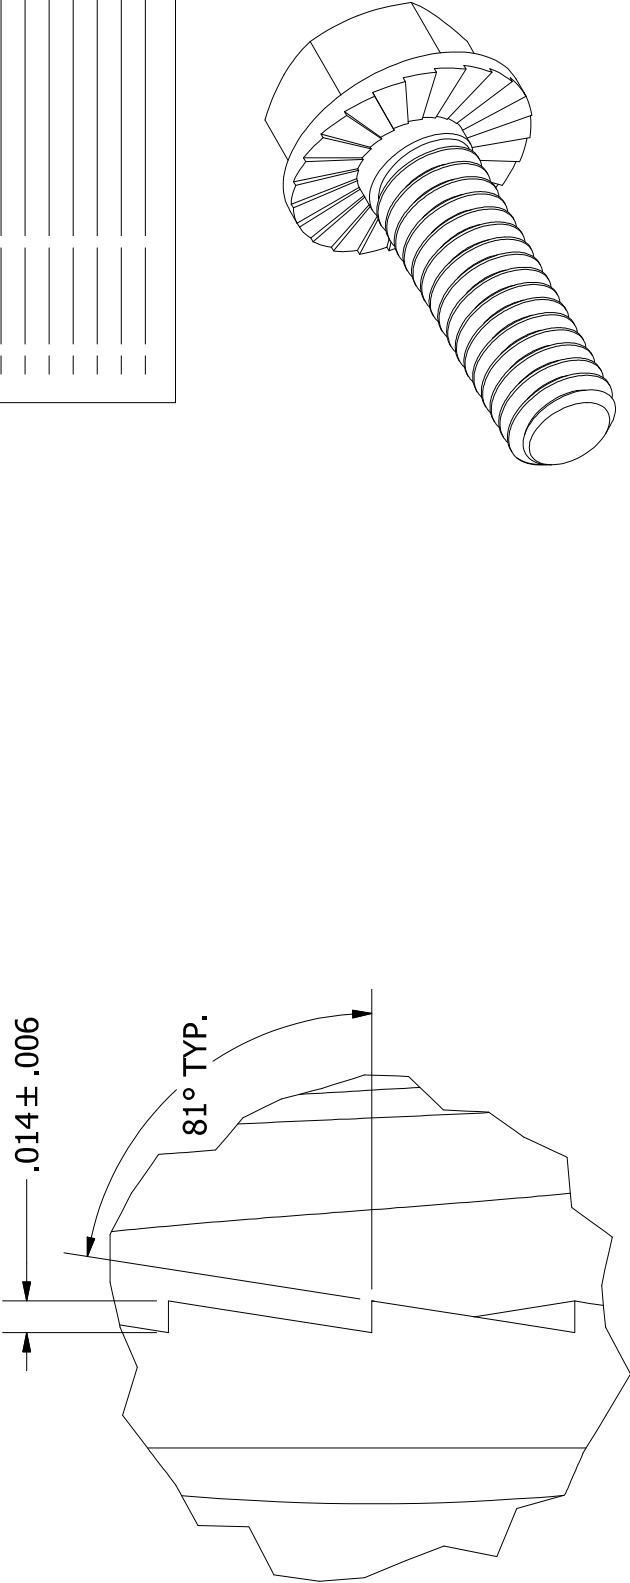

DETAIL A

intertek
Total Quality. Assured.

Report #: T6065-301-18
Date: 05/20/26
Verified by: *[Signature]*

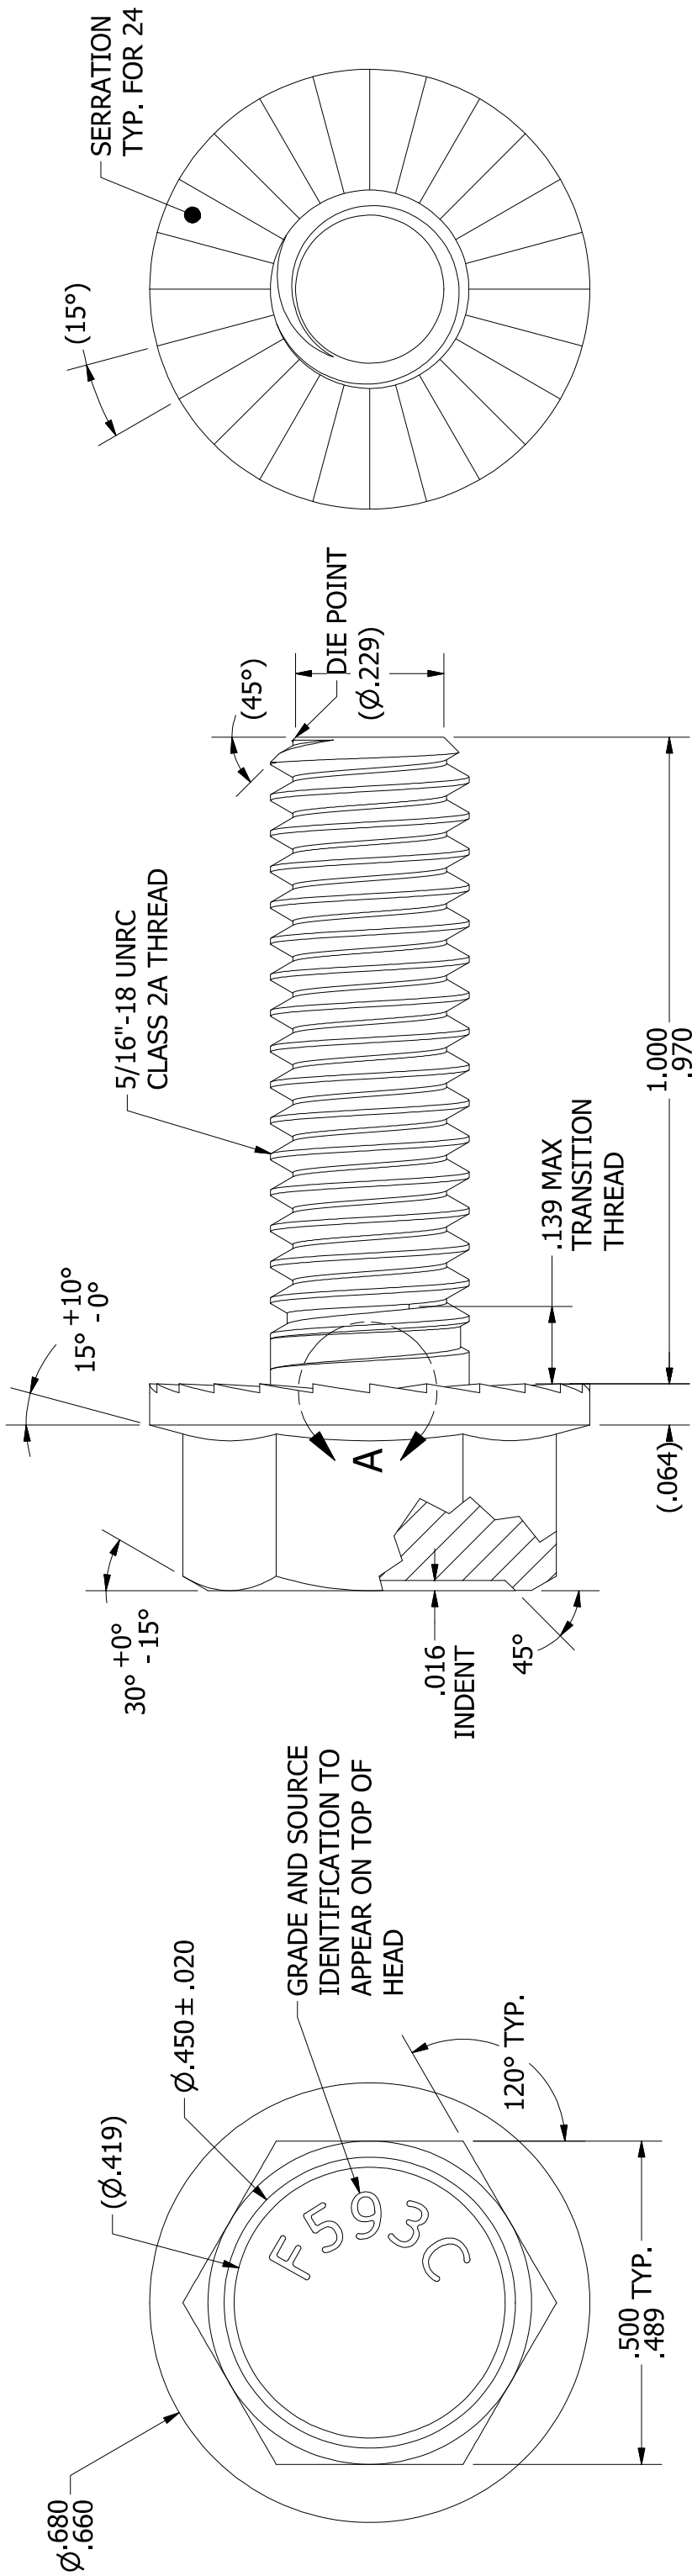

SnapNrack™
Solar Mounting Solutions

Sunrun South LLC
595 MARKET STREET, 20TH FLOOR • SAN FRANCISCO, CA 94105 USA
PHONE (415) 580-6800 • FAX (415) 580-6802
THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.

DESIGNER: G.McPheeters
DRAFTER: E.Hanlon
APPROVED BY: G.McPheeters

SCALE: NTS
DATE: 3/29/2016

PART NUMBER: 162-00120

DESCRIPTION: BOLT, FLANGE, SERRATED, 5/16IN-18 X 1IN, SS

REV A

242-10018 - ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN [REV/A] Default View as of 2026-05-19 Configuration: Released Revisions											
#	Item Revision Record	Revision Letter	Status	Revision Pnning	Change Pending	Quantity	Unit of Measure	Unit Type	Product Type	Attachments	Item Master Record
0.0	242-10018 - ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN [REV/A]	A		false	NU007908 - UR SKU updates		Each	Kit	Roof Attachment,Standoff Kit	242-10018 ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN, REV A 220225.dwg 242-10018 ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN, REV A 220225.pdf 242-10018 SNAPNRACK, ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN, REV A 220225.sdp 242-10018 SNAPNRACK, ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN, REV A 220225.igs	UR-FLMT-8.5 - ULTRA RAIL FLUSH-MOUNT KIT, 8-1/2IN
1.1	232-02544 - SNAPNRACK OMNIBASE [REV/B]	B	Latest	false		1	Each	Compound Part	Roof Attachment,Standoff Base	232-02544 SNAPNRACK, OMNIBASE, REV B 210901.pdf 232-02544 SNAPNRACK, OMNIBASE, REV B 210901.dwg 232-02544 SNAPNRACK, OMNIBASE, REV B 210901.sld	232-02544 - SNAPNRACK OMNIBASE
2.1	232-02543 - SNAPNRACK, OMNIBASE, CASTING [REV/B]	B	Latest	false		1	Each	Component Part	Roof Attachment,Standoff Base	232-02543 SNAPNRACK, OMNIBASE, CASTING, REV B 210901.sdp 232-02543 SNAPNRACK, OMNIBASE, CASTING, AS CAST, REV B 210901.sdp 232-02543 SNAPNRACK, OMNIBASE, CASTING, REV B 210901.dwg	232-02543 - SNAPNRACK, OMNIBASE, CASTING
2.2	162-00120 - BOLT, FLANGE, SERRATED, 5/16IN-18 X 1IN, SS [REV/A]	A	Latest	false		1	Each	Component Part	Mechanical Fastener,Bolt	162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.pdf 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.dwg 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.igs 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.pdf	162-00120 - BOLT, FLANGE, SERRATED, 5/16IN-18 X 1IN, SS
1.2	242-01259 - SNAPNRACK, ULTRA RAIL FLUSH STANDOFF (NO BASE), 8-1/2IN [REV/A]	A	Latest	false		1	Each	Assembly	Vertical Support,Standoff Shaft	242-01259 SNAPNRACK, ULTRA RAIL FLUSH STANDOFF (NO BASE), 8-1/2IN, pdf	242-01259 - SNAPNRACK, ULTRA RAIL FLUSH STANDOFF (NO BASE), 8-1/2IN
2.1	232-01056 - SNAPNRACK, STANDOFF SHAFT, 8-1/2IN [REV/H]	H	Latest	false		1	Each	Component Part	Vertical Support,Standoff Shaft	INSP 232-01056, SNAPNRACK STANDOFF SHAFT 8 1/2IN, STANDARD, REV H 160307.pdf 232-01056, SNAPNRACK STANDOFF SHAFT 8 1/2IN, STANDARD, REV H 160307.igs 232-01056, SNAPNRACK STANDOFF SHAFT 8 1/2IN, STANDARD, REV H 160307.dwg 232-01056, SNAPNRACK STANDOFF SHAFT 8 1/2IN, STANDARD, REV H 160307.pdf	232-01056 - SNAPNRACK, STANDOFF SHAFT, 8-1/2IN
2.3	232-02285 - SNAPNRACK, STANDOFF CLAMP, CLEAR [REV/D]	D	Latest	false		1	Each	Component Part	Vertical Support,Standoff Clamp	232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR, REV D 201030.dwg 232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR, REV D 201030.pdf 232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR, REV D 201030.igs	232-02285 - SNAPNRACK, STANDOFF CLAMP, CLEAR
2.4	232-02468 - SNAPNRACK, ULTRA RAIL MOUNT SPRING CAGE [REV/B]	B	Latest	false		1	Each	Component Part	Vertical Support,Ultra Mount	232-02468 SNAPNRACK, ULTRA RAIL MOUNT SPRING CAGE, REV B 230207.pdf 232-02468 SNAPNRACK, ULTRA RAIL MOUNT SPRING CAGE, REV B 230207.dwg 232-02468 SNAPNRACK, ULTRA RAIL MOUNT SPRING CAGE, REV B 230207.igs 232-02468 SNAPNRACK, ULTRA RAIL MOUNT SPRING CAGE, REV B 230207.sdp	232-02468 - SNAPNRACK, ULTRA RAIL MOUNT SPRING CAGE
2.5	232-02462 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR [REV/A]	A	Latest	false		1	Each	Component Part	Vertical Support,Ultra Mount	232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.dwg INSP - 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 170814 IGS.igs FMEA 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 170814 STP.sdp 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf	232-02462 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR
3.1	232-60006 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR [REV/D]	D	Latest	false		0.001	Each	Component Part	Indirect,Profile	232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR, REV D 180216.igs 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.dwg INSP - 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf FMEA 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf	232-60006 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR
2.6	232-02465 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR [REV/A]	A	Latest	false		1	Each	Component Part	Vertical Support,Ultra Mount	232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.dwg INSP - 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.pdf 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 170814 STP.sdp 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.pdf 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 170814 IGS.igs FMEA 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.pdf	232-02465 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR
3.1	232-60009 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 168IN, CLEAR [REV/D]	D	Latest	false		0.001	Each	Component Part	Indirect,Profile	232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf INSP - 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf FMEA 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.dwg 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 168IN, CLEAR, REV D 180216.igs	232-60009 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 168IN, CLEAR
2.7	232-02467 - SNAPNRACK, ULTRA RAIL MOUNT SPRING, SS [REV/B]	B	Latest	false		1	Each	Component Part	Vertical Support,Ultra Mount	232-02467 SNAPNRACK, ULTRA RAIL MOUNT SPRING, SS, REV B 246013.pdf 232-02467 SNAPNRACK, ULTRA RAIL MOUNT SPRING, SS, REV B 246013.dwg 232-02467 SNAPNRACK, ULTRA RAIL MOUNT SPRING, SS, REV B 246013.sdp	232-02467 - SNAPNRACK, ULTRA RAIL MOUNT SPRING, SS
2.8	165-02200 - WASHER, LOCK, 5/16IN, SPLIT, SS [REV/A]	A	Latest	false		1	Each	Component Part	Mechanical Fastener,Washer	165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.pdf 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.igs 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.dwg INSP - 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.pdf	165-02200 - WASHER, LOCK, 5/16IN, SPLIT, SS
2.9	162-01075 - BOLT, HEX CAP, 5/16IN-18 X 3IN, SS [REV/A]	A	Latest	false		1	Each	Component Part	Mechanical Fastener,Bolt	162-01075 - BOLT, HEX CAP, 5/16IN-18 X 3IN, SS	162-01075 - BOLT, HEX CAP, 5/16IN-18 X 3IN, SS
2.10	232-99016 - SNAPNRACK, BOX, 9 X 9 X 9IN [REV/A]	A	Latest	false		0.05	Each	Component Part		232-99016 - SNAPNRACK, BOX, 9 X 9 X 9 IN	232-99016 - SNAPNRACK, BOX, 9 X 9 X 9 IN
1.3	232-99042 - SNAPNRACK, BOX, 12 X 12 X 9IN [REV/A]	A	Latest	false		0.05	Each	Component Part	Indirect,Packaging	232-99042 - SNAPNRACK, BOX, 12 X 12 X 9 IN	232-99042 - SNAPNRACK, BOX, 12 X 12 X 9 IN
1.4	232-99006 - SNAPNRACK, BAG, 9 X 14IN, POLY, CLEAR [REV/A]	A	Latest	false		0.05	Each	Component Part		232-99006 - SNAPNRACK, BAG, 9 X 14 IN, POLY, CLEAR	232-99006 - SNAPNRACK, BAG, 9 X 14 IN, POLY, CLEAR

UR-TLTMT-14.0 - ULTRA RAIL TILT-MOUNT KIT, 14IN - Default View as of 2026-05-19 - Configuration: Released Revisions							Attachments	
#	Descriptor	Revision	Quantity	Lifecycle	Change Pending	Status		
0.0	UR-TLTMT-14.0 - ULTRA RAIL TILT-MOUNT KIT, 14IN						PROCESS DEVIATION, AP90 L Foot Sub (PRM-30-6103), 250527.pdf	
1.1	242-10021 - ULTRA RAIL TILT-MOUNT KIT, 14IN [REV:A]	A	1	Released	NU007908 - UR SKU updates	Latest	242-10021 SNAPNRACK, ULTRA RAIL TILT-MOUNT KIT, 14IN, REV A 220225.stp	
							242-10021 ULTRA RAIL TILT-MOUNT KIT, 14IN, REV A 220225.dwg 242-10021 ULTRA RAIL TILT-MOUNT KIT, 14IN, REV A 220225.pdf 242-10021 SNAPNRACK, ULTRA RAIL TILT-MOUNT KIT, 14IN, REV A 220225.igs	
2.1	242-92108 - SNAPNRACK, ULTRA RAIL TILT STANDOFF, 14IN (NO BASE) [REV:C]	C	1	Released		Latest	242-92108 SNAPNRACK, ULTRA RAIL TILT STANDOFF, 14IN (NO BASE)_REV C 220428.stp 242-92108 SNAPNRACK, ULTRA RAIL TILT STANDOFF, 14IN (NO BASE)_REV C 220428.dwg 242-92108 SNAPNRACK, ULTRA RAIL TILT STANDOFF, 14IN (NO BASE)_REV C 220428.pdf	
3.1	232-02359 - SNAPNRACK, STANDOFF SHAFT, 14IN [REV:A]	A	1	Released		Latest	232-02359 SNAPNRACK, STANDOFF SHAFT, 14IN, REV A 08212018.pdf 232-02359 SNAPNRACK, STANDOFF SHAFT, 14IN, REV A 08212018.dwg 232-02359 SNAPNRACK, STANDOFF SHAFT, 14IN, REV A 08212018.igs INSP - 232-02359 SNAPNRACK, STANDOFF SHAFT, 14IN, REV A 08212018.pdf 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.pdf 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.dwg 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.igs INSP - 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS, REV A 140116.pdf	
3.2	165-02200 - WASHER, LOCK, 5/16IN, SPLIT, SS [REV:A]	A	1	Released		Latest		
3.3	162-01070 - BOLT, HEX CAP, 5/16IN-18 X 2IN, SS [REV:A]	A	1	Released		Latest		
3.4	232-02285 - SNAPNRACK, STANDOFF CLAMP, CLEAR [REV:D]	D	1	Released		Latest	232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR, REV D 201030.dwg 232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR, REV D 201030.igs 232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR, REV D 201030.pdf	
3.5	163-01050 - NUT, FLANGE, SERRATED, 5/16IN-18, SS [REV:A]	A	1	Released		Latest		
3.6	232-02462 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR [REV:A]	A	1	Released		Latest	232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.dwg 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 170814.igs.igs FMEA 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 170814 STP.stp INSP - 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf	
4.1	232-60006 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR [REV:D]	D	0.001	Released		Latest	232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR, REV A 180822.pdf 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR, REV D 180216.igs INSP - 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.dwg FMEA 232-60009 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf 232-60009 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR, REV C 180821.dwg 232-60009 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR, REV D 180216.igs	
3.7	232-02465 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR [REV:A]	A	1	Released		Latest	232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.dwg 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 170814 STP.stp FMEA 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.pdf INSP - 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.pdf 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 180822.pdf 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR, REV A 170814 IGS.igs	
4.1	232-60009 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 168IN, CLEAR [REV:D]	D	0.001	Released		Latest	232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf INSP - 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf FMEA 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.pdf 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR, REV C 180821.dwg 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 168IN, CLEAR, REV D 180216.igs	
3.8	232-02521 - SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS [REV:A]	A	1	Released		Latest	232-02521 SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS, REV A 200312.dwg 232-02521 SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS, REV A 200312.pdf 232-02521 SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS, REV A 200312.igs	
3.9	162-03252-S - BOLT, SERRATED FLANGE, 5-16IN-18 X 2IN, SS [REV:A]	A	1	Released		Latest	162-03252 BOLT, FLANGE, SERRATED, 5-16IN-18 X 2IN, SS, REV A 200312.igs 162-03252 BOLT, FLANGE, SERRATED, 5-16IN-18 X 2IN, SS, REV A 200312.pdf 162-03252 BOLT, FLANGE, SERRATED, 5-16IN-18 X 2IN, SS, REV A 200312.dwg	
3.10	AP90 L FOOT, STEPPED, CLEAR [REV:D]	D	1	Released		Latest	232-02534 SNAPNRACK, AP90 L FOOT, REV D 241212.pdf 232-02534 SNAPNRACK, AP90 L FOOT, REV D 241212.stp 232-02534 SNAPNRACK, AP90 L FOOT, REV D 241212.igs	
3.11	165-01300 - WASHER, FLAT, 5/16IN X 3/4IN, SS, BULK [REV:A]	A	1	Released		Latest	INSP - 165-01300 5-16IN X 3-4IN SS FLAT WASHER, REV A 140116.pdf 165-01300 5-16IN X 3-4IN SS FLAT WASHER, REV A 140116.pdf 165-01300 5-16IN X 3-4IN SS FLAT WASHER, REV A 140116.igs 165-01300 5-16IN X 3-4IN SS FLAT WASHER, REV A 140116.dwg	
2.2	232-02544 - SNAPNRACK, OMNIBASE [REV:B]	B	1	Released		Latest	232-02544 SNAPNRACK, OMNIBASE, REV B 210901.dwg 232-02544 SNAPNRACK, OMNIBASE, REV B 210901.stp 232-02544 SNAPNRACK, OMNIBASE, REV B 210901.igs	
3.1	232-02543 - SNAPNRACK, OMNIBASE, CASTING [REV:B]	B	1	Released		Latest	232-02543 SNAPNRACK, OMNIBASE, CASTING, REV B 210901.stp 232-02543 SNAPNRACK, OMNIBASE, CASTING, REV B 210901.pdf 232-02543 SNAPNRACK, OMNIBASE, CASTING, AS CAST, REV B 210901.stp 232-02543 SNAPNRACK, OMNIBASE, CASTING, REV B 210901.dwg	
3.2	162-00120 - BOLT, FLANGE, SERRATED, 5/16IN-18 X 1IN, SS [REV:A]	A	1	Released		Latest	162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.pdf 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.dwg 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.igs 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS, REV A 160329.pdf	
2.3	232-99042 - SNAPNRACK, BOX, 12 X 12 X 9 IN [REV:A]	A	0.05	Released		Latest		
2.4	232-99006 - SNAPNRACK, BAG, 9 X 14 IN, POLY, CLEAR [REV:A]	A	0.05	Released		Latest		

UR-TLMT-23.0 - ULTRA RAIL TILT-MOUNT KIT, 23IN Default View as of 2026-05-19 Configuration: Released Revisions							Attachments	
#	Descriptor	Revision	Quantity	Lifecycle	Change Pending	Status		
0.0	UR-TLMT-23.0 - ULTRA RAIL TILT-MOUNT KIT, 23IN						PROCESS DEVIATION, AP90 L Foot Sub (FRM-30-6103)_250627.pdf	
1.1	242-10022 - ULTRA RAIL TILT-MOUNT KIT, 23IN [REV:A]	A	1	Released	NU007908 - UR SKU updates	Latest	242-10022 ULTRA RAIL TILT-MOUNT KIT, 23IN_REV A 220225.pdf 242-10022 SNAPNRACK, ULTRA RAIL TILT-MOUNT KIT, 23IN_REV A 220225.stp 242-10022 SNAPNRACK, ULTRA RAIL TILT-MOUNT KIT, 23IN_REV A 220225.igs	
2.1	232-02544 - SNAPNRACK, OMNIBASE [REV:B]	B	1	Released		Latest	232-02544 SNAPNRACK, OMNIBASE_REV B 210901.dwg 232-02544 SNAPNRACK, OMNIBASE_REV B 210901.stp 232-02544 SNAPNRACK, OMNIBASE_REV B 210901.stp	
3.1	232-02543 - SNAPNRACK, OMNIBASE, CASTING [REV:B]	B	1	Released		Latest	232-02543 SNAPNRACK, OMNIBASE, CASTING_REV B 210901.stp 232-02543 SNAPNRACK, OMNIBASE, CASTING_REV B 210901.pdf 232-02543 SNAPNRACK, OMNIBASE, CASTING_AS CAST_REV B 210901.stp	
3.2	162-00120 - BOLT, FLANGE, SERRATED, 5/16IN-18 X 1IN, SS [REV:A]	A	1	Released		Latest	232-02543 SNAPNRACK, OMNIBASE, CASTING_REV B 210901.dwg 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS_REV A 160329.pdf 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS_REV A 160329.dwg 162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS_REV A 160329.igs	
2.2	242-92109 - SNAPNRACK, ULTRA RAIL TILT STANDOFF, 23IN (NO BASE) [REV:C]	C	1	Released		Latest	162-00120 BOLT, FLANGE, SERRATED, 5-16IN-18 X 1IN, SS_REV A 160329.pdf 242-92109 SNAPNRACK, ULTRA RAIL TILT STANDOFF, 23IN (NO BASE)_REV C 220428.stp 242-92109 SNAPNRACK, ULTRA RAIL TILT STANDOFF, 23IN (NO BASE)_REV C 220428.pdf 242-92109 SNAPNRACK, ULTRA RAIL TILT STANDOFF, 23IN (NO BASE)_REV C 220428.dwg	
3.1	232-02360 - SNAPNRACK, STANDOFF SHAFT, 23IN [REV:A]	A	1	Released		Latest	INSP 232-02360 SNAPNRACK, STANDOFF SHAFT, 23IN_REV A_08212018.pdf 232-02360 SNAPNRACK, STANDOFF SHAFT, 23IN_REV A_08212018.dwg 232-02360 SNAPNRACK, STANDOFF SHAFT, 23IN_REV A_08212018.pdf	
3.2	165-02200 - WASHER, LOCK, 5/16IN, SPLIT, SS [REV:A]	A	1	Released		Latest	232-02360 SNAPNRACK, STANDOFF SHAFT, 23IN_REV A_08212018.igs 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS_REV A 140116.pdf 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS_REV A 140116.igs 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS_REV A 140116.dwg	
3.3	162-01070 - BOLT, HEX CAP, 5/16IN-18 X 2IN, SS [REV:A]	A	1	Released		Latest	INSP - 165-02200 WASHER, LOCK, 5-16IN, SPLIT, SS_REV A 140116.pdf	
3.4	232-02285 - SNAPNRACK, STANDOFF CLAMP, CLEAR [REV:D]	D	1	Released		Latest	232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR_REV D 201030.dwg 232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR_REV D 201030.pdf 232-02285 SNAPNRACK, STANDOFF CLAMP, CLEAR_REV D 201030.igs	
3.5	163-01050 - NUT, FLANGE, SERRATED, 5/16IN-18, SS [REV:A]	A	1	Released		Latest		
3.6	232-02462 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR [REV:A]	A	1	Released		Latest	232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR_REV A 180822.dwg INSP - 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR_REV A 180822.pdf 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR_REV A 170814 IGS.igs FMEA 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR_REV A 180822.pdf	
4.1	232-60006 - SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR [REV:D]	D	0.001	Released		Latest	232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR_REV A 170814 STP.stp 232-02462 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR_REV A 180822.pdf 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 168IN, CLEAR_REV D 180216.igs 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR_REV C 180821.dwg INSP - 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR_REV C 180821.pdf FMEA 232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR_REV C 180821.pdf	
3.7	232-02465 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR [REV:A]	A	1	Released		Latest	232-60006 SNAPNRACK, ULTRA RAIL MOUNT THRU PRC PROFILE, 98IN, CLEAR_REV C 180821.pdf INSP - 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR_REV A 180822.dwg 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR_REV A 170814 STP.stp 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR_REV A 180822.pdf	
4.1	232-60009 - SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 168IN, CLEAR [REV:D]	D	0.001	Released		Latest	232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR_REV A 180822.pdf FMEA 232-02465 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR_REV A 170814 IGS.igs 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR_REV C 180821.pdf INSP - 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR_REV C 180821.pdf FMEA 232-60009 SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC PROFILE, 98IN, CLEAR_REV C 180821.dwg	
3.8	232-02521 - SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS [REV:A]	A	1	Released		Latest	232-02521 SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS_REV A 200312.pdf 232-02521 SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS_REV A 200312.igs 232-02521 SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS_REV A 200312.dwg	
3.9	162-03252-S - BOLT, SERRATED FLANGE, 5-16IN-18 X 2IN, SS [REV:A]	A	1	Released		Latest	162-03252 BOLT, FLANGE, SERRATED, 5-16IN-18 X 2IN, SS_REV A 200312.igs 162-03252 BOLT, FLANGE, SERRATED, 5-16IN-18 X 2IN, SS_REV A 200312.pdf 162-03252 BOLT, FLANGE, SERRATED, 5-16IN-18 X 2IN, SS_REV A 200312.dwg	
3.10	232-02534S - SNAPNRACK, AP90 L FOOT, STEPPED, CLEAR [REV:D]	D	1	Released		Latest	232-02534 SNAPNRACK, AP90 L FOOT_REV D 241212.stp 232-02534 SNAPNRACK, AP90 L FOOT_REV D 241212.pdf	
3.11	165-01300 - WASHER, FLAT, 5/16IN X 3/4IN, SS, BULK [REV:A]	A	1	Released		Latest	165-01300 5-16IN X 3-4IN SS FLAT WASHER_REV A 140116.igs INSP - 165-01300 5-16IN X 3-4IN SS FLAT WASHER_REV A 140116.pdf 165-01300 5-16IN X 3-4IN SS FLAT WASHER_REV A 140116.dwg	
2.3	232-99042 - SNAPNRACK, BOX, 12 X 12 X 9 IN [REV:A]	A	0.05	Released		Latest		
2.4	232-99006 - SNAPNRACK, BAG, 9 X 14 IN, POLY, CLEAR [REV:A]	A	0.05	Released		Latest		

TEST REPORT FOR SNAPNRACK

Report No.: T6065.01-301-18 (R0)

Date: 05/21/26

SECTION 13

REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	05/21/26	N/A	Original Report Issue