

1. STANDARD GLAZING OPTION - .125"
MINIMUM DSB GLAZING MEETS UNIFORM STATIC
DESIGN PRESSURES SHOWN ON THIS DRAWING.
GLAZING SHALL HAVE A MAXIMUM HEIGHT OF
6.70" AND A MAXIMUM LENGTH OF 24.00".
GLAZING IS NOT IMPACT RESISTANT AND DOES
NOT MEET THE REQUIREMENTS FOR
WIND-BORNE DEBRIS REGIONS.

2. ALUMINUM FULL VIEW OPTION - ALUMINUM FULL VIEW SECTION MAY REPLACE ANY SECTION EXCEPT TOP AND BOTTOM PANELS. ALUMINUM FULL VIEW SECTION SHALL HAVE RAILS AND STILES OF EXTRUDED ALUMINUM ALLOY 6063-T6 WITH A 2-1/4" INTEGRAL FIN AND .125" MINIMUM DSB GLAZING INSTALLED WITH ALUMINUM RETAINERS IN ORDER TO MEET UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. AFV PANEL SIZE IS 45.5"x21.9" (MAX). GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

3. MINIMUM OF 1" OVERLAP ON BOTH JAMBS
REQUIRED TO MEET NEGATIVE DESIGN
PRESSURES.

4. SLIDE LOCKS REQUIRED.

5. SECTION STEEL TO HAVE THE FOLLOWING
MINIMUM THICKNESS:
401, 402 - 20 GA
403, 404 - 24 GA
405, 406 - 25 GA

6. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

7. TRACK CLIPS SHALL BE LOCATED WITH CENTERLINE OF BOTTOM CLIP SPACED 10" MAX FROM BOTTOM OF TRACK AND REMAINING TRACK CLIPS SPACED AT 24" O.C. MAX. SPACING BETWEEN TOP TRACK CLIP AND SPLICE PLATE SHALL BE 30" O.C. MAX.

8. WHEN MOUNTING TO WOOD, DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.

13 GA HORIZ ANGLE

15 GA MIN HORIZ TRACK

13 GA CONTINUOUS WALL ANGLE

15 GA MIN VERT TRACK

5/16"x1-5/8"
LAG SCREW AT EACH
HOLE LOCATION FOR
WOOD SUBSTRATE. SEE
SHEET 3 FOR MOUNTING
TO OTHER SUBSTRATES.

1/4-20x9/16" TRACK
BOLT AND 1/4-20 HEX
NUT AT EACH TRACK
CLIP LOCATION
(SEE DETAIL A SHEET 2)

11 GA TRACK CLIPS
(WELDED, BOLTED, OR
RIVETED TO WALL
ANGLE) SEE NOTE 7 AND
DETAIL F SHEET 2


SLIDE LOCK BOTH ENDS

NOTE: (4) SECTION SOLID DOOR SHOWN. SEE SHEET 2 FOR U-BAR LOCATIONS ON DOORS WITH OTHER SECTION QUANTITIES AND SEE NOTES 1 & 2 THIS SHEET FOR GLAZING OPTIONS.


COMPLIES WITH THE REQUIREMENTS OF IBC/IRC 2024.
COMPLIES WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE		
MAX DOOR WIDTH	DOOR HEIGHT	MAX UNIFORM LOAD EACH JAMB (PLF)
14'-2"	ALL	+80.8/-90.0

STATIC PRESSURE RATINGS	APPROVED SIZES
DESIGN PRESSURE(PSF): +11.4/-12.7	MAX WIDTH: 14'-2"
	MAX HEIGHT: 24'-1"
IMPACT/CYCLIC RATED: NO	MAX SECTION HEIGHT: 24"

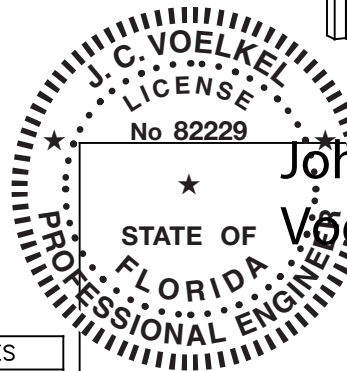


J. CHRISTIAN VDELKEL, PE
407 Navarre Street
Gulf Breeze, FL 32561
FL PE 82229
TX PE 133174

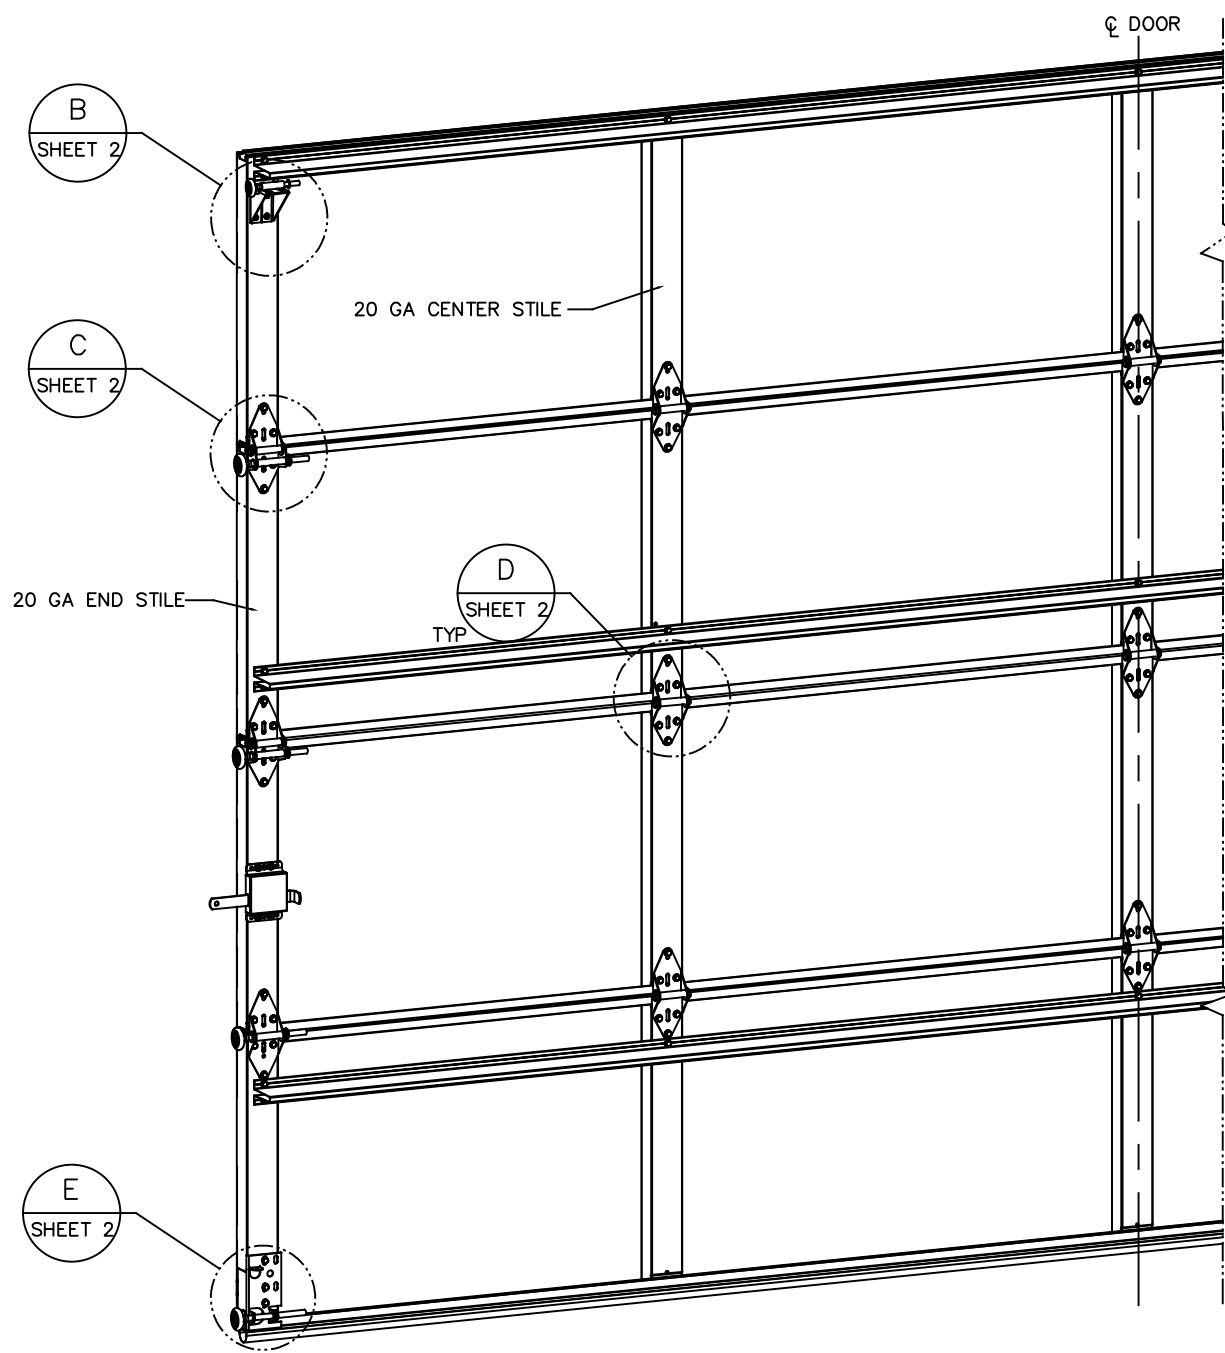

REVISIONS				
ER	REV	DESCRIPTION	DATE	APPROVAL
WL020	-	INITIAL DRAWING	1/29/26	SW
WL020	A	ADDED FBC NOTE	6/30/26	RW

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.

[illegible]

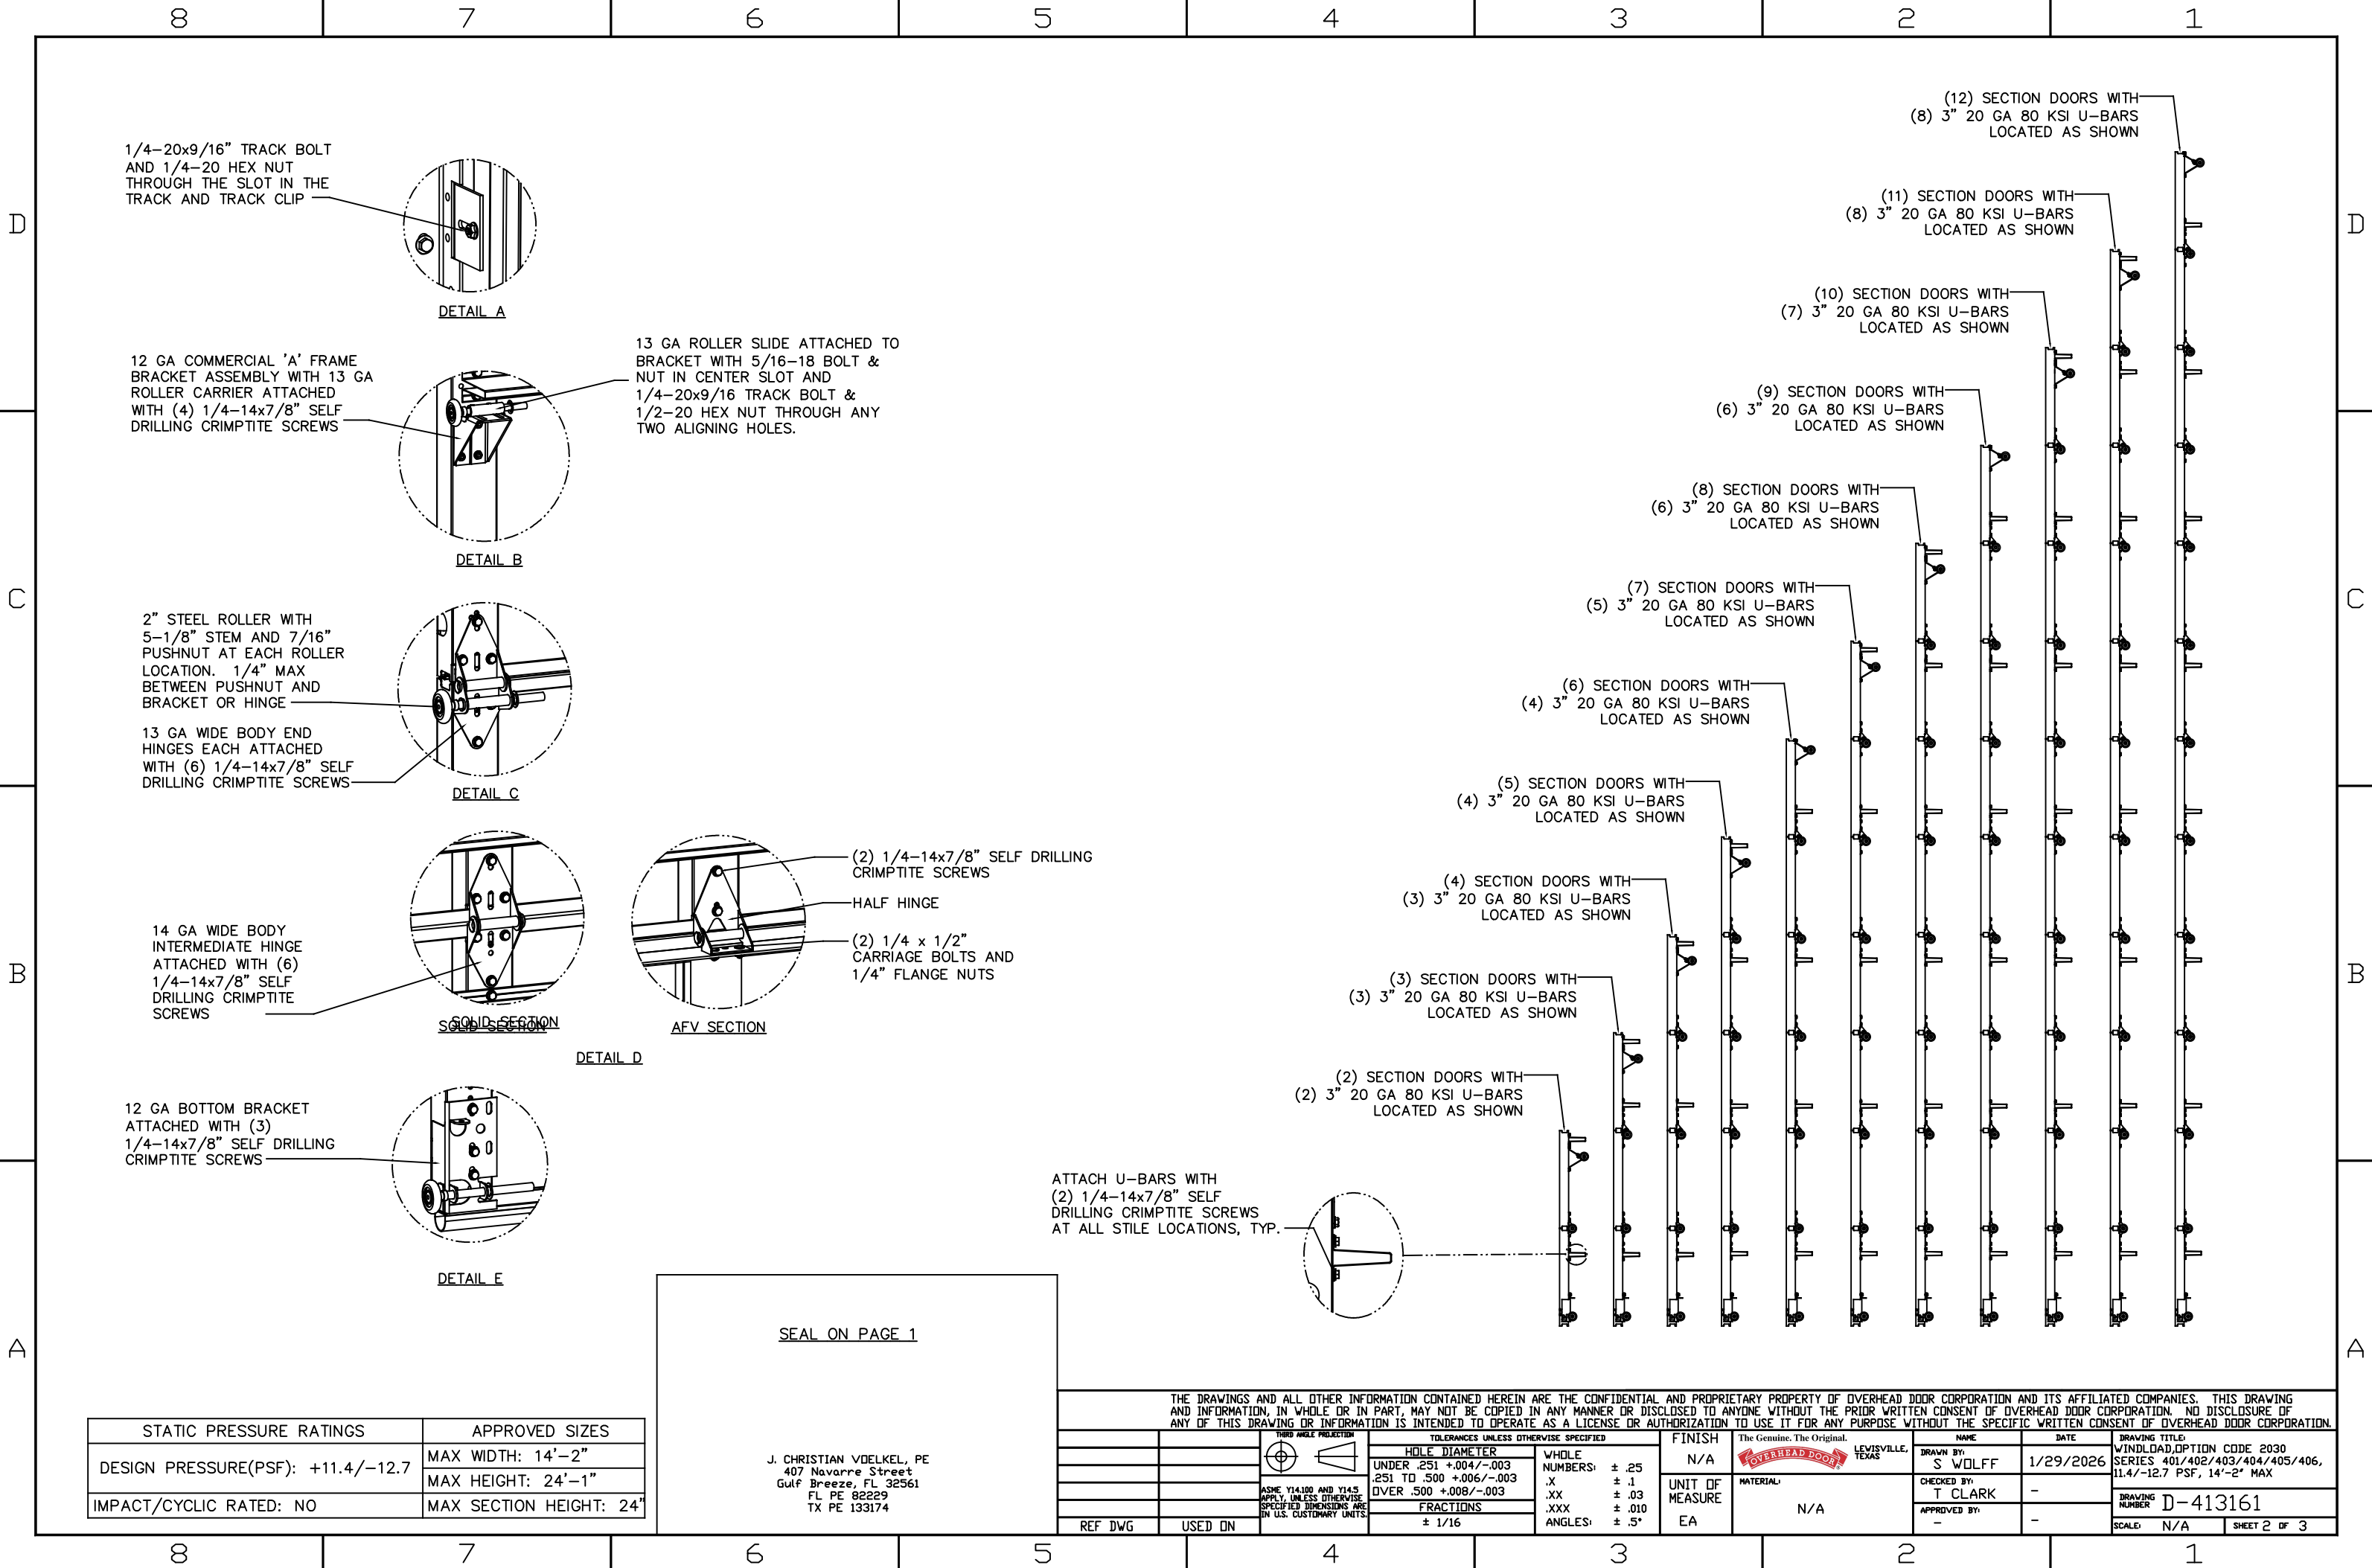

D

C

B


A

D








C

B

A

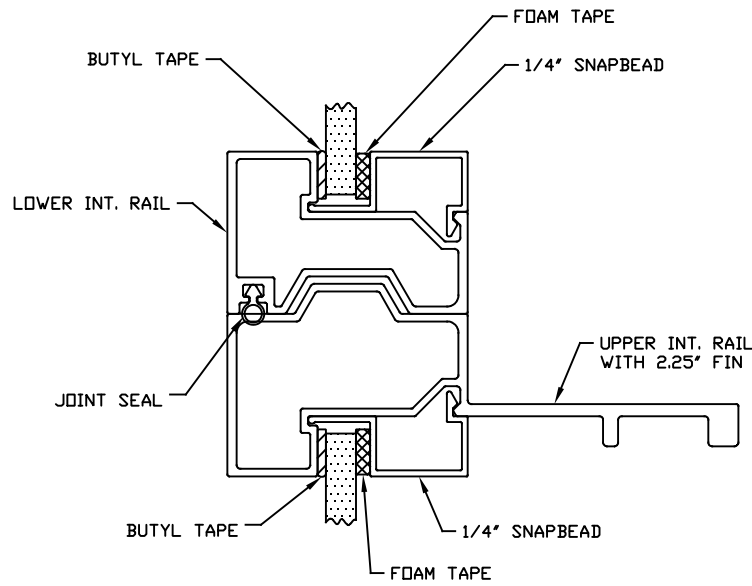

ALUMINUM FULL VIEW FRAME

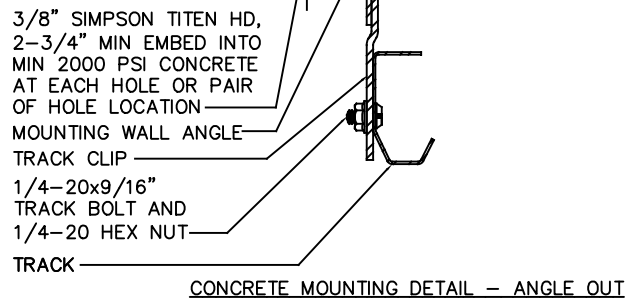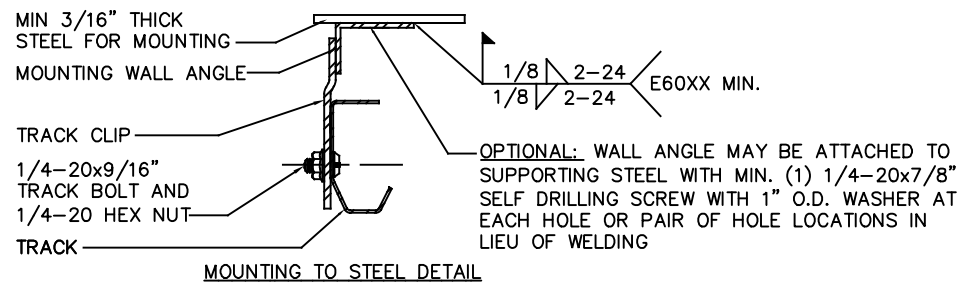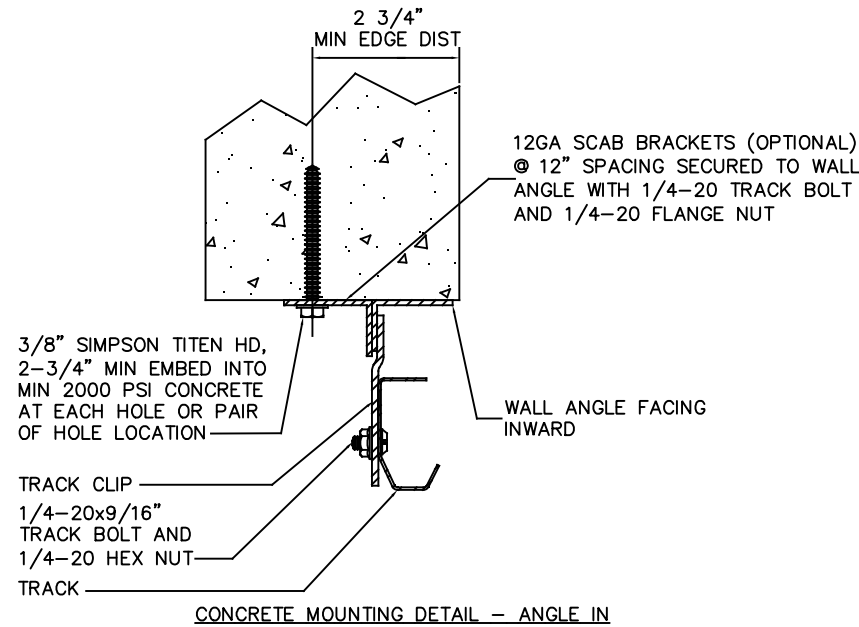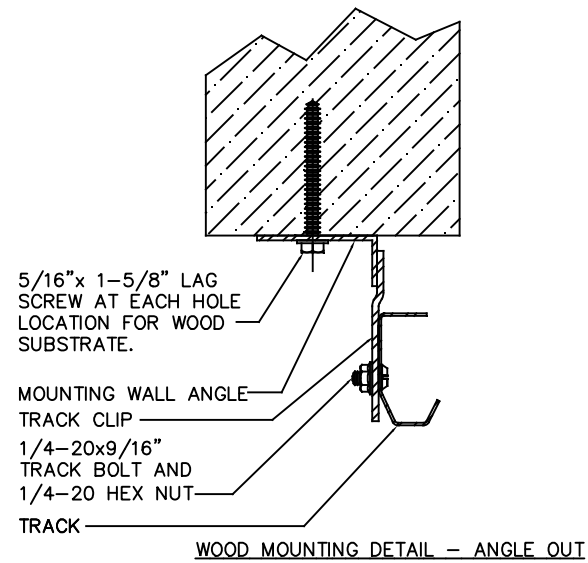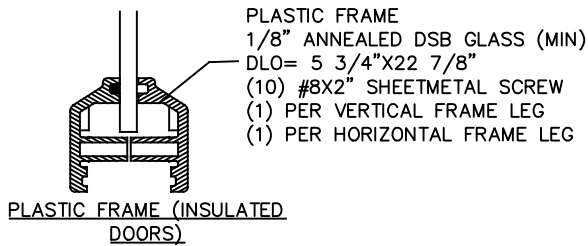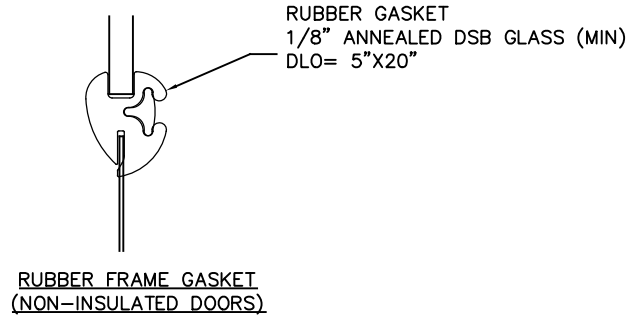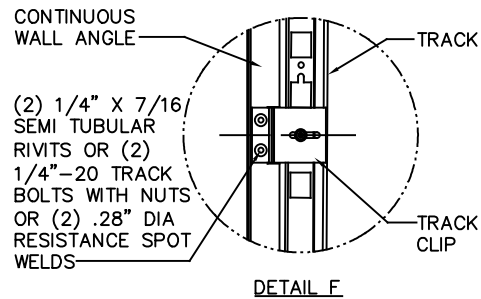

SEAL ON PAGE 1

J. CHRISTIAN VDEKEL, PE
407 Navarre Street
Gulf Breeze, FL 32561
FL PE 82229
TX PE 133174

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.											
TOLERANCES UNLESS OTHERWISE SPECIFIED				FINISH		The Genuine. The Original.		NAME		DATE	
HOLE DIAMETER				N/A		OVERHEAD DOOR		S WOLFF		1/29/2026	
UNDER .251 +.004/--.003				.X		LEWISVILLE, TEXAS		DRAWN BY:		DRAWING TITLE:	
.251 TO .500 +.006/--.003				.XX		MATERIAL:		CHECKED BY:		SERIES 401/402/403/404/405/406, 11.4/-12.7 PSF, 14'-2" MAX	
OVER .500 +.008/--.003				.XXX		N/A		T CLARK		DRAWING NUMBER	
FRACTIONS				UNIT OF MEASURE				APPROVED BY:		D-413161	
± 1/16				EA				-		SCALE: N/A	
THIRD ANGLE PROJECTION				ANGLES: ± .5°						SHEET 3 OF 3	
REF DWG		USED ON									