

▷ NOTES

NOTES:

1. STANDARD GLAZING OPTION - .125" MINIMUM DSB GLAZING MEETS UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. GLAZING SHALL HAVE A MAXIMUM HEIGHT OF 6.70" AND A MAXIMUM LENGTH OF 24.00". GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

2. ALUMINUM FULL VIEW OPTION – ALUMINUM FULL VIEW SECTION MAY REPLACE ANY SECTION EXCEPT TOP AND BOTTOM PANELS. ALUMINUM FULL VIEW SECTION SHALL HAVE RAILS AND STILES OF EXTRUDED ALUMINUM ALLOY 6063-T6 AND .125" MINIMUM DSB GLAZING INSTALLED WITH ALUMINUM RETAINERS IN ORDER TO MEET UNIFORM STATIC DESIGN PRESSURES SHOWN ON THIS DRAWING. AFV PANEL SIZE IS 51.5"x21.9" (MAX). GLAZING IS NOT IMPACT RESISTANT AND DOES NOT MEET THE REQUIREMENTS FOR WIND-BORNE DEBRIS REGIONS.

3. MINIMUM OF 1" OVERLAP ON BOTH JAMBS
REQUIRED TO MEET NEGATIVE DESIGN
PRESSURES.

4. SLIDE LOCKS REQUIRED.

5. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:

401, 402 – 20 GA
403, 404 – 24 GA
405, 406 – 25 GA

6. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.


7. TRACK CLIPS SHALL BE LOCATED WITH CENTERLINE OF BOTTOM CLIP SPACED 10" MAX FROM BOTTOM OF TRACK AND REMAINING TRACK CLIPS SPACED AT 24" O.C. MAX. SPACING BETWEEN TOP TRACK CLIP AND SPLICE PLATE SHALL BE 30" O.C. MAX.

8. WHEN MOUNTING TO WOOD, DOOR JAMB TO BE MINIMUM 2x6 STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT TO SUPPORTING STRUCTURE.


SUPERIMPOSED DESIGN PRESSURE
LOADS ON SUPPORTING STRUCTURE

MAX DOOR WIDTH	DOOR HEIGHT	MAX UNIFORM LOAD EACH JAMB (PLF)
9'-4"	ALL	+73.9/-84.6

STATIC PRESSURE RATINGS	APPROVED SIZES
DESIGN PRESSURE(PSF): +15.9/-18.2	MAX WIDTH: 9'-4"
	MAX HEIGHT: 24'-1"
IMPACT/CYCLIC RATED: NO	MAX SECTION HEIGHT: 24'

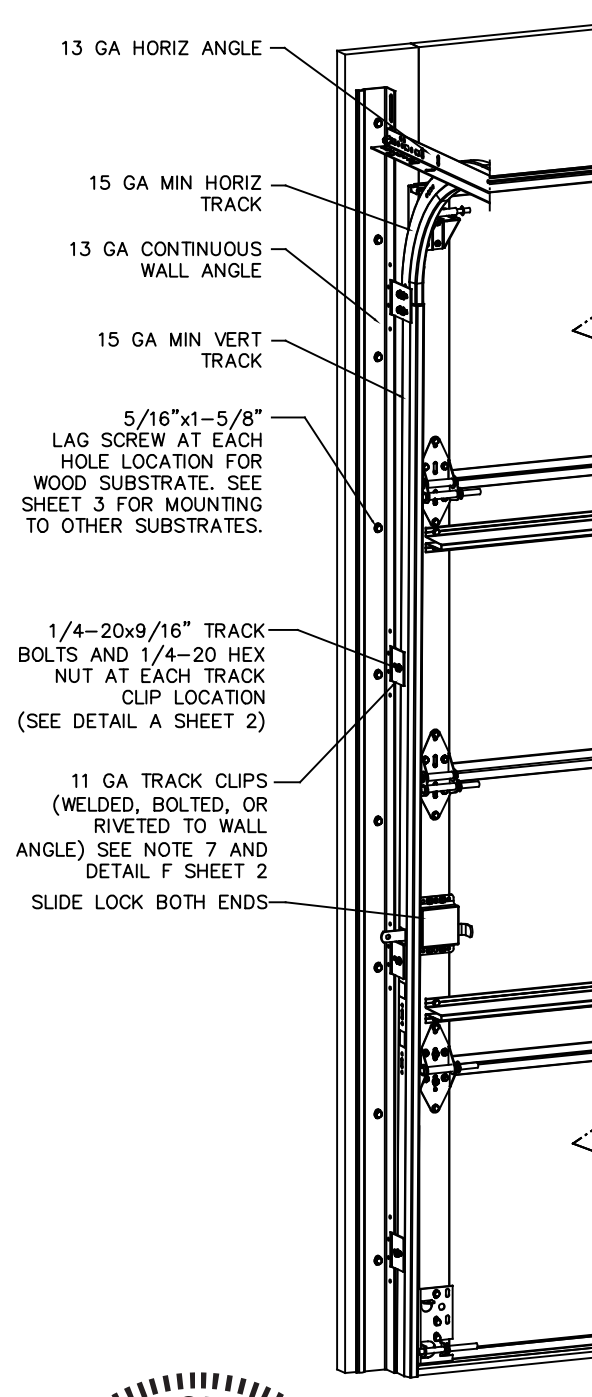


NOTE: (4) SECTION SOLID DOOR SHOWN. SEE SHEET 2 FOR U-BAR LOCATIONS ON DOORS WITH OTHER SECTION QUANTITIES AND SEE NOTES 1 & 2 THIS SHEET FOR GLAZING OPTIONS.

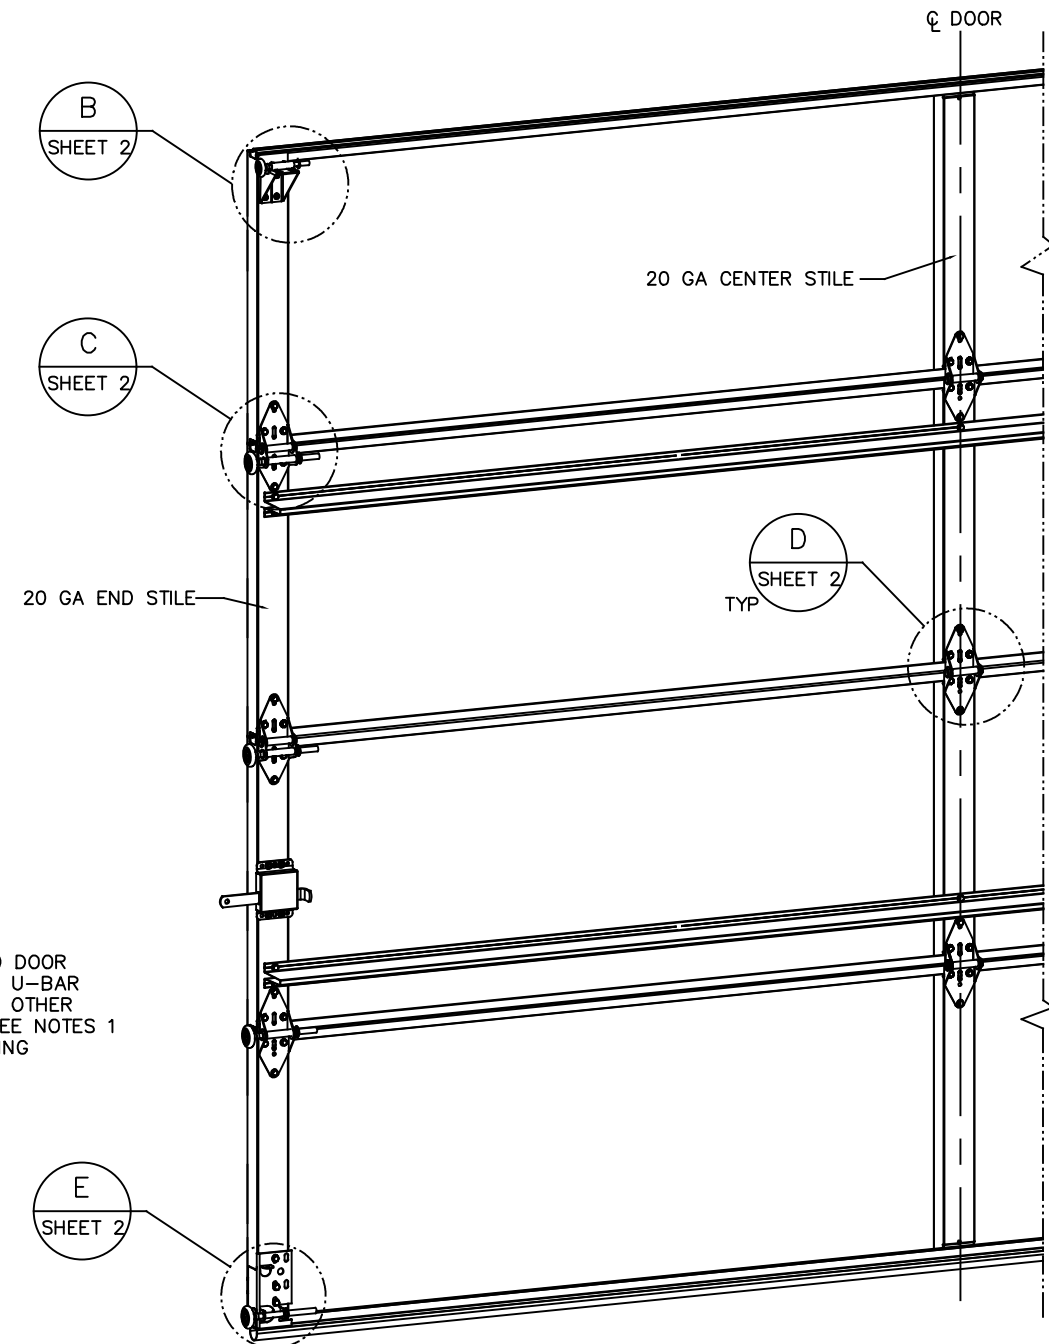

REVISIONS				
ER	REV	DESCRIPTION	DATE	APPROVAL
WL020	-	INITIAL DRAWING	1/29/26	SW
WL020	A	ADDED FBC NOTE	6/30/26	TC

Digitally signed
by John Voelkel
Date: 2026.07.10
16:03:30 -05'00'

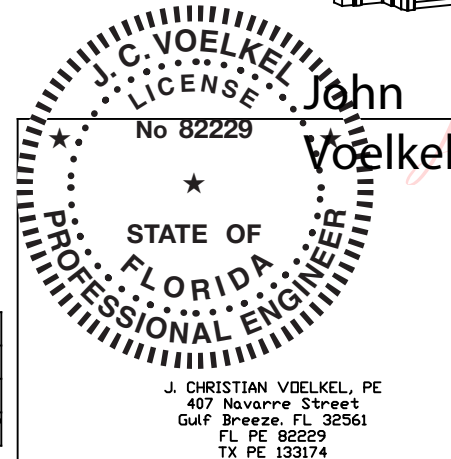

COMPLIES WITH THE REQUIREMENTS OF IBC/IRC 2024.
COMPLIES WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE.

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.

REF DWG		USED ON			TOLERANCES UNLESS OTHERWISE SPECIFIED HOLE DIAMETER UNDER .251 +.004/--.003 .251 TO .500 +.006/--.003 OVER .500 +.008/--.003 FRACTIONS ± 1/16 WHOLE NUMBERS: .X ± .1 .XX ± .03 .XXX ± .010 ANGLES: ± .5°		FINISH N/A UNIT OF MEASURE EA		The Genuine. The Original.  LEVISTVILLE, TEXAS MATERIAL: N/A		NAME DRAWN BY: S WOLFF CHECKED BY: T CLARK APPROVED BY: -		DATE 1/29/2026		DRAWING TITLE: WINDOW/DOOR OPTION CODE 2061 SERIES 401/402/403/404/405/406, 15.9"-18.2 PSF, 9'-4" MAX DRAWING NUMBER D-413144 SCALE: N/A SHEET 1 OF 3	
---------	--	---------	---	--	--	--	--	--	--	--	---	--	-------------------	--	--	--

D

C

B

A


D

C

B


A

1/4-20x9/16" TRACK BOLT
AND 1/4-20 HEX NUT
THROUGH THE SLOT IN THE
TRACK AND TRACK CLIP




DETAIL A

12 GA COMMERCIAL 'A' FRAME
BRACKET ASSEMBLY WITH 13 GA
ROLLER CARRIER ATTACHED
WITH (4) 1/4-14x7/8" SELF
DRILLING CRIMPTITE SCREWS




DETAIL B

2" STEEL ROLLER WITH
5-1/8" STEM AND 7/16"
PUSHNUT AT EACH ROLLER
LOCATION. 1/4" MAX
BETWEEN PUSHNUT AND
BRACKET OR HINGE




DETAIL C

14 GA WIDE BODY END
HINGE TO ATTACH SECTIONS
ONE AND TWO.
13 GA WIDE BODY END
HINGE TO ATTACH
REMAINING SECTIONS. FOR
ALL, ATTACH WITH (6)
1/4-14x7/8" SELF DRILLING
CRIMPTITE SCREWS





DETAIL D

14 GA WIDE BODY
INTERMEDIATE HINGE
ATTACHED WITH (6)
1/4-14x7/8" SELF
DRILLING CRIMPTITE
SCREWS



DETAIL E

13 GA ROLLER SLIDE ATTACHED TO
BRACKET WITH 5/16-18 BOLT &
NUT IN CENTER SLOT AND
1/4-20x9/16 TRACK BOLT &
1/2-20 HEX NUT THROUGH ANY
TWO ALIGNING HOLES.



AFV SECTION


(2) 1/4-14x7/8" SELF DRILLING
CRIMPTITE SCREWS

HALF HINGE

(2) 1/4 x 1/2"
CARRIAGE BOLTS AND
1/4" FLANGE NUTS




12 GA BOTTOM BRACKET
ATTACHED WITH (3)
1/4-14x7/8" SELF DRILLING
CRIMPTITE SCREWS



DETAIL E

ATTACH U-BARS WITH
(2) 1/4-14x7/8" SELF
DRILLING CRIMPTITE SCREWS
AT ALL STILE LOCATIONS, TYP.



(12) SECTION DOORS WITH
(4) 3" 20 GA 80 KSI U-BARS
(4) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(11) SECTION DOORS WITH
(3) 3" 20 GA 80 KSI U-BARS
(4) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(10) SECTION DOORS WITH
(3) 3" 20 GA 80 KSI U-BARS
(3) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(9) SECTION DOORS WITH
(3) 3" 20 GA 80 KSI U-BARS
(3) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(8) SECTION DOORS WITH
(2) 3" 20 GA 80 KSI U-BARS
(3) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(7) SECTION DOORS WITH
(2) 3" 20 GA 80 KSI U-BARS
(2) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(6) SECTION DOORS WITH
(2) 3" 20 GA 80 KSI U-BARS
(2) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(5) SECTION DOORS WITH
(1) 3" 20 GA 80 KSI U-BARS
(2) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(4) SECTION DOORS WITH
(1) 3" 20 GA 80 KSI U-BARS
(1) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN


(3) SECTION DOORS WITH
(1) 3" 20 GA 80 KSI U-BARS
(1) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(2) SECTION DOORS WITH
(1) 2" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

SEAL ON PAGE 1

J. CHRISTIAN VDEKEL, PE
407 Navarre Street
Gulf Breeze, FL 32561
FL PE 82229
TX PE 133174

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.



TOLERANCES UNLESS OTHERWISE SPECIFIED	
HOLE DIAMETER	WHOLE NUMBERS: ± .25
UNDER .251 +.004/- .003	.X ± .1
.251 TO .500 +.006/- .003	.XX ± .03
OVER .500 +.008/- .003	.XXX ± .010
FRACTIONS	ANGLES: ± .5°
± 1/16	

FINISH	N/A
UNIT OF MEASURE	EA








MATERIAL	N/A
----------	-----

NAME	LEWISVILLE, TEXAS
DATE	1/29/2026

DRAWN BY	S WOLFF
CHECKED BY	T CLARK
APPROVED BY	-

DRAWING TITLE	WINDLOAD/OPTION CODE 2061
SERIES	401/402/403/404/405/406, 15.9/-18.2 PSF, 9'-4" MAX
DRAWING NUMBER	D-413144
SCALE	N/A
SHEET	2 OF 3

STATIC PRESSURE RATINGS	APPROVED SIZES
DESIGN PRESSURE(PSF): +15.9/-18.2	MAX WIDTH: 9'-4"
	MAX HEIGHT: 24'-1"
IMPACT/CYCLIC RATED: NO	MAX SECTION HEIGHT: 24"

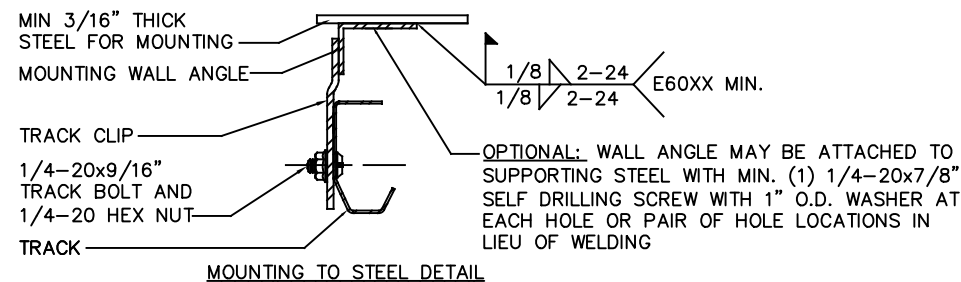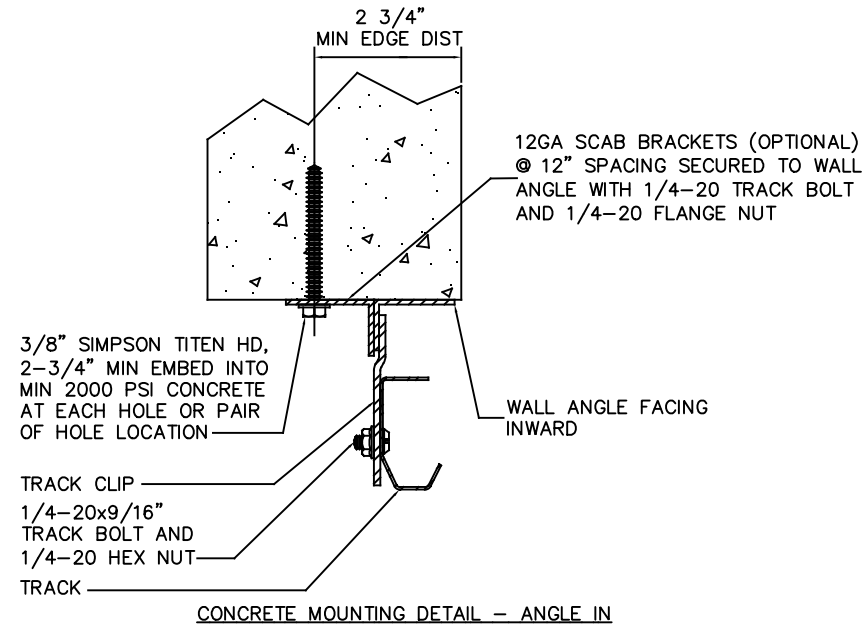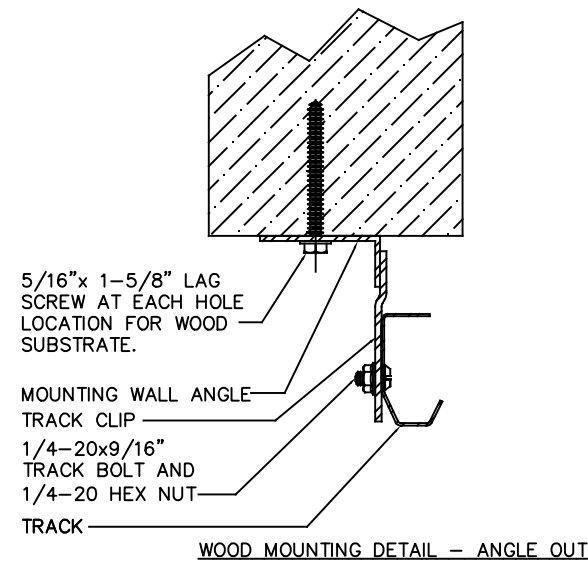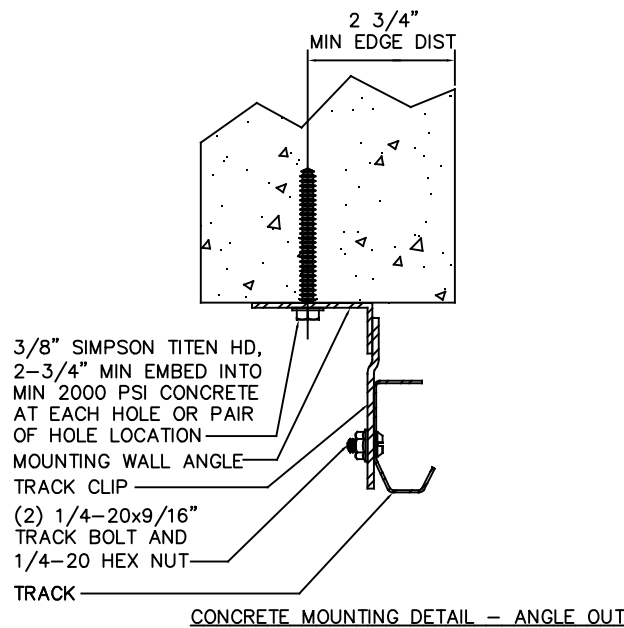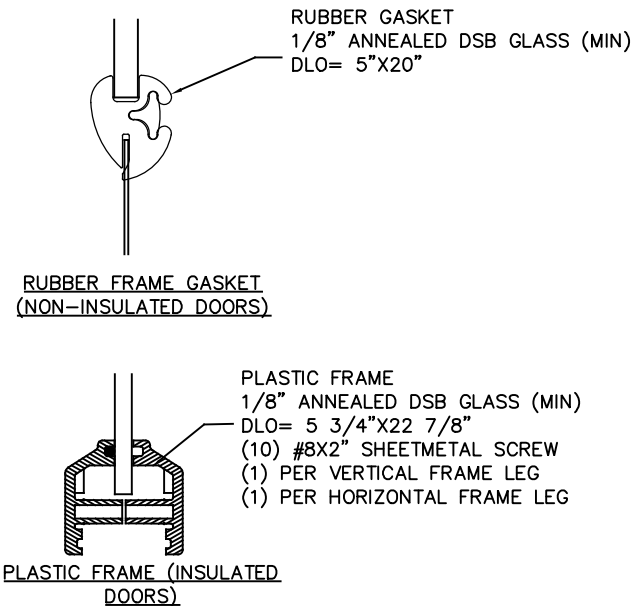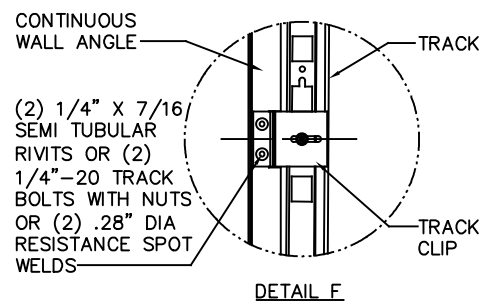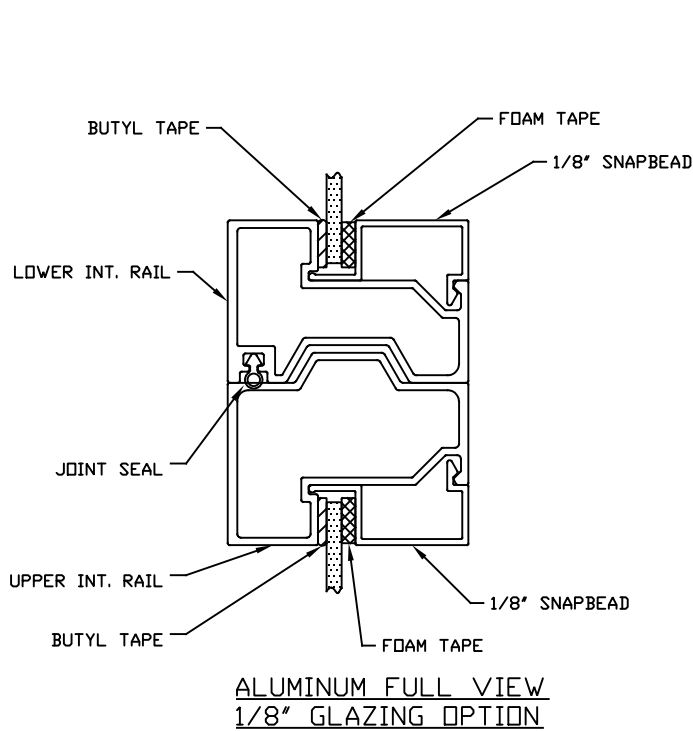

STATIC PRESSURE RATINGS	APPROVED SIZES
DESIGN PRESSURE(PSF): +15.9/-18.2	MAX WIDTH: 9'-4"
	MAX HEIGHT: 24'-1"
IMPACT/CYCLIC RATED: NO	MAX SECTION HEIGHT: 24"

SEAL ON PAGE 1

J. CHRISTIAN VDELKEL, PE
407 Navarre Street
Gulf Breeze, FL 32561
FL PE 82229
TX PE 133174

THE DRAWINGS AND ALL OTHER INFORMATION CONTAINED HEREIN ARE THE CONFIDENTIAL AND PROPRIETARY PROPERTY OF OVERHEAD DOOR CORPORATION AND ITS AFFILIATED COMPANIES. THIS DRAWING AND INFORMATION, IN WHOLE OR IN PART, MAY NOT BE COPIED IN ANY MANNER OR DISCLOSED TO ANYONE WITHOUT THE PRIOR WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION. NO DISCLOSURE OF ANY OF THIS DRAWING OR INFORMATION IS INTENDED TO OPERATE AS A LICENSE OR AUTHORIZATION TO USE IT FOR ANY PURPOSE WITHOUT THE SPECIFIC WRITTEN CONSENT OF OVERHEAD DOOR CORPORATION.									
TOLERANCES UNLESS OTHERWISE SPECIFIED		FINISH		The Genuine. The Original.		NAME		DATE	
HOLE DIAMETER		N/A		OVERHEAD DOOR		LEWISVILLE, TEXAS		1/29/2026	
UNDER .251 +.004/--.003	WHOLE NUMBERS: ± .25	UNIT OF MEASURE		MATERIAL		DRAWN BY: S WOLFF		DRAWING TITLE: WINDLOAD/OPTION CODE 2061	
.251 TO .500 +.006/--.003	.X ± .1	EA		N/A		CHECKED BY: T CLARK		SERIES 401/402/403/404/405/406, 15.9/-18.2 PSF, 9'-4" MAX	
OVER .500 +.008/--.003	.XX ± .03					APPROVED BY: -		DRAWING NUMBER D-413144	
FRACTIONS									
± 1/16	.XXX ± .010							SCALE: N/A	
THIRD ANGLE PROJECTION									
REF DWG	USED ON							SHEET 3 OF 3	