




250 Staunton Turnpike, Parkersburg, WV 26104

9700 Series
Vinyl Fixed Window
w/ Nailing Fin
"NON-IMPACT"

GENERAL NOTES


1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Horizontal cross sections
3	Buck & frame anchoring
4	Bill of materials, components and glazing details

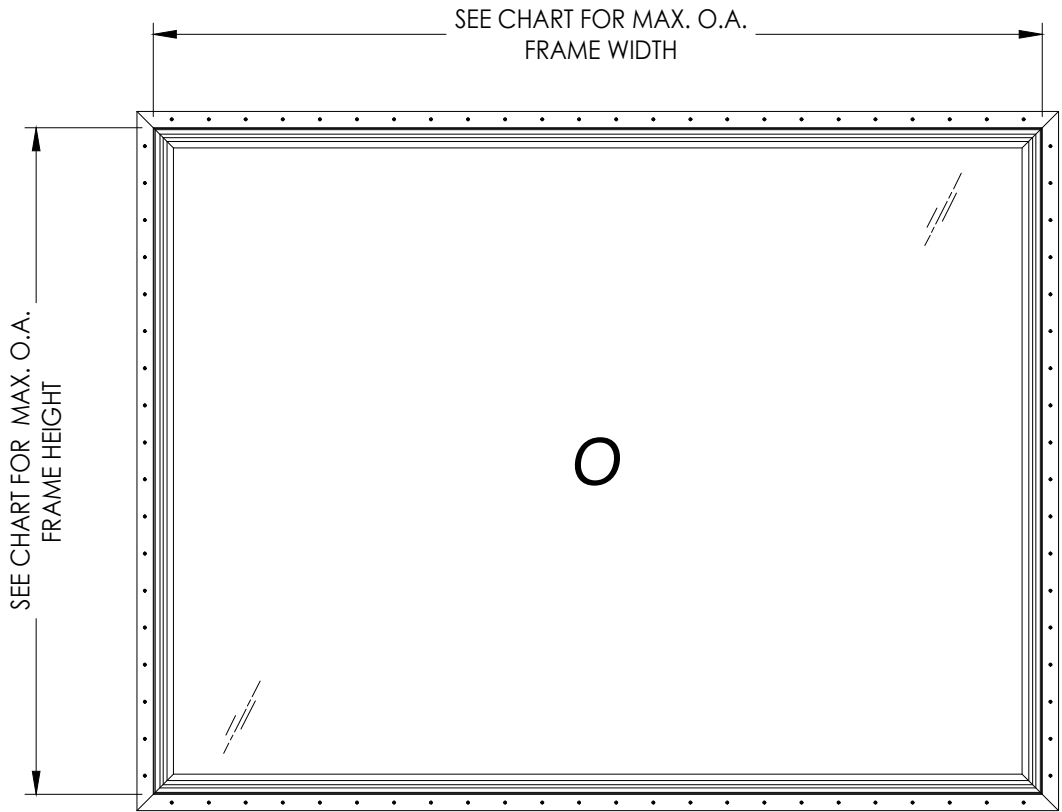

NOTE: HORIZONTAL OR VERTICAL ORIENTATION IS ALLOWED

MAX. FRAME DIMENSION	MAX. D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
58.0" X 48.0"	53.63" X 43.63"	G1	+60.0	-60.0
74.0" X 63.0"	69.63" X 58.63"	G2	+60.0	-60.0
86.0" X 56.0"	81.63" X 51.63"	G2	+60.0	-60.0
96.0" X 72.0"	91.63" X 67.63"	G3	+60.0	-65.0

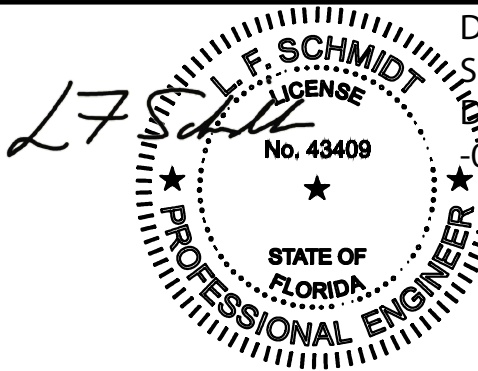

Digitally signed by Lyndon F Schmidt
Date: 2026.08.17 11:56:36
-04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

9700 SERIES
VINYL FIXED WINDOW

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES



DATE: 6/18/26
SCALE: N.T.S.
DWG. BY: LFS
CHK. BY: RW
DRAWING NO.: FL-48286.3
SHEET 1 OF 4

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


REVISIONS

© 2026 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Wincore Window Company\FL-48286\FL-48286.3.dwg

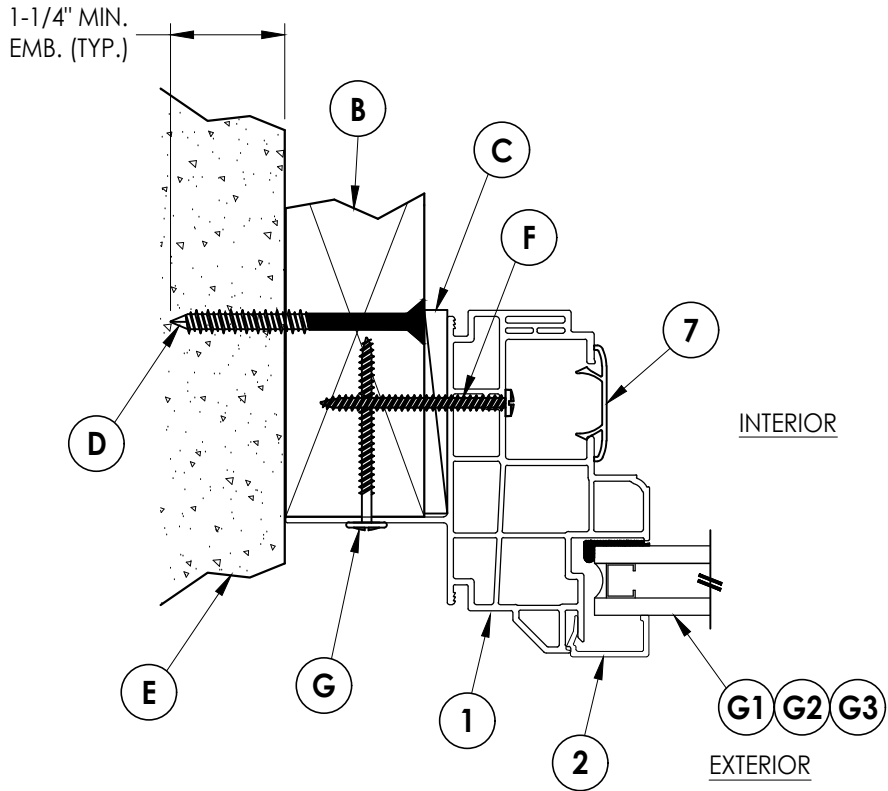
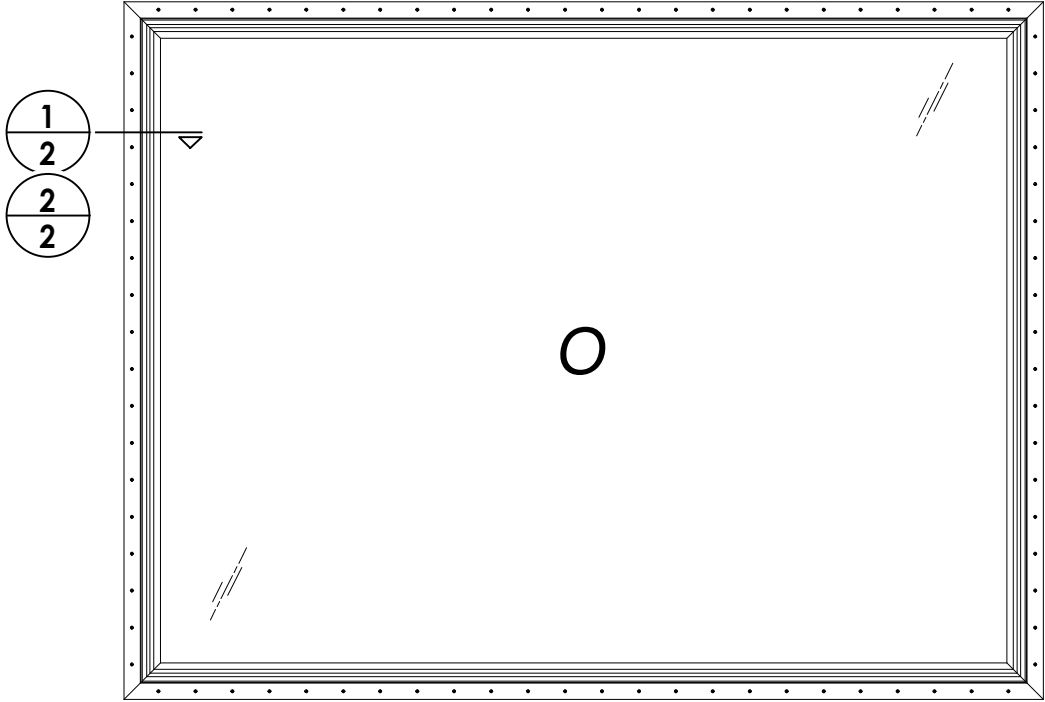


1 HORIZONTAL CROSS SECTION
2 Shown w/ 2X Buck Construction

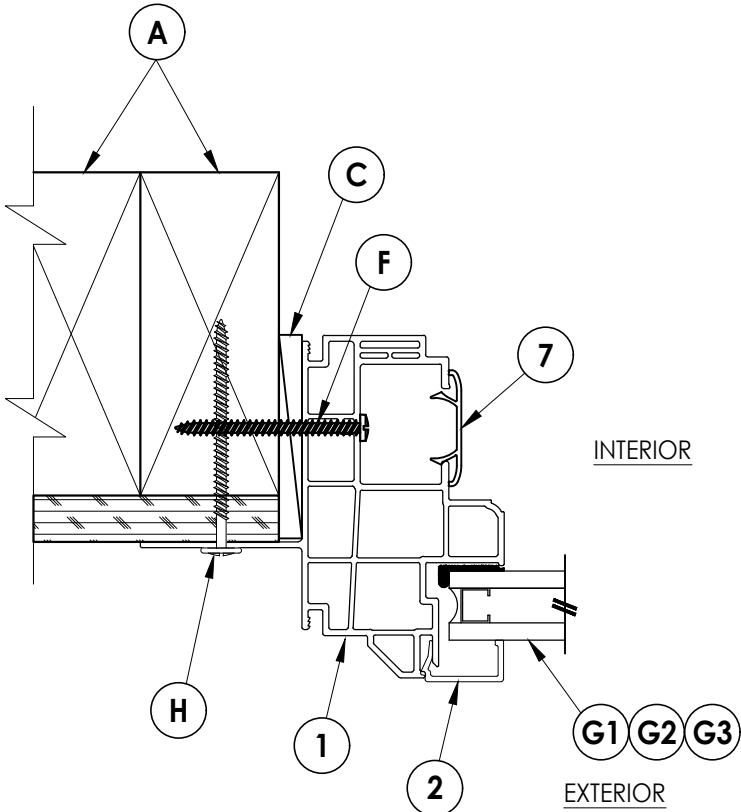

2 HORIZONTAL CROSS SECTION
2 Shown w/ Stud Construction

DATE: 6/24/26				BUILDING CONSULTANTS, INC.			
SCALE: N.T.S.				P.O. Box 230, Valrico, FL 33595			
DWG. BY: LFS				Phone No.: 813.659.9197			
CHK. BY: RW				FBPE Registry No. 9813			
DRAWING NO.: FL-48286.3				RW			
SHEET 2 OF 4				PART OR ASSEMBLY:			
				HORIZONTAL			
				CROSS SECTIONS			
				9700 SERIES			
				VINYL FIXED WINDOW			
				Documents Prepared By:			
				Lyndon F. Schmidt			
				P.E. No. 43409			

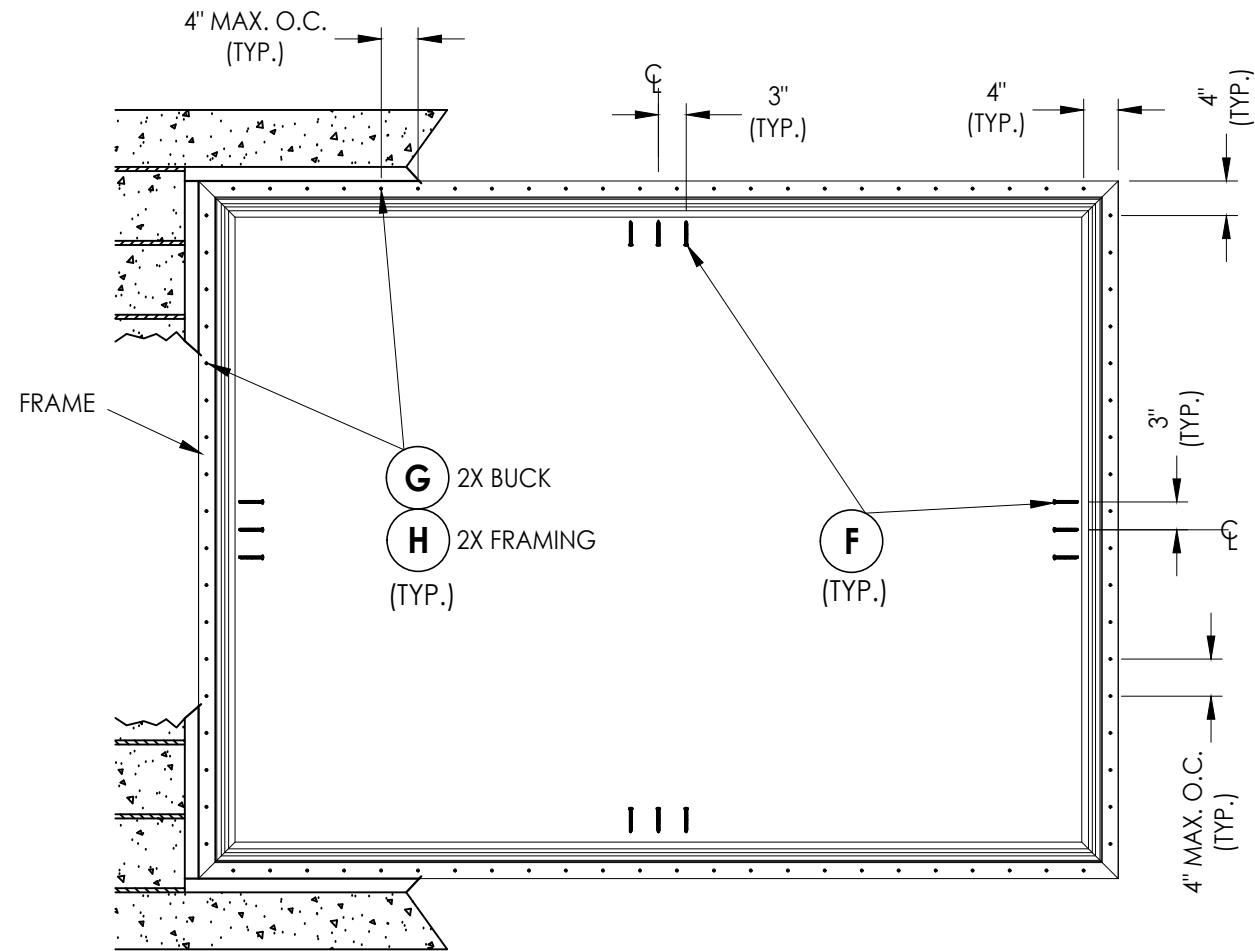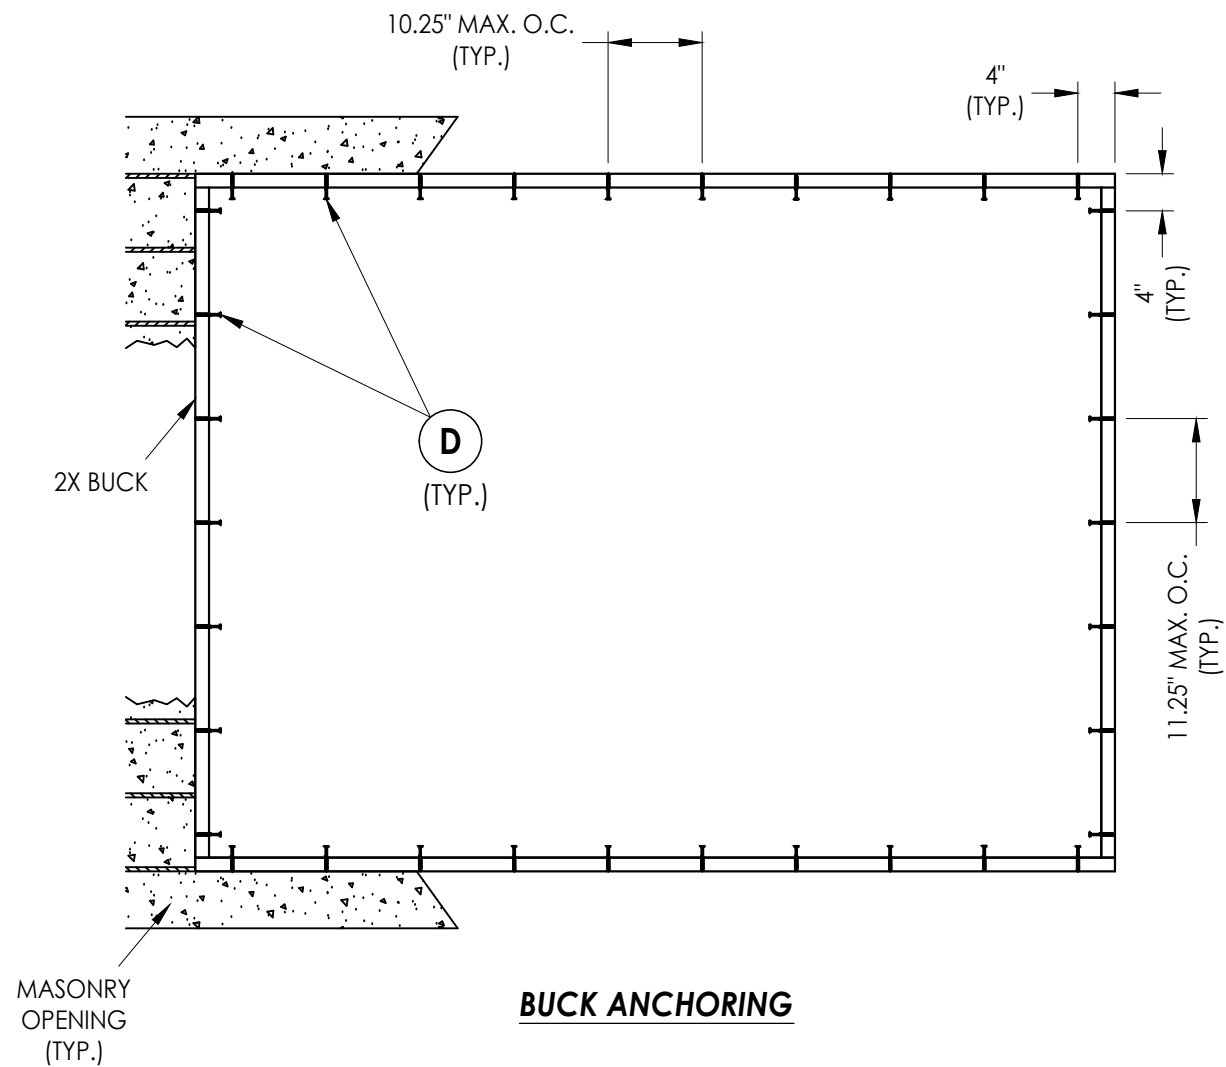

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

1	8/17/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
NO.	DATE			BY	
					REVISIONS

DATE: 6/18/26

SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: *RW*

DRAWING NO.:

FL-48286.3

SHEET 3 OF 4

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2026 R.W. BUILDING CONSULTANTS INC.

