


panoramah! (Jofebar S.A.)

MONORAIL FIXED WINDOW

(HVHZ)(IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: ALUMINUM 6063-T5
- GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

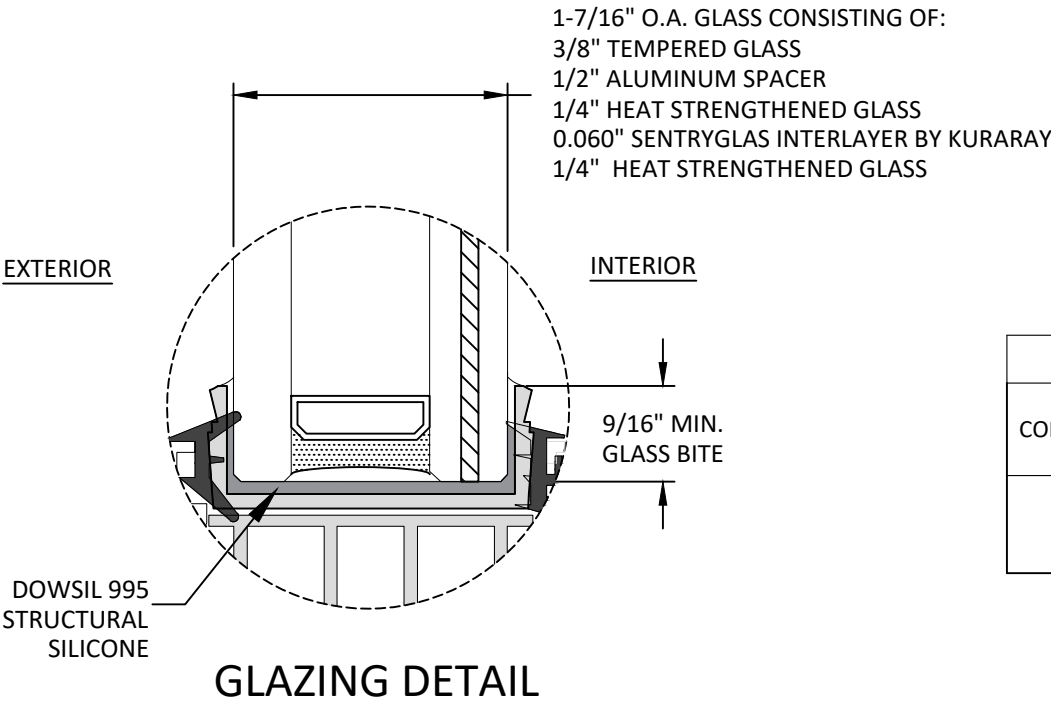

- GLAZING NOTES:
- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.
 - GLAZING BEAD CAN BE PLACED ON INTERIOR OR EXTERIOR.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATION & ANCHOR LAYOUT
3	DESIGN PRESSURE TABLES
4	VERTICAL SECTION
5	HORIZONTAL SECTION
6	INSTALLATION NOTES & ANCHOR DETAILS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
O	SEE TABLES ON SHEET 3			LARGE & SMALL MISSILE IMPACT

panoramah!

Jofebar

RUA D. MARCOS DA CRUZ, 1240
4455-482 PERAFITA - MATOSINHOS
PH: (+351) 229 996 311
EMAIL: JOFEBAR@JOFEBAR.COM

TITLE: MONORAIL FIXED WINDOW (HVHZ)(IMPACT)
GENERAL NOTES & GLAZING DETAIL

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

B.D. BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.16 17:30:00 -03'00'

HERMES F. NORERO
LICENSE
No. 73778
STATE OF FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL48366

DATE: **03.16.2026**

DWG. BY: **HJ**CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **JFB009**


SECTION: **1**REV. **0**

OF 6

c:\Users\daniel(built rago)\building drops, inc\building drops\products - name change\dwgs\fa\fbp009.dwg 8/13/2026 1:23 PM

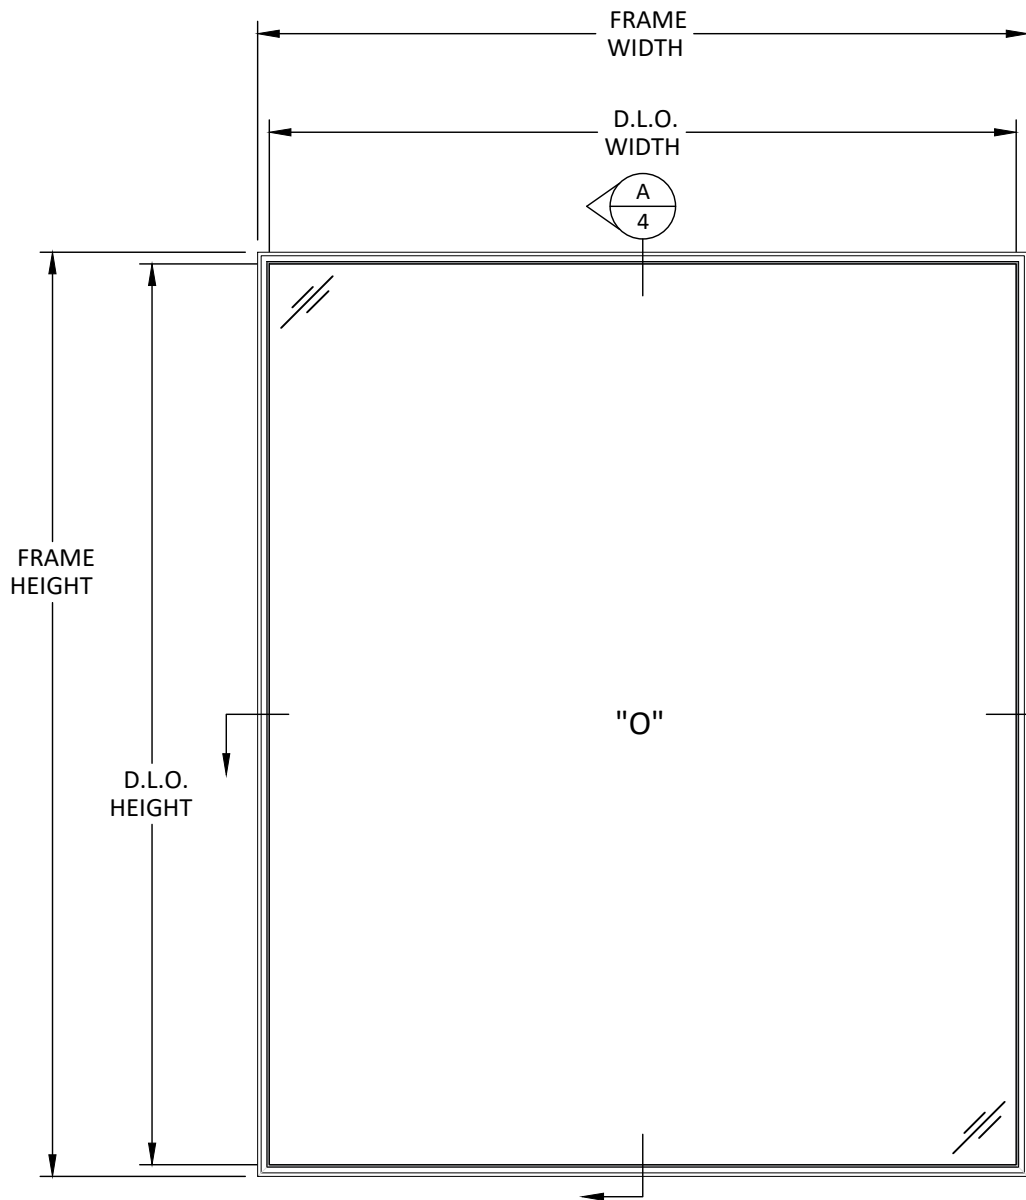

ELEVATION
MONORAIL FIXED WINDOW

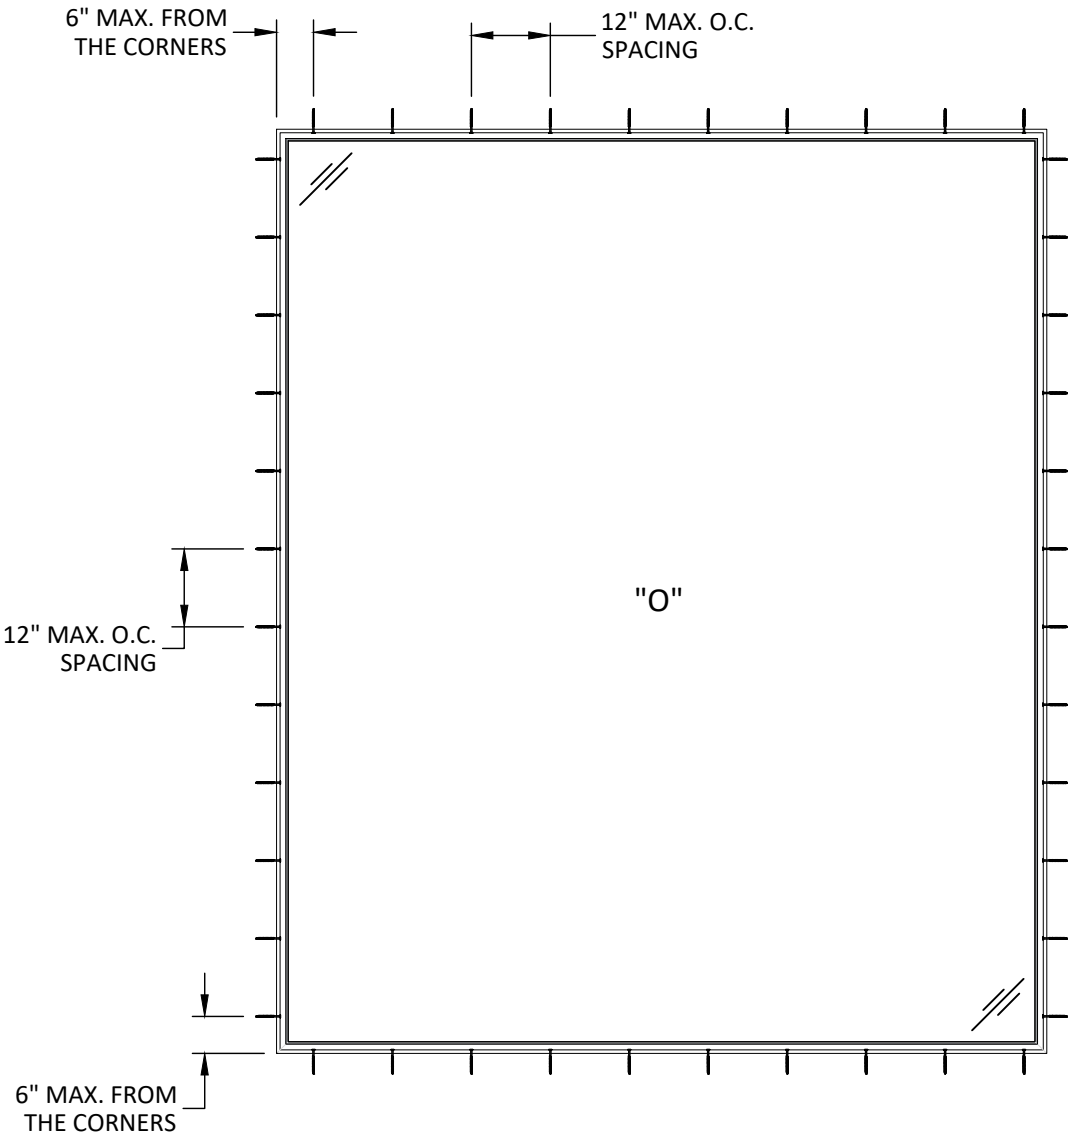

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

D.L.O. HEIGHT = FRAME HEIGHT - 3.75"
D.L.O. WIDTH = FRAME WIDTH - 3.75"

panoramah!

Jofebar

RUA D. MARCOS DA CRUZ, 1240
4455-482 PERAFITA - MATOSINHOS
PH: (+351) 229 996 311
EMAIL: JOFEBAR@JOFEBAR.COM

TITLE: MONORAIL FIXED WINDOW
(HVHZ)/(IMPACT)

ELEVATION & ANCHOR LAYOUT

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

B.D.

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL48366

DATE:

03.16.2026

DWG. BY:

HJ

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

JFB009

SECTION:

2

REV.

0



OF 6

8/13/2026 1:23 PM

c:\users\daniel\build\cago\building drops, inc\building drops landing - common\projects\jofebar sa\fbc-26-0321.1 - panoramah! aluminum impact products - name change\dwgs\fa\fb009.dwg

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		POS. (+)	NEG. (-)
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)		
42	84	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		75.0	75.0
72		75.0	75.0
78		60.0	60.0
84		60.0	60.0
42	90	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		75.0	75.0
72		75.0	75.0
78		60.0	60.0
84		60.0	60.0
90	96	60.0	60.0
42		75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		75.0	75.0
72		60.0	60.0
78		60.0	60.0
84	102	60.0	60.0
90		60.0	60.0
96		60.0	60.0
42		75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72	108	60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
102		60.0	60.0
42		75.0	75.0
48		75.0	75.0
54	114	75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
102	120	60.0	60.0
108		60.0	60.0
114		60.0	60.0
42		75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		60.0	60.0
66		60.0	60.0
72	126	60.0	60.0
78		60.0	60.0
84		60.0	60.0
90		60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120	132	60.0	60.0
42		75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84	138	60.0	60.0
90		60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
42	144	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	150	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	156	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	162	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	168	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	174	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	180	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	186	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	192	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	198	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	204	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	210	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	216	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	222	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	228	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	234	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	240	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	246	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	252	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	258	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	264	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	270	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	276	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	282	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	288	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	294	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	300	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	306	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0
42	312	75.0	75.0
48		75.0	75.0
54		75.0	75.0
60		75.0	75.0
66		60.0	60.0
72		60.0	60.0
78		60.0	60.0
84		60.0	60.0
90	318	60.0	60.0
96		60.0	60.0
102		60.0	60.0
108		60.0	60.0
114		60.0	60.0
120		60.0	60.0
126		60.0	60.0
132		60.0	60.0

c:\Users\danielbuitrago\building drops, inc\building drops landing - common\projects\jofebar\sa\fbc-26-0321.1 - panoramahi aluminum impact products - name change\dwgs\fa\fb009.dwg 8/13/2026 1:23 PM

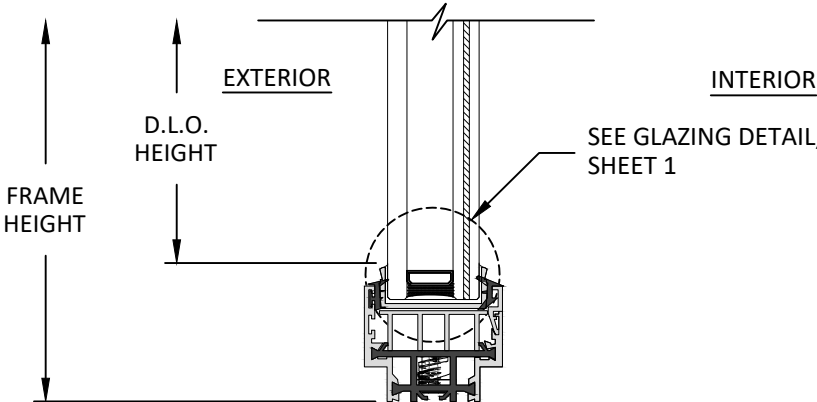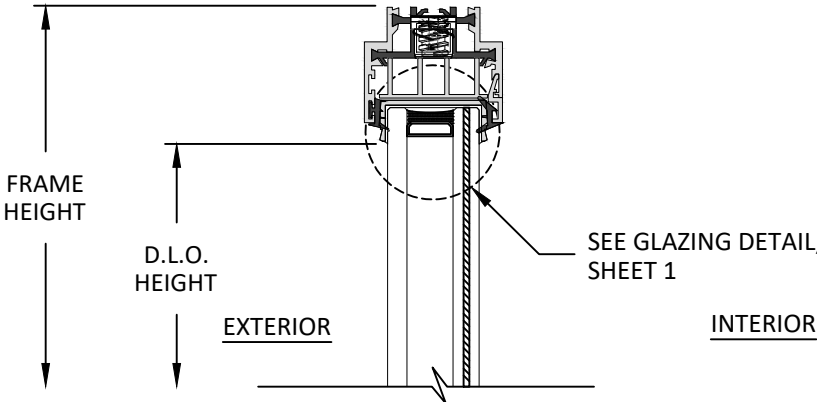

A
4 **VERTICAL SECTION**
TYP. SECTION DETAIL

panoramah!

Jofebar

RUA D. MARCOS DA CRUZ, 1240
4455-482 PERAFITA - MATOSINHOS
PH: (+351) 229 996 311
EMAIL: JOFEBAR@JOFEBAR.COM

TITLE: MONORAIL FIXED WINDOW
(HVHZ)/(IMPACT)

VERTICAL SECTION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

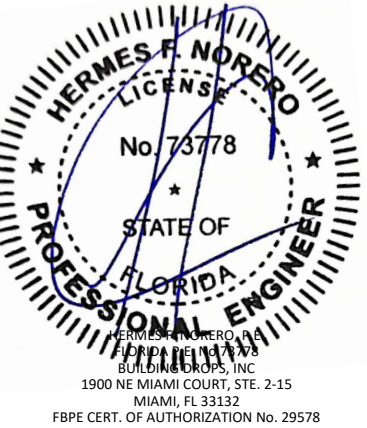

FL #:	FL48366	
DATE:	03.16.2026	
DWG. BY:	HJ	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	JFB009	
SECTION:	4	REV. 0

c:\users\daniel\trabajo\building drops, inc\building drops landing - common\projects\jofebar\sa\fbc-26-0321.1 - panoramah! aluminum impact products - name change\dwgs\fa\fb009.dwg 8/13/2026 1:23 PM

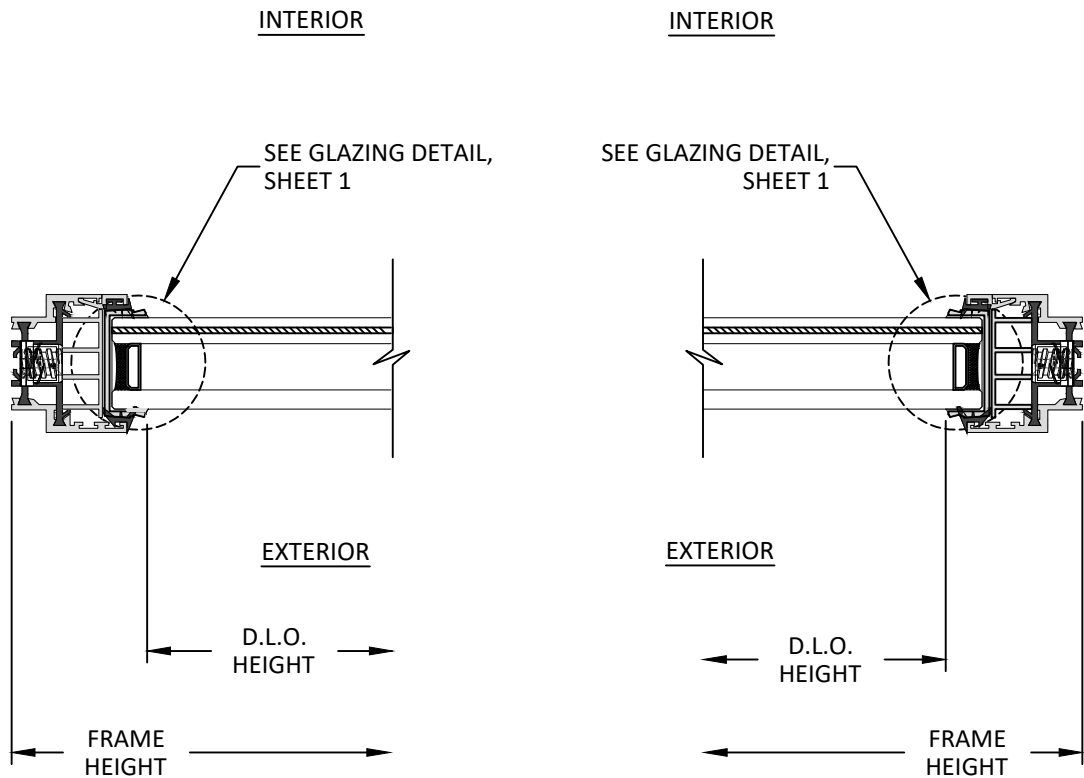

A
5 **HORIZONTAL SECTION**
TYP. SECTION DETAIL

panoramah!

Jofebar

RUA D. MARCOS DA CRUZ, 1240
4455-482 PERAFITA - MATOSINHOS
PH: (+351) 229 996 311
EMAIL: JOFEBAR@JOFEBAR.COM

TITLE: MONORAIL FIXED WINDOW
(HVHZ)/(IMPACT)

HORIZONTAL SECTION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

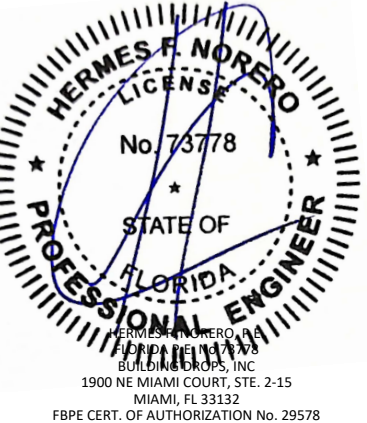


FL #:	FL48366
DATE:	03.16.2026
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	JFB009
SECTION:	REV.
5	0


c:\users\daniel(built rago)\building drops, inc\building drops landing - common\projects\jofebar sa\fb-26-0321.1 - panoramah! aluminum impact products - name change\dwgs\fa\fb009.dwg 8/13/2026 1:23 PM

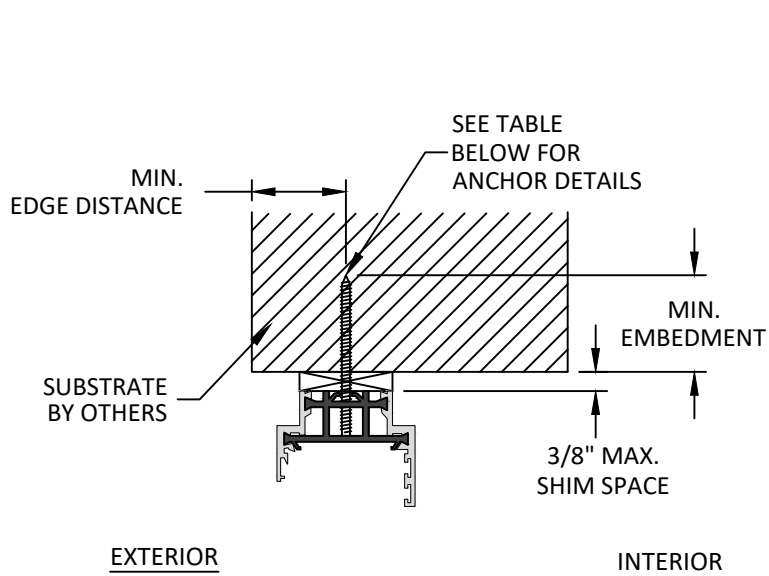

A
6 VERTICAL SECTION
HEAD - THROUGH FRAME

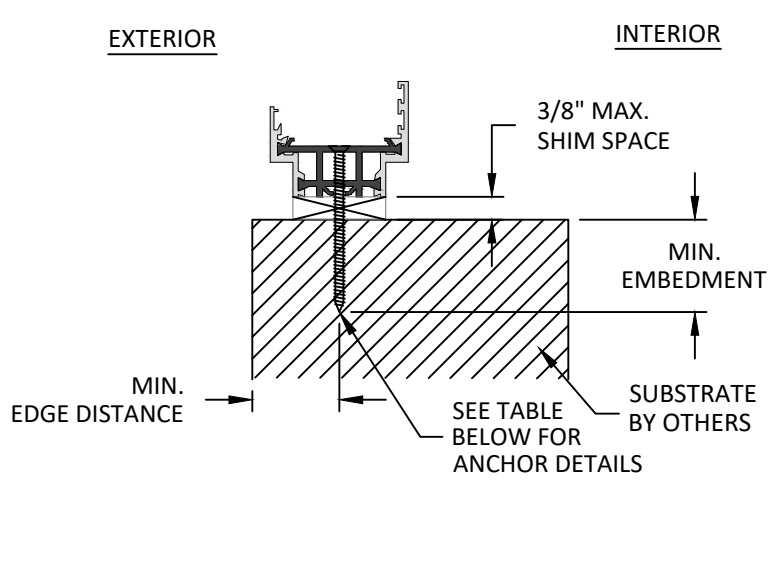

B
6 VERTICAL SECTION
SILL - THROUGH FRAME

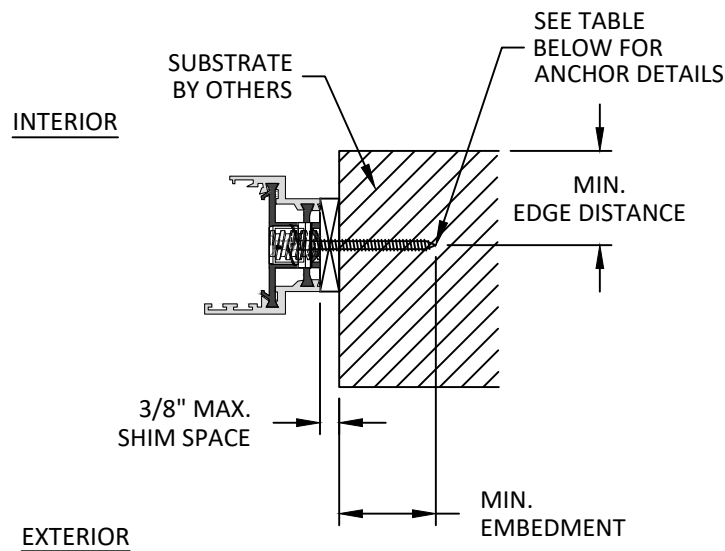

C
6 HORIZONTAL SECTION
JAMB - THROUGH FRAME


INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME INSTALLATION	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	1/4" SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000PSI	1/4" ITW TAPCON	1.50"	2.50"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1/4" ITW TAPCON	1.00"	2.50"

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

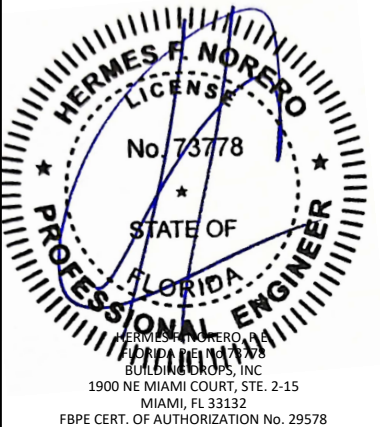

FL #:		FL48366
DATE:		03.16.2026
DWG. BY:	CHK. BY:	
HJ	HFN	
SCALE:		NTS
DWG. #:		JFB009
SECTION:	REV.	
6	0	
OF 6		