
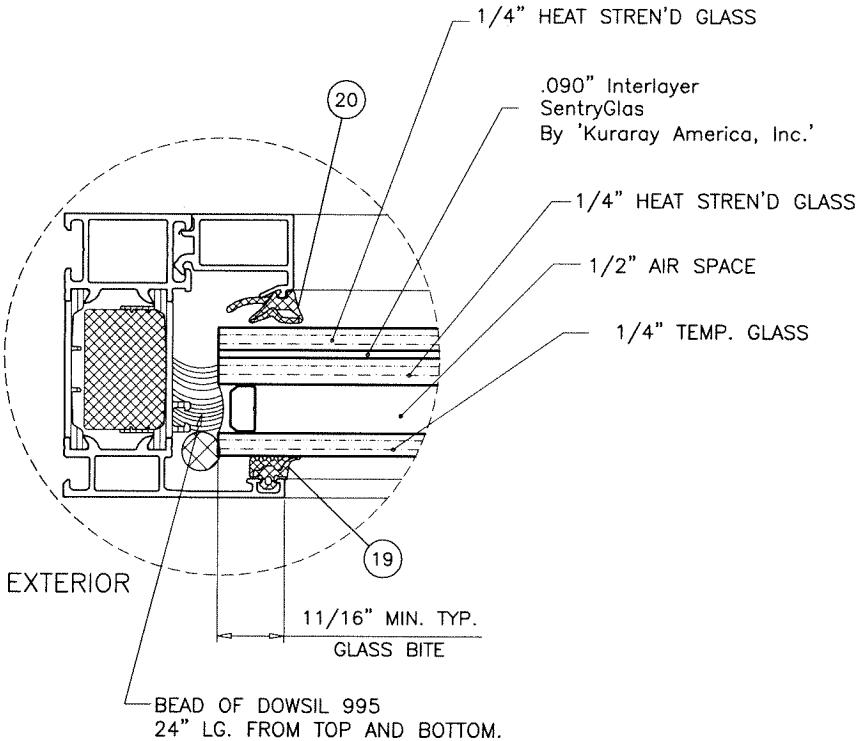


*** PRODUCTS DEPICTED ARE THE PROPERTY OF BIGFOOT DOOR CORP.
USE OF THIS PRODUCT REQUIRES WRITTEN AUTHORIZATION BY BIGFOOT DOOR CORP.
TO THE BUILDING DEPARTMENT WHEN APPLYING FOR A PERMIT. ***

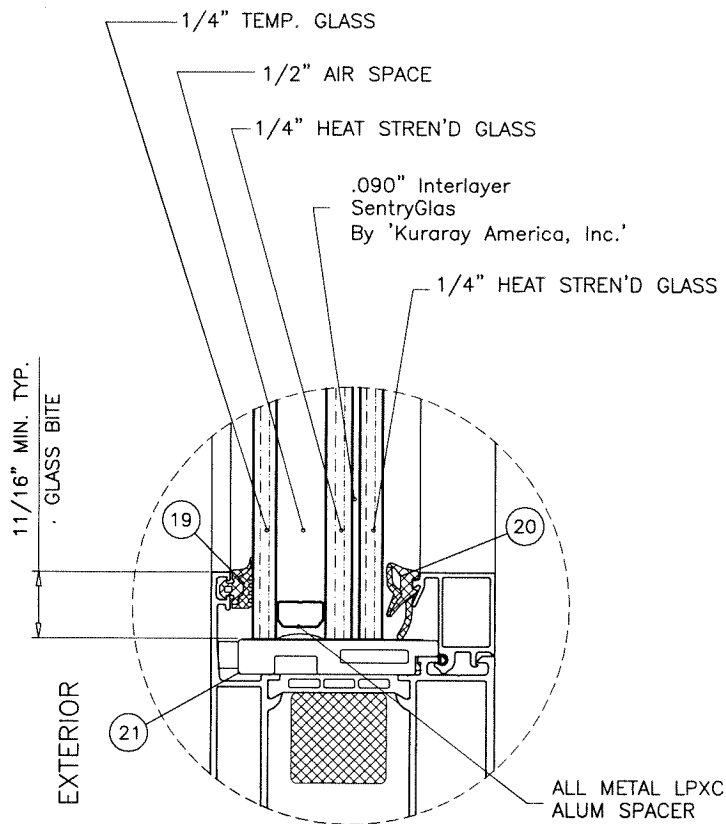

GLASS TYPE '1'
1-5/16" OVERALL INSUL. LAM. GLASS

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES AWS 70.HI / 75.SI+ OUTSWING TERRACE DOOR

APPROVAL APPLIES TO SINGLE UNITS
CODE REQUIREMENTS FOR SAFEGUARDS MUST BE OBSERVED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA
BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT
LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL
OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

JAMB ANCHOR SPACING (INCHES)	
PRESSURE (PSF)	TYPE A & B
55	12-1/2"
70	9-3/4"


FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET
CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES.
COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

INSUL. LAM. GLASS
LARGE MISSILE IMPACT

Sealed: 9/15/2026

FL # 48427

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

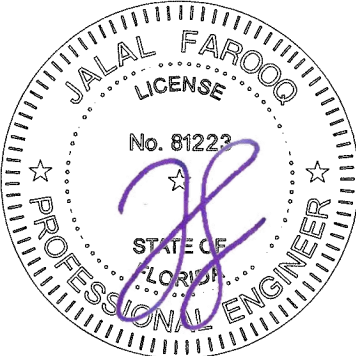

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538
CMP-ANL\26-25F-BF

SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)
Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887 www.bigfootdoor.com

revisions:	no	date	by	description
date:	09-08-26	scale:	1 : 2	dr. by: MLS
chk. by:				
drawing no.	26-25F			
sheet	1 of 13			

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL: (305) 264-8100 FAX: (305) 262-6978
CMP-ANL\26-25F-BF

SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)

Bigfoot Door Corp.

1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887 www.bigfootdoor.com

revisions: no date by description

date: 09-08-26


scale: 1/2" = 1'-0"

dr. by: MLS

chk. by:

drawing no.
26-25F

sheet 2 of 13

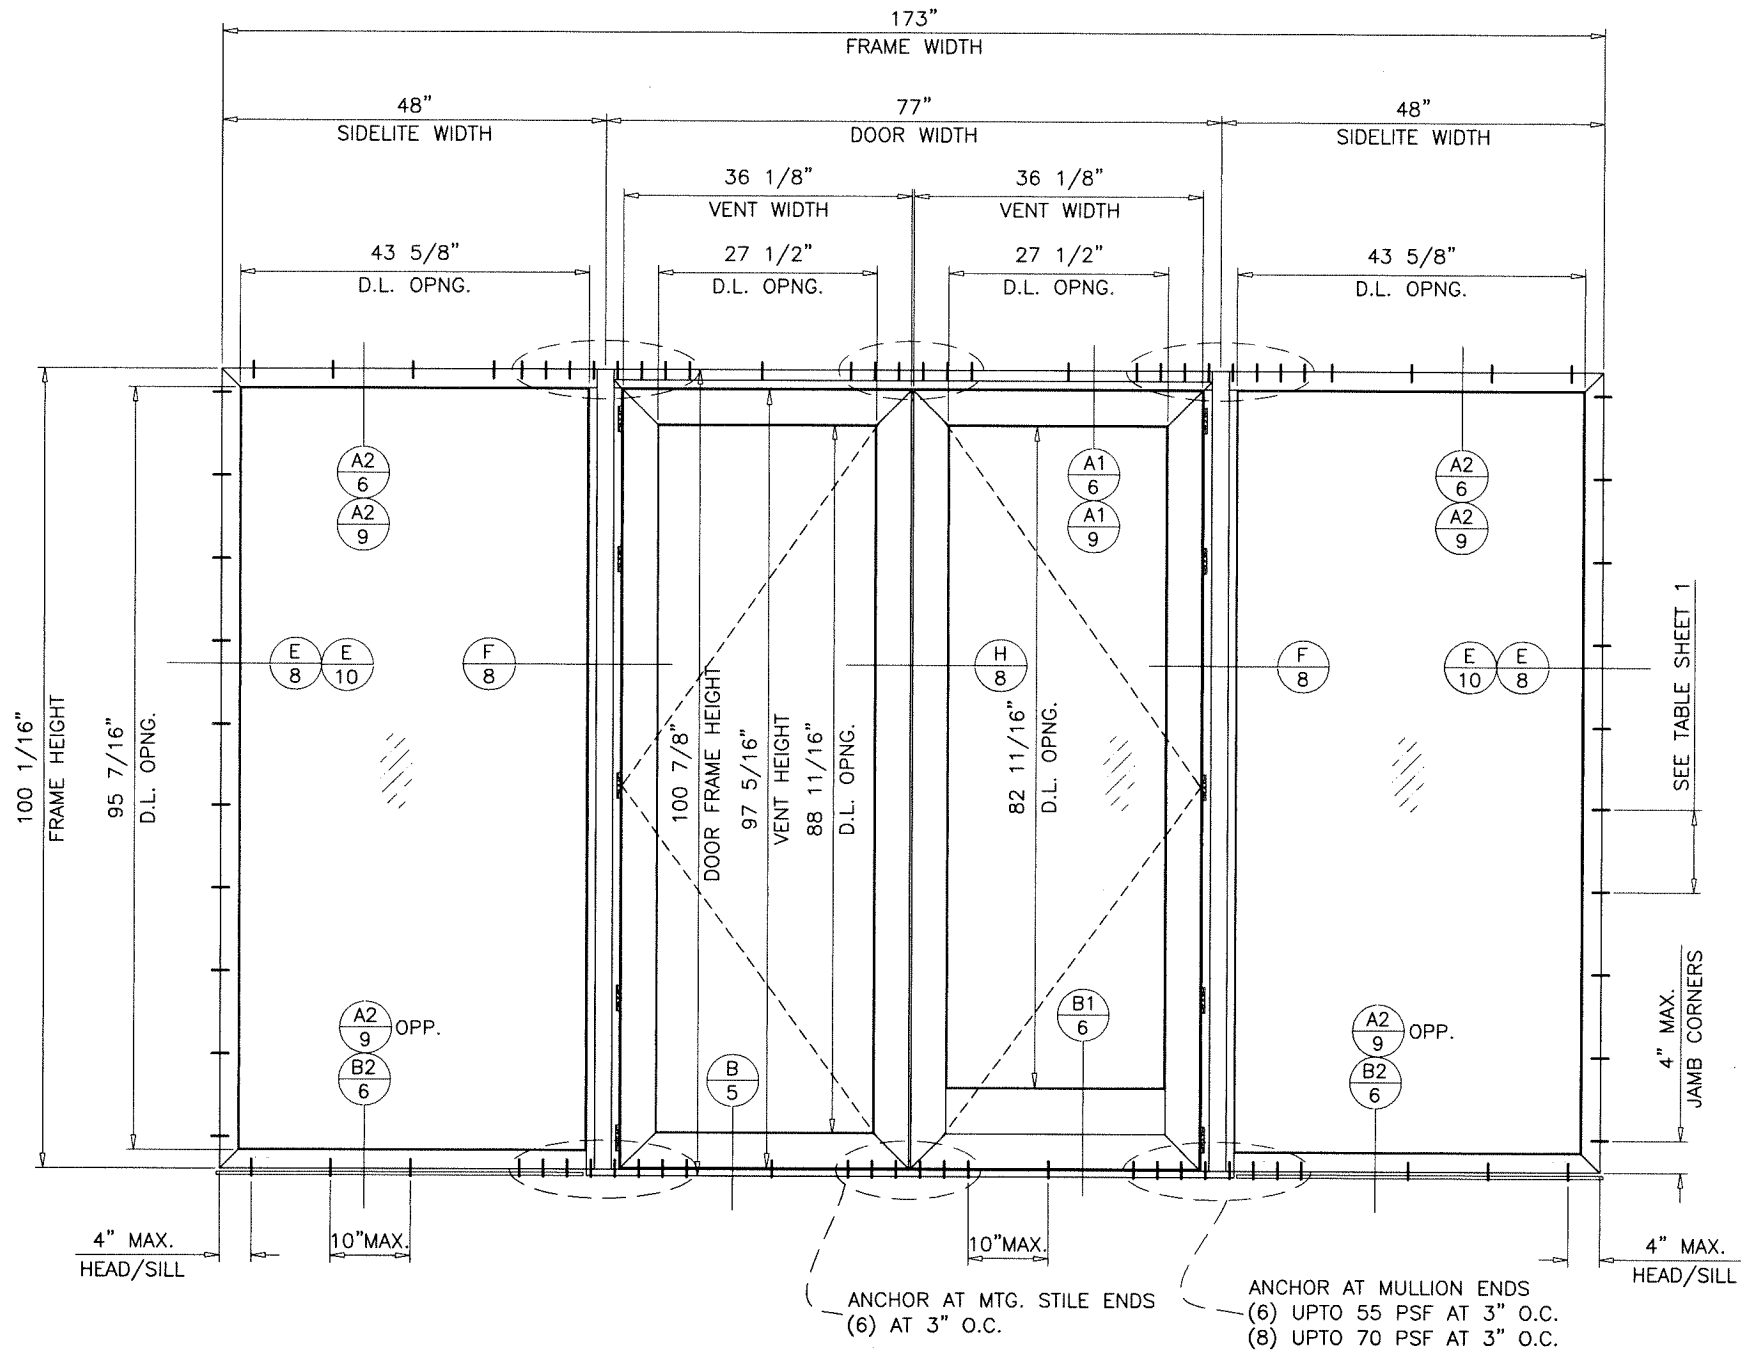

TYPICAL ELEVATION
TESTED UNIT

DOOR LOAD CAPACITY - PSF		
DOUBLE DOOR W/ SIDELITE (0XX0)		
DOOR WIDTH	FRAME HEIGHT (W/ HEADER ADAPTER)	EXT.(+) INT.(-)
77"	100-7/8"	60.0
	93-1/16"	65.0
	86-7/16"	70.0


NOTE:
INTERPOLATION BETWEEN WIDTHS ALLOWED.

NOTES:
1. USE CHART ON THIS SHEET FOR DOOR CAPACITY IN COMBINATION WITH SIDELITE.
2. FOR SIDELITE CAPACITY SE CHART ON SHEET # 4.

LOWER VALUES FROM STEPS 1 AND 2 WILL APPLY TO ENTIRE SYSTEM.


Sealed: 9/15/2026

FL # 48427

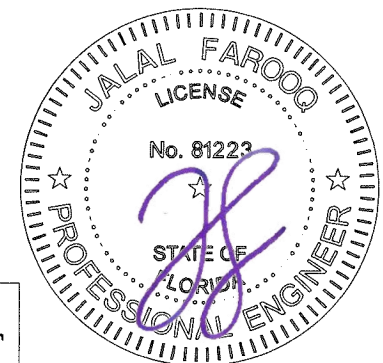

INSUL. LAM. GLASS
LARGE MISSILE IMPACT

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

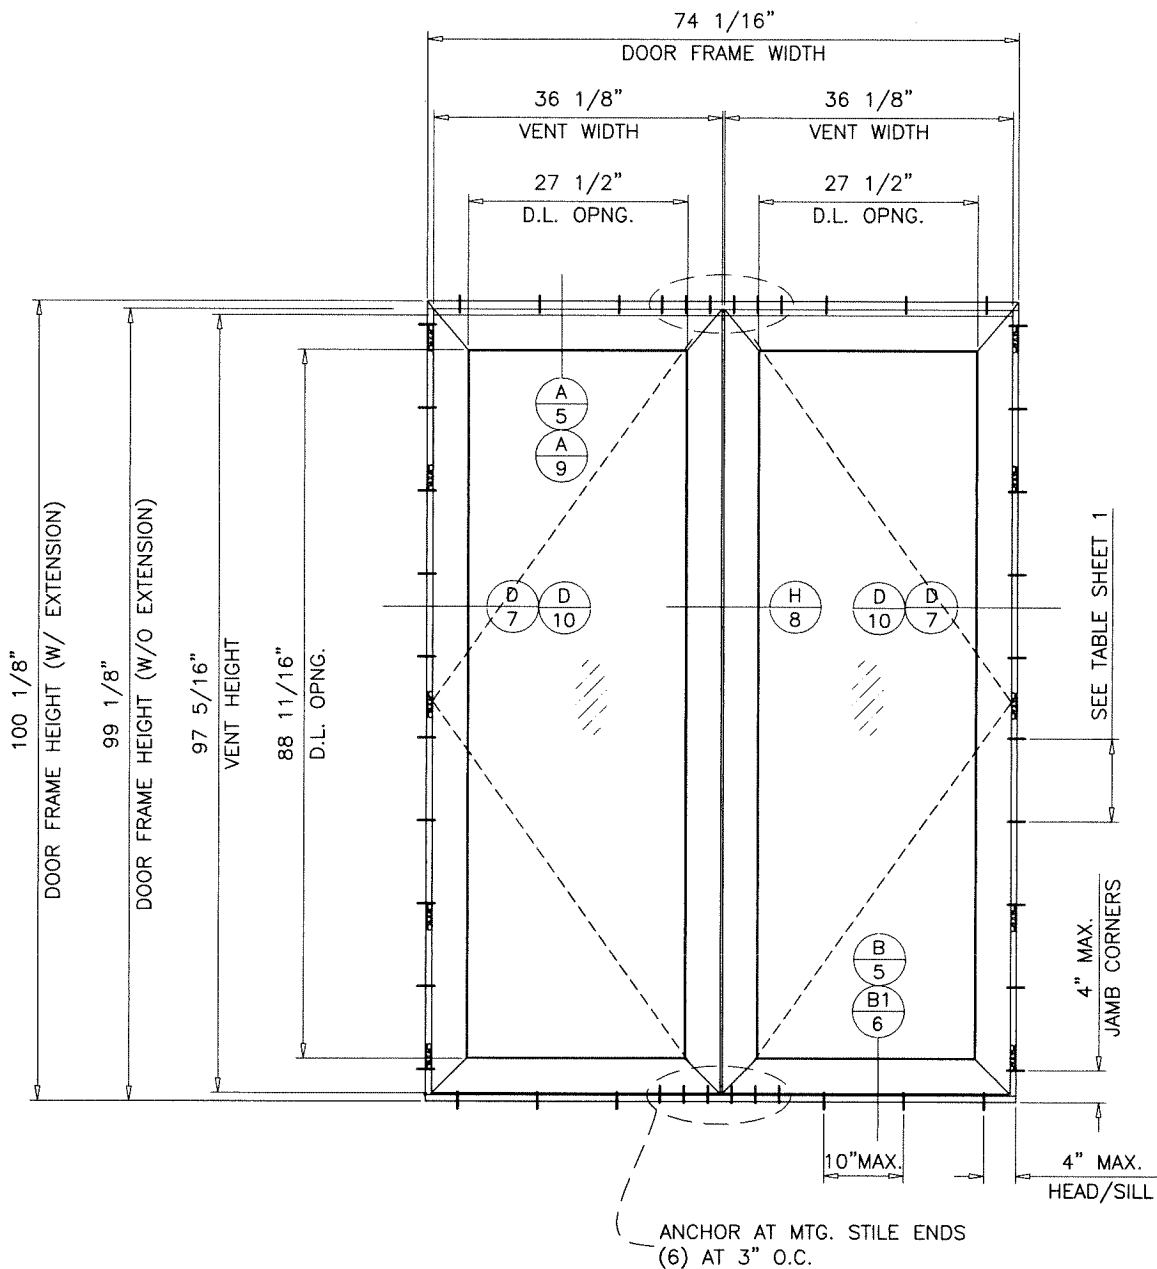


TYPICAL ELEVATION
TESTED UNIT

DOOR LOAD CAPACITY - PSF		
DOUBLE DOOR (XX)		
DOOR WIDTH	FRAME HEIGHT (W/ EXTENSION)	EXT.(+) INT.(-)
74 -1/16"	100-1/8"	60.0
	92-5/16"	65.0
	85-11/16"	70.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

NOTE:
INTERPOLATION BETWEEN WIDTHS
ALLOWED.

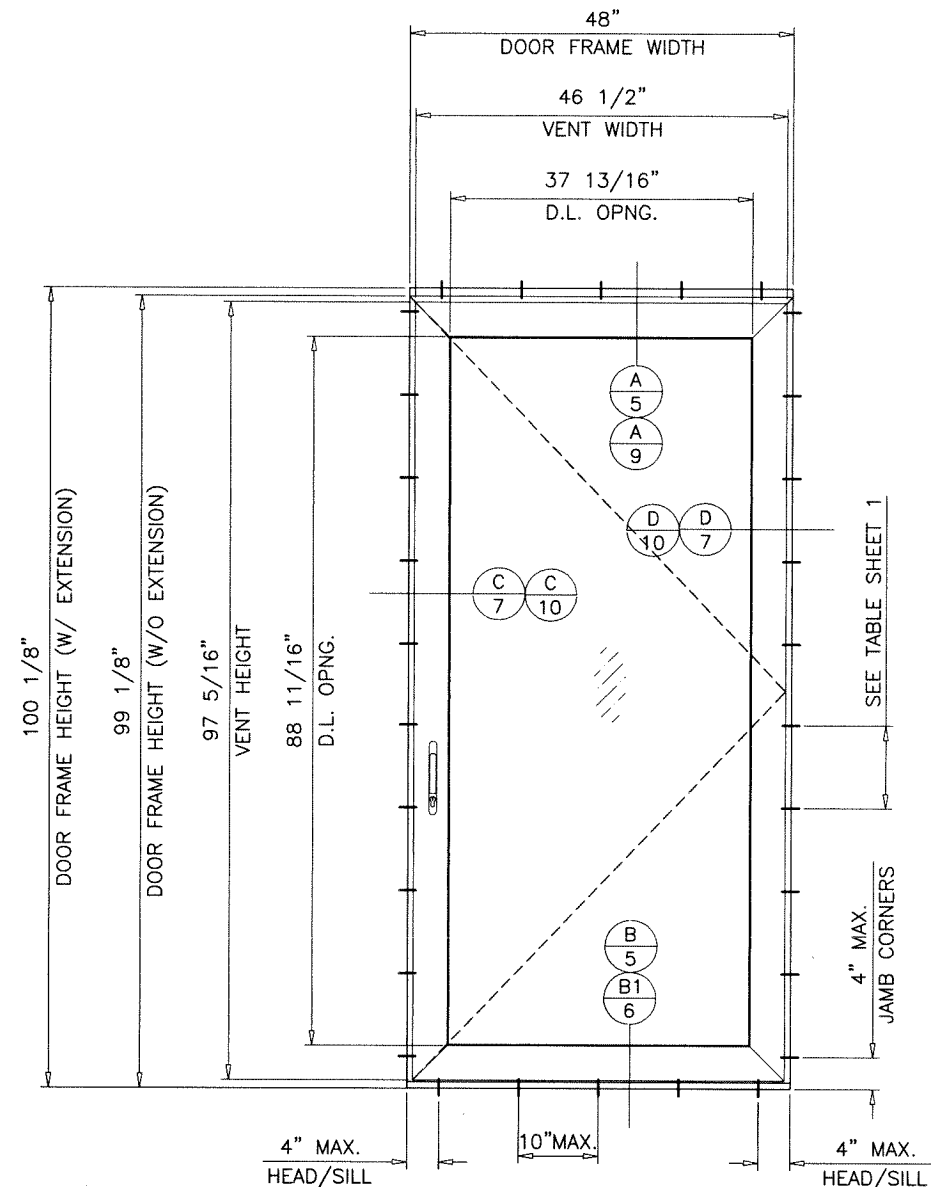


TYPICAL ELEVATION
TESTED UNIT

DOOR LOAD CAPACITY - PSF		
SINGLE DOOR (X)		
DOOR WIDTH	FRAME HEIGHT (W/ EXTENSION)	EXT.(+) INT.(-)
48"	100-1/8"	70.0

Sealed: 9/15/2026

INSUL. LAM. GLASS
LARGE MISSILE IMPACT

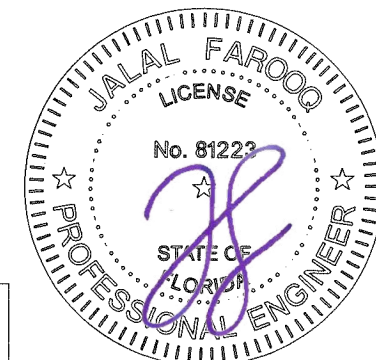


FL # 48427

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
CMP-ANL\26-25F-BF

SERIES AWS 70.H/75.S+ OUTSWING TERRACE DOOR (L.M.I.)
Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887 www.bigfootdoor.com

revisions:		no date by description	
date:	09-08-26	no	date
scale:	1/2" = 1'-0"	by	description
dr. by:	M.S.		
chk. by:			
drawing no.	26-25F		
sheet	3 of 13		

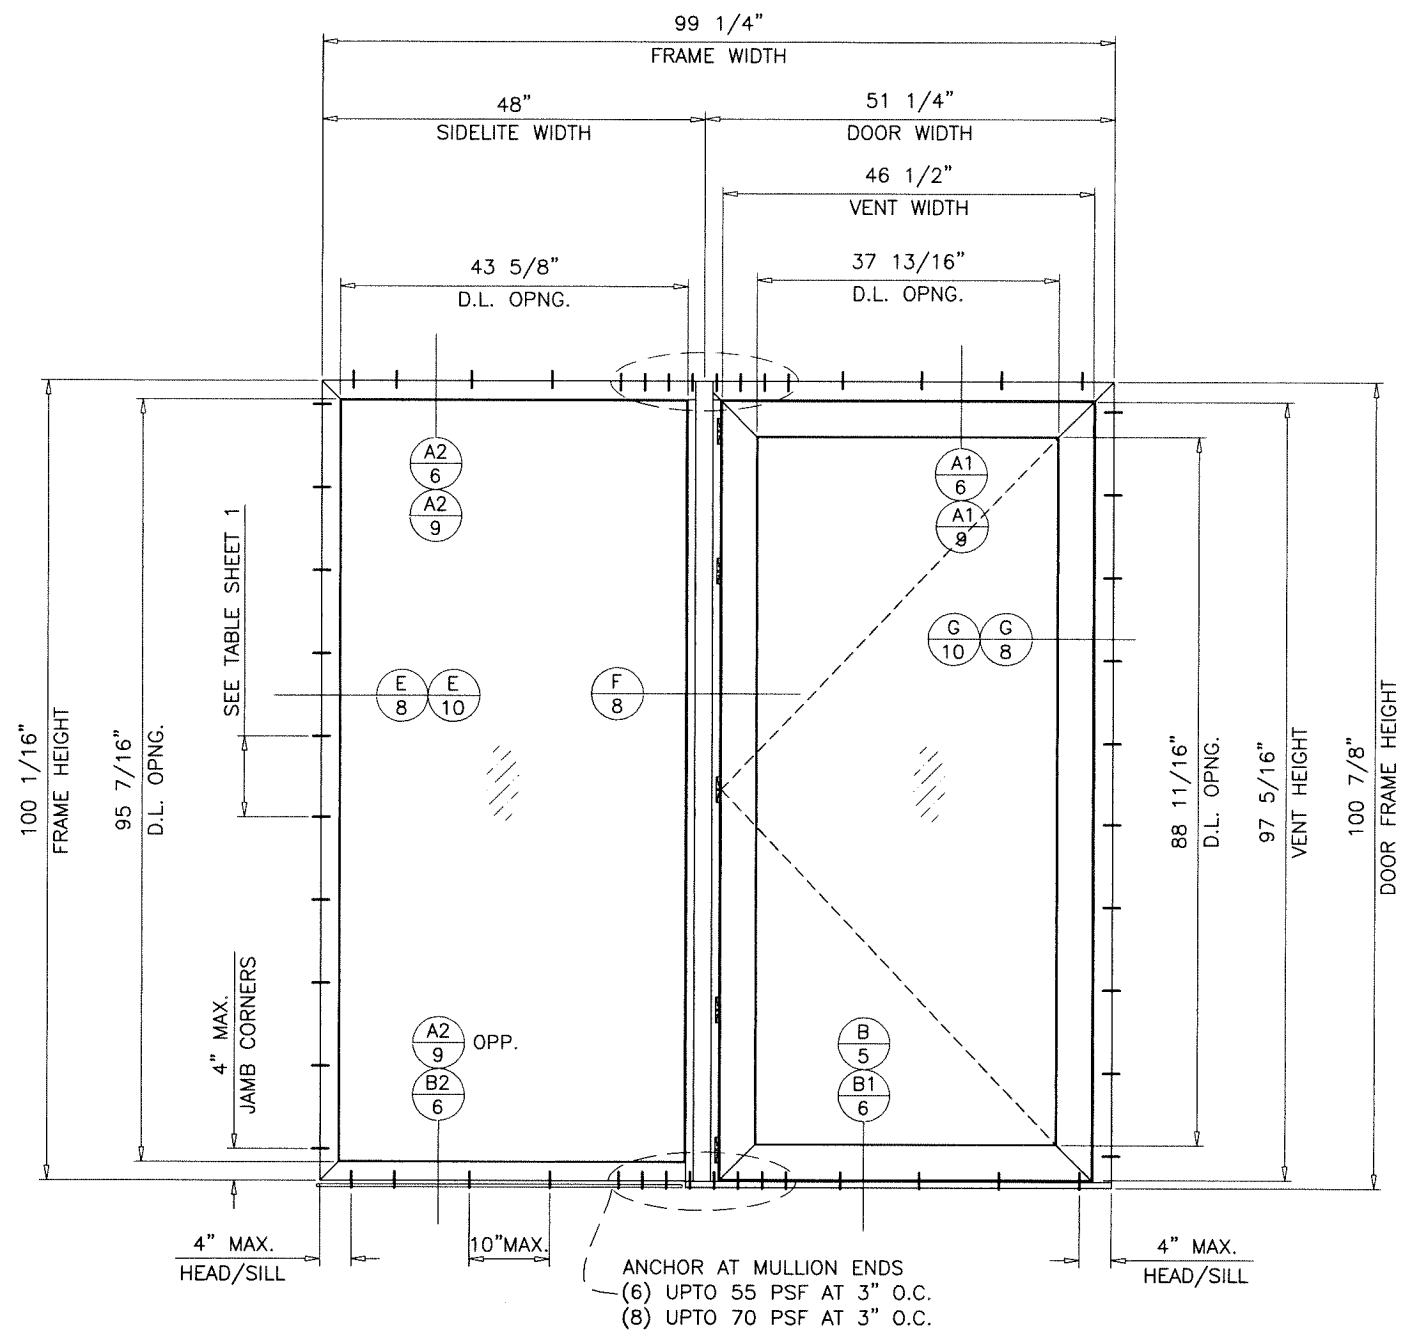

DOOR LOAD CAPACITY - PSF		
SINGLE DOOR W/ SIDELITE (OX)		
DOOR WIDTH	FRAME HEIGHT (W/ HEADER ADAPTER)	EXT.(+) INT.(-)
51-1/4"	100-7/8"	70.0


NOTE:
INTERPOLATION BETWEEN WIDTHS
ALLOWED.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

NOTES:

1. USE CHART ON THIS SHEET FOR DOOR CAPACITY IN COMBINATION WITH SIDELITE.
2. FOR SIDELITE CAPACITY SE CHART ON SHEET # 4.

LOWER VALUES FROM STEPS 1 AND 2
WILL APPLY TO ENTIRE SYSTEM.

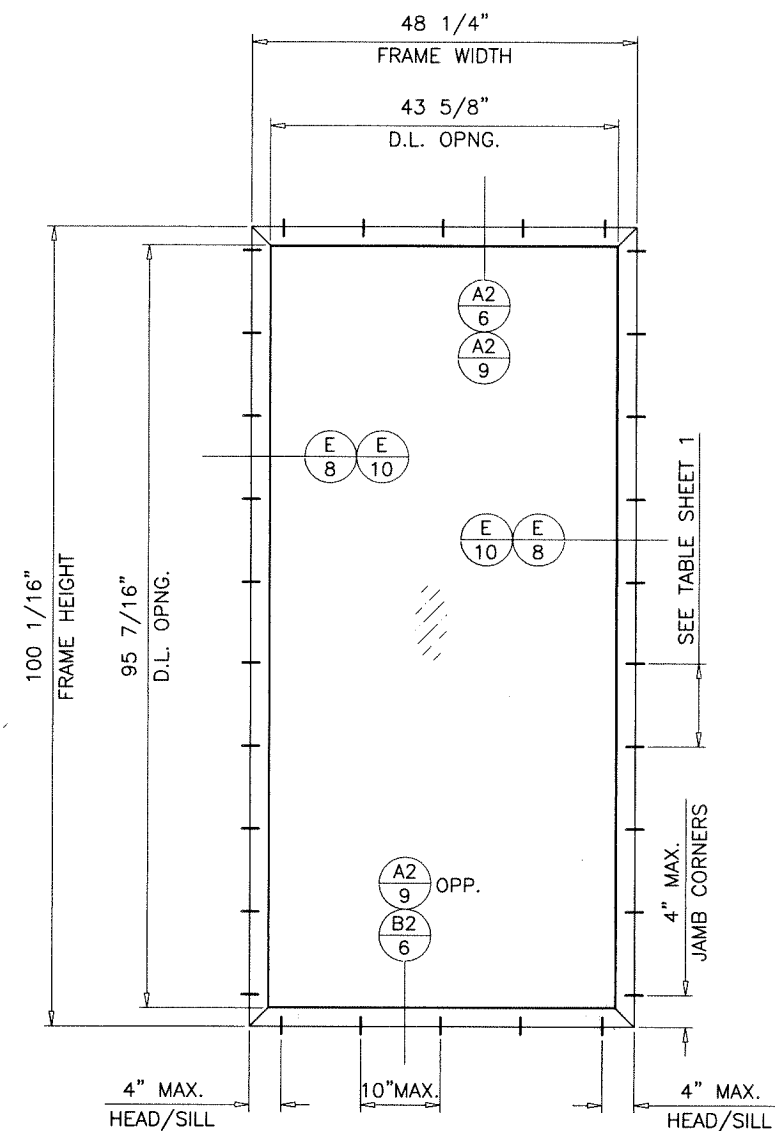


DESIGN LOAD CAPACITY - PSF		
WINDOW DIMS.		GLASS TYPE '1'
HEIGHT	WIDTH	EXT.(+) INT.(-)
72"	36"	70.0
	42"	70.0
	48"	70.0
	54"	62.5
	60"	53.3
	66"	51.2
84"	36"	70.0
	42"	70.0
	48"	70.0
	54"	62.5
90"	36"	70.0
	42"	70.0
	48"	70.0
96"	36"	70.0
	42"	70.0
	48"	70.0
100-1/16"	48-1/4"	70.0
102"	36"	70.0
	42"	70.0
108"	36"	70.0
	42"	70.0

NOTE:
CHART APPLIES TO FIXED WINDOW
PORTION ONLY. WIDTH AND HEIGHT
DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY

NOTE:
INTERPOLATION BETWEEN WIDTHS
ALLOWED.

Sealed: 9/15/2026

FL # 48427

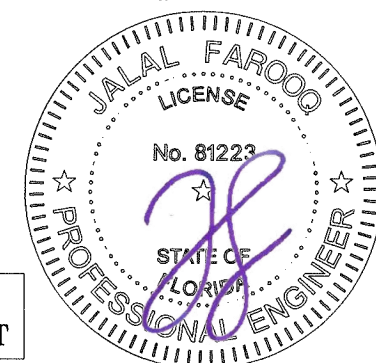

INSUL. LAM. GLASS
LARGE MISSILE IMPACT

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978



Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887
www.bigfootdoor.com

[illegible]

date: 09-08-26
 scale: 1/2" = 1'-0"
 dr. by: MLS
 chkh. by:

drawing no.
26-25F

sheet 4 of 13

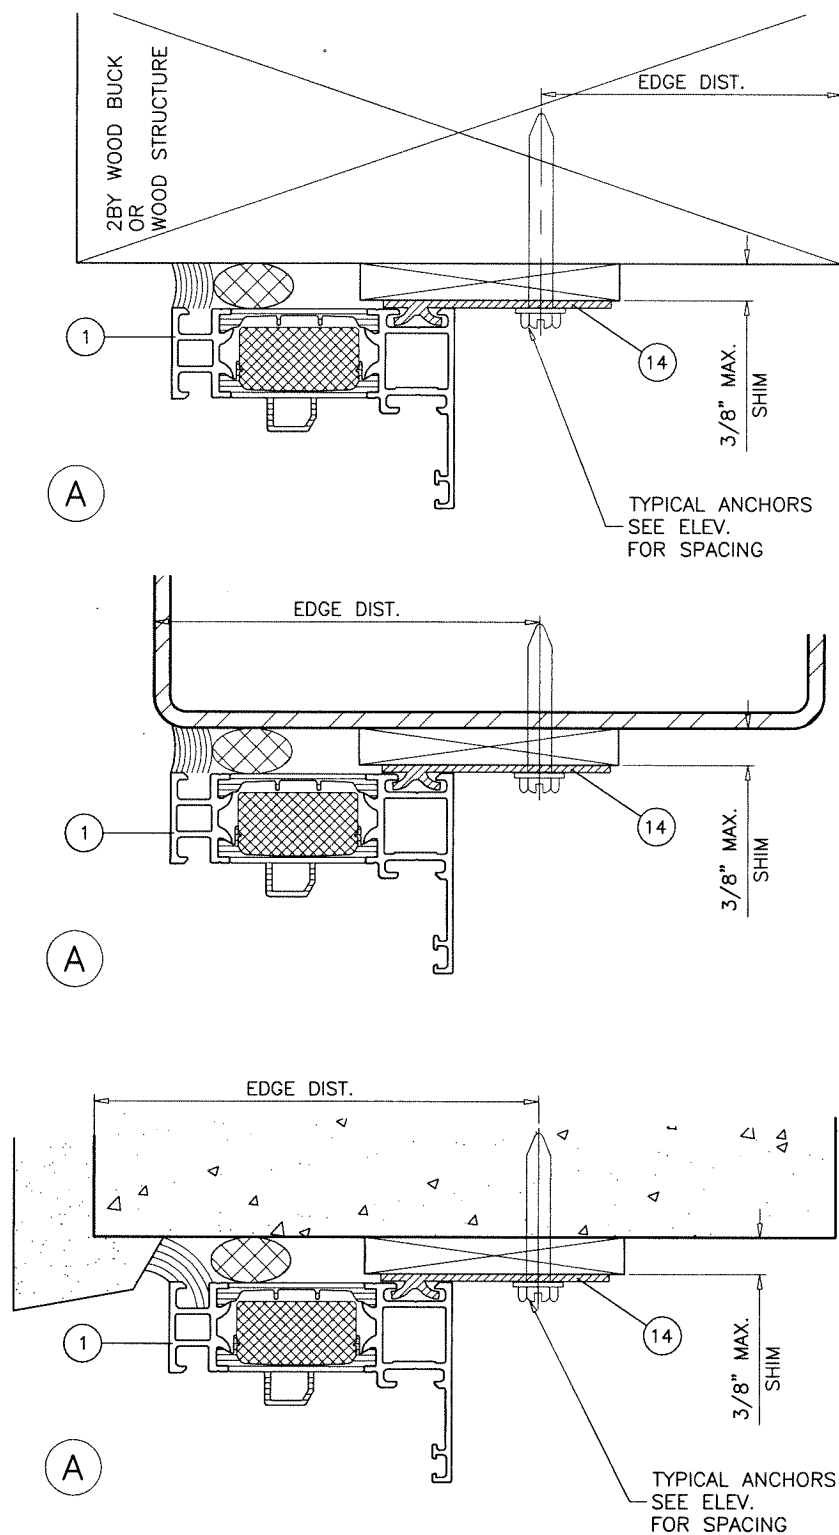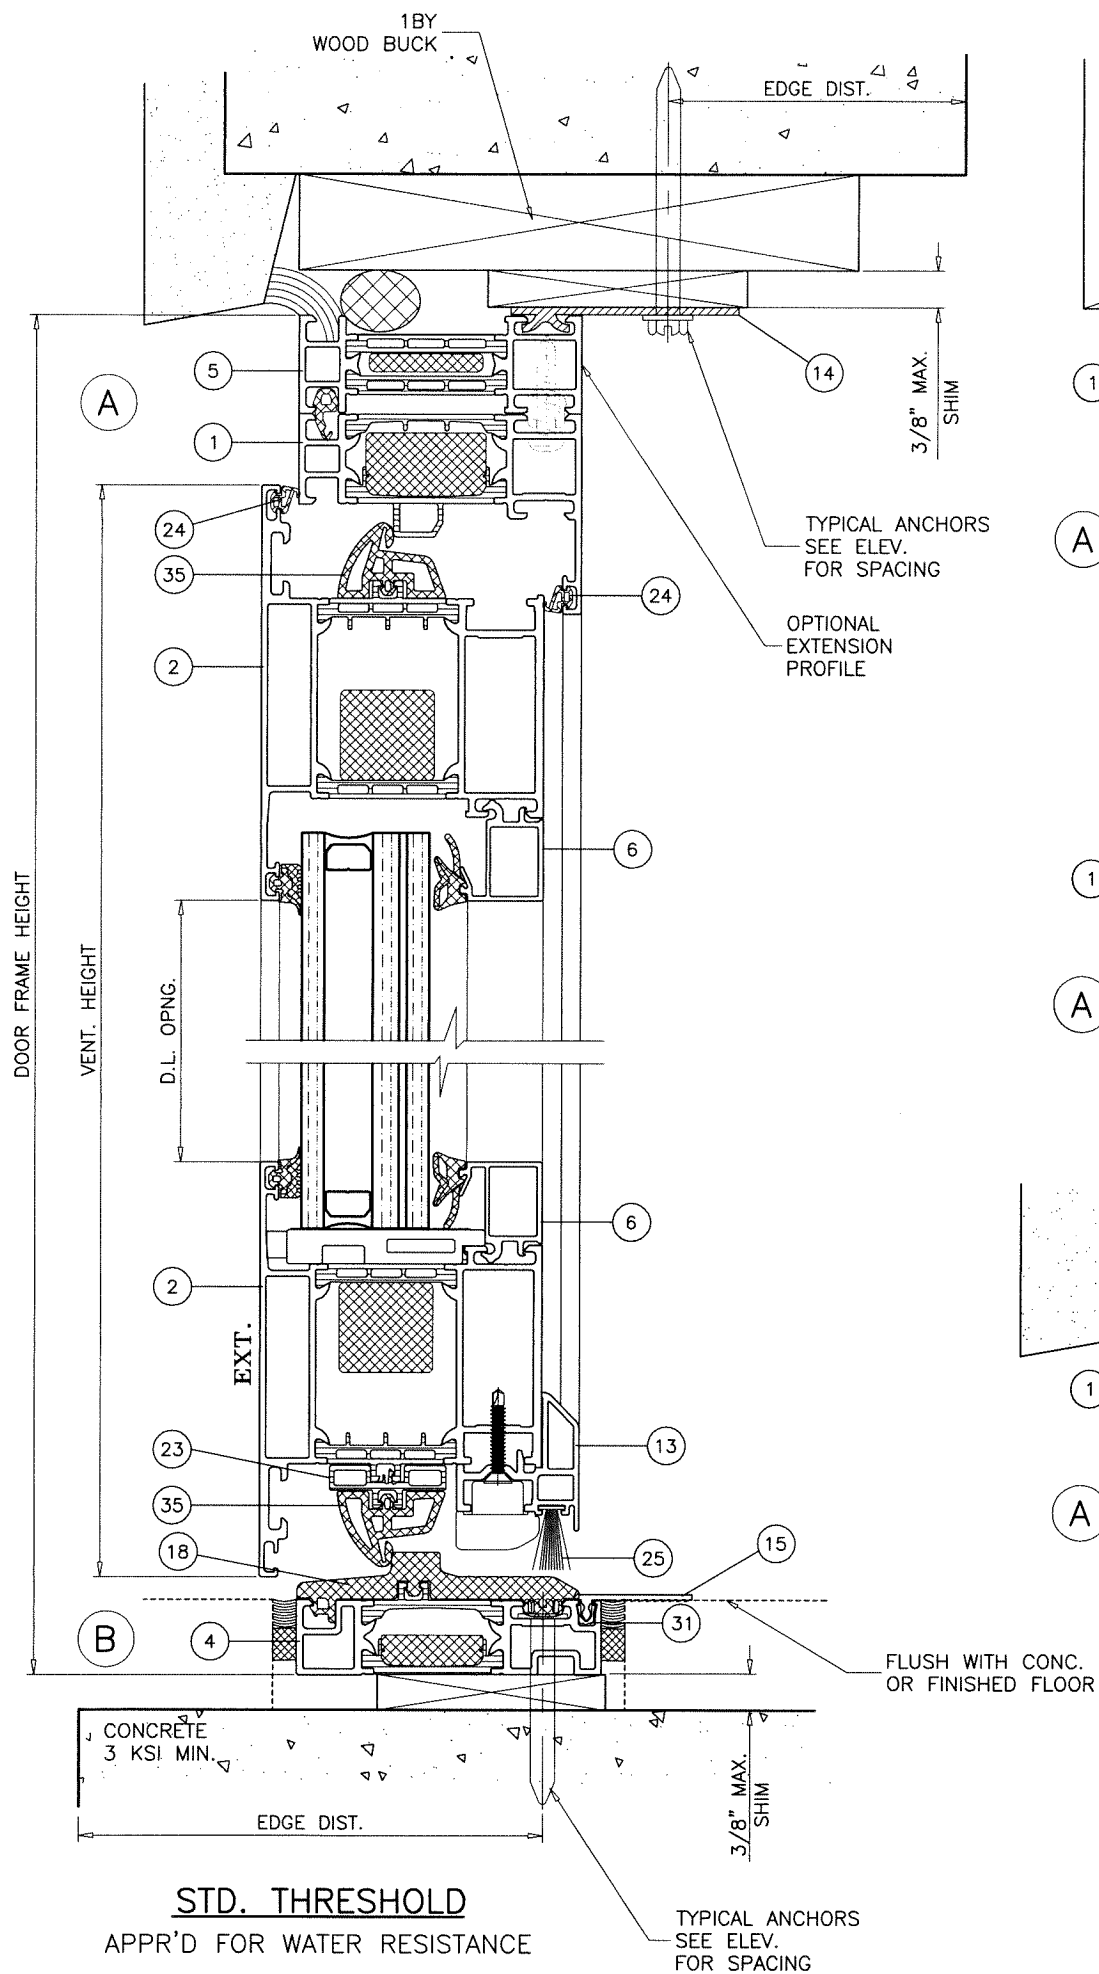

WOOD BUCKS AND METAL STRUCTURE NOT BY 'BIGFOOT' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE A - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE B - 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS OR
 INTO METAL STRUCTURES (HEAD/JAMBS)
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.
 INTO BLOCK = 2-1/2" MIN.


WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:

ALL FRAME MITRE CORNERS AND T JOINTS SEALED WITH BIGFOOT (298864) SILICONE SEALANT.
 ALL CORNERS AND T-CLEATS FILLED WITH BIGFOOT SEALANT (298900).

Sealed: 9/15/2026

FL # 48427



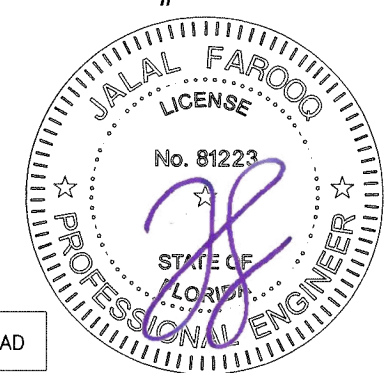


STRAP ANCHOR INSTALLATION AT HEAD

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 CMP-ANL \ 26-25F-BF

SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)
Bigfoot Door Corp.
 1677 Aimco Boulevard
 Mississauga, ON. L4W 1H7
 PHONE: (905) 602-5887 www.bigfootdoor.com

revisions:		no date by description	
date:	09-08-26	scale:	1 : 2
dr. by:	MLS	chk. by:	
drawing no.		26-25F	
sheet		5 of 13	

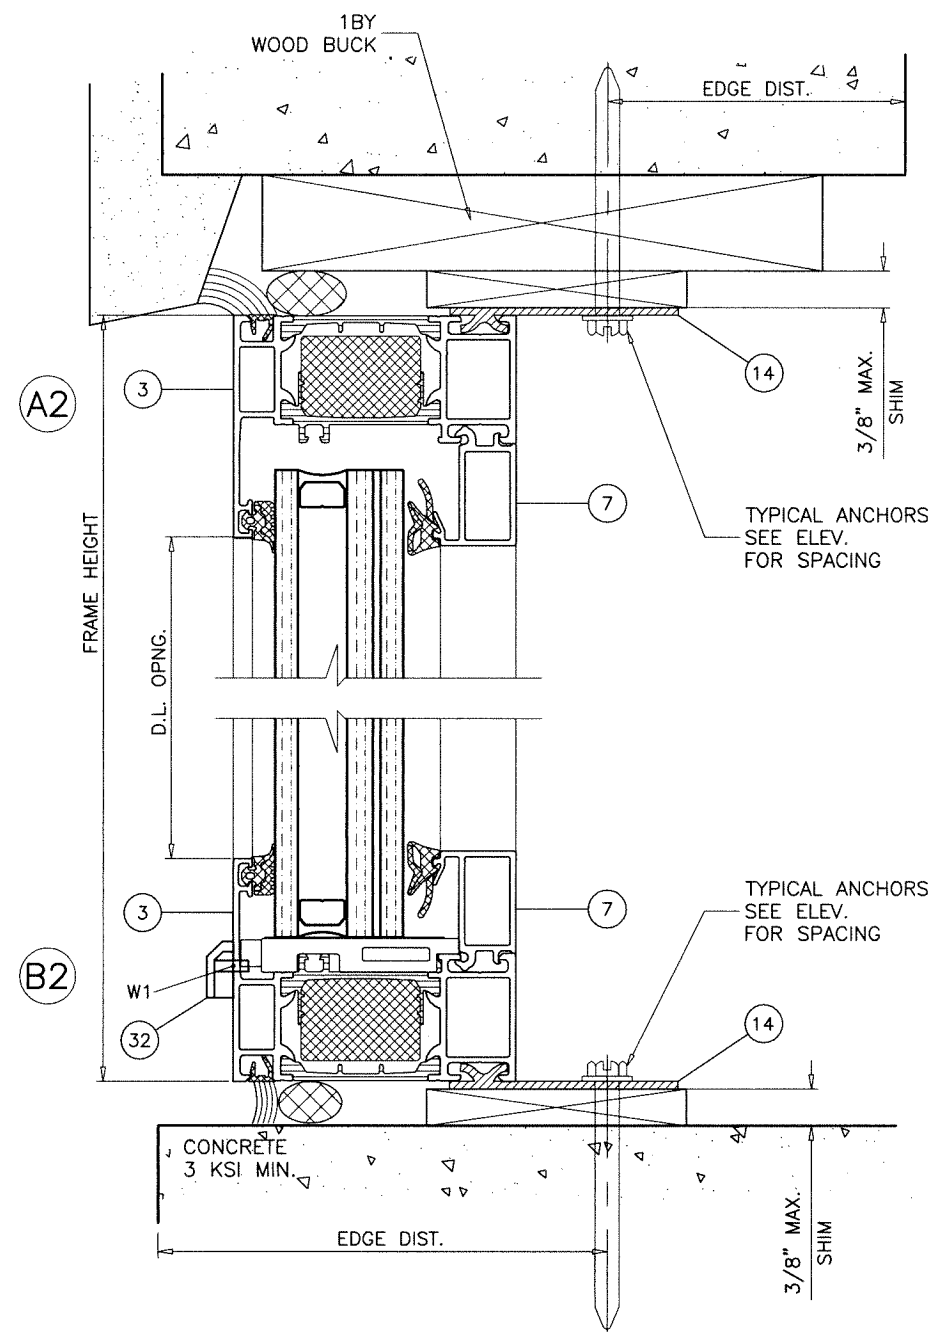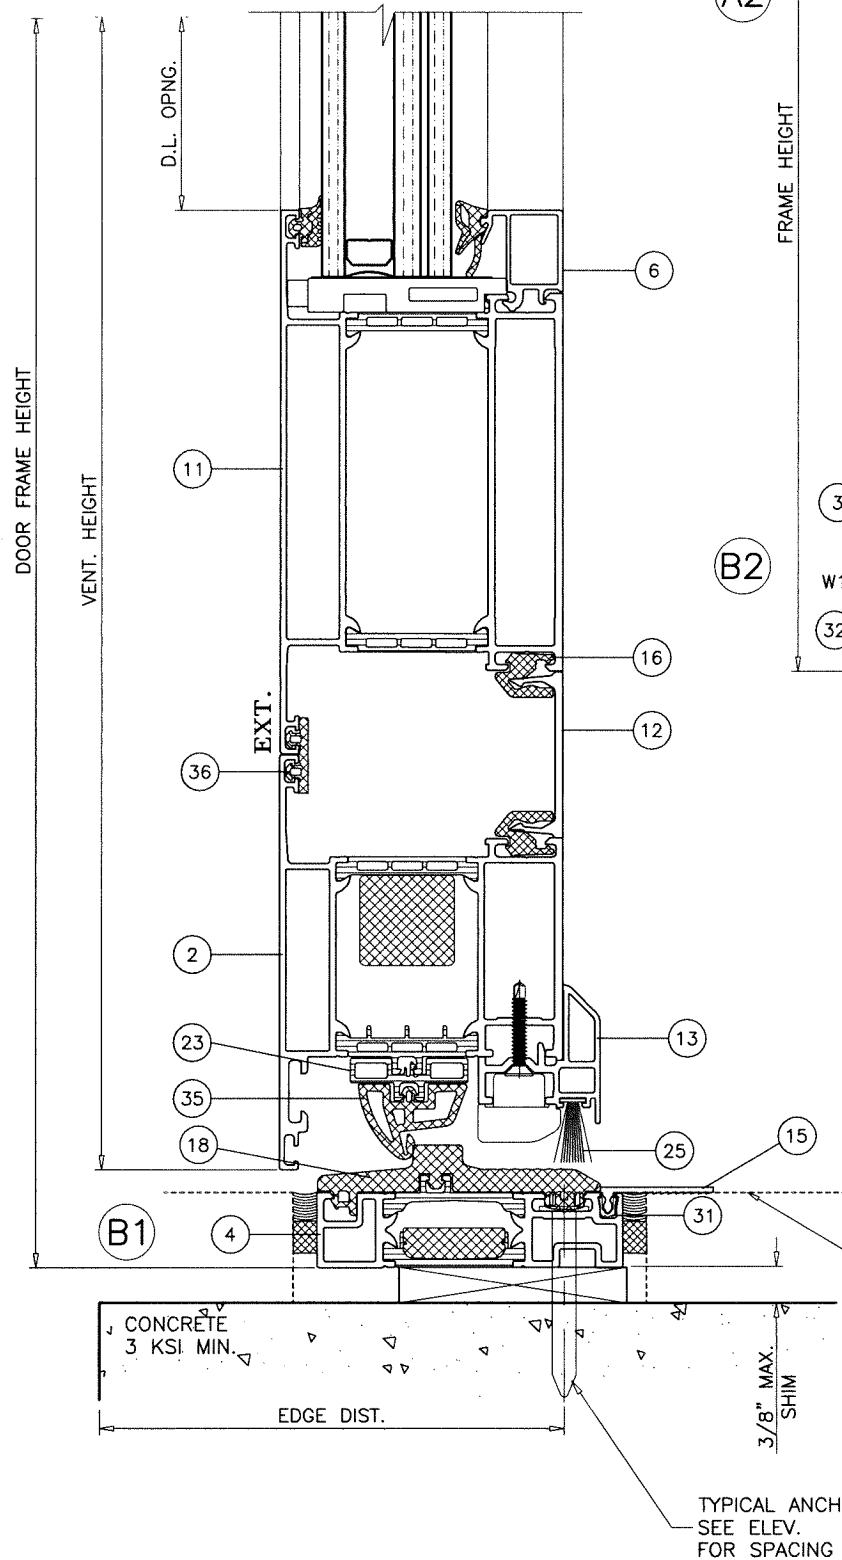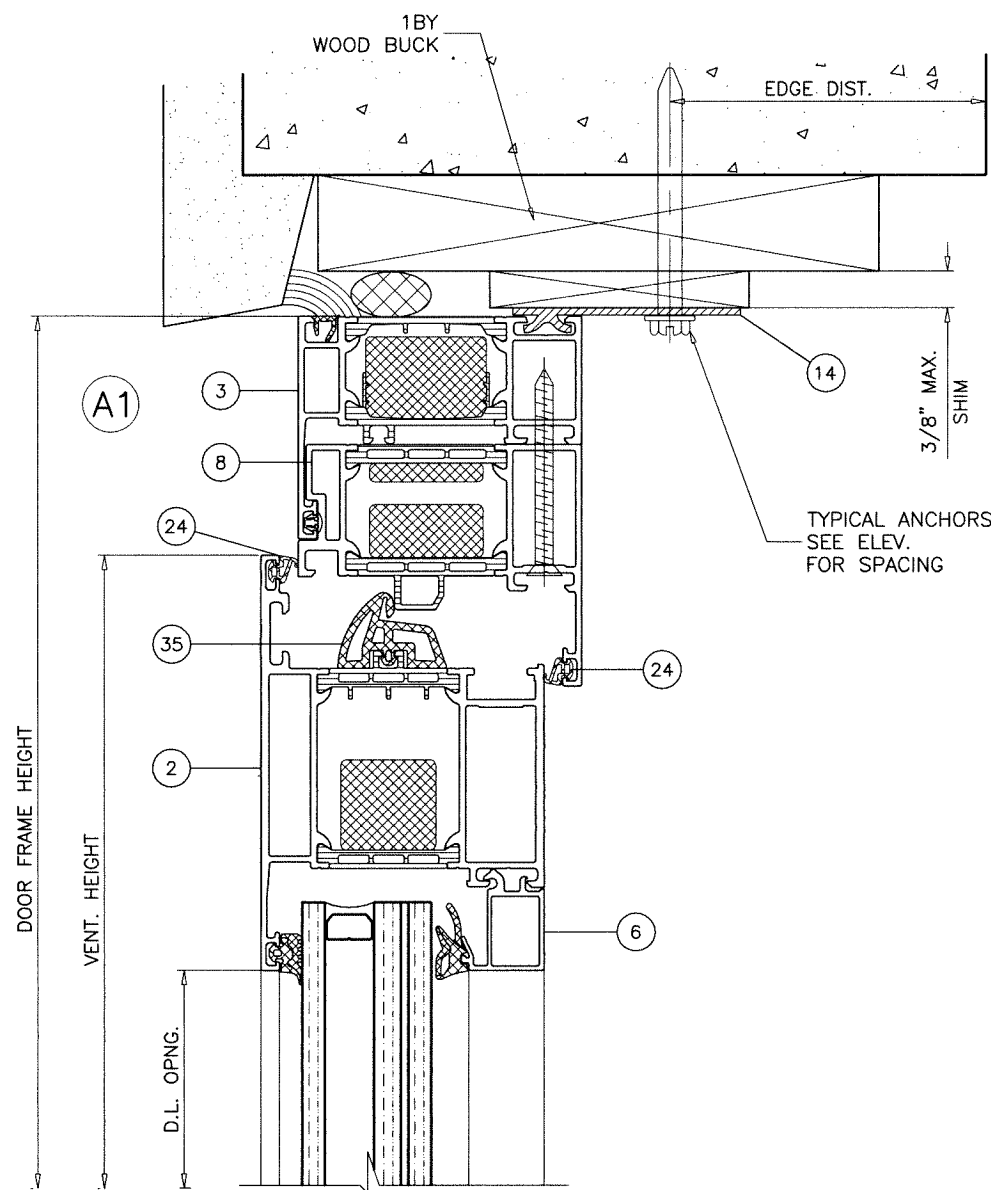


WEEPHOLES:
 W1 = (3) AT FIXED LITE SILL.
 ONE AT EACH END AND ONE AT CENTER

FLUSH WITH CONC.
 OR FINISHED FLOOR

Sealed: 9/15/2026

STRAP ANCHOR INSTALLATION

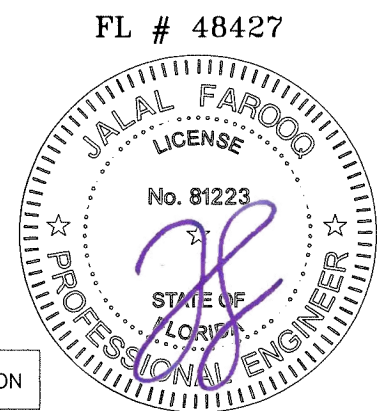

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

CMP-ANL\26-25F-BF


SERIES AWS 70.H/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)

Bigfoot Door Corp.
 1677 Aimco Boulevard
 Mississauga, ON. L4W 1H7
 PHONE: (905) 602-5887 www.bigfootdoor.com


revisions:	
no	date by description

date: 09-08-26
 scale: 1 : 2
 dr. by: MLS
 chk. by:


drawing no.
26-25F
 sheet 6 of 13

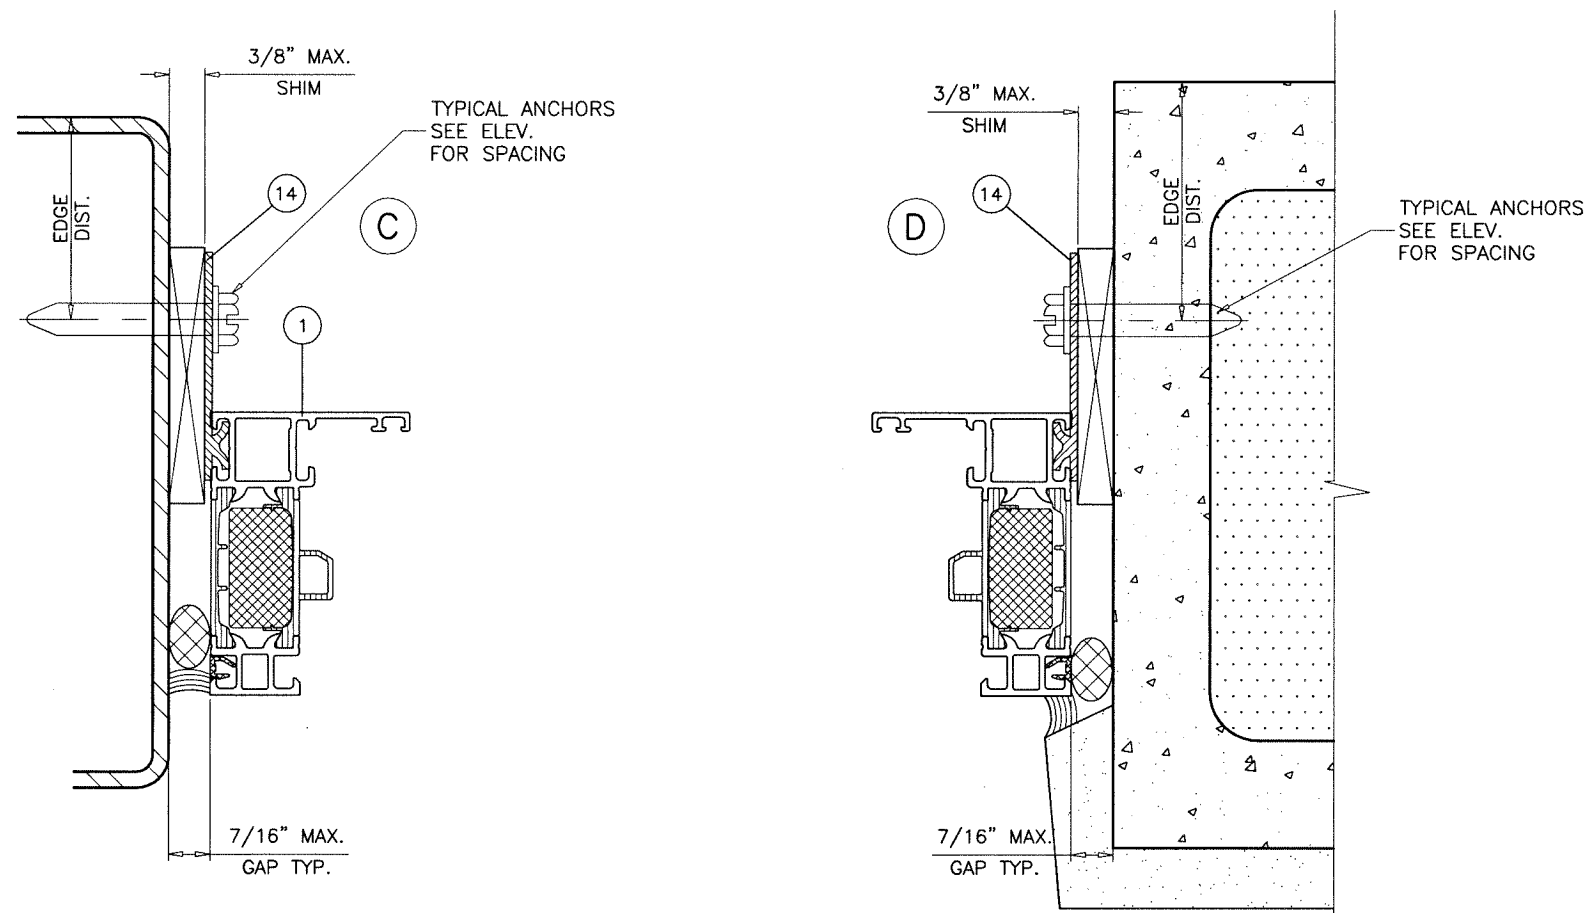

FL # 48427

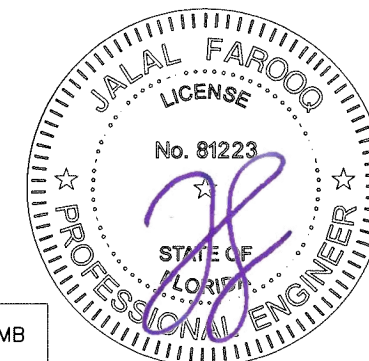


drawing no. 26-25F		sheet 7 of 13	
date:	09-08-26	revisions:	
scale: 1 : 2		no	date
dr. by: MLS			by
chk. by:			description
SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)			
Bigfoot Door Corp. 1677 Aimco Boulevard Mississauga, ON. L4W 1H7 PHONE: (905) 602-5887 www.bigfootdoor.com			

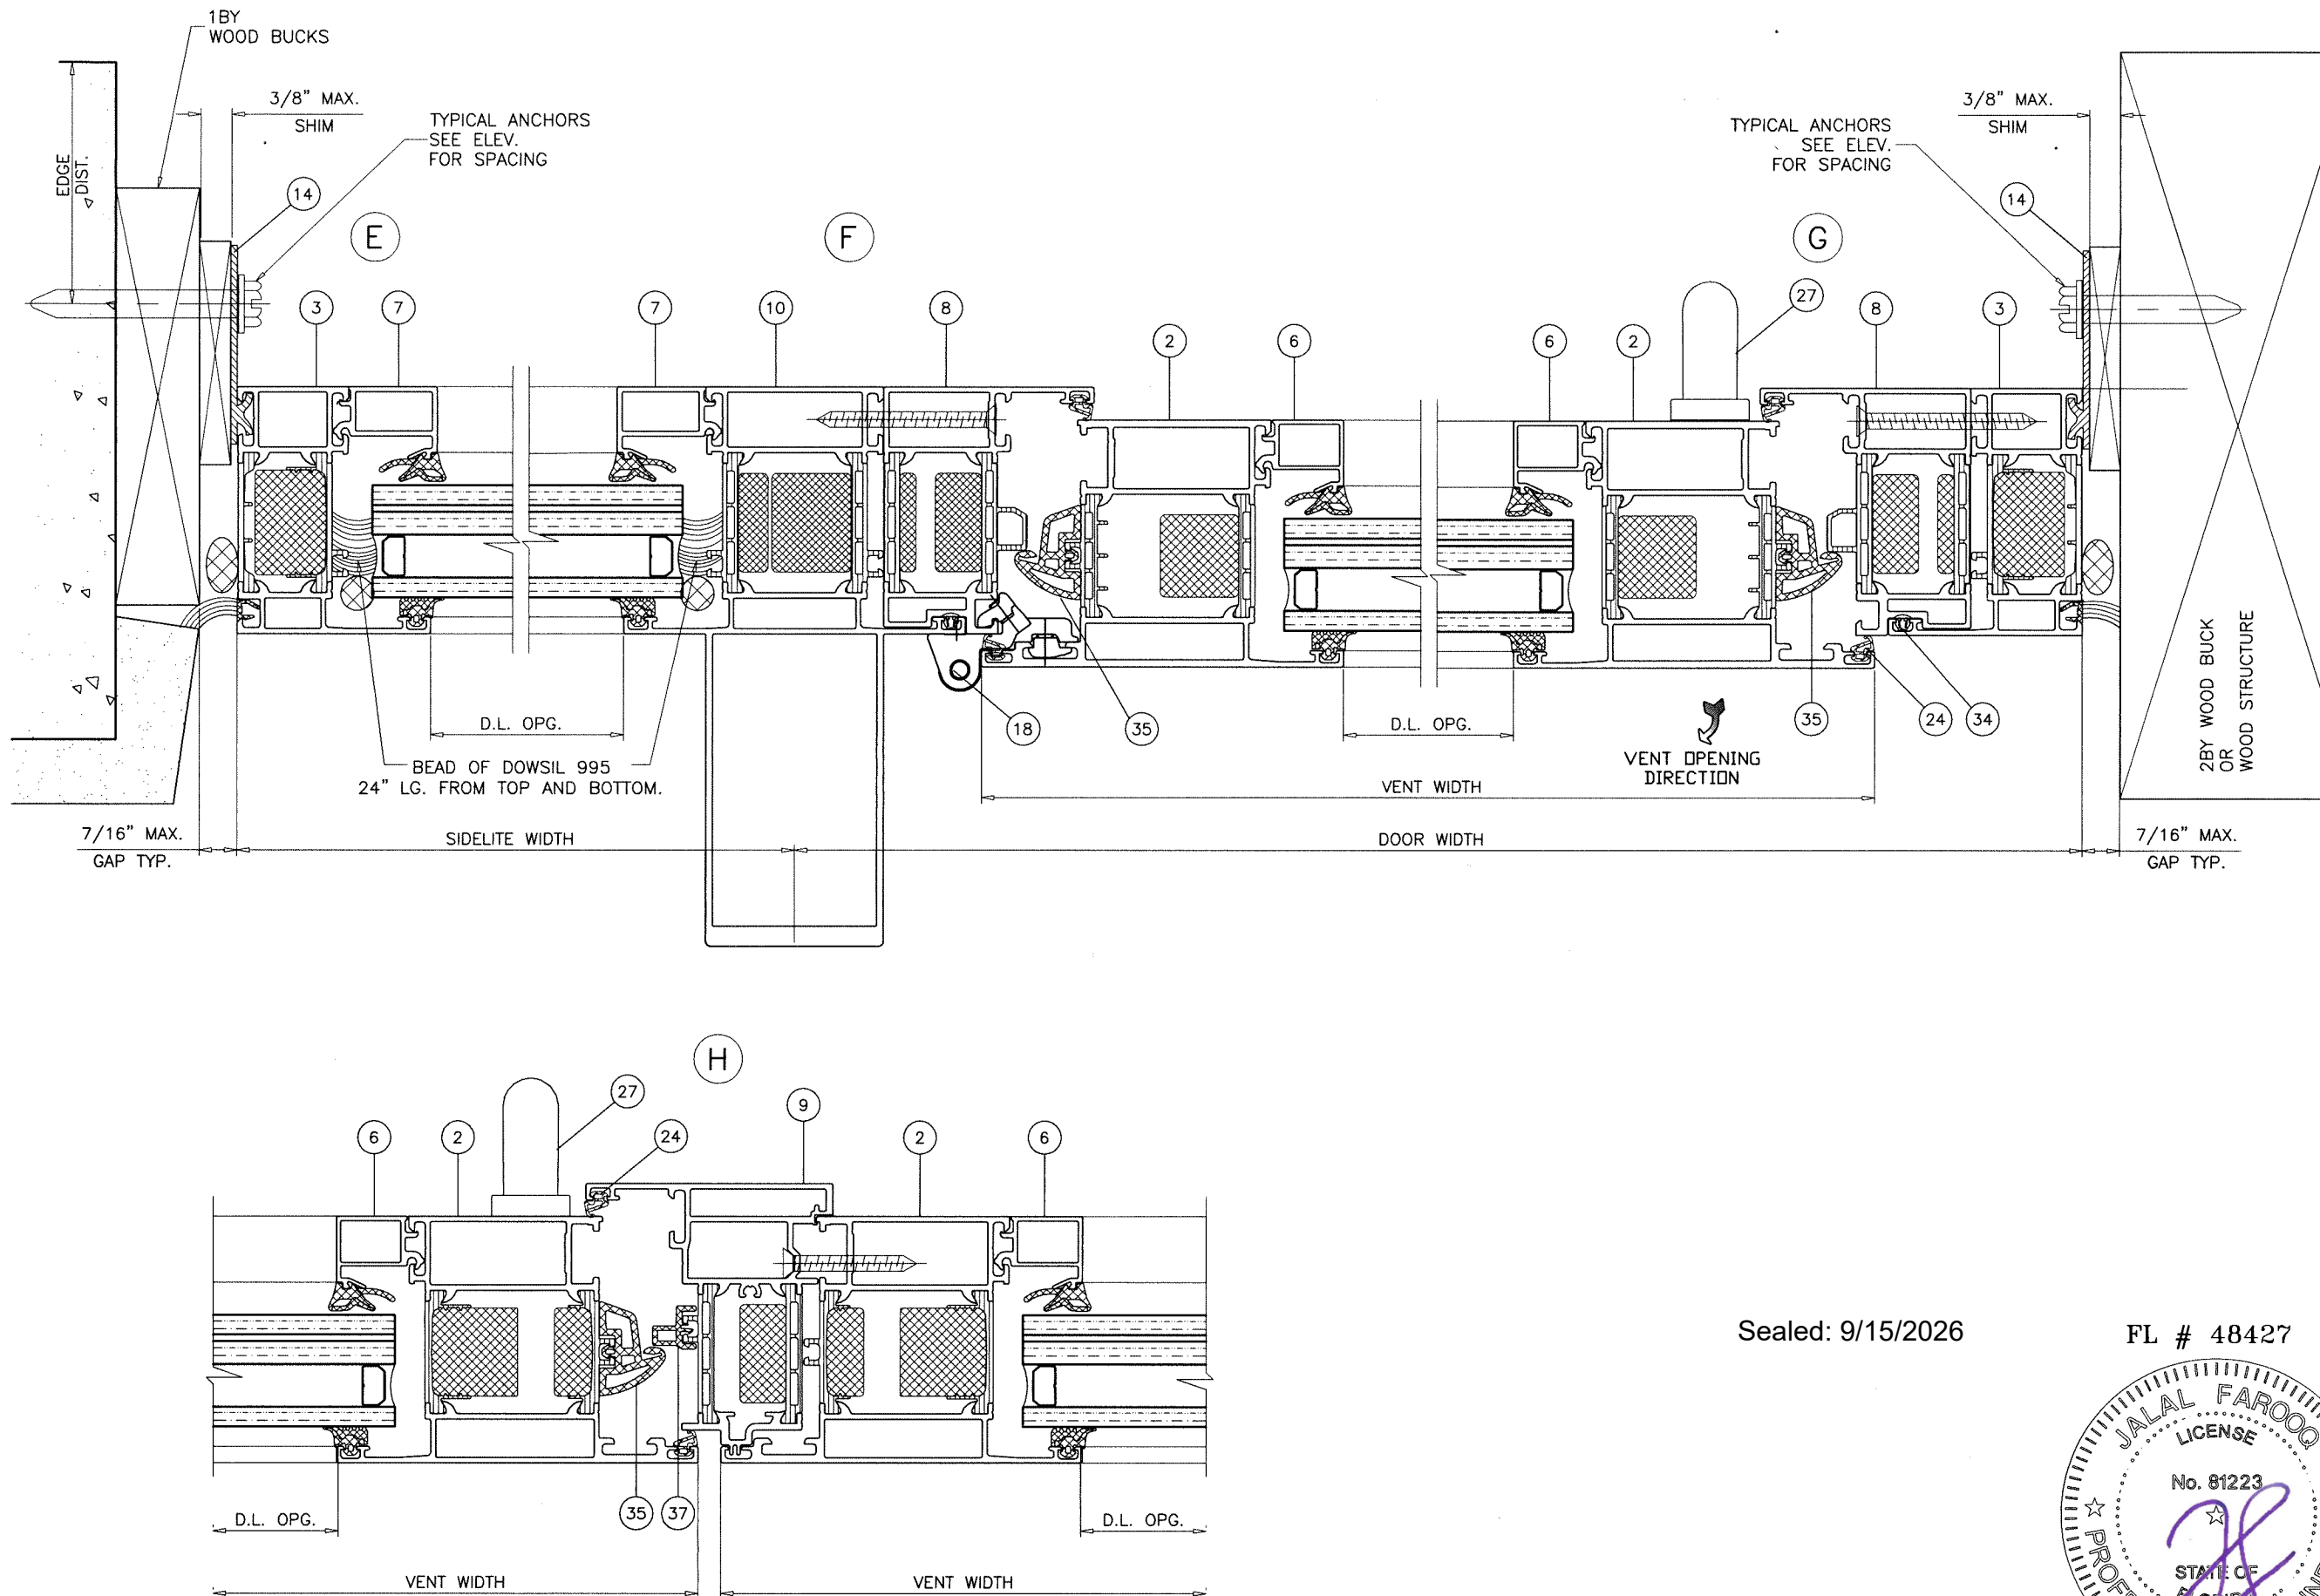

Sealed: 9/15/2026

FL # 48427




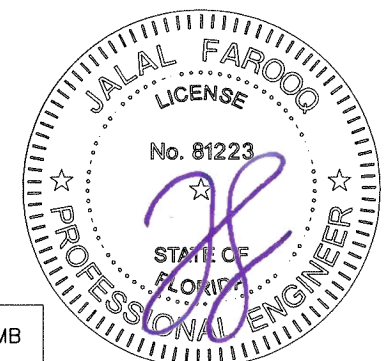


STRAP ANCHOR INSTALLATION AT JAMB

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX (305) 262-6978
 CMP-ANL\26-25F-BF

SERIES AWS 70.H/75.S+ OUTSWING TERRACE DOOR (L.M.I.)
Bigfoot Door Corp.
 1677 Airco Boulevard
 Mississauga, ON, L4W 1H7
 PHONE: (905) 602-5887 www.bigfootdoor.com


revisions:		no		date		by		description	
date:	09-08-26	no	1	scale:	1 : 2	dr. by:	MLS	chk. by:	
drawing no.		26-25F		sheet		8 of 13			

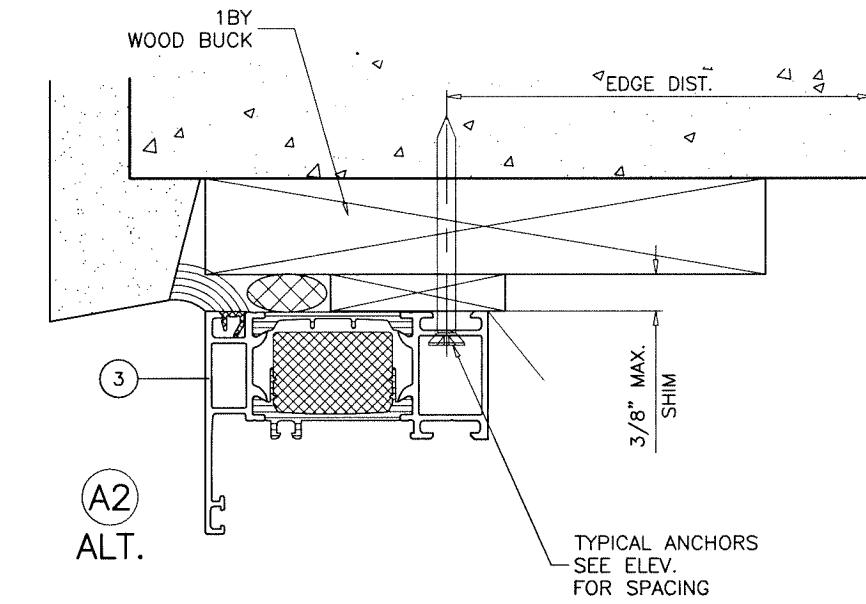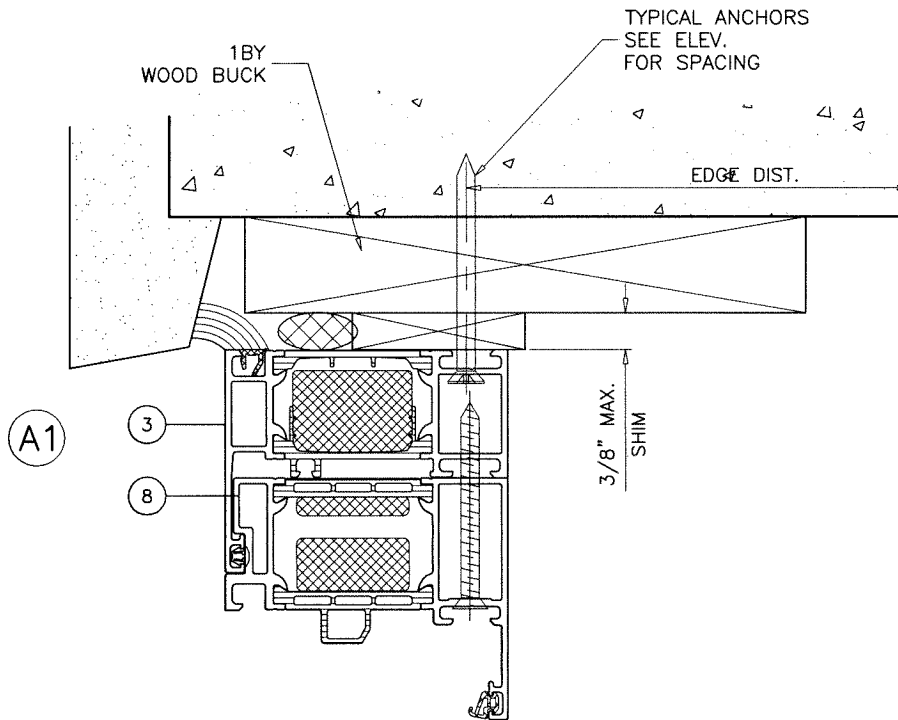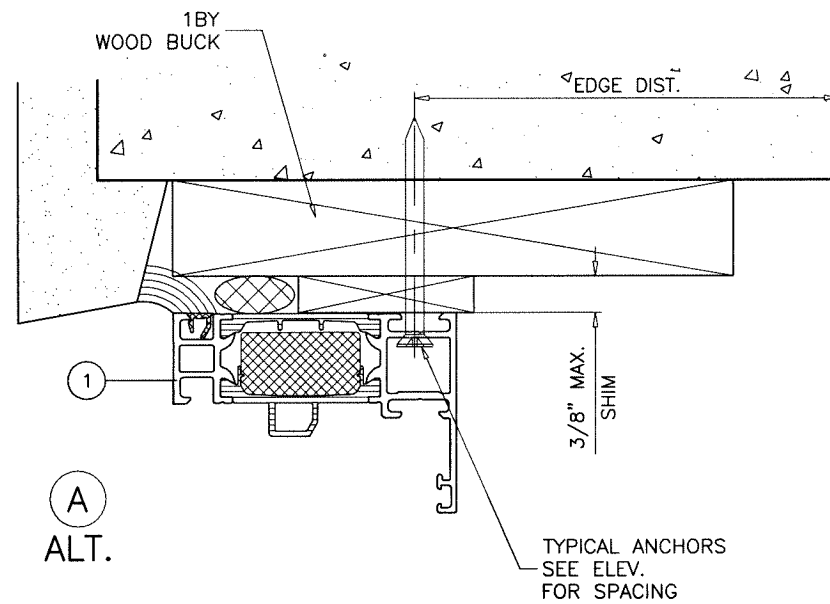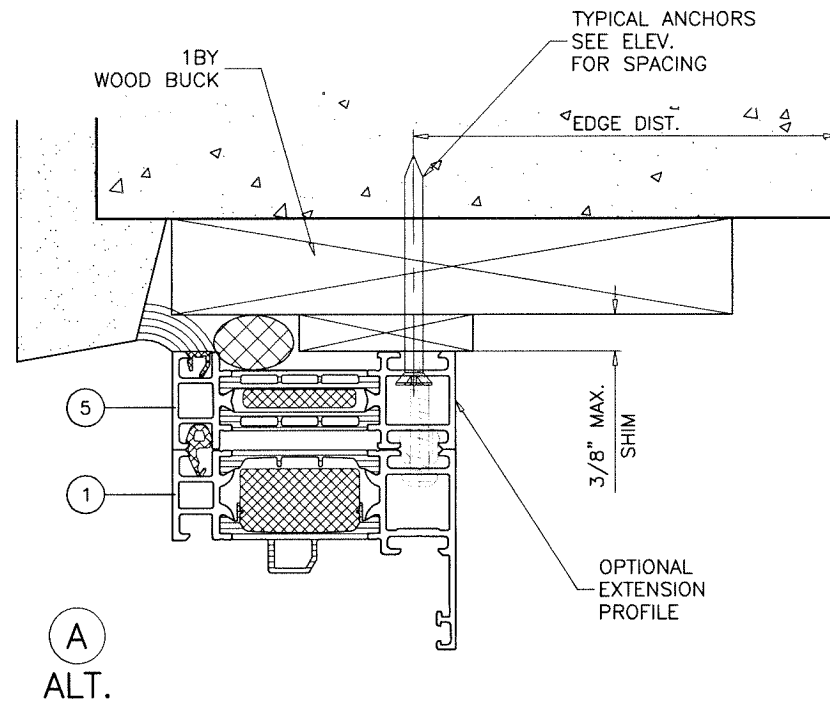

TYPICAL THROUGH FRAME INSTALLATION DETAILS
APPLIES TO ALL OTHER SHOWN SUBSTRATES.

Sealed: 9/15/2026

FL # 48427

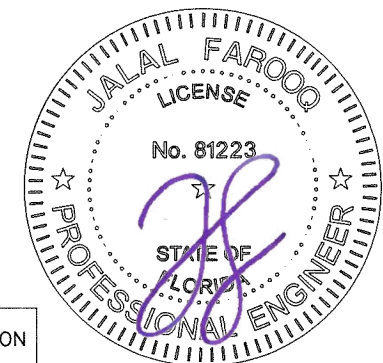




THROUGH FRAME ANCHOR INSTALLATION

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
CMP-ANL\26-25F-BF

SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)

Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887 www.bigfootdoor.com


revisions:		no		date		by		description	
date:	09-08-26	scale:	1 : 2	dr.	by:	MLS	chk.	by:	
drawing no.		26-25F		sheet 9 of 13					

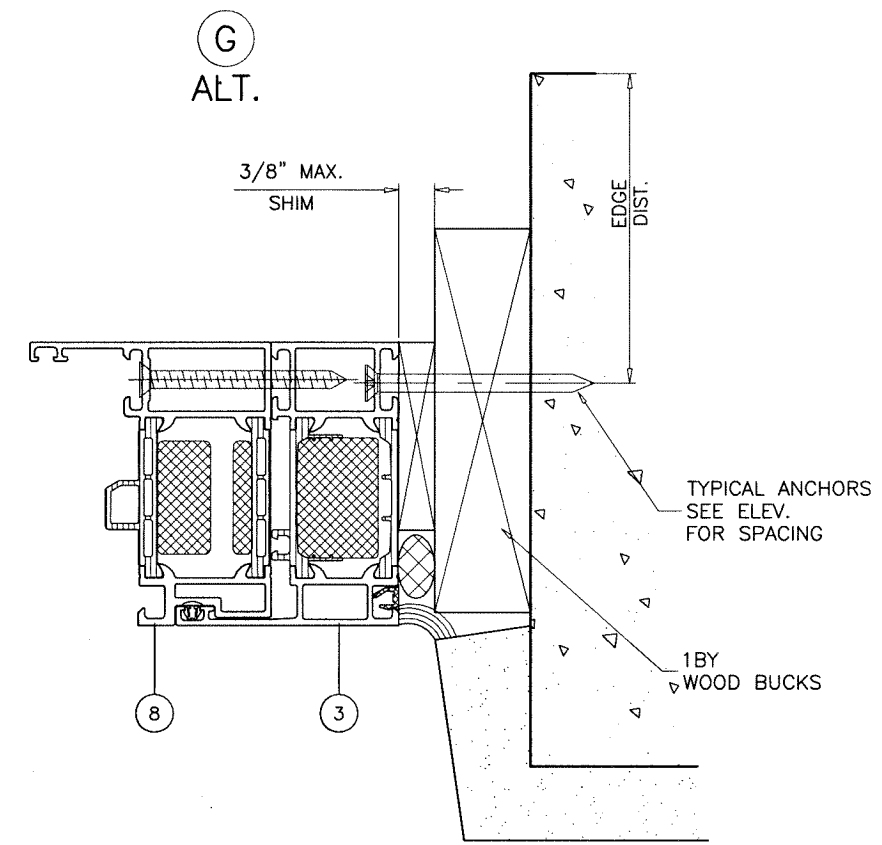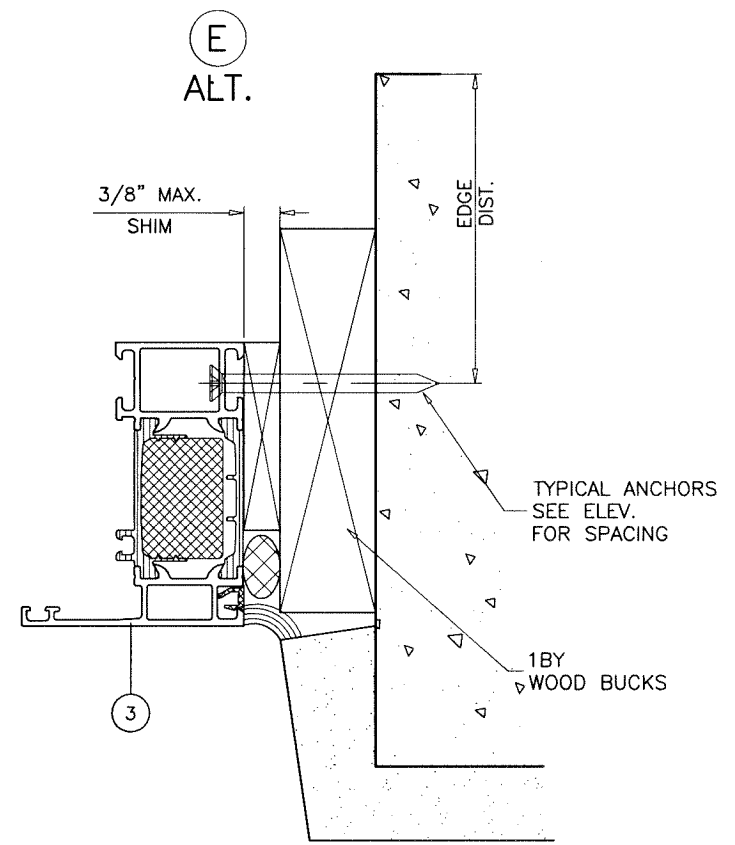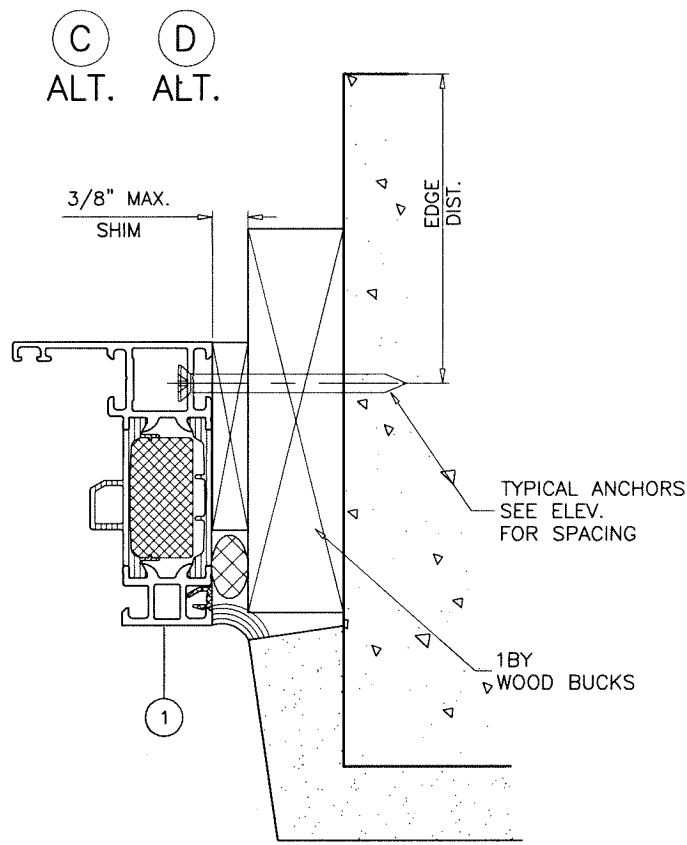

TYPICAL THROUGH FRAME INSTALLATION DETAILS APPLIES TO ALL OTHER SHOWN SUBSTRATES.

Sealed: 9/15/2026

FL # 48427

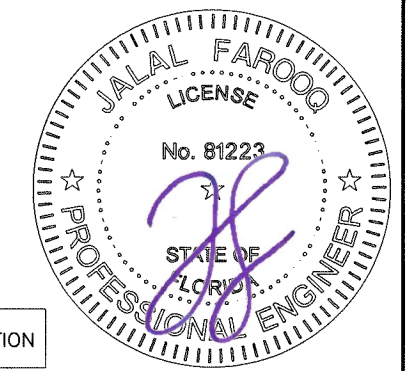

THROUGH FRAME ANCHOR INSTALLATION

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

CMP-ANL\26-25F-BF

SERIES AWS 70.H/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)

Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887 www.bigfootdoor.com

revisions:	
no	date by description

date: 09-08-26

scale: 1 : 2



dr. by: MLS

chk. by:

drawing no.

26-25F

sheet 10 of 13

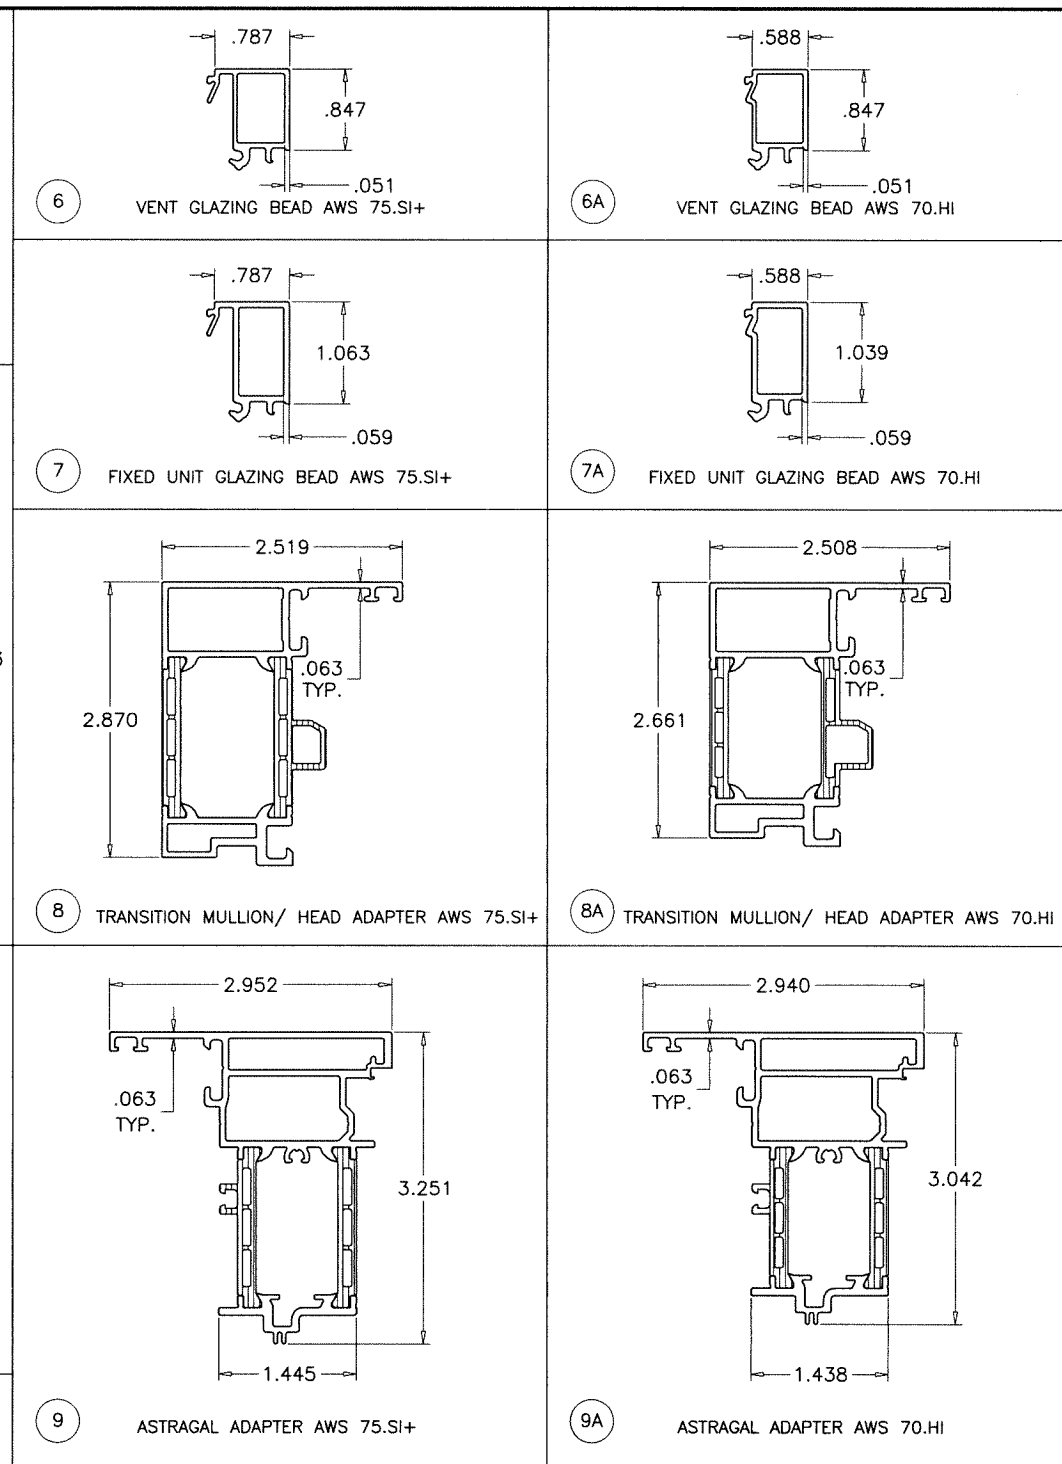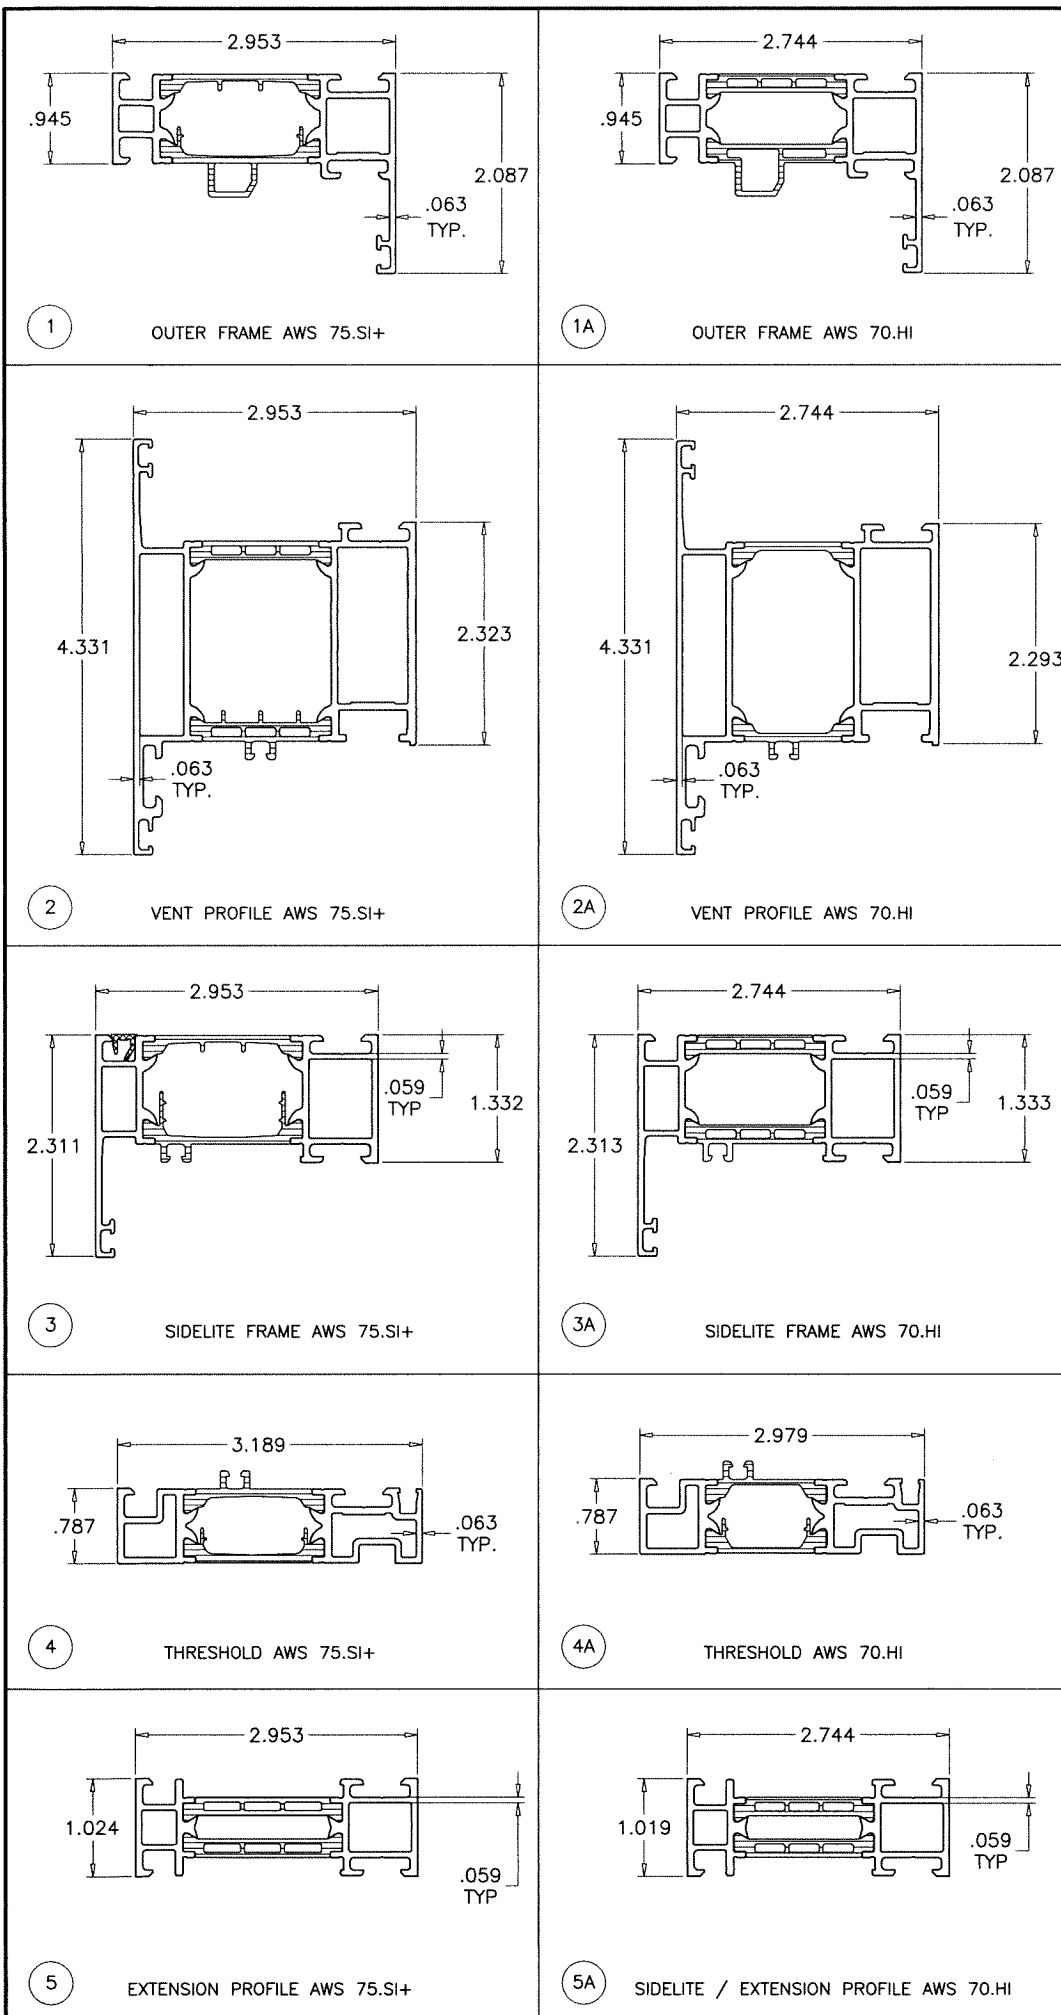

Sealed: 9/15/2026

FL # 48427



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538
CMP-ANL\26-25F-BF


SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)

Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887 www.bigfootdoor.com


revisions:	no	date	by	description

date: 09-08-26
scale: 1 : 2
dr. by: MLS
chk. by:


drawing no.
26-25F
sheet 11 of 13

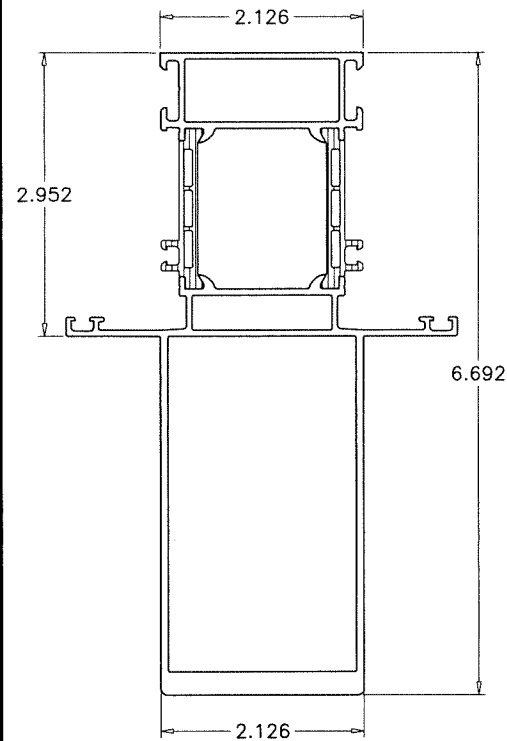


10 TRANSITION MULLION AWS 75.SI+

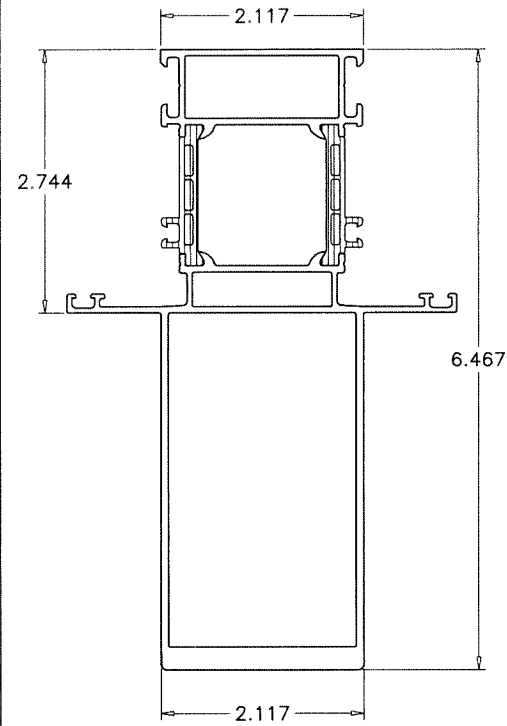


10A TRANSITION MULLION AWS 70.HI

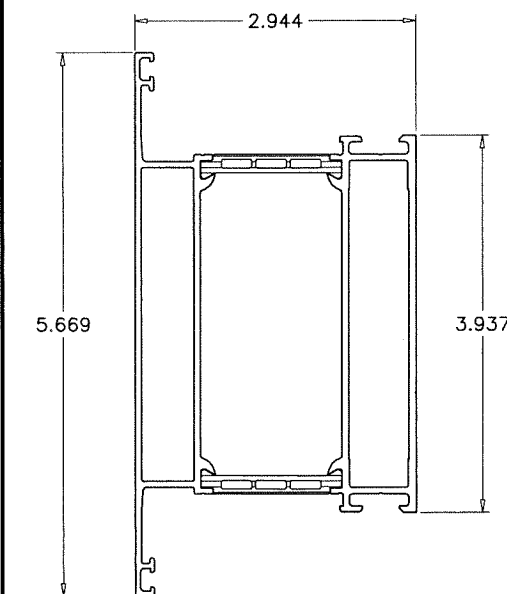


11 HI-BOTTOM ADAPTER AWS 75.SI+

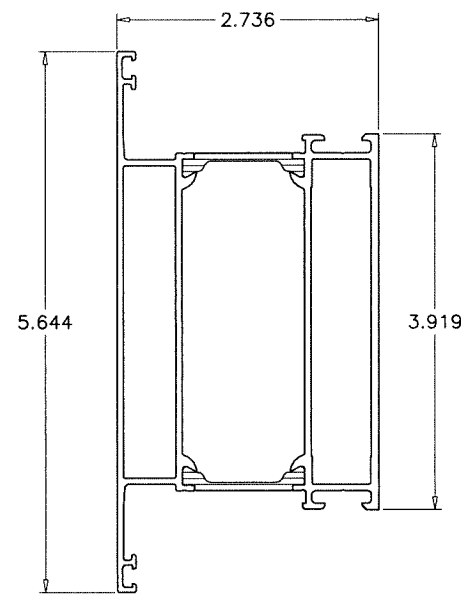


11A HI-BOTTOM ADAPTER AWS 70.HI




12 10" BOTTOM RAIL COVER



13 DOOR SILL ADAPTER

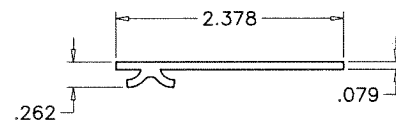


14 STRAP ANCHOR



15 WALL ATTACHMENT

Sealed: 9/15/2026

FL # 48427

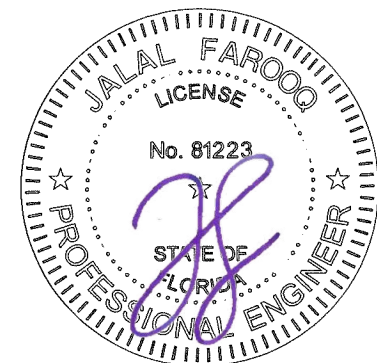

date: 09-08-26		revisions:	
scale: 1 : 2		no	date by description
dr. by: M.L.S.			
chk. by:			
drawing no. 26-25F			
sheet 12 of 13			

SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)



Bigfoot Door Corp.

1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

af c

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL
1	480830	4	AWS 75.SI+ OUTER FRAME	6063-T6
1A	197360	4	AWS 70.HI OUTER FRAME	6063-T6
2	480790	4	AWS 75.SI+ VENT PROFILE	6063-T6
2A	486380	4	AWS 70.HI VENT PROFILE	6063-T6
3	382130	4	AWS 75.SI+ SIDELITE FRAME	6063-T6
3A	358150	4	AWS 70.HI SIDELITE FRAME	6063-T6
4	486756	1	AWS 75.SI+ THRESHOLD	6063-T6
4A	486706	1	AWS 70.HI THRESHOLD	6063-T6
5	382070	AS REQD.	AWS 75.SI+ EXTENSION PROFILE	6063-T6
5A	358090	AS REQD.	AWS 70.HI EXTENSION PROFILE	6063-T6
6	345510	AS REQD.	AWS 75.SI+ VENT GLAZING BEAD	6063-T6
6A	346610	AS REQD.	AWS 70.HI VENT GLAZING BEAD	6063-T6
7	467770	AS REQD.	AWS 75.SI+ FIXED UNIT GLAZING BEAD	6063-T6
7A	489760	AS REQD.	AWS 70.HI FIXED UNIT GLAZING BEAD	6063-T6
8	494320	AS REQD.	AWS 75.SI+ TRANSITION MULLION/ HEAD ADAPTER	6063-T6
8A	494310	AS REQD.	AWS 70.HI TRANSITION MULLION/ HEAD ADAPTER	6063-T6
9	485460	AS REQD.	AWS 75.SI+ ASTRAGAL ADAPTER	6063-T6
9A	197580	AS REQD.	AWS 70.HI ASTRAGAL ADAPTER	6063-T6
10	367300	AS REQD.	AWS 75.SI+ TRANSITION MULLION	6063-T6
10A	367210	AS REQD.	AWS 70.HI TRANSITION MULLION	6063-T6
11	9634794	AS REQD.	AWS 75.SI+ HI-BOTTOM ADAPTER	6063-T6
11A	9635019	AS REQD.	AWS 70.HI HI-BOTTOM ADAPTER	6063-T6
12	9634795	AS REQD.	10" BOTTOM RAIL COVER	6063-T6
13	485880	AS REQD.	AWS 75.SI+/ 70.HI WEATHERSTRIP CARRIER	6063-T6
14	207628	AS REQD.	STRAP ANCHOR HEAD/JAMBS	50961-Fe/Zn 8 C
15	129560	AS REQD.	WALL ATTACHMENT	
16	203108	AS REQD.	PROFILE RETAINING CLIP	
17	236522/236523	AS REQD.	CORNER KEY	6063-T6
18	278475	AS REQD.	AWS 75.SI+ THRESHOLD COVER PRF. 75	
18A	278470	AS REQD.	AWS 70.HI THRESHOLD COVER PRF. 75	
19	284321	AS REQD.	GASKET 6	
19A	284351	AS REQD.	AWS 70.HI OUTER GLAZING GASKET	
20	284836	AS REQD.	AWS 75.SI+ WED. GASKET CIRC7-8MM	
20A	284837	AS REQD.	AWS 70.HI WED. GASKET CIRC7-10MM	
21	288163	2/ LITE	AWS 75.SI+ GLAZING SUPPORT	POLYAMIDE 80±5 SHORE A
21A	288166	2/ LITE	AWS 70.HI GLAZING SUPPORT	POLYAMIDE 80±5 SHORE A
22	106116	AS REQD.	LOCKING BAR	6063-T6
23	278467	AS REQD.	ADAPTER PROFILE MD	
24	224310	AS REQD.	CONTINUOUS REBATE GASKET	EPDM
25	278244	AS REQD.	BRUSH SEAL	
26	248807	5	BARREL HINGE	
27	269622	1	AWS 75.SI+ HANDLE	
27A	9639482	1	AWS 70.HI HANDLE	
28	248890/248891	1	6-POINT VERT LOCK	
29	248890/248891	1	2-POINT HORIZONTAL LOCK	
30	--	AS REQD.	SCHUCO SEALANT	
31	203086	AS REQD.	RETAINING CLIP	
32	208694	3/ LITE	WEEP SLOT COVER	
33	244516	AS REQD.	HEAD/SILL COVER	
34	224197	AS REQD.	DOOR ADAPTER GASKET	
35	278260	AS REQD.	CENTRE GASKET	
36	224114	AS REQD.	HI-BOTTOM RAIL CONNECTOR	
37	278461	AS REQD.	ASTRAGAL CENTRE GASKET RECEPTOR	

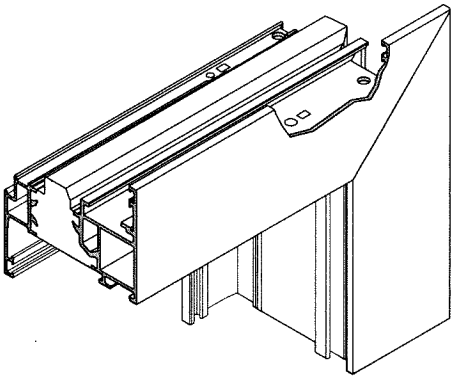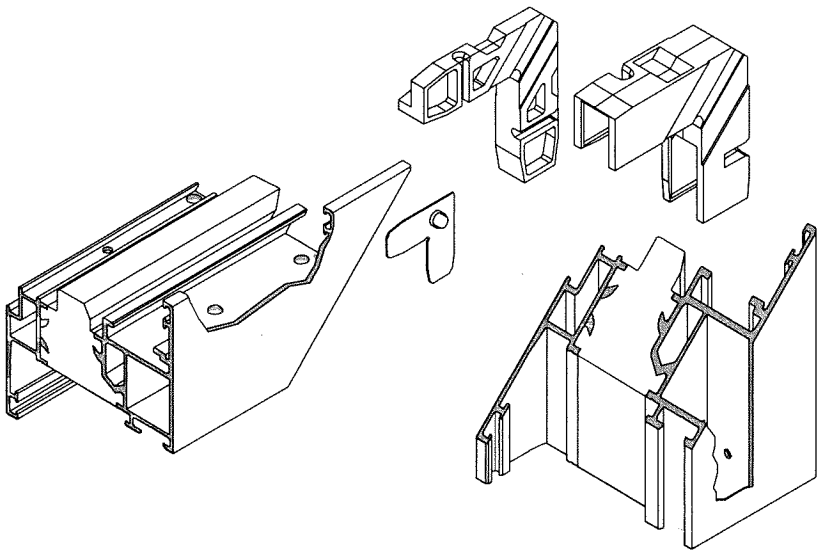

Sealed: 9/15/2026

FL # 48427



HINGES

(5) BARREL HINGE (248807). AT 3" FROM TOP AND BOTTOM ENDS AND 23-1/2", 47" AND 70-1/2" FROM BOTTOM CORNER

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
C.A.N. 3538

SERIES AWS 70.HI/75.SI+ OUTSWING TERRACE DOOR (L.M.I.)

Bigfoot Door Corp.
1677 Aimco Boulevard
Mississauga, ON. L4W 1H7
PHONE: (905) 602-5887
www.bigfootdoor.com

revisions:		no		date		by		description	
date:		09-08-26		scale:		1 : 2		dr. by: MLS	
chk. by:									
drawing no.				26-25F					
sheet 13 of 13									

CMP-ANL\26-25F-BF