

MODEL DESIGNATION: Simonton Double Hung Triple or Twin Series 75–75 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE: See Size Chart






DESIGN PRESSURE RATING: See Size Chart

USABLE CONFIGURATIONS: $\frac{X}{X} \frac{X}{X} \frac{X}{X}$ or $\frac{X}{X} \frac{X}{X}$

GENERAL DESCRIPTION: The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

NO P.E. SEAL REQUIRED.
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS

REV. #	REVISIONS:	REVISED BY:	DATE:
5	UPDATED SIZES PER NEW TESTING.	T.D.D.	08/28/13
6	ADDED MIN. EDGE DIST., SEE NOTES.	LMH	06/16/15
7	ADDED NOTES 10 & 11 – AAMA 800 AND PAGE 2.	LMH	08/18/16
8	UPDATED NOTES 9 & 11.	LMH	11/13/17
9	UPDATED TO CURRENT FBC	KKB	06/04/24

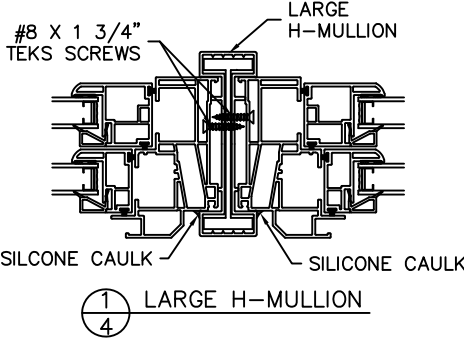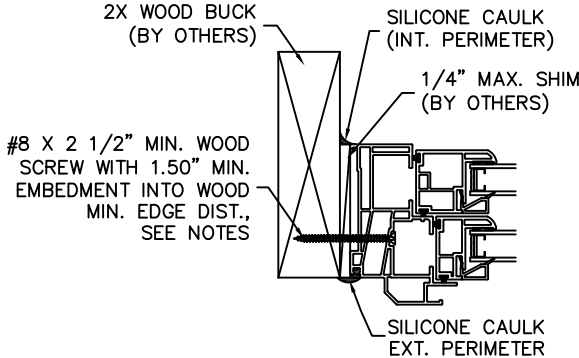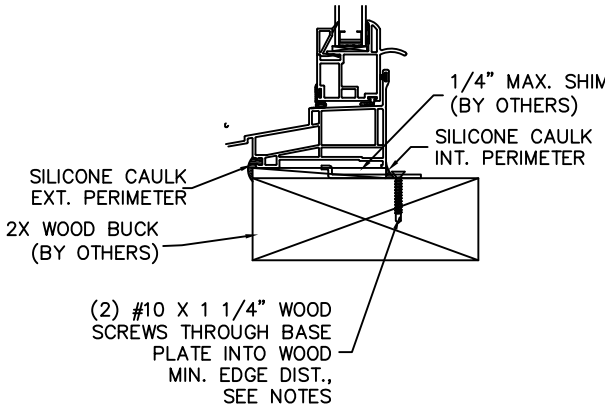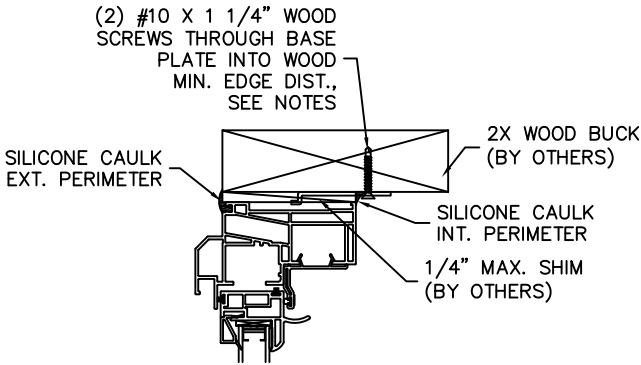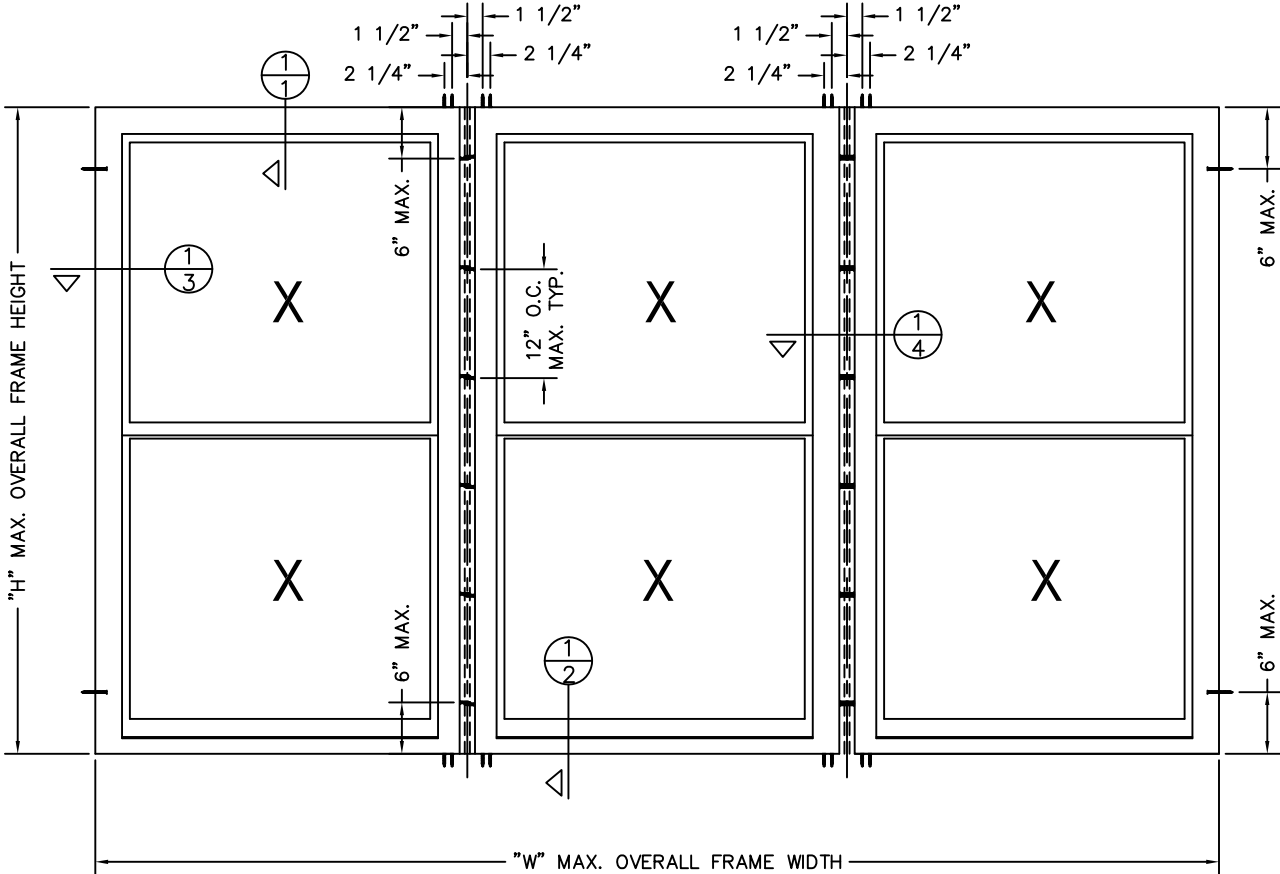

NOTES:

1. THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN. FOR USE OUTSIDE THE H.V.H.Z ONLY.
2. ALL INTERIOR AND EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED.
3. ANCHORS SHALL BE SPECIFIED AND SPACED AS SHOWN. ANCHOR EMBEDMENT INTO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO AND INTO WOOD. ANCHORS MUST ACHIEVE A MINIMUM EMBEDMENT OF 1 1/2" INTO WOOD AND MAINTAIN A MINIMUM EDGE DISTANCE OF 1".
4. THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER OR CONTRACTOR.
5. SHIMS (BY OTHERS) ARE OPTIONAL. MAXIMUM SHIM STACK IS 1/4".
6. WOOD BUCKS (BY OTHERS) MUST BE ENGINEERED AND ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
7. WHEN USED IN AREAS REQUIRING IMPACT PROTECTION, THIS PRODUCT REQUIRES THE USE OF IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
8. FLASHING (BY OTHERS) MUST BE APPLIED USING THE ASTM E 2112 METHOD APPROPRIATE FOR THE OPENING INTO WHICH THE WINDOW IS BEING INSTALLED.
9. GLAZING COMPLIES WITH ASTM E 1300.
11. Designation "X" is for Operable Panel and "O" is for Fixed Panel.
12. Use a backer rod on joints > 3/4" deep and/or wider than 1/4". Finished caulk joint should be a minimum of 3/8" deep.

CONFIGURATION TYPE	SIZE CHART		
	OVERALL SIZE		DP RATING
	WIDTH "W"	HEIGHT "H"	
TRIPLE	109"	74"	±50 PSF
TWIN	73"	74"	±50 PSF

DISCLOSURE STATEMENT This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source. FILE: FL 5167	MATERIAL:		Dimensional Tolerances Unless Otherwise Specified Decimals Angles .X ± .03 .XX ± .01 .XXX ± .005 0° 30 min.	 SIMONTON® W I N D O W S 1 Cochrane Avenue Pennsboro, WV 26415	SIZE: DRAWING NO.: B IN0060	REV.: 9
	RMS FINISH:				DRAWN BY: T.D.D.	DATE: 03/21/06
	EXCEPT AS NOTED ALLOY & TEMPER:				CHECKED BY:	DATE:
	WEIGHT:	VOLUME:			APPRV'D BY:	DATE:
	SURFACE AREA:	PERIMETER:			SERIES: 75–75 TRIPLE or TWIN H–MULLED DOUBLE HUNG	
	FINISH TREATMENT:	TITLE: 1X BUCK INSTALLATION				