

MODEL DESIGNATION: Simonton Series 07-09 / 07-10 / 07-20 Vinyl Fixed Window

MAXIMUM OVERALL NOMINAL SIZE: See size chart






DESIGN PRESSURE RATING: See size chart

USABLE CONFIGURATIONS: 0

GENERAL DESCRIPTION: The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

NO P.E. SEAL REQUIRED
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS

REV. #	REVISIONS:	REVISED BY:	DATE:
6	ADDED GLAZING DETAILS.	T.D.D.	06/06/11
7	ADDED 37" X 84" UNIT SIZE.	T.D.D.	06/25/12
8	ADDED MIN. EDGE DISTANCE TO NOTES	GJM	06/16/15
9	ADDED AAMA 800 NOTES 11 & 12	LMH	05/26/16
10	UPDATED TO CURRENT FBC.	LMH	04/17/24

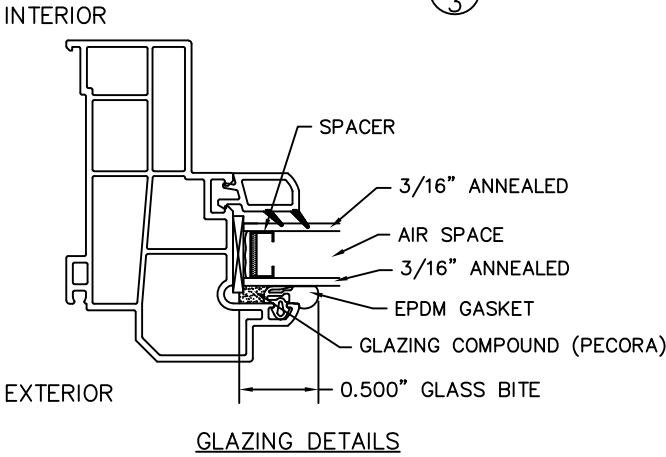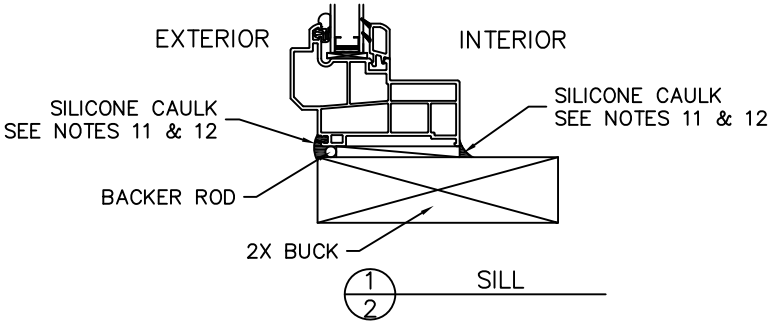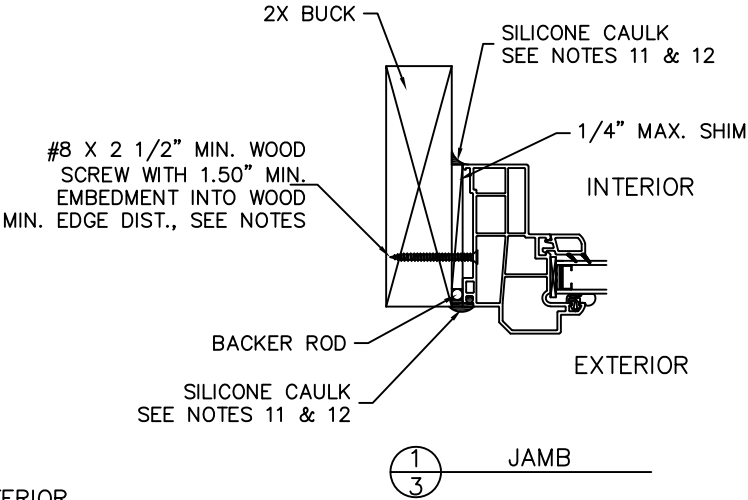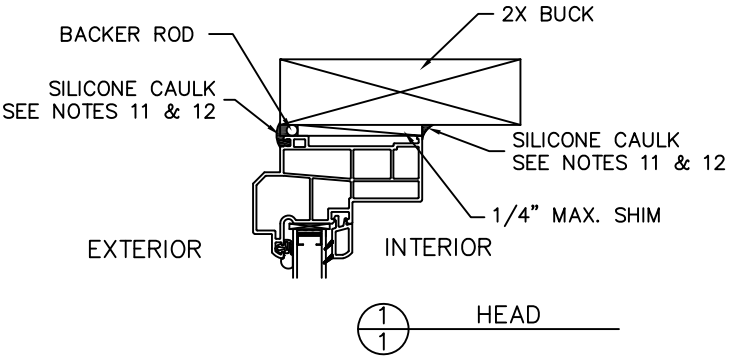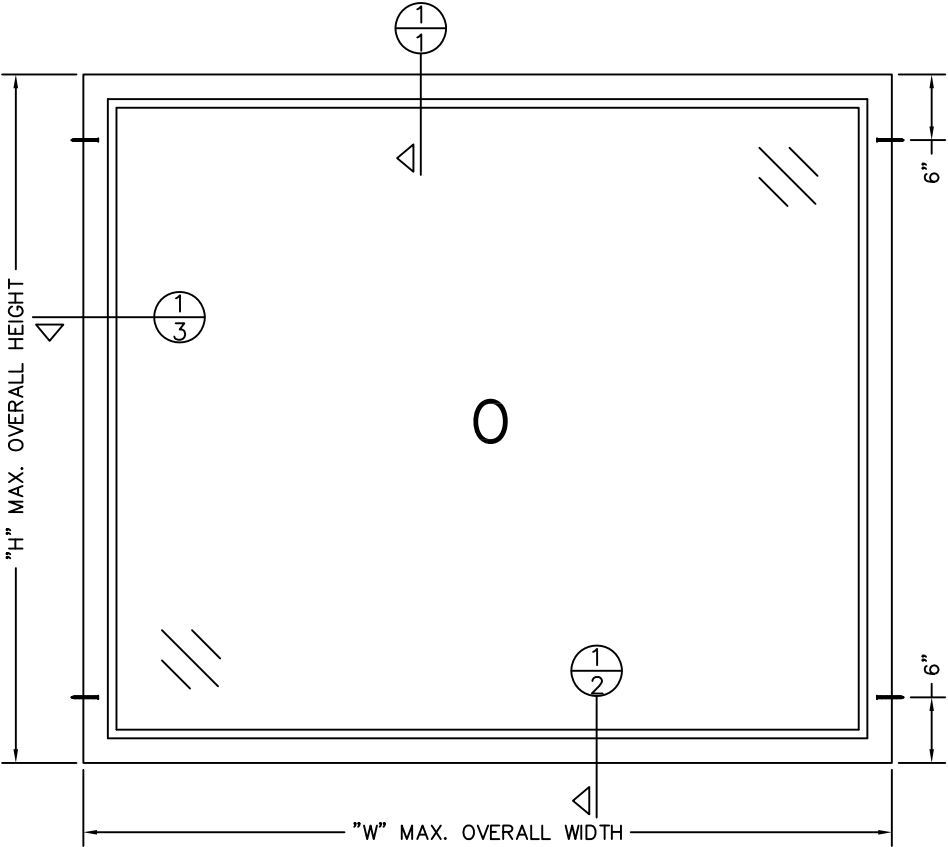

SIZE CHART		
OVERALL SIZE		DP RATING
WIDTH "W"	HEIGHT "H"	
37"	84"	±50 PSF
74"	63"	±55 PSF

- NOTES:
- THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE OUTSIDE THE HVHZ, AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN.
 - ALL EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED. INTERIOR CAULKING IS OPTIONAL UNLESS NOTED OTHERWISE.
 - ANCHORS SHALL BE SPECIFIED AND SPACED AS SHOWN. ANCHOR EMBEDMENT INTO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO AND INTO WOOD.
 - THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR.
 - SHIMS ARE OPTIONAL. MAXIMUM SHIM STACK IS 1/4".
 - WOOD BUCKS (BY OTHERS) MUST BE ENGINEERED AND ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
 - WHEN USED IN AREAS REQUIRING IMPACT PROTECTION, THIS PRODUCT REQUIRES THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
 - FLASHING SHOULD BE APPLIED USING THE ASTM E 2112 METHOD APPROPRIATE FOR THE OPENING INTO WHICH THE WINDOW IS BEING INSTALLED.
 - INSTALLATION SCREWS MUST BE AT LEAST 3/4" FROM THE EDGE OF THE WOOD.
 - GLAZING SHALL COMPLY WITH ASTM E 1300.
 - USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP.
 - DESIGNATION "X" IS FOR OPERABLE PANEL AND "O" IS FOR FIXED PANEL.

DISCLOSURE STATEMENT This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source. FILE: FL 5177	MATERIAL:		Dimensional Tolerances Unless Otherwise Specified Decimals Angles .X ± .03 .XX ± .01 .XXX ± .005	 SIMONTON® W I N D O W S 1 Cochrane Avenue Pennsboro, WV 26415	SIZE: DRAWING NO.: REV.
	RMS FINISH:				B IN0108 10
	EXCEPT AS NOTED				DRAWN BY: DATE:
	ALLOY & TEMPER:				R.T.W. 02/16/07
	WEIGHT: VOLUME:				CHECKED BY: DATE:
SURFACE AREA: PERIMETER:		G.L.S. 02/21/07			
FINISH TREATMENT:		SCALE: FIT SHEET: 1 of 1 APPR'VD BY: DATE:			
SERIES: 07-09 / 07-10 / 07-20 PICTURE (FIXED) WINDOW				TITLE: 2X BUCK INSTALLATION	