

MODEL DESIGNATION:

Simonton Horizontal Slider Series 75-75 / 07-09 / 07-10 / 07-20 /
07-75 / 75-09 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE:

See Size Chart

DESIGN PRESSURE RATING:

See Size Chart


USABLE CONFIGURATIONS:

XX

GENERAL DESCRIPTION:


The head, sill, and side jambs are extruded PVC. The wall thickness
through which the anchor screw penetrates is a minimum of 0.070".

Lucas Turner,
PE 58201
2024.08.30
11:04:08
-05'00'






08/08/2024
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRACE
TRAIL, CAMDEN, TN 38320
PH. 941-380-1574

REV. #:	REVISIONS:	REVISED BY:	DATE:
5	UPDATED SIZES PER NEW TESTING.	T.D.D.	03/19/14
6	ADDED MIN. EDGE DIST. NOTE.	B.J.S.	06/19/15
7	ADDED MULTIPLE SUBSTRATES & O.C. TO SIZE CHART.	LMH	11/27/17
8	UPDATED FOR 7TH EDITION (2020) FBC	LMH	02/15/21
9	UPDATED FOR CURRENT FBC	LMH	08/08/24

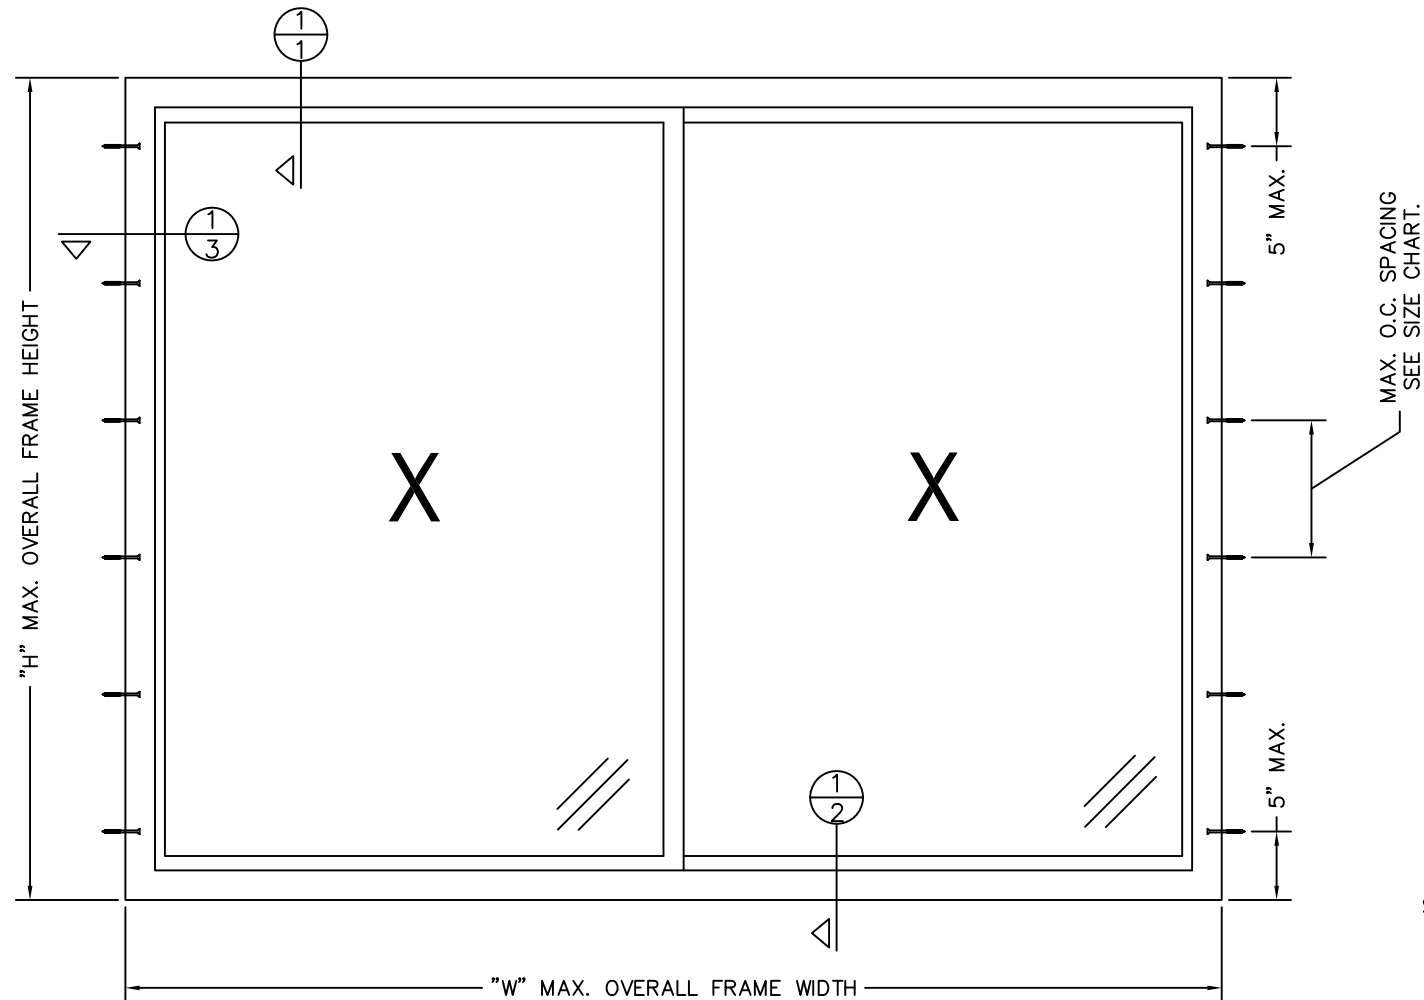

SIZE CHART			
OVERALL SIZE WIDTH "W"	OVERALL SIZE HEIGHT "H"	O.C. SPACING	DP RATING
78"	63"	18"	±25 PSF
78"	63"	12"	±40 PSF
72"	48"	10"	±45 PSF
63"	48"	10"	±55 PSF

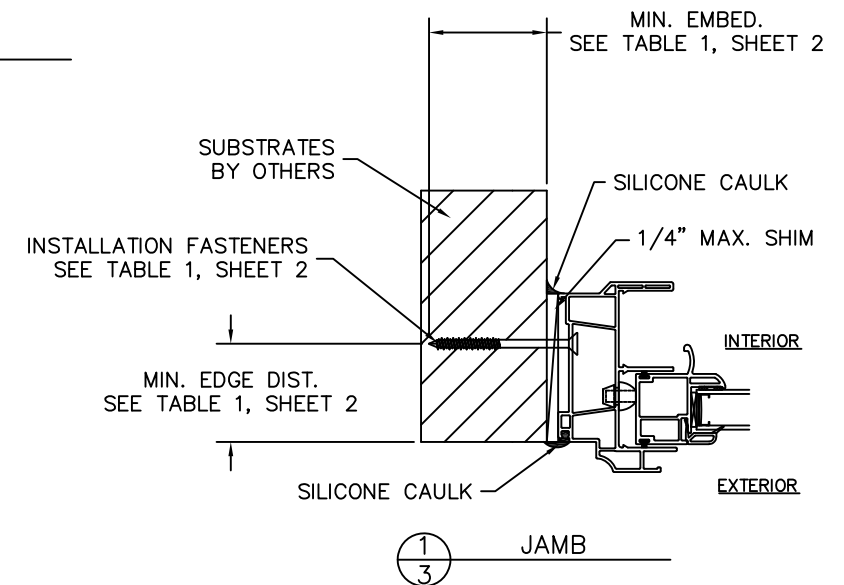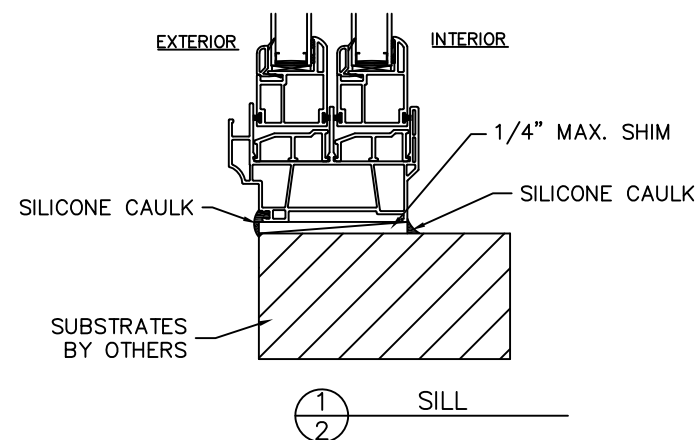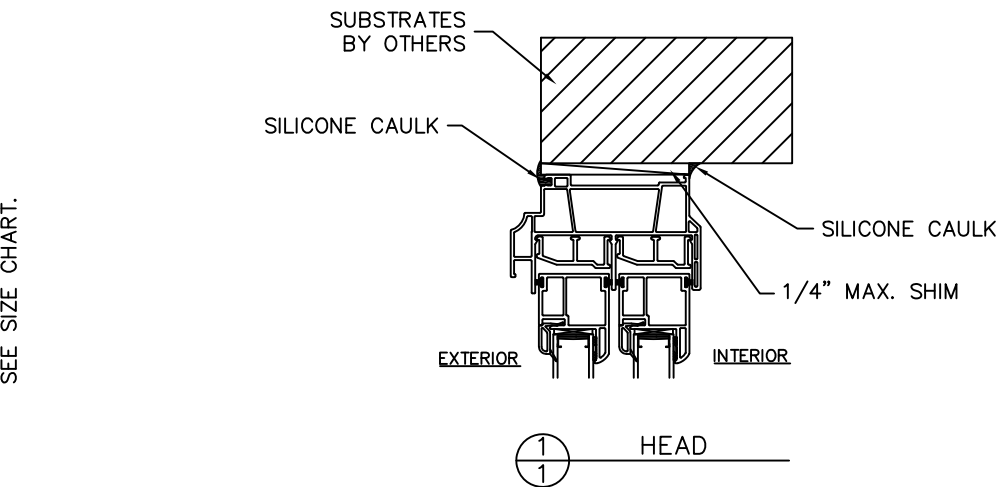DISCLOSURE STATEMENT

This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source.

FILE: FL 5179

MATERIAL:

RMS FINISH:

EXCEPT AS NOTED

ALLOY & TEMPER:

WEIGHT:

VOLUME:

SURFACE AREA:

PERIMETER:

FINISH TREATMENT:

Dimensional Tolerances
Unless Otherwise Specified

Decimals Angles
.X ± .03
.XX ± .01
.XXX ± .005
0° 30 min.



SCALE: FIT	SHEET: 1 of 2	APPRV'D BY:	DATE:
SERIES: 75-75 / 07-09 / 07-10 / 07-20 07-75 / 75-09 / 75-10 / 75-20 SLIDER			
TITLE: 1X BUCK INSTALLATION			

SIZE: DRAWING NO.:
B IN0224

DRAWN BY: T.D.D. DATE: 01/29/08

CHECKED BY: DATE:

APPRV'D BY: DATE:

REV.:
9

4		3		2		1																																						
MODEL DESIGNATION:		Simonton Horizontal Slider Series 07-75 / 07-09 / 07-10 / 07-20 / 75-09 Vinyl Window		 08/08/2024 LUCAS A. TURNER, P.E. FL PE # 58201 TURNER ENGINEERING & CONSULTING, INC. (COA # 29779) 2428 OLD NATCHEZ TRACE TRAIL, CAMDEN, TN 38320 PH. 941-380-1574		REV. #:	REVISIONS:	REVISED BY:	DATE:																																			
MAXIMUM OVERALL NOMINAL SIZE:		See Size Chart				5	UPDATED SIZES PER NEW TESTING.	T.D.D.	03/19/14																																			
DESIGN PRESSURE RATING:		See Size Chart				6	ADDED MIN. EDGE DIST. NOTE.	B.J.S.	06/19/15																																			
USABLE CONFIGURATIONS:		XX				7	ADDED MULTIPLE SUBSTRATES & O.C. TO SIZE CHART.	LMH	11/27/17																																			
GENERAL DESCRIPTION:		The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".				8	UPDATED FOR 7TH EDITION (2020) FBC	LMH	02/15/21																																			
						9	UPDATED FOR CURRENT FBC	LMH	08/08/24																																			
TABLE 1: INSTALLATION FASTENERS TABLE <table><tr><th>ID</th><th>SUBSTRATE TYPE</th><th>ANCHOR TYPE</th><th>MIN. EMBED</th><th>MIN. EDGE DISTANCE</th></tr><tr><td>A</td><td>CONCRETE (2 KSI MIN.)</td><td>3/16" ITW TAPCON</td><td>1-1/2"</td><td>1-1/8"</td></tr><tr><td>B</td><td>HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)</td><td>3/16" ITW TAPCON</td><td>1"</td><td>2"</td></tr><tr><td>C</td><td>2X MIN. SOUTHERN PINE WOOD (G=0.55)</td><td>3/16" ITW TAPCON</td><td>1-3/8"</td><td>7/8"</td></tr><tr><td>D</td><td>2X MIN. SOUTHERN PINE WOOD (G=0.55)</td><td>#10 WOOD SCREW</td><td>1-3/8"</td><td>7/8"</td></tr><tr><td>E</td><td>16 GAUGE (0.060") MIN. STEEL STUD, 33KSI YIELD MIN.</td><td>#10-16 ITW TEKS SELF-DRILLING SCREW</td><td>FULL THREAD</td><td>1/2"</td></tr><tr><td>F</td><td>1/8" ALUM. 6063-T5 MIN. OR 1/8" STEEL 36 KSI MIN.</td><td>#10 GRADE 5 SELF-TAPPING/DRILLING SCREW</td><td>FULL THREAD</td><td>1/2"</td></tr></table>										ID	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED	MIN. EDGE DISTANCE	A	CONCRETE (2 KSI MIN.)	3/16" ITW TAPCON	1-1/2"	1-1/8"	B	HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"	C	2X MIN. SOUTHERN PINE WOOD (G=0.55)	3/16" ITW TAPCON	1-3/8"	7/8"	D	2X MIN. SOUTHERN PINE WOOD (G=0.55)	#10 WOOD SCREW	1-3/8"	7/8"	E	16 GAUGE (0.060") MIN. STEEL STUD, 33KSI YIELD MIN.	#10-16 ITW TEKS SELF-DRILLING SCREW	FULL THREAD	1/2"	F	1/8" ALUM. 6063-T5 MIN. OR 1/8" STEEL 36 KSI MIN.	#10 GRADE 5 SELF-TAPPING/DRILLING SCREW	FULL THREAD	1/2"
ID	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED	MIN. EDGE DISTANCE																																								
A	CONCRETE (2 KSI MIN.)	3/16" ITW TAPCON	1-1/2"	1-1/8"																																								
B	HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"																																								
C	2X MIN. SOUTHERN PINE WOOD (G=0.55)	3/16" ITW TAPCON	1-3/8"	7/8"																																								
D	2X MIN. SOUTHERN PINE WOOD (G=0.55)	#10 WOOD SCREW	1-3/8"	7/8"																																								
E	16 GAUGE (0.060") MIN. STEEL STUD, 33KSI YIELD MIN.	#10-16 ITW TEKS SELF-DRILLING SCREW	FULL THREAD	1/2"																																								
F	1/8" ALUM. 6063-T5 MIN. OR 1/8" STEEL 36 KSI MIN.	#10 GRADE 5 SELF-TAPPING/DRILLING SCREW	FULL THREAD	1/2"																																								
NOTES: 1. THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE OUTSIDE THE HVHZ, AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN. 2. ALL INTERIOR AND EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED. 3. ANCHOR TYPE, SIZE, SPACING, EMBEDMENT, AND EDGE DISTANCE SHALL BE AS SPECIFIED IN THESE DRAWINGS. USE APPROPRIATE ANCHORAGE FROM TABLE I ACCORDING TO SUBSTRATE TYPE. A MINIMUM CENTER-TO-CENTER SPACING OF 3" SHALL BE MAINTAINED BETWEEN ALL ITW TAPCONS IN ANY DIRECTION. 4. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR MASONRY OPENINGS WITH WOOD BUCKS LESS THAN 1-1/2" THICK, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, AND INTO MASONRY SUBSTRATE. WOOD BUCKS WITH MASONRY ARE OPTIONAL. 5. WOOD OR MASONRY OPENINGS, BUCKS, AND BUCK FASTENERS, BY OTHERS, SHALL BE PROPERLY DESIGNED AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. 6. THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR. 7. SHIMS ARE REQUIRED WHERE GAPS OF GREATER THAN 1/16" EXIST BETWEEN OPENING AND FRAME. MAX. SHIM STACK IS 1/4". SHIMS SHALL BE LOAD-BEARING AND CAPABLE OF TRANSFERRING LOADS TO THE SUBSTRATE. 8. WHEN USED IN AREAS REQUIRING IMPACT PROTECTION, THIS PRODUCT REQUIRES THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION. 9. SEALING AND FLASHING BY OTHERS SHOULD BE APPLIED USING THE ASTM E 2112 METHODOLOGY APPROPRIATE FOR THE OPENING INTO WHICH THE PRODUCT IS BEING INSTALLED. OVERALL WATER PENETRATION RESISTANCE OF THE INSTALLED PRODUCT IS NOT ADDRESSED IN THIS DRAWING AND IS THE RESPONSIBILITY OF OTHERS. 10. GLAZING SHALL COMPLY WITH ASTM E 1300. 11. ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS. ANY DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT REACTIONS IN ACCORDANCE WITH CODE REQUIREMENTS. 12. A WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR THE ANALYSIS OF WOOD SCREWS ONLY. 13. PRODUCTS SHALL BE CONSTRUCTED AS SPECIFIED IN TEST REPORTS ATI-D2299.01-50I-47, ATI-D2300.01-50I-47-RI AND ATI-D2303.01-50I-47-RI. 14. DESIGNATION "X" AND "O" STAND FOR THE FOLLOWING: X: OPERABLE PANELO: FIXED PANEL 15. USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP.																																												
4		3		2		1																																						
DISCLOSURE STATEMENT This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source. FILE: FL 5179		MATERIAL:		Dimensional Tolerances Unless Otherwise Specified DecimalsAngles .X ± .03 .XX ± .01 .XXX ± .005		 SIMONTON® W I N D O W S 1 Cochrane Avenue Pennsboro, WV 26415 SCALE: FITSHEET: 2 of 2 SERIES: 07-75 / 75-09 / 75-10 / 75-20 SLIDER TITLE: 1X BUCK INSTALLATION		SIZE: DRAWING NO.: REV.:																																				
		RMS FINISH:						BINO224																																				
		EXCEPT AS NOTED						DRAWN BY: DATE:																																				
		ALLOY & TEMPER:						T.D.D.01/29/08																																				
WEIGHT:		VOLUME:	CHECKED BY: DATE:																																									
SURFACE AREA:		PERIMETER:	APPR'VD BY: DATE:																																									
FINISH TREATMENT:																																												