


MODEL DESIGNATION: Simonton Single Hung Series 43-17 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE: See Size Chart

DESIGN PRESSURE RATING: See Size Chart

USABLE CONFIGURATIONS: $\frac{0}{X} \frac{0}{X}$

GENERAL DESCRIPTION: The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

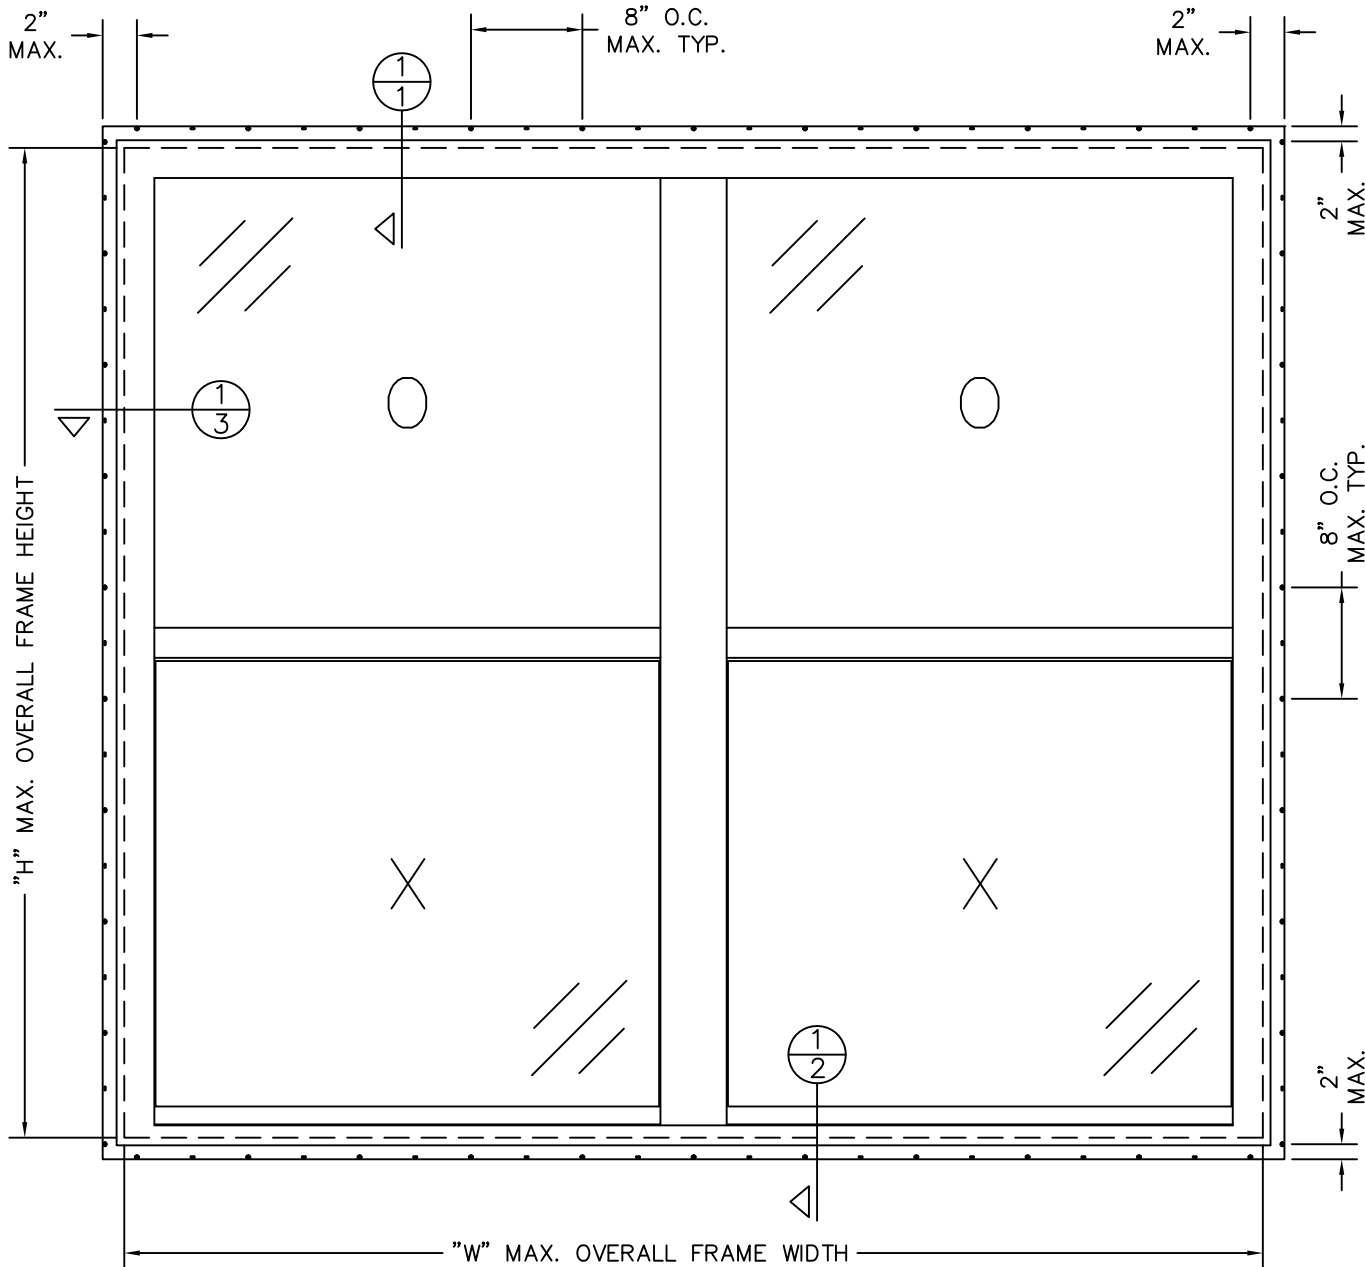

SIZE CHART		
OVERALL SIZE		DP RATING
WIDTH "W"	HEIGHT "H"	
89"	63"	±30 PSF
73"	63"	±35 PSF
73"	74"	±45 PSF

DISCLOSURE STATEMENT

This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or in part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source.

FILE: FL 5414

MATERIAL:

RMS FINISH:

EXCEPT AS NOTED

ALLOY & TEMPER:

r	WEIGHT:
---	---------

VOLUME:	
---------	--

SURFACE AREA:

PERIMETER:

FINISH TREATMENT:

Dimensional Tolerances
Unless Otherwise Specified

Decimals	Angles
.X ± .03	
.XX ± .01	0° 30 min.
.XXX ± .005	

SIZE: B	DRAWING NO.: IN0161	REV.: 7
---------	---------------------	---------

DRAWN BY: T.D.D.	DATE: 11/09/07
CHECKED BY:	DATE:






SIMONTON®
W I N D O W S
1 Cochrane Avenue
Pennsboro, WV 26415

SCALE: FIT	SHEET: 1 of 1	APPRV'D BY:	DATE:
---------------	------------------	-------------	-------

SERIES: 43-17 SINGLE HUNG T-MULLED TWIN

2X BUCK INSTALLATION

NO P.E. SEAL REQUIRED
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS

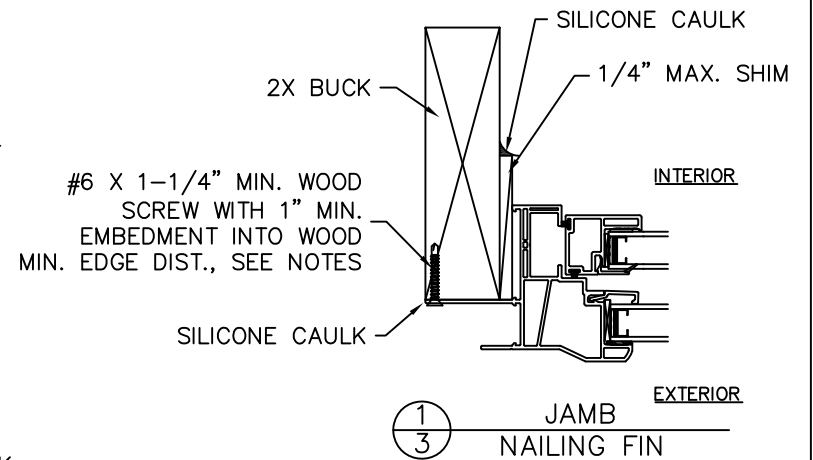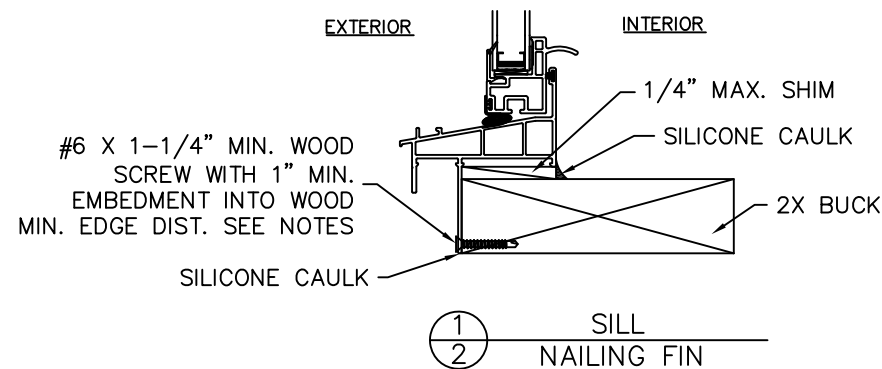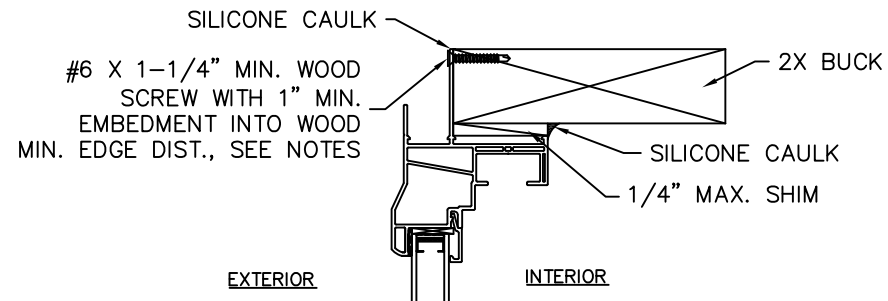

NOTES:

1. THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODES AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN, FOR USE OUTSIDE THE H.V.H.Z.
2. ALL EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED. INTERIOR CAULKING IS OPTIONAL UNLESS NOTED OTHERWISE.
3. ANCHORS SHALL BE AS SPECIFIED AND SPACED AS SHOWN. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO AND INTO WOOD.
4. THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR.
5. SHIMS ARE OPTIONAL. MAX. SHIM STACK IS 1/4".
6. WOOD BUCKS (BY OTHERS) MUST BE ENGINEERED AND ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
7. WHEN USED IN AREAS REQUIRING IMPACT PROTECTION THIS PRODUCT REQUIRES THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
8. FLASHING SHOULD BE APPLIED USING THE ASTM E 2112 METHODOLOGY APPROPRIATE FOR THE OPENING INTO WHICH THE WINDOW IS BEING INSTALLED.
9. INSTALLATION SCREWS MUST BE AT LEAST 1/2" FROM THE EDGE OF THE WOOD.
10. GLAZING SHALL COMPLY WITH ASTM E 1300.
11. USE SILICONE CAULK COMPLIANT WITH AAMA 800 - SEALANT SPECIFICATIONS FOR USE WITH ARCHITECTURAL FENESTRATION PRODUCTS. FOR MORE DETAILS SEE VISIT SIMONTON.COM.
12. USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP.
13. DESIGNATION "X" AND "O" STAND FOR THE FOLLOWING: X: OPERABLE PANEL - O: FIXED PANEL.