

MODEL DESIGNATION: SIMONTON IMPACT RESISTANT DOUBLE HUNG TWIN SERIES 42-19 VINYL WINDOW

MAXIMUM OVERALL NOMINAL SIZE: TWIN UP TO 73" x 74"



DESIGN PRESSURE RATING: POSITIVE: 50.0 PSF
NEGATIVE: 50.0 PSF

USABLE CONFIGURATIONS: X X
X X

GENERAL DESCRIPTION: THE HEAD, SILL, AND SIDE JAMBS ARE EXTRUDED PVC. THE WALL THICKNESS THROUGH WHICH THE ANCHOR SCREW PENETRATES IS A MINIMUM OF 0.070".

NO P.E. SEAL REQUIRED
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS

REV. #:	REVISIONS:	REVISED BY:	DATE:
1	ADDED MIN. EDGE DIST. NOTE.	B.J.S.	06/17/15
2	ADDED NOTES 11 & 12 - AAMA 800	LMH	08/19/16
3	UPDATED FOR 7TH EDITION 2020 FBC	LMH	11/28/20

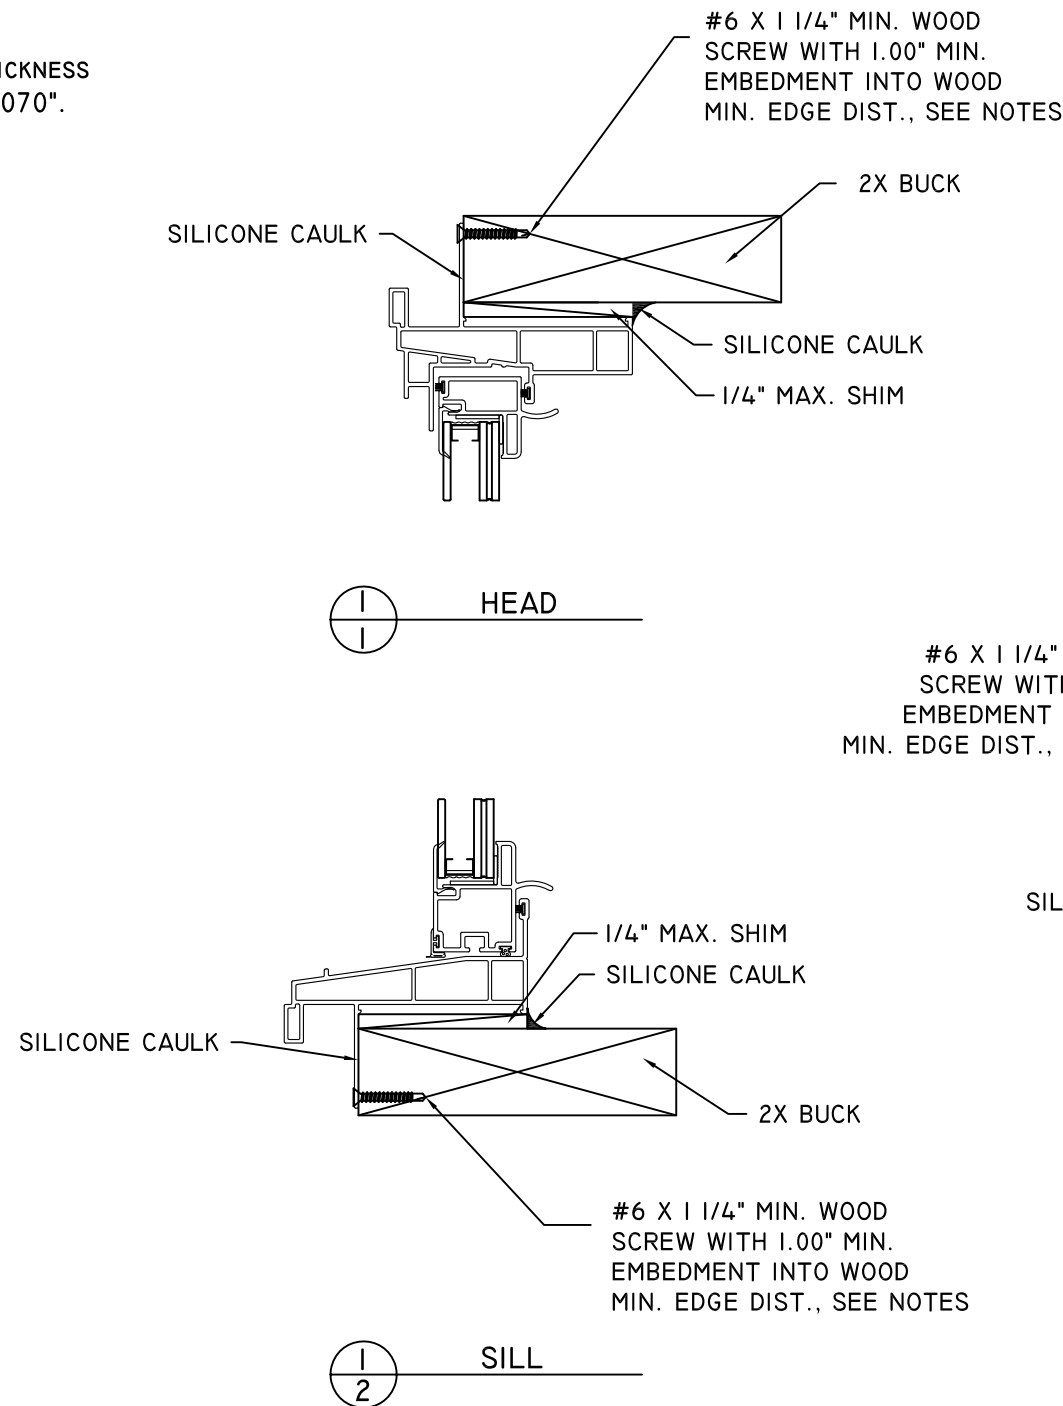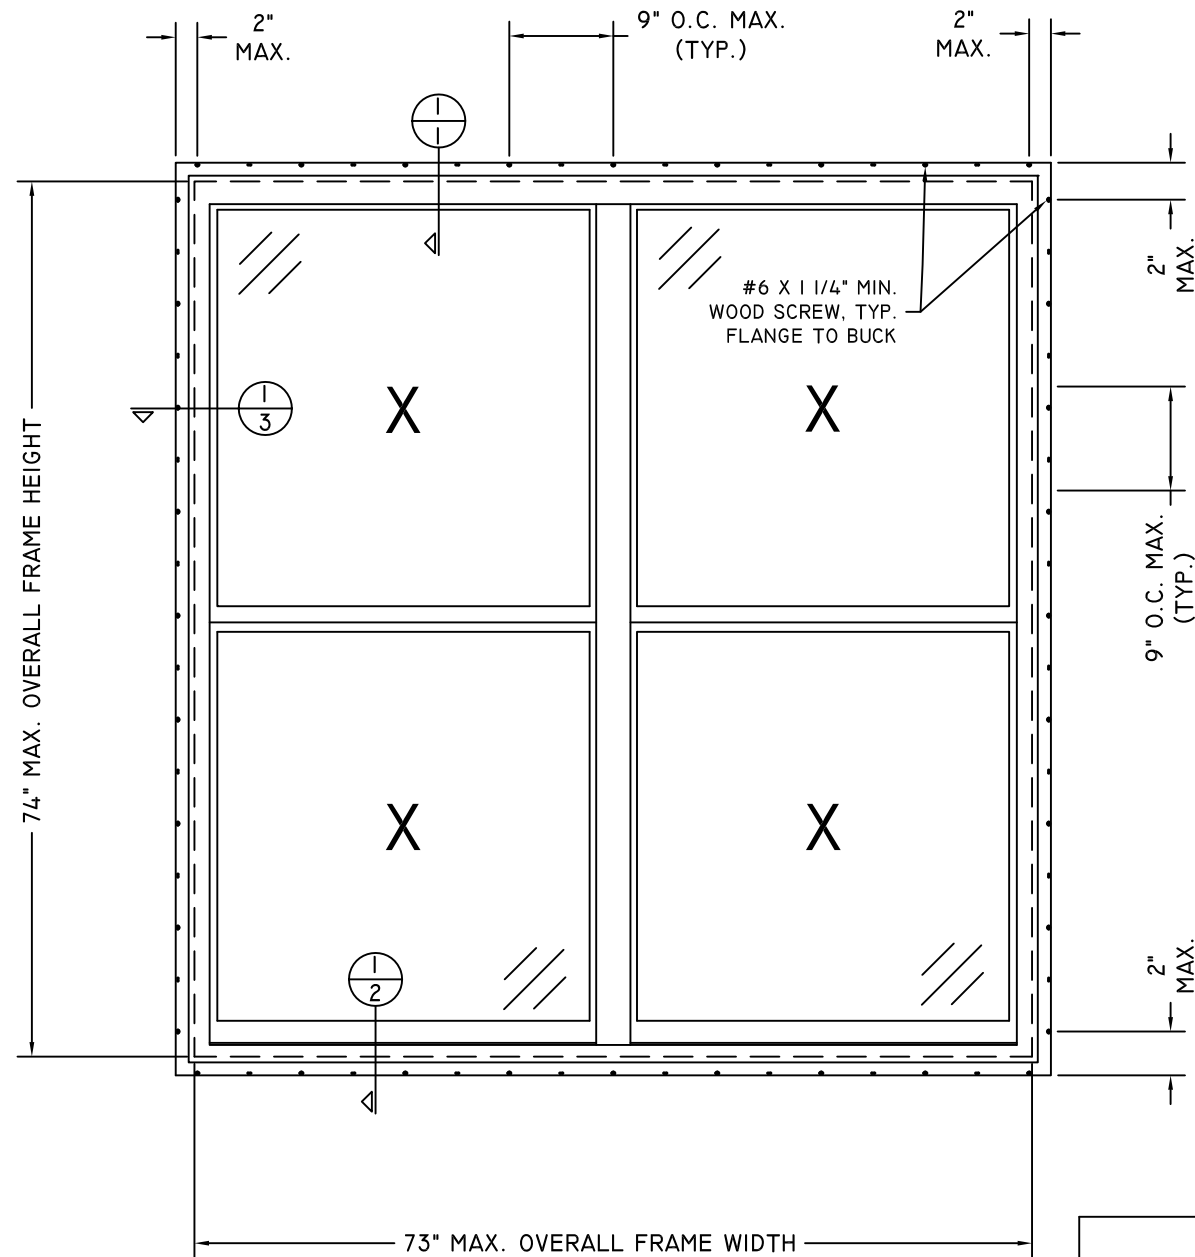

DISCLOSURE STATEMENT
THIS DOCUMENT IS THE PROPERTY OF SIMONTON WINDOWS, WHICH RETAINS ALL PROPRIETARY AND OTHER RIGHTS TO ITS SUBJECT MATTER. THIS DOCUMENT IS PROVIDED TO THE RECIPIENT ON THE EXPRESSED CONDITION THAT IT IS NOT TO BE DISCLOSED, REPRODUCED IN WHOLE OR PART, NOR USED IN CONJUNCTION WITH THE DESIGN, MANUFACTURE OR REPAIR OF GOODS FOR ANYONE OTHER THAN SIMONTON WINDOWS WITHOUT ITS CONSENT. THIS RESTRICTION DOES NOT LIMIT THE RECIPIENT'S RIGHTS TO UTILIZE INFORMATION CONTAINED IN THIS DOCUMENT WHICH IS PROPERLY OBTAINED FROM ANOTHER SOURCE.

FILE: FL 5419

MATERIAL:	
RMS FINISH:	EXCEPT AS NOTED
ALLOY & TEMPER:	
WEIGHT:	VOLUME:
SURFACE AREA:	PERIMETER:
FINISH TREATMENT:	

DIMENSIONAL TOLERANCES UNLESS OTHERWISE SPECIFIED	
DECIMALS	ANGLES
.X ± .03	
.XX ± .01	0° 30 MIN.
.XXX ± .005	

SIMONTON
WINDOWS
1 Cochrane Avenue
Pennsboro, WV 26415

SIZE: B	DRAWING NO.: IN0550	REV.: 3
DRAWN BY: T.D.D.	DATE: 05/01/12	
CHECKED BY:	DATE:	
APPR'D BY:	DATE:	

SCALE: FIT SHEET: 1 of 2

SERIES: 42-19 IMPACT RESISTANT DOUBLE HUNG TWIN

TITLE: 2X BUCK INSTALLATION

MODEL DESIGNATION: SIMONTON IMPACT RESISTANT DOUBLE HUNG TWIN SERIES 42-19 VINYL WINDOW

MAXIMUM OVERALL NOMINAL SIZE: TWIN UP TO 73" x 74"

DESIGN PRESSURE RATING: POSITIVE: 50.0 PSF
NEGATIVE: 50.0 PSF

USABLE CONFIGURATIONS: X X
X X


GENERAL DESCRIPTION: THE HEAD, SILL, AND SIDE JAMBS ARE EXTRUDED PVC. THE WALL THICKNESS THROUGH WHICH THE ANCHOR SCREW PENETRATES IS A MINIMUM OF 0.070".

NO P.E. SEAL REQUIRED
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS

REV. #:	REVISIONS:	REVISED BY:	DATE:
1	ADDED MIN. EDGE DIST. NOTE.	B.J.S.	06/17/15
2	ADDED NOTES 11 & 12 - AAMA 800	LMH	08/19/16
3	UPDATED FOR 7TH EDITION 2020 FBC	LMH	11/28/20

NOTES:

- THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE OUTSIDE THE HVHZ, AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN.
- ALL INTERIOR AND EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED.
- ANCHOR TYPE, SIZE, SPACING, EMBEDMENT, AND EDGE DISTANCE SHALL BE AS SPECIFIED IN THESE DRAWINGS.
- ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO.
- INSTALLATION SCREWS SHOULD BE A MINIMUM OF 3/4" FROM EDGE OF WOOD.
- WOOD BUCKS, AND BUCK FASTENERS, BY OTHERS, SHALL BE PROPERLY DESIGNED AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR.
- SHIMS ARE OPTIONAL. MAX. SHIM STACK IS 1/4".
- WHEN USED IN AREAS REQUIRING IMPACT PROTECTION, THIS PRODUCT DOES NOT REQUIRE THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
- SEALING AND FLASHING BY OTHERS SHOULD BE APPLIED USING THE ASTM E 2112 METHODOLOGY APPROPRIATE FOR THE OPENING INTO WHICH THE PRODUCT IS BEING INSTALLED. OVERALL WATER PENETRATION RESISTANCE OF THE INSTALLED PRODUCT IS NOT ADDRESSED IN THIS DRAWING AND IS THE RESPONSIBILITY OF OTHERS.
- GLAZING SHALL COMPLY WITH ASTM E 1300.
- ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS. ANY DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT REACTIONS IN ACCORDANCE WITH CODE REQUIREMENTS.
- IF 2" x 4" BUCKS ARE USED, ANCHOR SCREWS MAY BE INSERTED THROUGH THE INTERIOR TRACK. ANCHOR SCREWS USED IN EXTERIOR BALANCE TRACK SHOULD BE FLUSH WITH THE VINYL.
- QUANTITY OF ANCHORS ATTACHING THE JAMB TO THE MULLION WILL VARY DEPENDING ON THE HEIGHT OF THE UNIT. DISTANCE BETWEEN ANCHORS MUST NOT EXCEED 12 INCHES ON CENTER.
- DESIGNATION "X" IS FOR OPERABLE PANEL AND "O" IS FOR FIXED PANEL
- USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP.

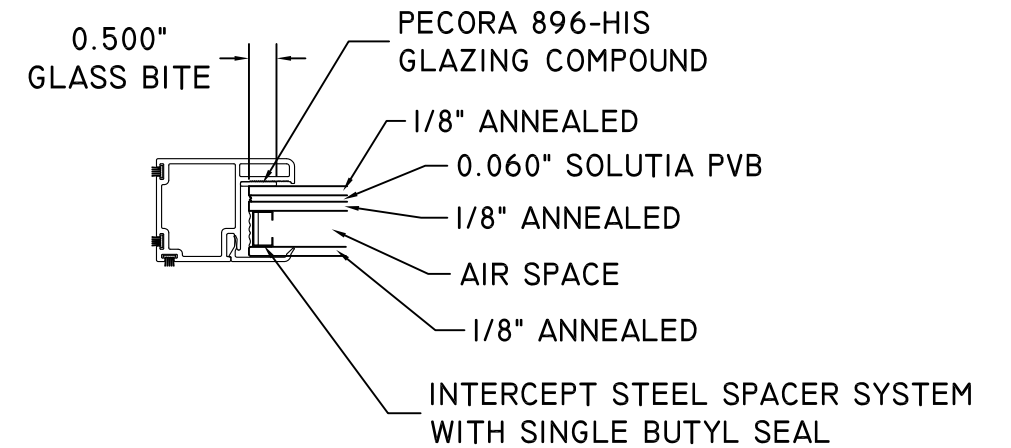

7/8" INSULATED ANNEALED IMPACT GLASS
WITH 0.060" PVB INTERLAYER

<p align="center">DISCLOSURE STATEMENT</p> <p>THIS DOCUMENT IS THE PROPERTY OF SIMONTON WINDOWS, WHICH RETAINS ALL PROPRIETARY AND OTHER RIGHTS TO ITS SUBJECT MATTER. THIS DOCUMENT IS PROVIDED TO THE RECIPIENT ON THE EXPRESSED CONDITION THAT IT IS NOT TO BE DISCLOSED, REPRODUCED IN WHOLE OR PART, NOR USED IN CONJUNCTION WITH THE DESIGN, MANUFACTURE OR REPAIR OF GOODS FOR ANYONE OTHER THAN SIMONTON WINDOWS WITHOUT ITS CONSENT. THIS RESTRICTION DOES NOT LIMIT THE RECIPIENT'S RIGHTS TO UTILIZE INFORMATION CONTAINED IN THIS DOCUMENT WHICH IS PROPERLY OBTAINED FROM ANOTHER SOURCE.</p>	MATERIAL:	<p align="center">DIMENSIONAL TOLERANCES UNLESS OTHERWISE SPECIFIED</p> <p>DECIMALS ANGLES</p> <p>.X ± .03 .XX ± .01 .XXX ± .005</p>	<p align="center">SIMONTON® W I N D O W S</p> <p>1 Cochrane Avenue Pennsboro, WV 26415</p>	SIZE: B	DRAWING NO.: IN0550	REV.: 3	
	RMS FINISH: EXCEPT AS NOTED			ALLOY & TEMPER:	DRAWN BY: T.D.D.	DATE: 05/01/12	
WEIGHT:	VOLUME:	SURFACE AREA:	PERIMETER:	CHECKED BY:	DATE:	APPR'D BY:	DATE:
FINISH TREATMENT:	SCALE: FIT		SHEET: 2 OF 2	SERIES: 42-19 IMPACT RESISTANT DOUBLE HUNG TWIN			
FILE: FL 5419	TITLE: 2X BUCK INSTALLATION						