MODEL DESIGNATION:

Simonton Impact Resistant Double Hung Series 42-19 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE:

See Size Chart

DESIGN PRESSURE RATING:


See Size Chart

USABLE CONFIGURATIONS:

 $\frac{\mathsf{X}}{\mathsf{X}}$

GENERAL DESCRIPTION:

The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

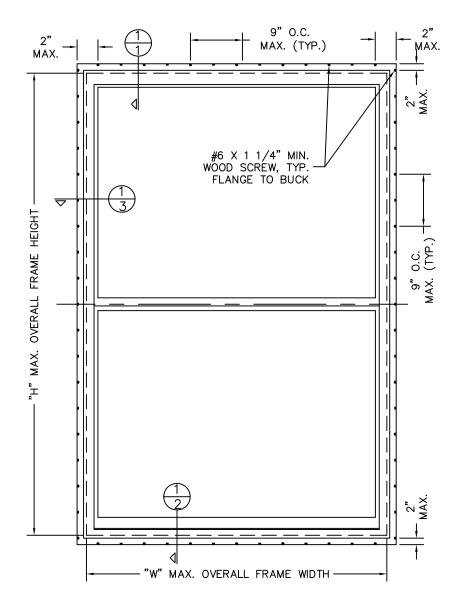


	SIZE CHART				
OVERAL	L SIZE				
WIDTH	HEIGHT	DP RATING			
"W"	"H"				
36"	63"				
36"	74"	±50 PSF			
38"	72"				


FILE: FL 5419




11/11/2020 LUCAS Á. TÚRNER, P.E. FL PE # 58201 TURNER ENGINEERING & CONSULTING, INC. (COA # 29779) 2428 OLD NATCHEZ TRACE TRAIL, CAMDEN, TN 38320 PH. 941-380-1574

REV. #:		REVISED BY:	DATE:
1	ADDED 38 X 72 TO SIZE CHART PER NEW TESTING.	T.D.D.	06/19/12
2	UPDATE FOR MULTIPLE SUBSTRATE TYPES	L.A.T.	09/10/14
3	UPDATED NOTES	LMH	11/11/20
		•	
	•	•	

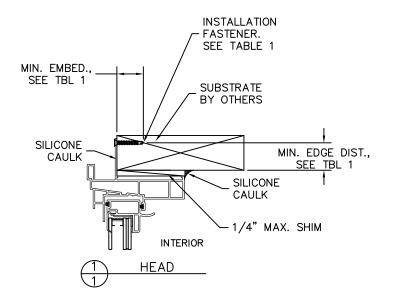

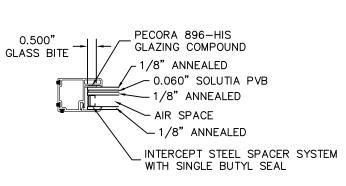

7/8" INSULATED ANNEALED IMPACT GLASS WITH 0.060" PVB INTERLAYER

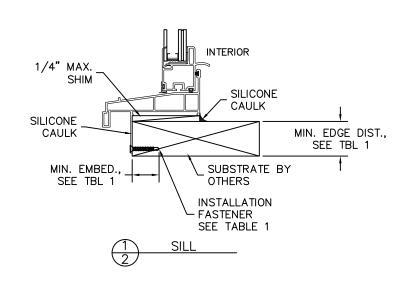

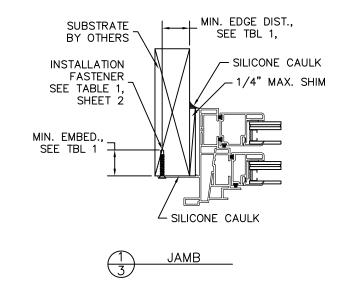


TABLE	1:	FIN	INSTALLATION	FASTENERS	TABLE
1/1066		1 11 1	II VOI / LE/ LII OI V	I / NO I LINE NO	1/10

- 17 (TABLE 1: THE INSTITUTE TABLE						
ID	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DISTANCE			
		ANCHOR THROUGH FIN:					
A 2X MIN. SOUTHERN PINE WOOD (G=0.55)		#6 WOOD SCREW	1"	3/8"			

DISCLOSURE STATEMENT This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole part, nor used in conjunction with the design, manufacture repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this

document which is properly obtained from another source.

	MATERIAL:			
า	RMS FINISH:		Dimensional	Tolerances
er. ed	EXCEPT AS NOTED ALLOY & TEMPER:		<u>Unless Otherw</u>	<u>ise Specified</u>
or				
or	WEIGHT:	VOLUME:	Decimals	Angles
		DEDIVIETED.	.X ± .03	
	SURFACE AREA:	PERIMETER:	.XX ± .03	0° 30 min.
•	FINISH TREATMENT:		.XXX ± .005	

د. ا		SIZE:	DRAWING	NO.:	REV
SIMON TON'L		В		10540	
WINI		DRAV	WN BY:	DATE:	
		T.D.D.		04/19/12	
	1 Cochrane Avenue		KED BY:	DATE:	
Pennsboro, W					
SCALE:	SHEET:	APPF	RV'D BY:	DATE:	
FIT	1 of 2				
SERIES:					
42-19 DOUBLE HUNG (II			T RESIST	ANT)	

TITLE: FIN INSTALLATION, FIN ANCHOR TABLE MODEL DESIGNATION:

Simonton Impact Resistant Double Hung Series 42—19 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE:

See Size Chart

DESIGN PRESSURE RATING:


See Size Chart


USABLE CONFIGURATIONS:_

 $\frac{X}{X}$

GENERAL DESCRIPTION:

The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

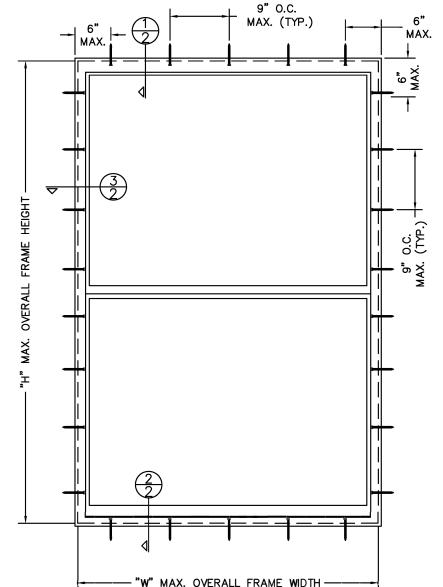




SIZE CHART				
	L SIZE			
WIDTH	HEIGHT	DP RATING		
"W"	"H"			
36"	63 "			
36"	74"	±50 PSF		
38"	72"			


FILE: FL 5419




	D	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED	MIN. EDGE DIST.
1	Α	CONCRETE (2.85 KSI MIN.)	3/16" ELCO ULTRACON	1"	1"
		HOLLOW OR GROUT—FILLED CMU (ASTM C90)	3/16" ELCO ULTRACON	1-1/4"	2 1/2"

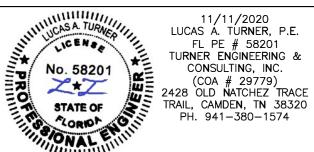

REV. #:		REVISED BY:	DATE:
1	ADDED 38 X 72 TO SIZE CHART PER NEW TESTING.	T.D.D.	06/19/12
2	UPDATE FOR MULTIPLE SUBSTRATE TYPES	L.A.T.	09/10/14
3	UPDATED NOTES	LMH	11/11/20
		•	•

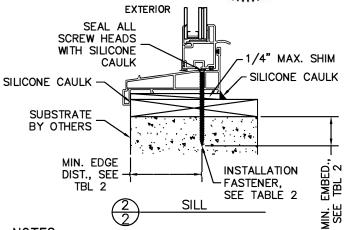



NOTES:

- I. THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE TEXAS & FLORIDA BUILDING CODES AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN, FOR USE OUTSIDE THE H.V.H.Z.
- 2. ALL INTERIOR PERIMETER SURFACES AND EXTERIOR FINS OF THE WINDOW MUST BE CAULKED.
- 3. ANCHOR TYPE, SIZE, SPACING, AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS.
- 4. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FIN INSTALLATIONS TO CONCRETE/MASONRY OPENINGS REQUIRE THE USE OF 2X WOOD BUCKS BETWEEN PRODUCT AND SUBSTRATE, WITH PRODUCT INSTALLATION TO 2X BUCK AS INDICATED ON SHEET I. FOR FLANGE INSTALLATIONS TO CONCRETE/CMU OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, AND INTO SUBSTRATE, SEE SHEET 2. FLANGE INSTALLATIONS TO SOLID CONCRETE OR GROUT-FILLED CMU MAY INCLUDE BUT DO NOT REQUIRE IX WOOD BUCKS BETWEEN PRODUCT AND SUBSTRATE. FLANGE INSTALLATIONS TO HOLLOW CMU REQUIRE THE USE OF IX BUCKS BETWEEN PRODUCT AND SUBSTRATE.
- 5. Wood or masonry openings, bucks, and buck fasteners, by others, shall be properly designed and installed to transfer wind loads to the structure. Substrates shall meet the minimum strength requirements as shown in Table I, sheet I, and Table 2. sheet 2.
- 6. THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR.
- 7. SHIMS ARE REQUIRED WHERE GAPS OF GREATER THAN 1/16" EXIST BETWEEN OPENING AND FRAME. MAX. SHIM STACK IS 1/4". SHIMS SHALL BE LOAD-BEARING AND CAPABLE OF TRANSFERRING LOADS TO THE SUBSTRATE.
- 8. WHEN USED IN AREAS REQUIRING IMPACT PROTECTION CONFORMING TO MISSILE LEVEL C, WIND ZONE 2, THIS PRODUCT DOES NOT REQUIRE THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
- 9. SEALING AND FLASHING BY OTHERS SHOULD BE APPLIED USING THE ASTM E 2112 METHODOLOGY APPROPRIATE FOR THE OPENING INTO WHICH THE DOOR IS BEING INSTALLED. OVERALL WATER PENETRATION RESISTANCE OF THE INSTALLED PRODUCT IS THE RESPONSIBILITY OF OTHERS.
- 10. GLAZING SHALL COMPLY WITH ASTM E 1300-04.
- 12. A MINIMUM CENTER-TO-CENTER SPACING OF 3" SHALL BE MAINTAINED BETWEEN ALL ELCO ULTRACONS IN ANY DIRECTION.
- 13. ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS. ANY DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT REACTIONS IN ACCORDANCE WITH CODE REQUIREMENTS.
- 14. A WIND LOAD DURATION FACTOR CD = 1.6 WAS USED FOR THE ANALYSIS OF WOOD SCREWS ONLY.
- 15. WINDOWS SHALL BE CONSTRUCTED AS SPECIFIED IN TEST REPORTS A3993.01-501-47, A4937.01-501-47-R0, 7583.01-501-47-R1, B7589.01-501-47-R0, B7701.01-501-47-R1, AND B9722.01-109-47-R0 BY ARCHITECTURAL TESTING, INC.

DISCLOSURE STATEMENT

This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source.

