

1. VINYL OR WOOD DOOR STOP
NAILED A MAXIMUM OF 6" O.C. MUST
OVERLAP TOP AND BOTH ENDS OF
PANELS MINIMUM 7/16" TO MEET
NEGATIVE PRESSURES.

2. SLIDE LOCK OR OPERATOR
REQUIRED. LOW HEADROOM REQUIRES
A LOCK ON THE LEFT AND RIGHT
SIDE OF THE DOOR.


3. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

4. SECTION STEEL TO HAVE THE FOLLOWING MINIMUM THICKNESS:
EXTERIOR - 27 GA
INTERIOR - 30 GA

5. TRACK MOUNTING SURFACE TO BE MINIMUM SOUTHERN PINE STRUCTURAL GRADE LUMBER. REFER TO JAMB CONNECTION SUPPLEMENT FOR ATTACHMENT OF A 2X6 TO THE BUILDING JAMBS. IF NEEDED.

6. FOR LOW HEAD ROOM LIFT
CONDITIONS, TOP BRACKET SHALL BE
A LHR TOP BRACKET IN LIEU OF
THE BRACKET SHOWN ON THIS
DRAWING. SEE LHR, DETAIL A, SHEET
2.

7. 11 GA ROLLER SLIDES WITH WELDED ENDS AND 11 GA REINFORCING BRACKET REQUIRED FOR DOORS > 8' TALL.

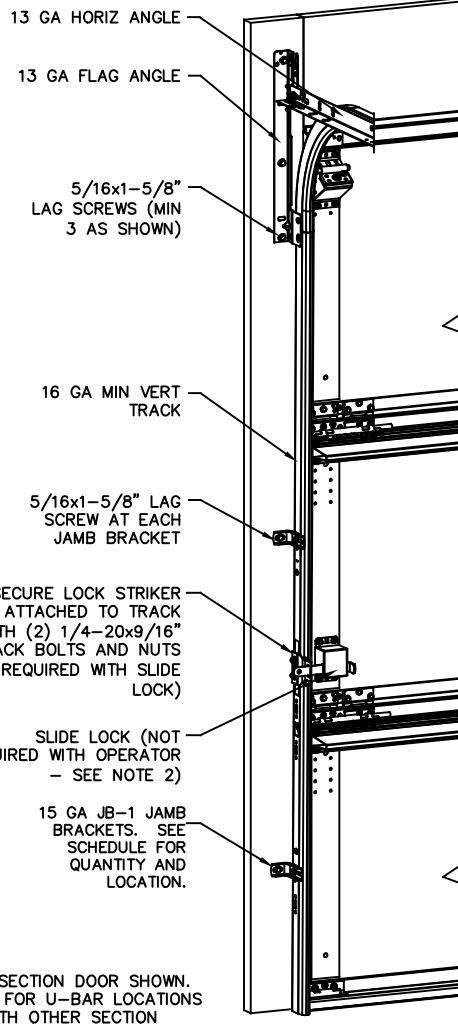


NOTE: (3) SECTION DOOR SHOWN.
SEE SHEET 2 FOR U-BAR LOCATIONS
ON DOORS WITH OTHER SECTION
QUANTITIES.

JAMB			BRACKET SCHEDULE	
DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	TRACK TYPE	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS $\pm 2"$)
7'-0"	3	2	FAT	12" (JB), 44" (JB)
8'-0"	4	3	FAT	10" (JB), 48" (JB), 66" (JB)
> 8'-0"				SEE NOTE BELOW

(JB) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT. ALL DOORS GREATER THAN 8' IN HEIGHT REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SUPPLEMENT TRACK CHART FOR DETAILS.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE		
DOOR WIDTH	DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)
10'-0"	ALL	+96.0/-110.0

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

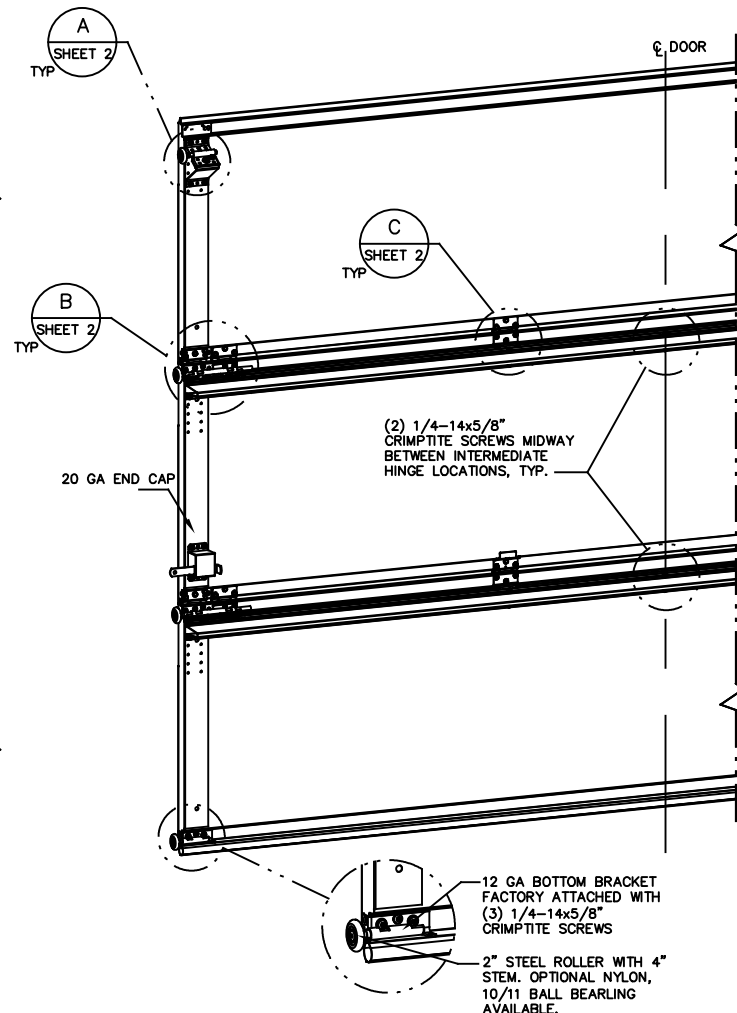

This door has been tested per ANSI/DASMA 108


STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.		SIZE: A	
DESIGN (PSF): +19.20/-22.00		MAX WIDTH: 10'-0"		DATE		NAME	
		MAX HEIGHT: 14'-0"		DRAWN 1/16/06		GRT	
IMPACT/CYCLIC RATED (YES/NO): NO		MAX SECTION HEIGHT: 28"		CHECKED 2/10/06		MRB	
MODELS 9700/9510				SHEET 1 OF 2			
				DRAWING PART NO. 313626		REV. H	
WINDLOAD SPECIFICATION OPTION CODE 0512							

E CHANGES MADE
PER ETC
LABORATORIES
TESTING AND
CHANGES TO
GENERAL FORMAT
1/16/06 GRT

F UPDATED TITLE
BLOCK
4/15/13 GRT

G UPDATED DUE TO
TESTING AND
CHANGES TO
GENERAL FORMAT
8-19-16 GAC

H UPDATED ADDING
NYLON ROLLER PCR
32442 8-5-20 JQ

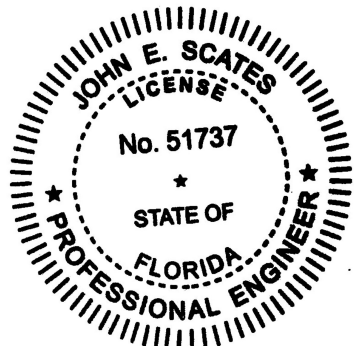

Digitally signed by John E. Scates, P.E.
Date: 2020.08.11 15:15:52 -05'00'

JOHN E. SCATES, PE
2560 KING ARTHUR #124-54
LEWISVILLE, TX 75056
FL PE 51737 TX PE 56308/F-2203



A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

