





MODEL 692/652V (24 GA. STEEL SKIN)

OPTIONAL DSB GLASS OR 1/8" ACRYLIC LITES AVAILABLE (SEE SECTION B-B). OPTIONAL ACRYLIC IS PLASKOLITE OPTIX OR LUCITE CP, AN APPROVED CC2 PLASTIC IN COMPLIANCE WITH IBC/FBC 2606.

(5) INTERMEDIATE STILES FOR 16' WIDE DOOR. ATTACHED W/ TOG-L-LOC (TOP & BOT) AND URETHANE ADHESIVE (ALONG CENTER)


THE OPTIONAL GLAZING SHOWN ON THIS DRAWING MEETS THE WIND LOAD REQUIREMENTS OF THE FLORIDA BUILDING CODE OR INTERNATIONAL BUILDING CODE BUT DOES NOT MEET THE IMPACT RESISTANT REQUIREMENT FOR WINDBORNE DEBRIS REGIONS (REF. CHAPTER 16 FBC/IBC)

REV	DATE	DESCRIPTION
5	05/19/2005	UPDATED CODE REF., SPECIFIED OPTIONAL ACRYLIC.
6	10/07/2005	ADDED ROLLER OPTION
7	11/2008	ADDED MPC; MAX HT WAS 14-0.
8	02/2012	UPDATED WINDCODE CHART
9	11/30/20	UPDATED TITLE BLOCK AND REMOVED WINDCODE CHART.

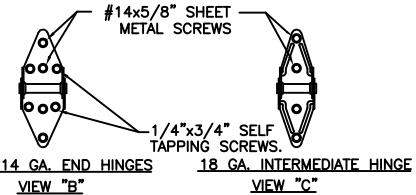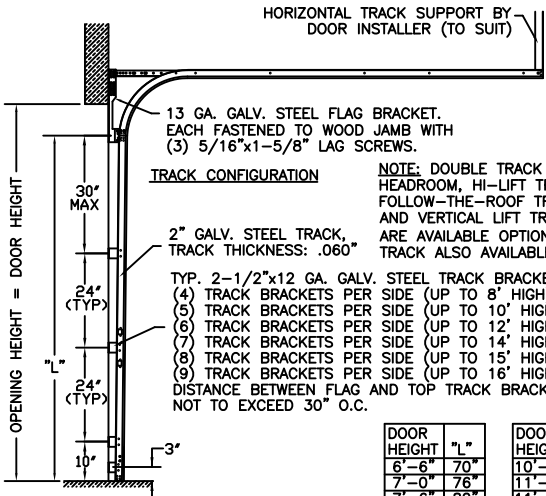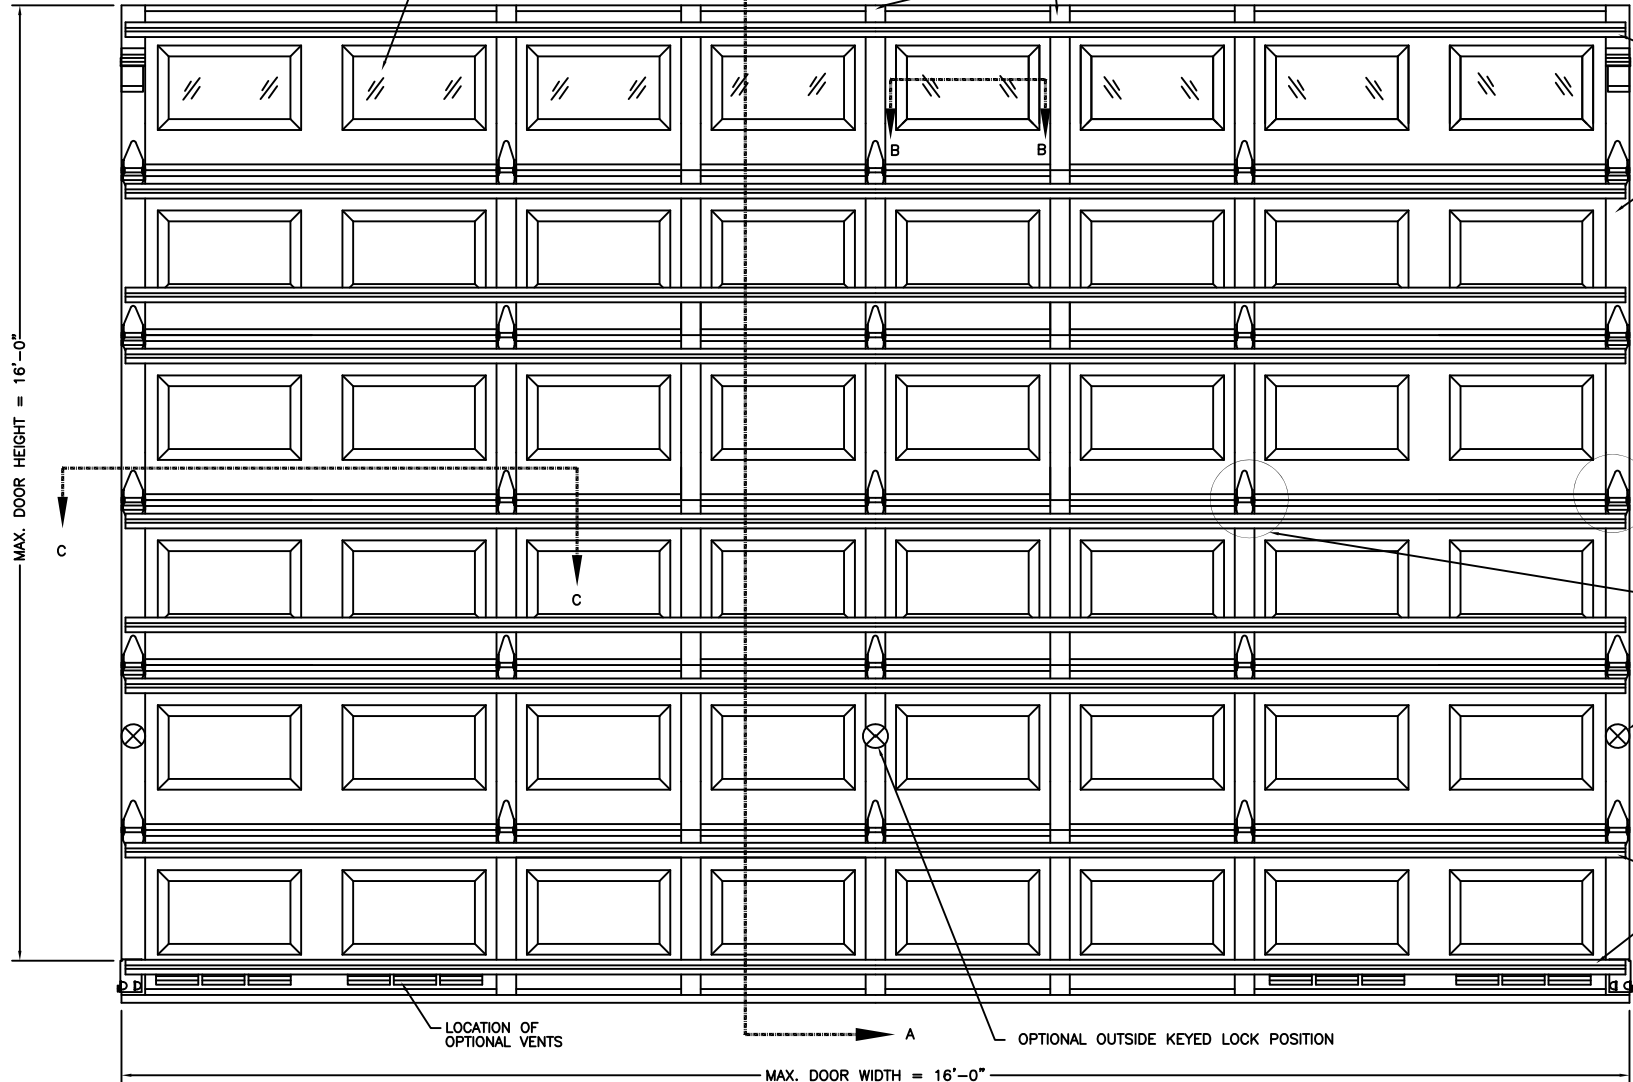





VERTICAL JAMB ATTACHMENT (WOOD FRAME BUILDINGS): 1/2"x3" LAG SCREWS ON 19" CENTERS. 1-1/8" O.D. MIN. WASHER REQUIRED. LAG SCREWS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.

VERTICAL JAMB ATTACHMENT (C-90 BLOCK OR 2,000 PSI MIN. CONCRETE COLUMN): 3/8"x4" SLEEVE ANCHOR BOLTS ON 21" CENTERS (C-90 BLOCK) OR 24" CENTERS (2,000 PSI MIN. CONCRETE) OR 1/4"x4" TAPCON SCREWS ON 17-1/2" CENTERS (2,000 PSI MIN. CONCRETE). WASHERS INCLUDED WITH SLEEVE ANCHORS, 1" O.D. MIN. WASHERS REQUIRED WITH TAPCONS. ANCHORS MAY BE COUNTERSUNK (BUT NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SURFACE. HORIZONTAL JAMBS DO NOT TRANSFER LOAD.

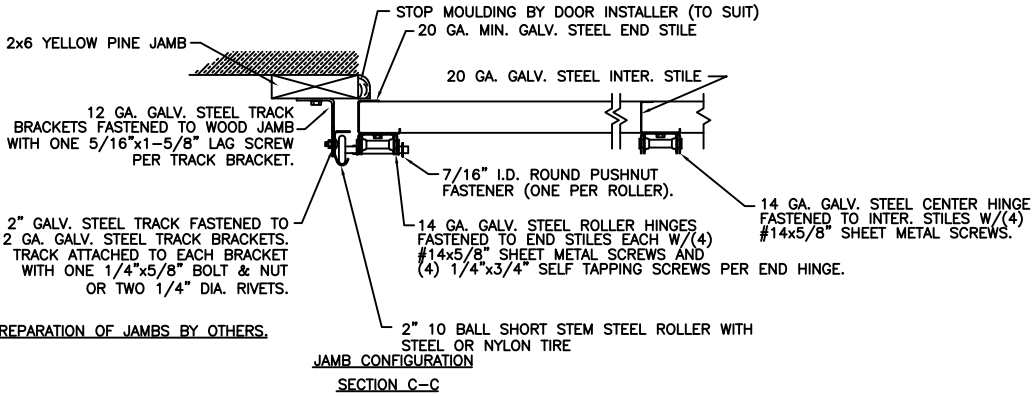

NOTE 1: DOORS UP TO 7'-0" HIGH CONSIST OF (4) SECTIONS (NOT SHOWN). DOORS 7'-3" TO 8'-9" HIGH CONSIST OF (5) SECTIONS (NOT SHOWN). DOORS 9'-0" TO 10'-6" HIGH CONSIST OF (6) SECTIONS (NOT SHOWN). DOORS 10'-9" TO 12'-3" HIGH CONSIST OF (7) SECTIONS (NOT SHOWN). DOORS 12'-6" TO 14'-0" HIGH CONSIST OF (8) SECTIONS (NOT SHOWN). DOORS 14'-3" TO 15'-9" HIGH CONSIST OF (9) SECTIONS (NOT SHOWN). DOORS 16'-0" HIGH CONSIST OF (10) SECTIONS (NOT SHOWN).

OPTIONAL 10 SCREW WINDOW LITE 1/4" SCALE SECTION B-B

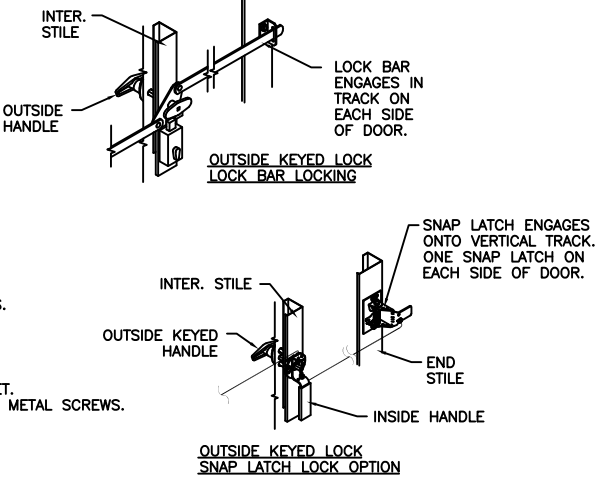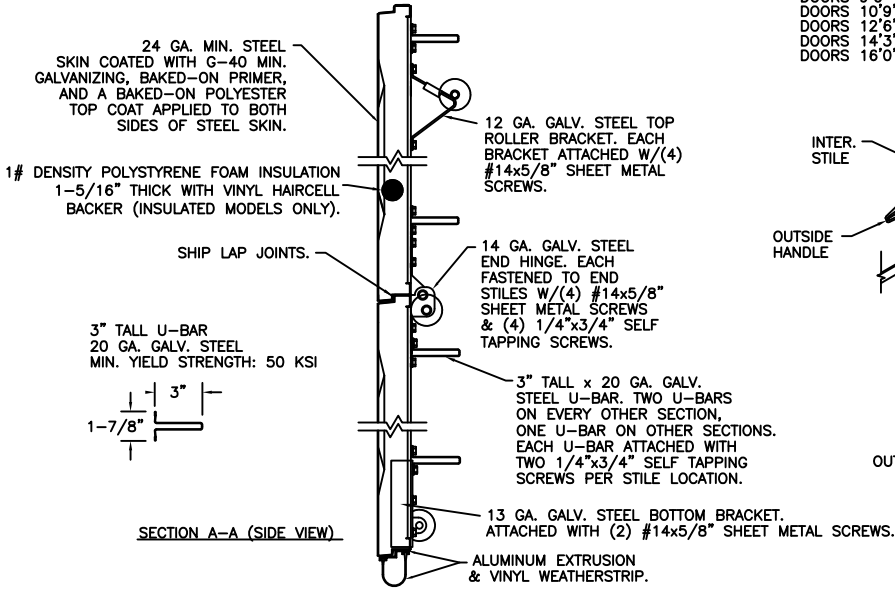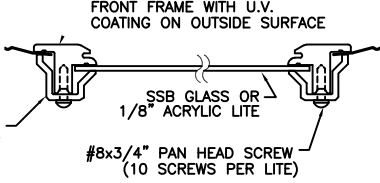

NOTE 2: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

DESIGN ENGINEER: MARK WESTERFIELD, P.E. FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513
DESIGN LOADS: +24.0 PSF & -24.5 PSF.
TEST LOADS: +36.0 PSF & -37.0 PSF.



CLOPAY CORPORATION
8585 DUKE BLVD.
MASON, OH 45040
(513) 770-4800
Clopay Corporation All Rights Reserved.
CLOPAY CORP. ALL RIGHTS RESERVED.

MANUFACTURING PRODUCT CODE:
MPC: C-PAN-2F141
DATE: 11/12/96
DRAWN BY: MWW
CHECKED BY:

WINDLOAD RATING W4	MAX. DOOR SIZE: 16'0"W x 16'0"H
DESCRIPTION: MODEL 692 +24/-24.5 PSF (DES. LOAD)	
DRAWING NUMBER: B 101781	VER: IBC