


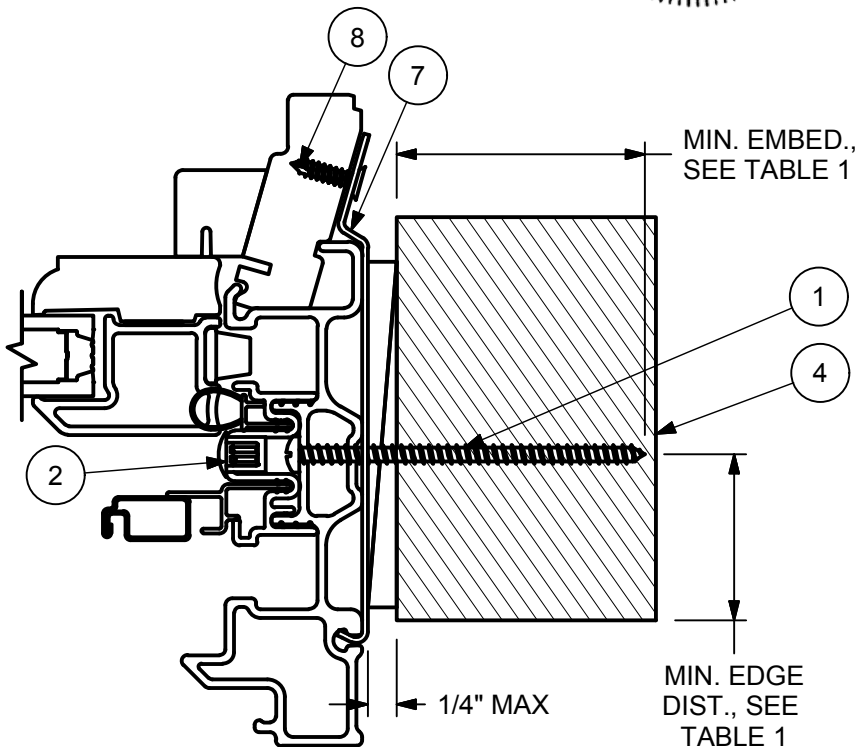
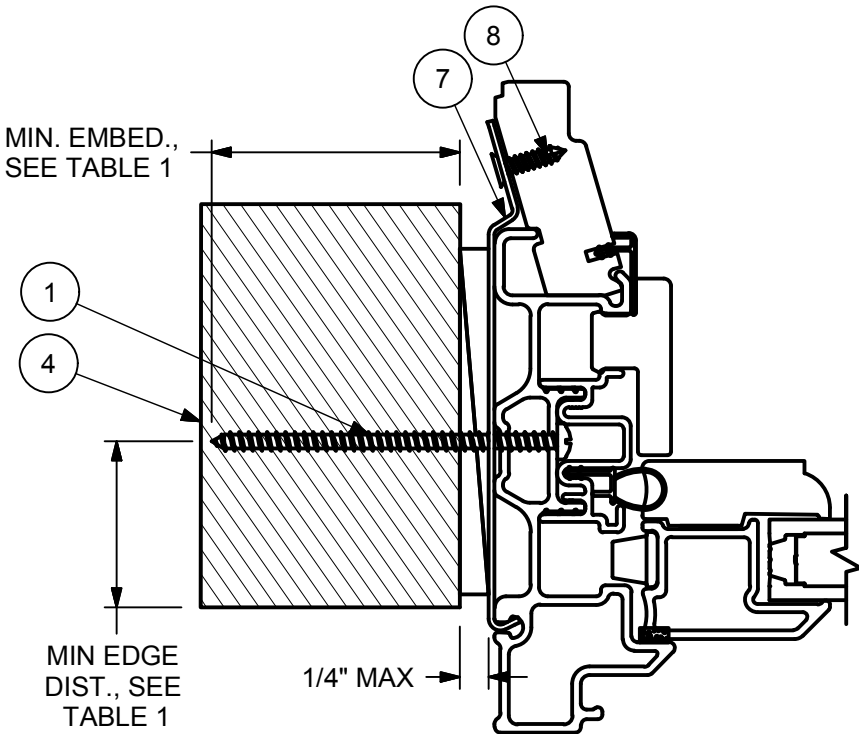


TABLE 1: FRAME INSTALLATION ANCHOR REQUIREMENTS TABLE			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN)	3/16" ITW TAPCON	1-1/2"	1-1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
16 GAUGE (0.060") MIN. STEEL STUD, 33 KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN.	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	3 THREADS BEYOND METAL WALL	1/2"

Lucas Turner
2023.12.15
12:31:25
-06'00'

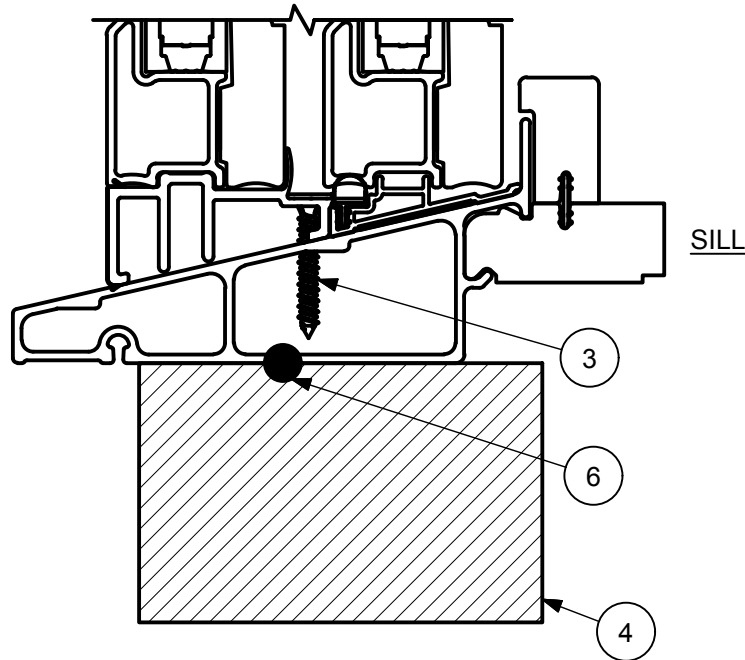

12/15/2023
LUCAS TURNER
FL PE 58201
TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE
TRL. CAMDEN, TN, 38320
PH 941-380-1574

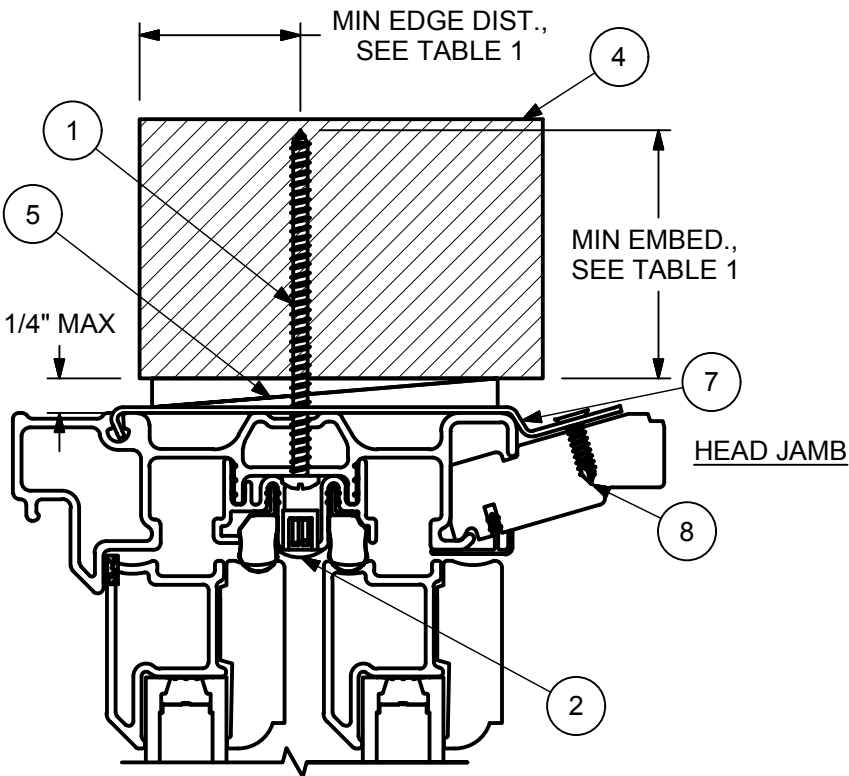

- NOTES:**
- 1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
 - 2. FLORIDA PRODUCT APPROVAL: FL6529
 - 3. FOR ELEVATIONS AND ADDITIONAL REQUIREMENTS, REFER TO DOC 00113696

- THROUGH JAMB INSTALLATION:**
- ATTACH INSTALLATION BRACKET AT EACH THROUGH JAMB HOLE LOCATION WITH TWO #7 X 5/8" SCREWS PER BRACKET
 - SECURE UNIT TO FRAMING AT EACH LOCATION WITH ONE FASTENER PER TABLE 1. SEE ELEVATIONS FOR SCREW LOCATIONS
 - PLACE ONE NON-CONTINUOUS 5/16" DIAMETER BEAD OF ASTM C920 GRADE NS CLASS 25 SEALANT ON THE SILL FRAMING UNDER THE WINDOW
 - JAMBS
 - 3 FASTENERS / JAMB FOR RO HEIGHTS LESS THAN 36.250"
 - 4 FASTENERS / JAMB FOR RO HEIGHTS 36.250" AND GREATER. FASTENER NEAR CENTERLINE IS ADDED
 - HEAD JAMB
 - 2 FASTENERS / HEAD JAMB FOR ALL RO WIDTHS
 - 2 ADDITIONAL FASTENERS / HEAD JAMB FOR ALL ITGLTS
 - HEAD JAMB STATIONARY BRACKET
 - INSTALL 1 FASTENER PER BRACKET
 - SILL
 - 1 #8 X 1.250" FASTENER PER MEETING STILE

8	00003212	#7-19 X .625" TYPE AB-17, FULL THREAD SCREW
7	00070642	INSTALLATION CLIP, THROUGH JAMB
6	NA	ASTM C920 GRADE NS CLASS 25 SEALANT
5	NA	SHIM
4	NA	FRAMING MATERIAL, SEE TABLE 1
3	00076264	#8-15 X 1.250", PH, WH, HI-LO THREAD SCREW
2	00073114	THROUGH JAMB PLUG
1	NA	INSTALLATION FASTENER, SEE TABLE 1
ITEM	DWG NO	DESCRIPTION

PARTS LIST



RESEARCH & DEVELOPMENT
WARROAD, MN, USA, (218) 386-4021

PRODUCT		ELEVATE	
CATEGORY:			
UNIT TYPE:		ELGL, ELGLTS	
DWG TYPE:		INSTALLATION	
DESCRIPTION:		METHOD, THROUGH JAMB, NON-WOOD	
CHK:	SAL	SIZE:	CLASS:
07/12/18		B	MISC
APP:	JMD	SCALE:	DATE:
07/12/18		3:5	05/25/18
DWG NO:		00113282	
DWG BY:		SMITH, BRENDAN	
SHEET:		1 OF 1	

NOTICE - CONFIDENTIAL INFORMATION

The information in this document is privileged and strictly confidential. The information contained herein shall be used only by Marvin Windows and Doors employees and by those agents or suppliers granted official written permission. If the reader of this document is not the intended recipient, or the employee or agent of the intended recipient, please delete this document from all data storage devices, and destroy all hard copies. Any unauthorized dissemination, distribution, copying or other use of the information contained in this document is strictly prohibited.