




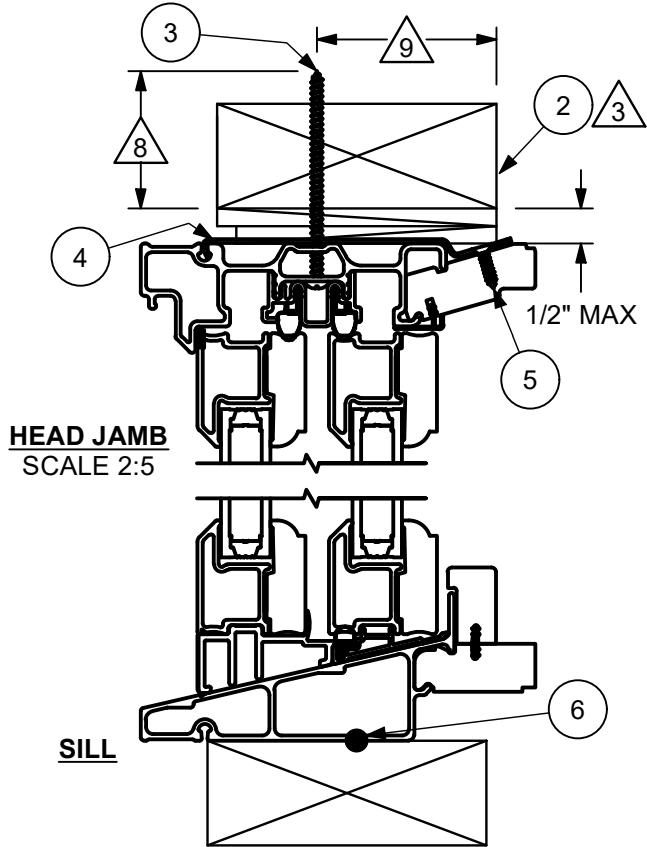

HEAD JAMB
SCALE 2:5

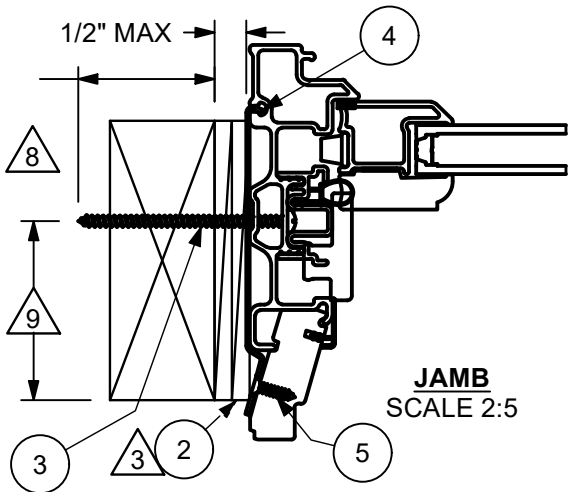


JAMB
SCALE 2:5

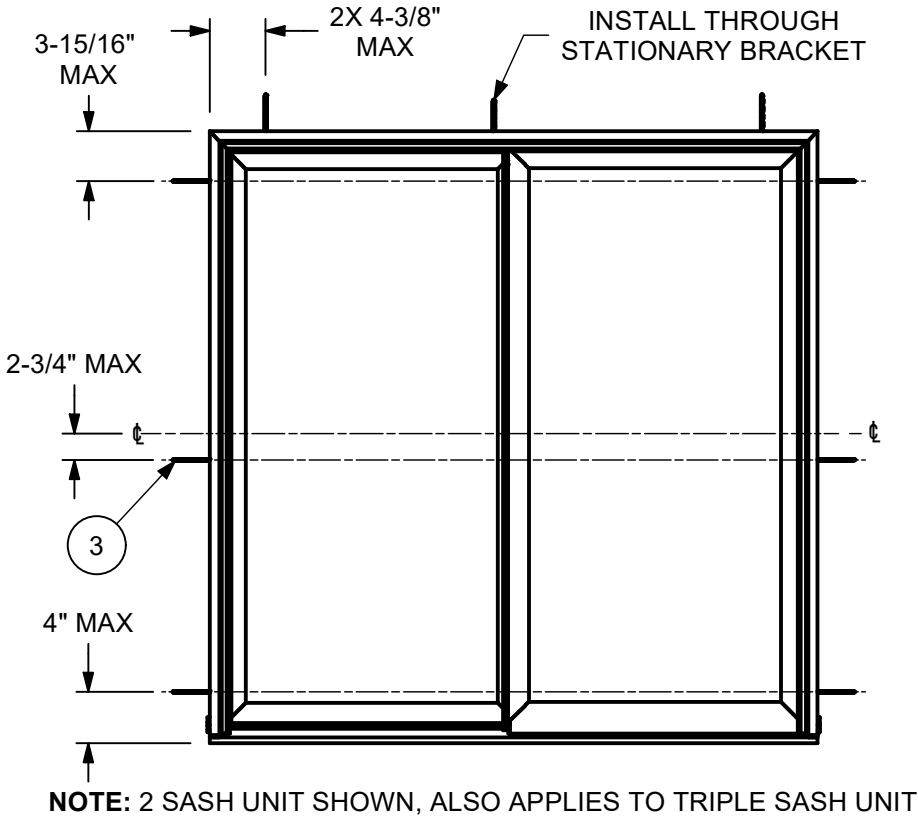

NOTE: 2 SASH UNIT SHOWN, ALSO APPLIES TO TRIPLE SASH UNIT

THROUGH JAMB INSTALLATION METHOD:

- UNIT MUST NOT BE IN DIRECT CONTACT WITH EITHER CONCRETE OR TREATED BUCK MATERIAL. IF SHIM SPACE IS LESS THAN 1/8" WRAPPING THE UNIT ON ALL 4 SIDES INCLUDING CLADDING WITH WINDOW FLASHING TAPE IS REQUIRED AS A BARRIER BETWEEN THE UNIT AND CONCRETE OR TREATED LUMBER
- ATTACH INSTALLATION BRACKET AT EACH THROUGH JAMB HOLE LOCATION WITH TWO #7 X 5/8" SCREWS PER BRACKET
- INSTALL #8 X 3" SCREWS THROUGH PRE-DRILLED HOLES IN THE JAMBS AND HEAD JAMB. MINIMUM OF 2 FASTENERS PER SIDE
- INSTALL #8 X 3" SCREW THROUGH EACH STATIONARY BRACKET
- PLACE ONE NON-CONTINUOUS 5/16" DIAMETER BEAD OF ASTM C920 GRADE NS, CLASS 25 SEALANT ON THE SILL FRAMING UNDER UNIT




GLAZING DETAIL

NOTES:

1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING REQUIREMENTS, REFER TO THE INSTALLATION INSTRUCTIONS PROVIDED WITH THE UNIT
- △ 3. SHIMS:
 - A SHIM MUST BE PLACED AT THE MEETING STILES AND 4-6" FROM EACH CORNER
 - ALL OTHERS MUST BE PLACED A MAX OF 15 INCHES APART
4. IF CHEMICALLY TREATED LUMBER IS USED FOR BUCK MATERIAL, FASTENERS INTO THE BUCK MUST BE A MINIMUM OF 0.90 OZ/FT^2 ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316
- △ 5. MINIMUM NAIL EMBEDMENT DEPTH: 1-15/16"
- △ 6. MINIMUM NAIL EDGE DISTANCE: 1/2"
- △ 7. GLASS COMPLIES WITH ASTM E1300
- △ 8. MINIMUM SCREW EMBEDMENT DEPTH: 1-1/2"
- △ 9. MINIMUM SCREW EDGE DISTANCE: 1"


CATEGORY:
GLIDER

UNIT TYPE:
ELGL, ELGL TS

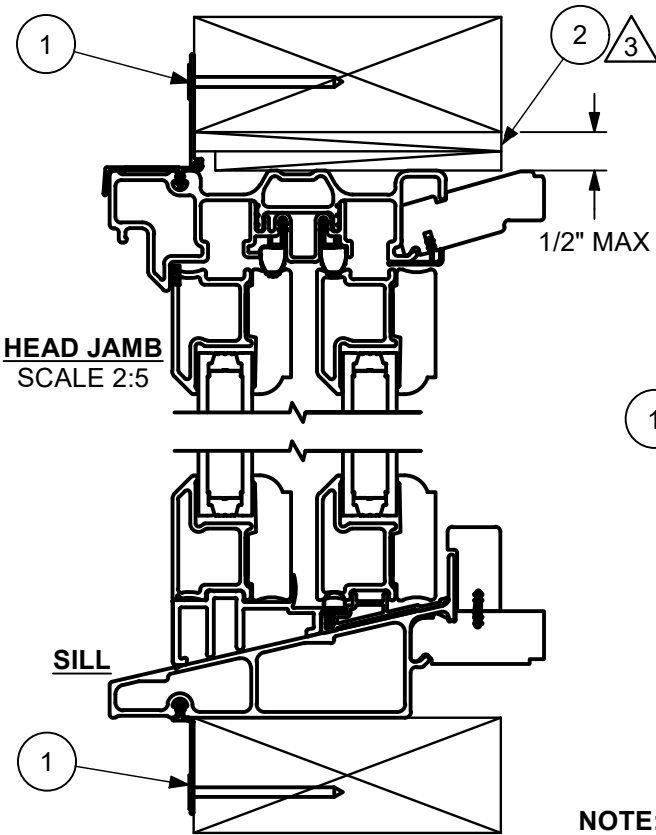


HEAD JAMB
SCALE 2:5

SILL

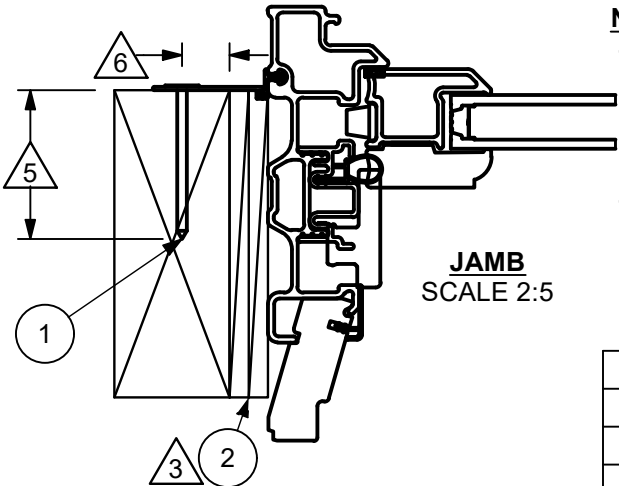

JAMB
SCALE 2:5

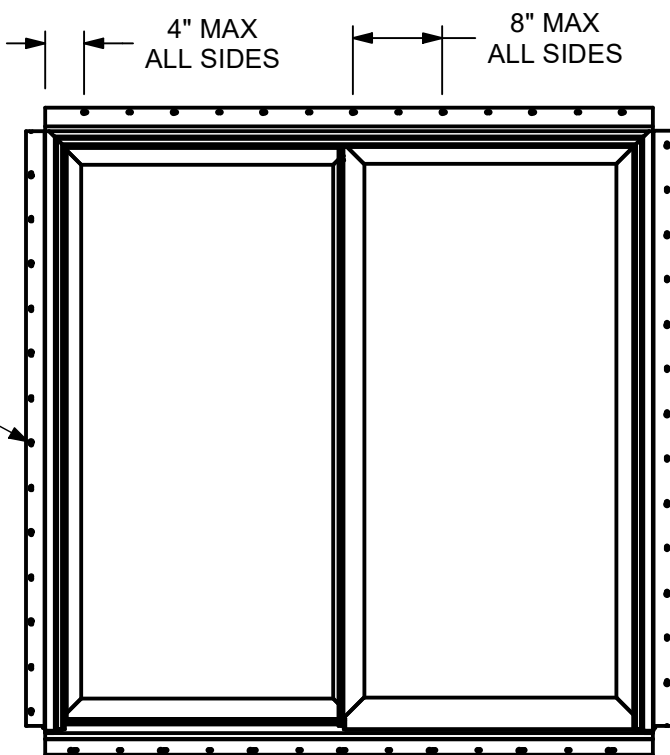

NOTE: 2 SASH UNIT SHOWN, ALSO APPLIES TO TRIPLE SASH UNIT

NAILING FIN INSTALLATION METHOD:

- UNIT MUST NOT BE IN DIRECT CONTACT WITH EITHER CONCRETE OR TREATED BUCK MATERIAL. IF SHIM SPACE IS LESS THAN 1/8" WRAPPING THE UNIT ON ALL 4 SIDES INCLUDING CLADDING WITH WINDOW FLASHING TAPE IS REQUIRED AS A BARRIER BETWEEN THE UNIT AND CONCRETE OR TREATED LUMBER
- MINIMUM OF 2 FASTENERS PER SIDE

6	NA	ASTM C920 GRADE NS, CLASS 25 SEALANT
5	00003212	#7-19 X .625" TYPE AB-17, FULL THREAD
4	00070642	THRU - JAMB INSTALLATION CLIP
3	00003264	#8-18 X 3.000" TYPE AB, FULL THREAD
2	NA	SHIM
1	NA	2" ROOFING NAIL
ITEM	DWG NO	DESCRIPTION
PARTS LIST		

MARVIN[®] RESEARCH & DEVELOPMENT

COLLECTION: ELEVATE

DWG TYPE: INSTALLATION
DESCRIPTION: INSTALLATION METHODS/ELEVATIONS, NAIL FIN/JAMB SCREW

CHK:	SIZE: B	CLASS: ASSY	DWG NO: 00078915
APP:	SCALE: 1:15	DATE: 2/7/2012	DWG BY: MITTERLING, AARON
			SHEET: 1 OF 2