



Product Evaluation Report
E.F. BAVIS & ASSOCIATES, INC.

8' Fixed Window

Florida Product Approval # 6587.4 R9

Florida Building Code 2026

Per Rule 61G20-3

Method: 1 -D

Category: Windows

Subcategory: Fixed

Compliance Method: 61G20-3.005(1)(d)

HVHZ

Product Manufacturer:

E.F. Bavis & Associates, Inc.

201 Grandin Road

Maineville, Ohio 45039

Engineer Evaluator:


Johnathan Green, P.E. #88223

Florida Evaluation ANE ID: 12901

Contents:

Evaluation Report: Page 1 - 3

Installation Detail: Page 4 - 19

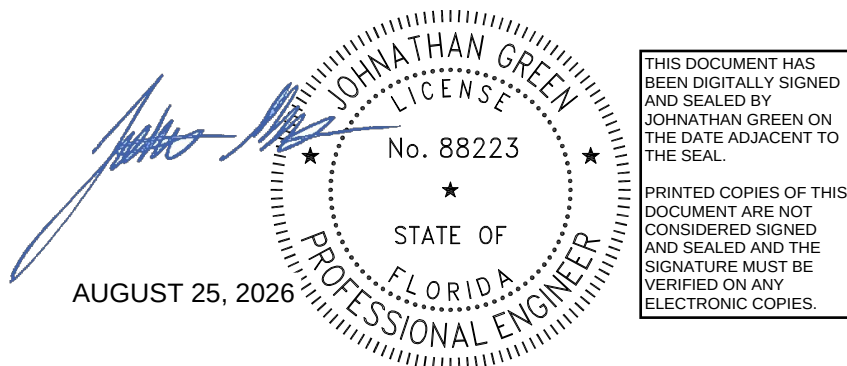



Compliance Statement:	The product as described in this report has demonstrated compliance with the Florida Building Code 2026 including High Velocity Hurricane Zone.
Product Description:	8' Fixed Window Model #12103993.
Window Frame Size:	7'-4 3/8" wide x 2'-8 3/4" high x 6 7/8" deep
Window Frame:	Material: 14 Ga. ASTM A653 Grade 50, Galvannealed A60 Frame Coating: Nominal 3 mils Powder Coat
Glazing:	1 1/4" (nominal) thick bullet resistant glass. The glass consists of 3/32" annealed on interior face, 3/8" annealed, 1/2" annealed and 1/4" annealed on the exterior side. A layer of 0.030" Kuraray Trosifol PVB is placed between each layer of glass.
Glazing Interlayer:	Kuraray America, Inc. 0.030" Kuraray Trosifol PVB Interlayer Miami Dade NOA NO: 26-0625.05
Window Frame Anchorage:	Header: Six fasteners equally spaced, 7 5/16" from each end then 14 3/4" O.C. Sill: Six fasteners located in pairs of two at 2" apart, 8 1/4" from each end and at center. Jamb: Three fasteners located 6", 17 1/4" and 28 1/2" from bottom of frame for each jamb. All fasteners shall be Corrosion Resistance: Per Florida Building Code 2026 and Section 1711 for installations within 3000 ft. of a saltwater coastline.
Substrate:	Minimum 14 Ga. Stud framed opening or Minimum Grout filled C90 Concrete Block Nominal 8" or Minimum No 2 S.P.F. Wood frame Substrate must be designed in accordance w/ Florida Building Code 2026.
Anchor Edge Distance:	Minimum 3/4" edge distance for 14 Ga. steel framing Minimum 3" edge distance for Grout filled C90 Concrete Block Nominal 8" Minimum 1 1/4" edge distance for No 2 S.P.F. Wood frame
Design Wind Pressures:	+ / - 75.0 psf



Performance Standards:

The product described herein has demonstrated compliance with:

- TAS 201-94: Large Missile Impact Test.
- TAS 202-94: Criteria for Testing Impact and Non-Impact Resistance Building Envelope Components Using Static Air Pressure.
- TAS 203-94: Criteria for Testing Products Subject to Cyclic Wind Pressure Loading.
- ASTM F588: Type D Hand & Tool Manipulation Test

Reference Data:

1. Test Reports T195-08
Farabaugh Engineering & Testing, Inc.
2. Anchor Calculations
Terrence E. Wolfe, P.E. # 44923
3. Certificate of Independence
By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing
(FBC Organization # ANE ID: 12901)

Quality Assurance Entity:

The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.


Installation:

Install per manufacturer's recommended details.

Design Procedure:

Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2026 for wall cladding wind loads. These component wind loads for wall cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to the structure. Support framing must be in compliance with Florida Building Code 2026.


	E.F.BAVIS & ASSOC. INC.		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: .XX ± .01; .XXX ± .005 FRACTIONS: + - 1/32" ANGLES: + - 30° REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		8' FIXED WINDOW		MODEL 12103993		PAGE 2 OF 15	
	201 GRANDIN RD. P.O. BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552		THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.				DWG. 8' WT-HUR		DATE ORDERED: 12/16/04 BAP	
							REV. 06/27/08		COPYRIGHT 1996,2002 E.F.Bavis & Assoc. Inc.	
VERTICAL FRAME CROSS SECTION, FOR PLANT QUALITY CONTROL										

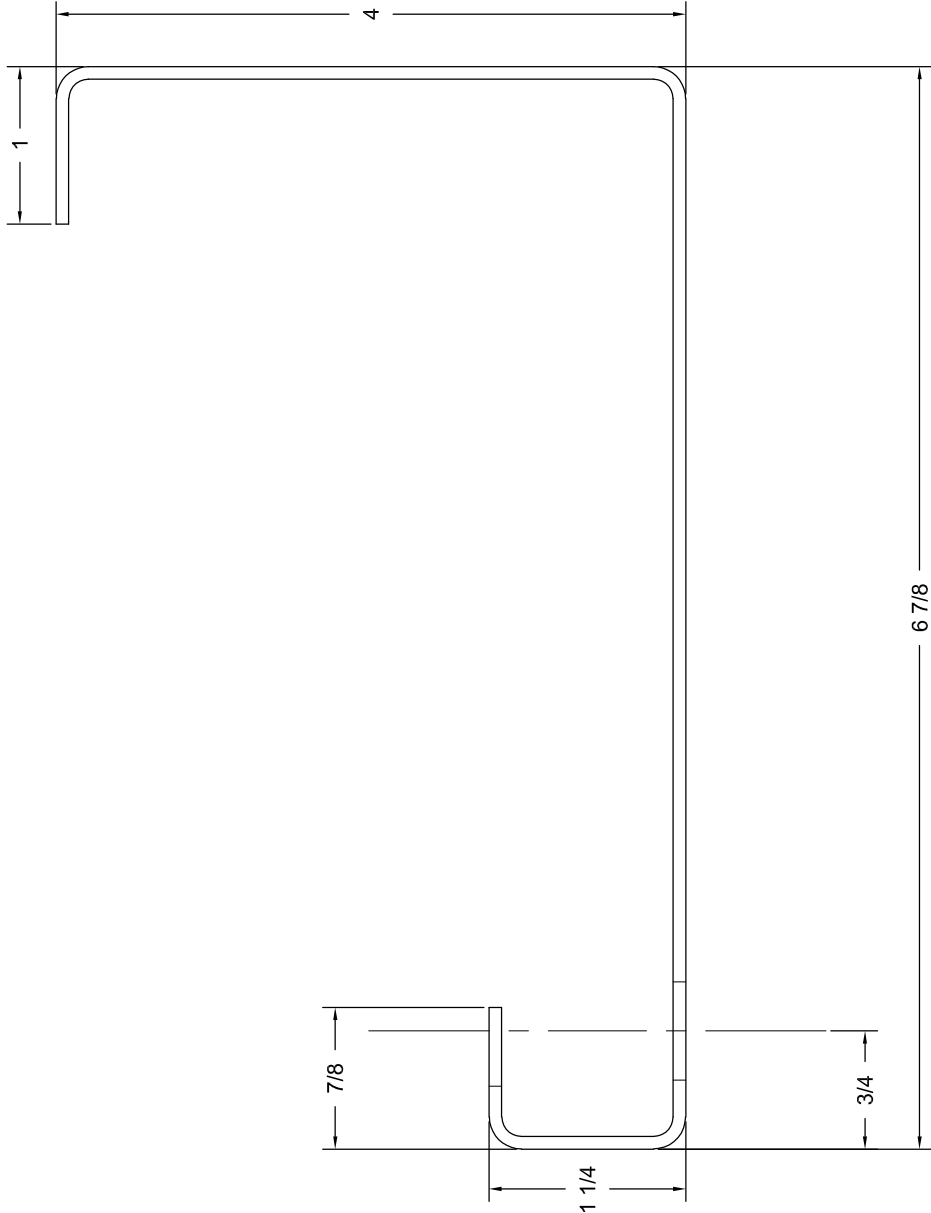

ITEM - 1

MATERIAL: ASTM A653 .0785 (14 GAUGE) GALVANNEALED A60


E F	E.F.BAVIS & ASSOC. INC. 201 GRANDIN RD. P.O.BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552	UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: XX +-.01; .XXX +-.005 FRACTIONS: + - 1/32; ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		MODEL		12103993		PAGE			
		THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.		8' FIXED WINDOW		DWG.		8' WT-HUR		DATE CREATED: 12/16/04 BAP	
						REV.		06/27/08		MJC E.F.Bavis & Assoc. Inc.	
										COPYRIGHT 1996,2002	
										E.F.Bavis & Assoc. Inc.	
TOP FRAME CROSS SECTION, FOR PLANT QUALITY CONTROL											

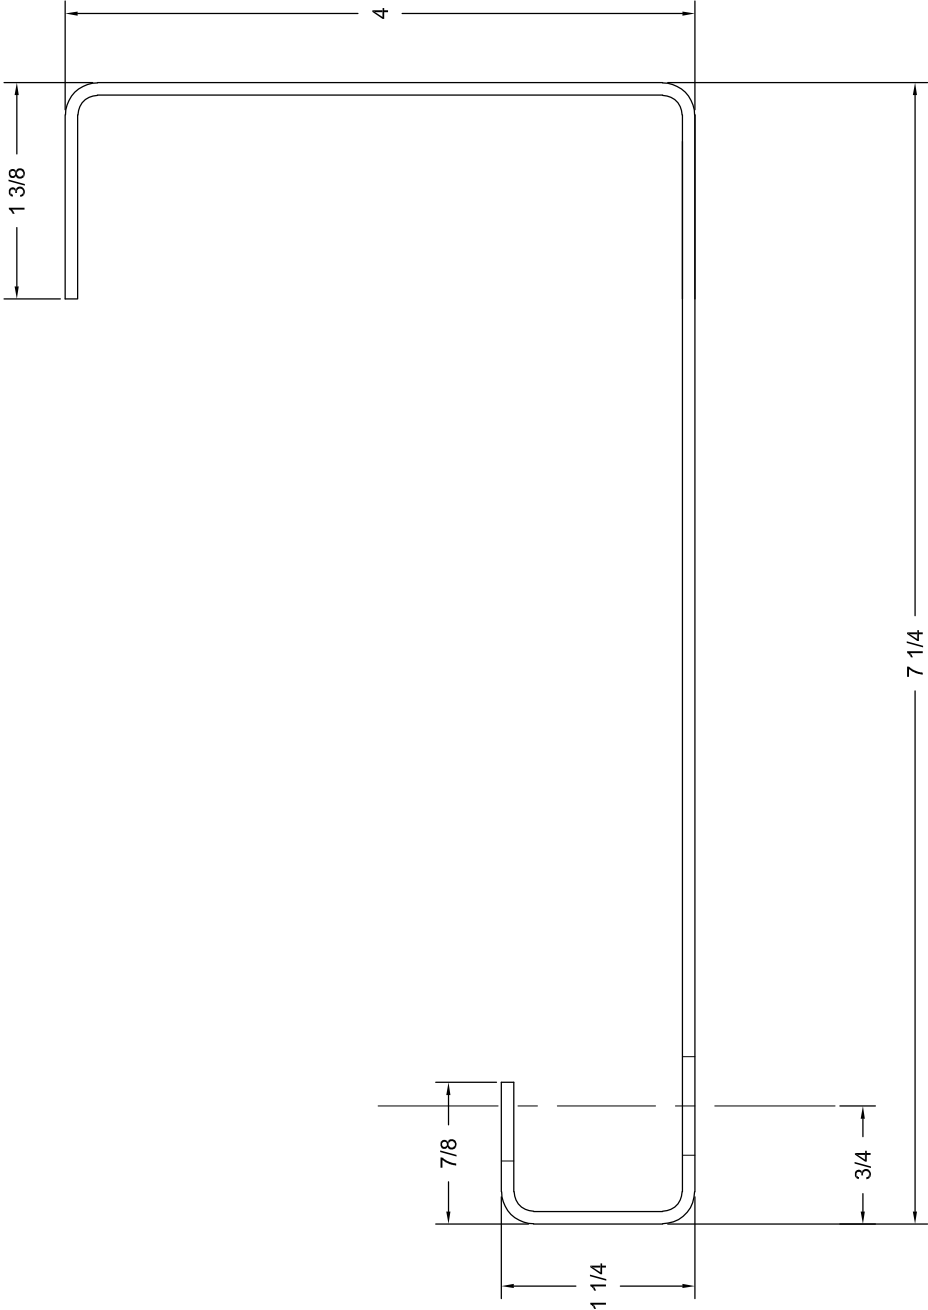

ITEM - 2


MATERIAL: ASTM A653 .0785 (14 GAUGE) GALVANNEALED A60

	E.F.BAVIS & ASSOC. INC.		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: .XX ± .01; .XXX ± .005 FRACTIONS: + - 1/32; ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		MODEL		12103993		PAGE		
	201 GRANDIN RD. P.O.BOX 337		THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE; OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.		DWG.		8' WT-HUR		4 OF 15		
	MAINEVILLE, OH. 45039 0337				REV.				DATE CREATED: 12/16/04 BAP		
	PH 513-677-0500 FAX 513-677-0552				DATE:				COPYRIGHT 1996,2002 E.F.Bavis & Assoc. Inc.		
8' FIXED WINDOW											
LOWER SILL CROSS SECTION, FOR PLANT QUALITY CONTROL											

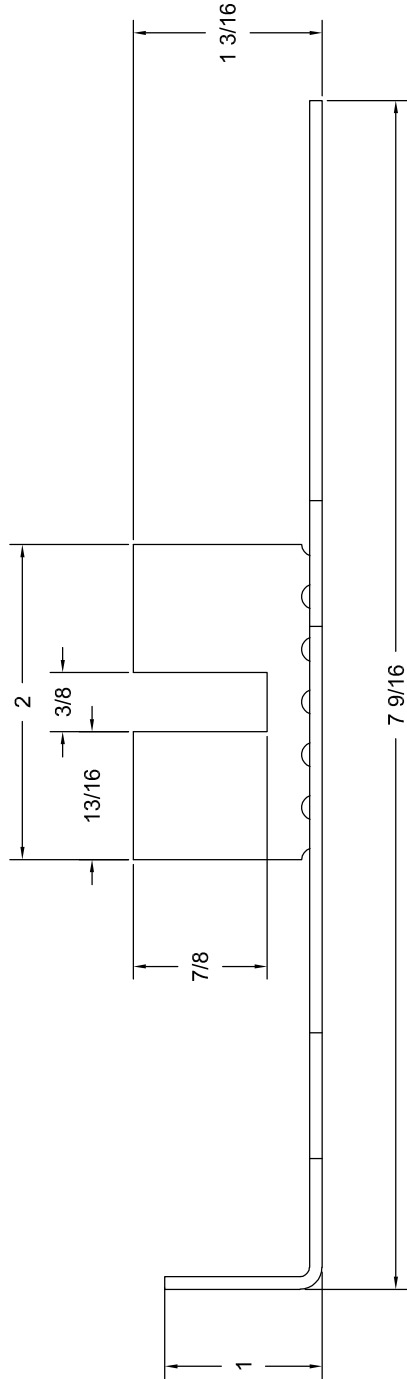


	E.F.BAVIS & ASSOC. INC.		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: .XX +-.01; .XXX +-.005 FRACTIONS: + - 1/32; ANGLES: + -.30° REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		MODEL		12103993		PAGE	
	201 GRANDIN RD. P.O.BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552		THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.		DWG.		8' WT-HUR		DATE CREATED: 12/16/04 BAP	
					REV.		08/21/12		MJC COPYRIGHT 1996,2002 E.F.Bavis & Assoc. Inc.	

UPPER SILL CROSS SECTION, FOR PLANT QUALITY CONTROL

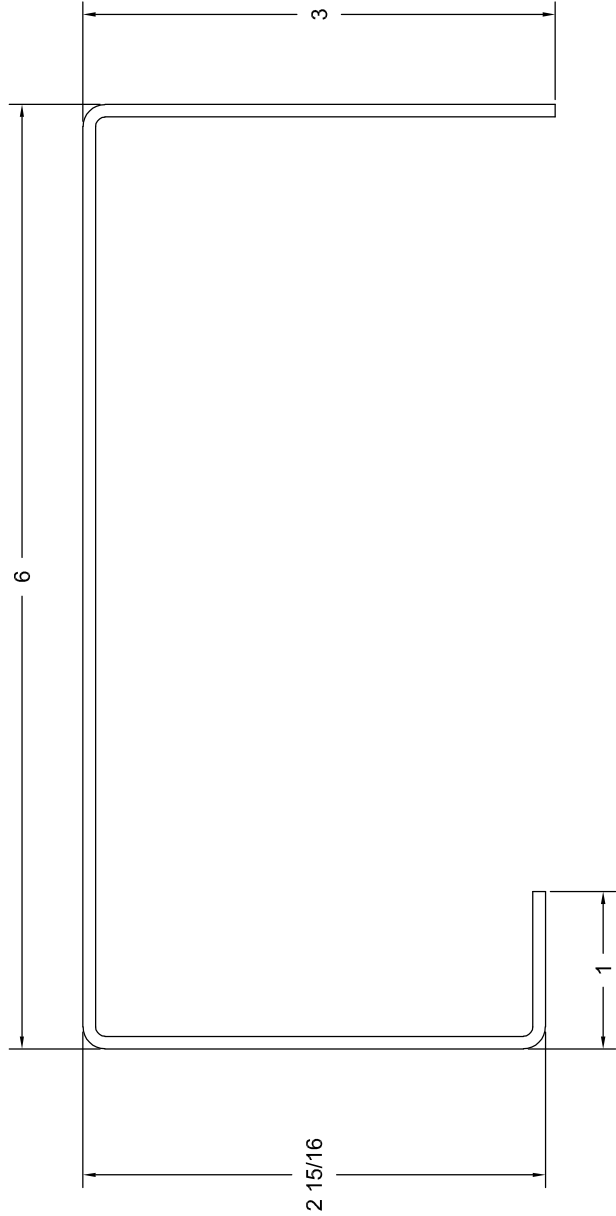

	E.F.BAVIS & ASSOC. INC.		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: .XX ± .01 ; .XXX ± .005 FRACTIONS: + - 1/32" ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		12103993		PAGE
	201 GRANDIN RD. P.O.BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552		THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.		8' FIXED WINDOW		6 OF 15
					DWG. 8' WT-HUR		DATE CREATED: 12/16/04 BAP
				REV.		COPYRIGHT 1996,2002 E.F.Bavis & Assoc. Inc.	
				DATE:			


WINDOW FILLER PLUG, FOR PLANT QUALITY CONTROL

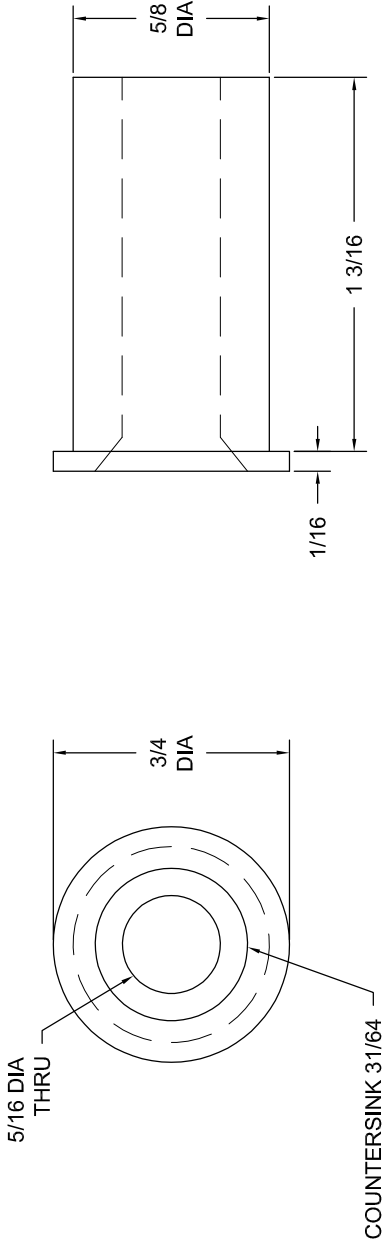


ITEM - 5
MATERIAL: 12L14 STEEL


	E.F. BAVIS & ASSOC. INC. 201 GRANDIN RD. P.O. BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552	UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: .XX +-.01 ; .XXX +-.005 FRACTIONS: + - 1/32; ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX. THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.	8' FIXED WINDOW	MODEL: 12103993	PAGE: 9 OF 15
			DWG. 8' WT-HUR	DATE: 12/16/04	BAP
			REV. DATE:	REV. DATE:	COPYRIGHT 1996,2002 E.F.Bavis & Assoc. Inc.

FASTENER INSTALLATION DETAIL: MASONRY, HEAD & JAMB

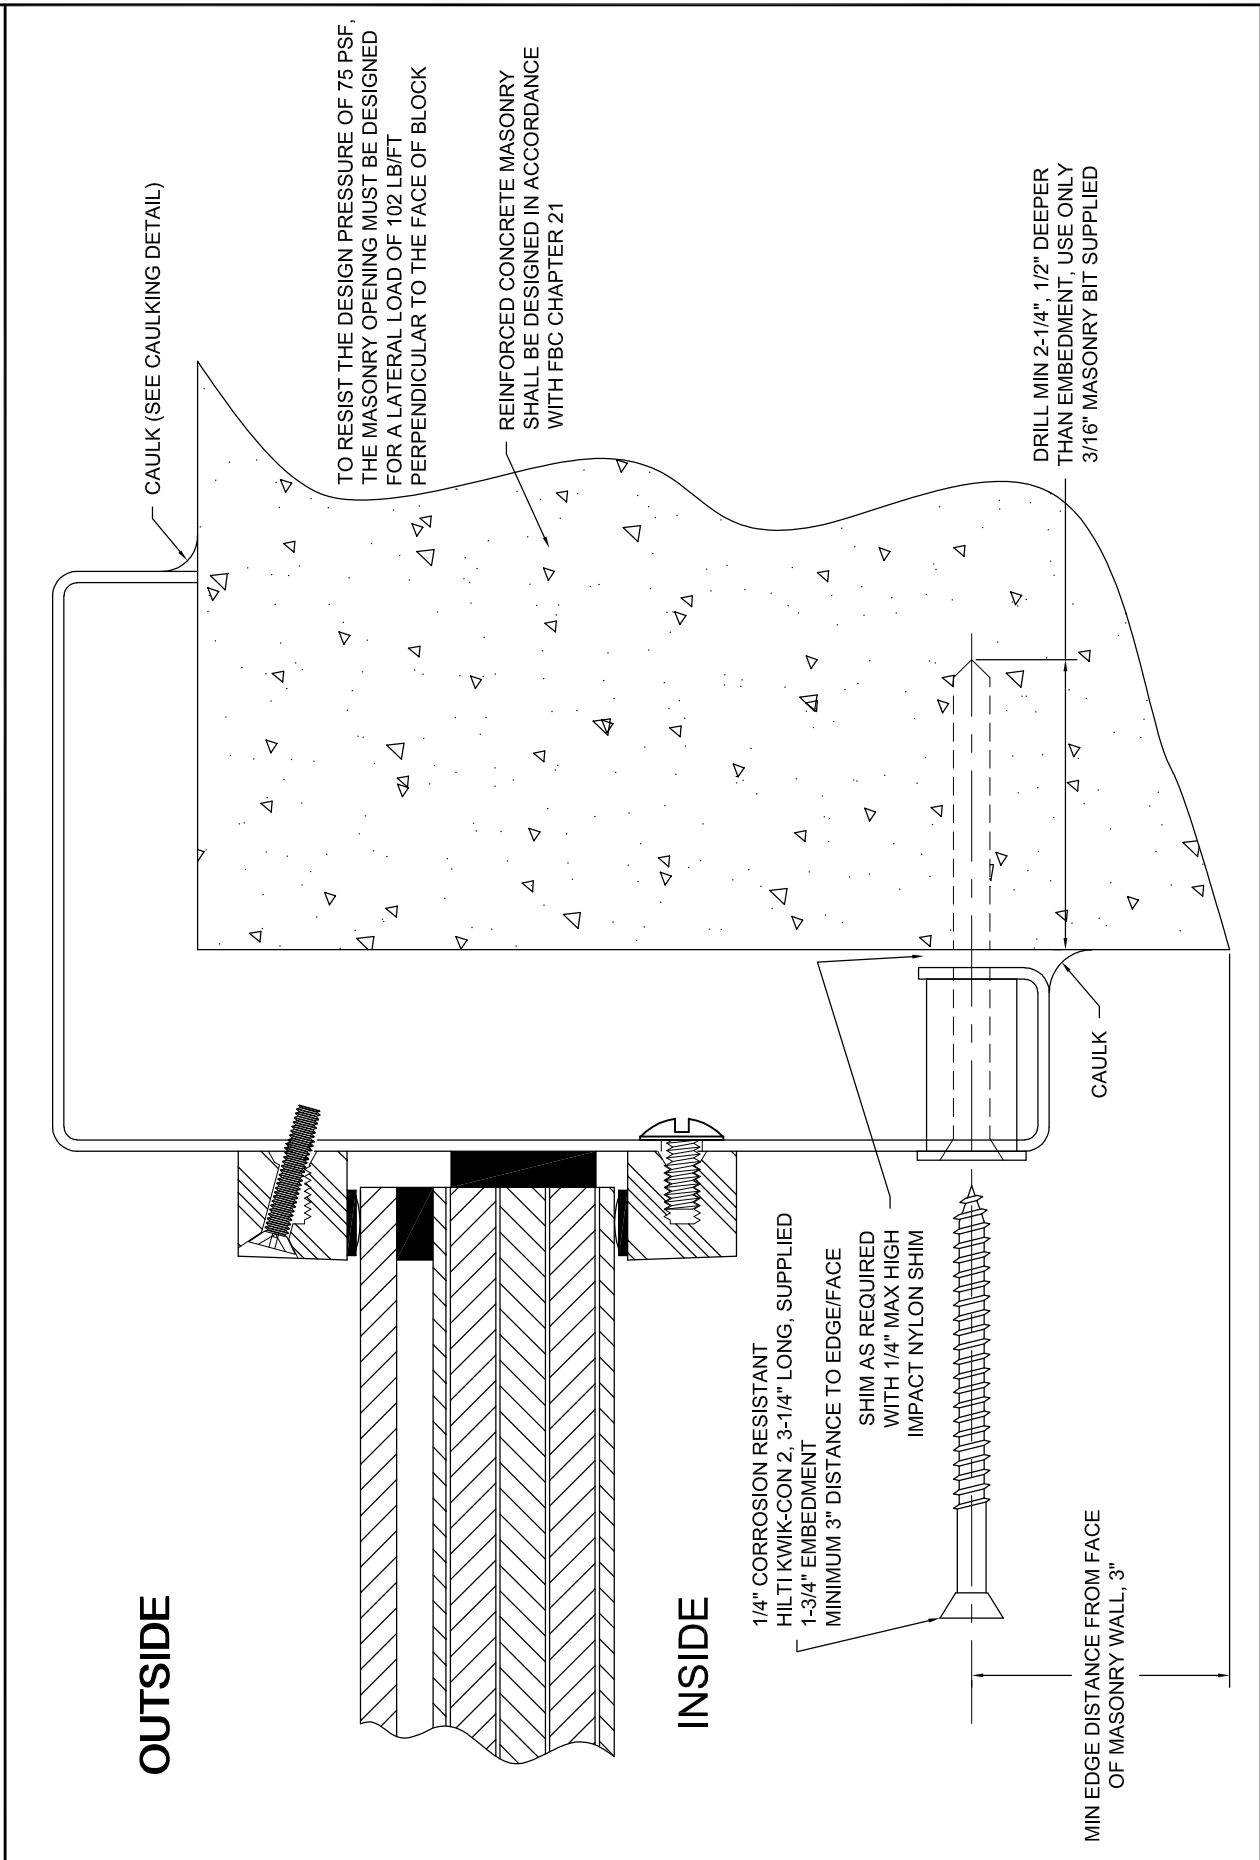

FASTENER INSTALLATION DETAIL: METAL, HEAD AND JAMB, FIELD VERIFIED

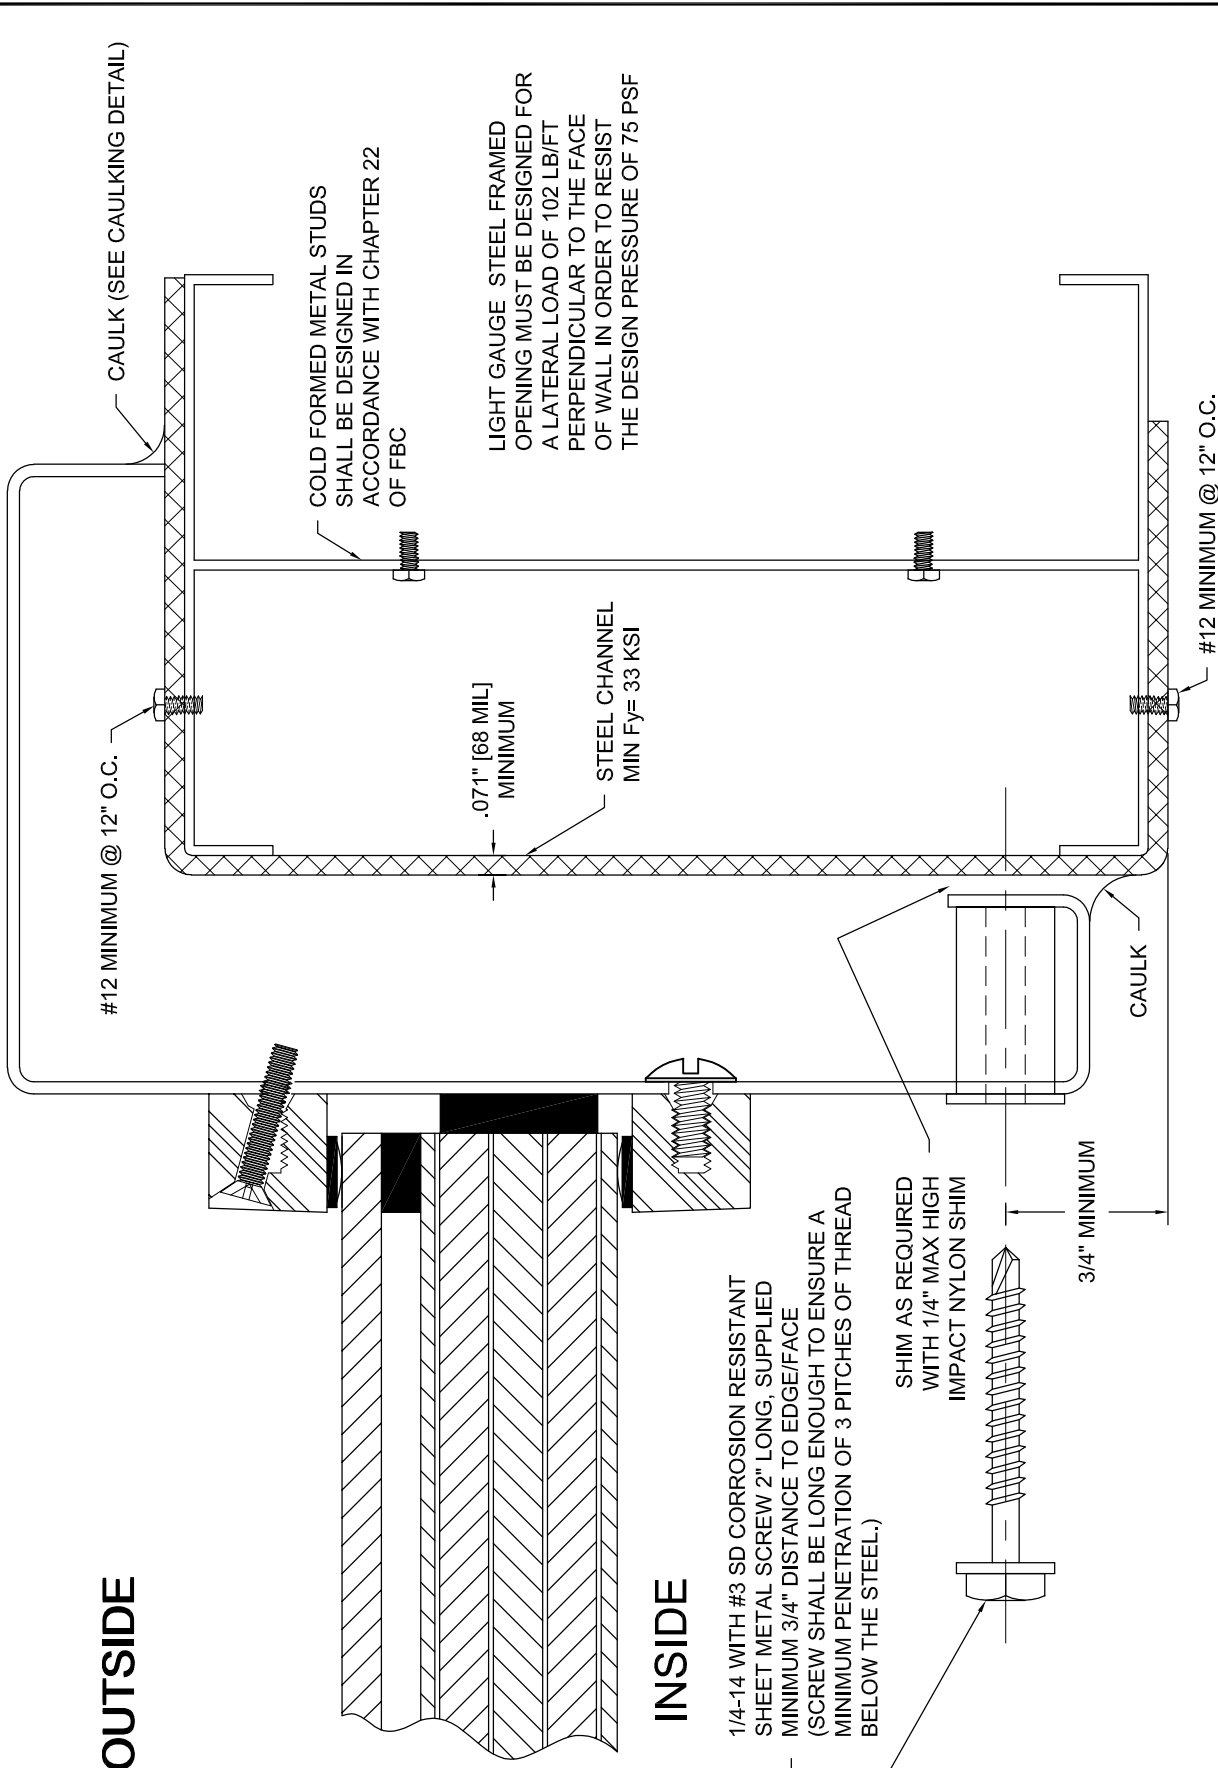

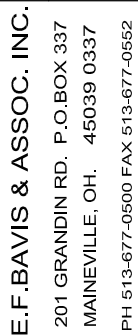


UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES
DECIMALS; .XX +.01; .XXX +.005 FRACTIONS; + -1/32; ANGLES; + - 30'
REMOVE ALL BURNS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.

THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF
E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL
NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE,
OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.


MODEL	12103993
DWG.	8' WT-HUR
REV. DATE:	

PAGE		11 OF 15	
DATE CREATED:	12/16/04	BAP	
		COPYRIGHT 1996, 2002 E.F. Bawls & Assoc. Inc.	

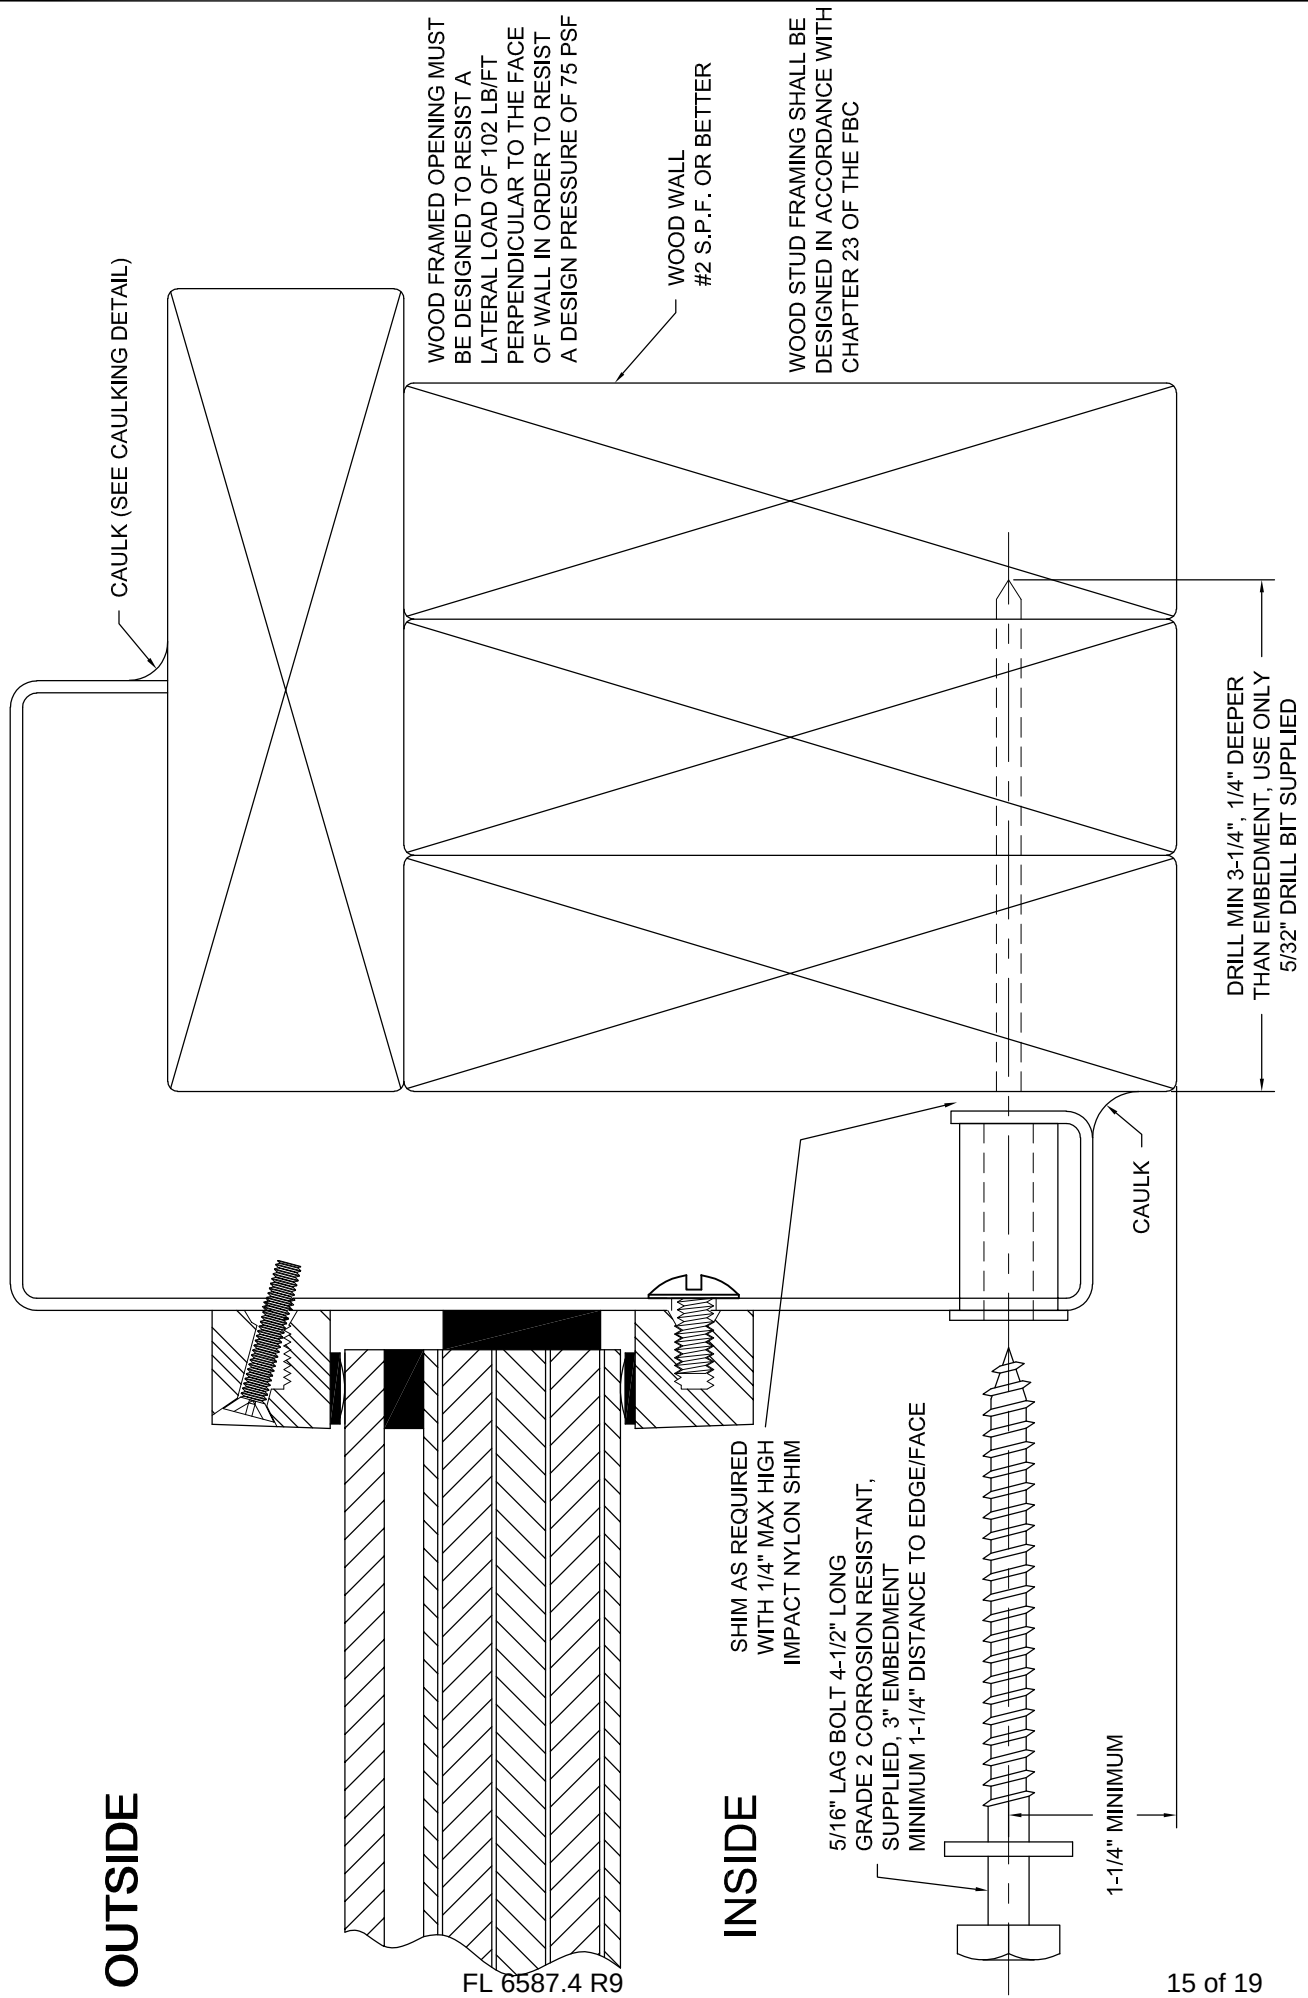

		E.F.BAVIS & ASSOC. INC. 201 GRANDIN RD. P.O.BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: XX + -.01; XXX + -.005 FRACTIONS: + - 1/32; ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.		8' FIXED WINDOW		MODEL: 12103993		PAGE 12 OF 15	
								DWG. 8' WT-HUR		DATE CREATED: 12/16/04 BAP			
								REV. DATE:		COPYRIGHT 1996,2002 E.F.Bavis & Assoc. Inc.			
FASTENER INSTALLATION DETAIL: SILL, MASONRY WALL, FIELD VERIFIED													

TO RESIST THE DESIGN PRESSURE OF 75 PSF,
 THE MASONRY OPENING MUST BE DESIGNED
 FOR A LATERAL LOAD OF 102 LB/FT
 PERPENDICULAR TO THE FACE OF BLOCK

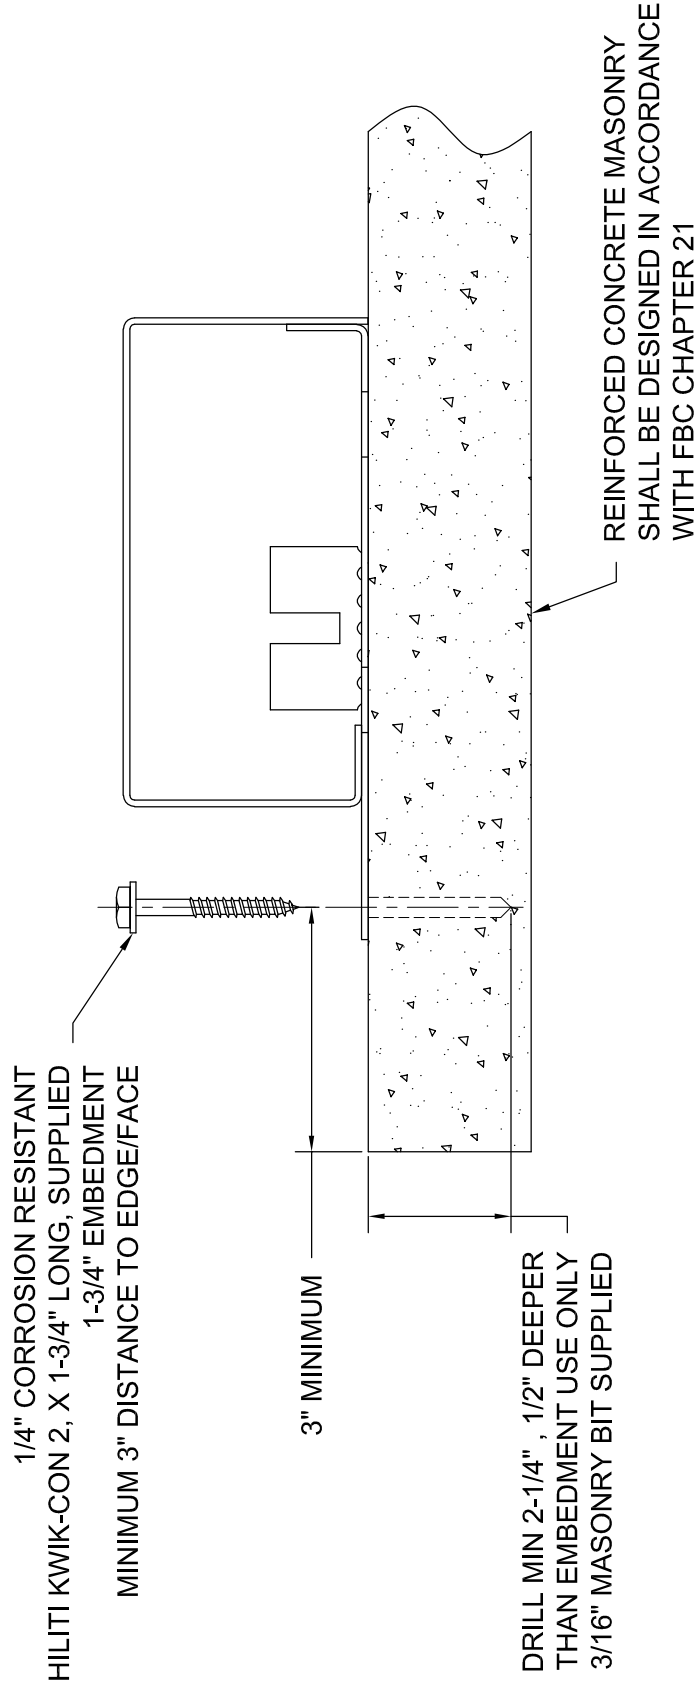


	E.F. BAVIS & ASSOC. INC. 201 GRANDIN RD. P.O. BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: .XX + -.01; .XXX + -.005 FRACTIONS: + - 1/32; ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R .02 OR .02 X .02 CHAMFER MAX.		8' FIXED WINDOW		MODEL 12103993	PAGE 13 OF 15
	THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF <u>E.F.BAVIS & ASSOC. INC.</u>						DWG. 8' WT-HUR	DATE CREATED 12/16/04 BAP
							REV. DATE:	COPYRIGHT 1986,2002 E.F.Bavis & Assoc. Inc.
FASTENER INSTALLATION DETAIL: SILL, METAL WALL, FIELD VERIFIED								

COLD FORMED METAL STUDS
SHALL BE DESIGNED IN
ACCORDANCE WITH CHAPTER 22
OF FBC

LIGHT GAUGE STEEL FRAMED
OPENING MUST BE DESIGNED FOR
A LATERAL LOAD OF 102 LB/FT
PERPENDICULAR TO THE FACE
OF WALL IN ORDER TO RESIST
THE DESIGN PRESSURE OF 75 PSF

1/4-14 WITH #3 SD SHEET METAL SCREW 1" LONG, SUPPLIED
MINIMUM 3/4" DISTANCE TO EDGE/FACE
(SCREW SHALL BE LONG ENOUGH TO ENSURE A MINIMUM
PENETRATION OF 3 PITCHES OF THREAD BELOW THE STEEL.)

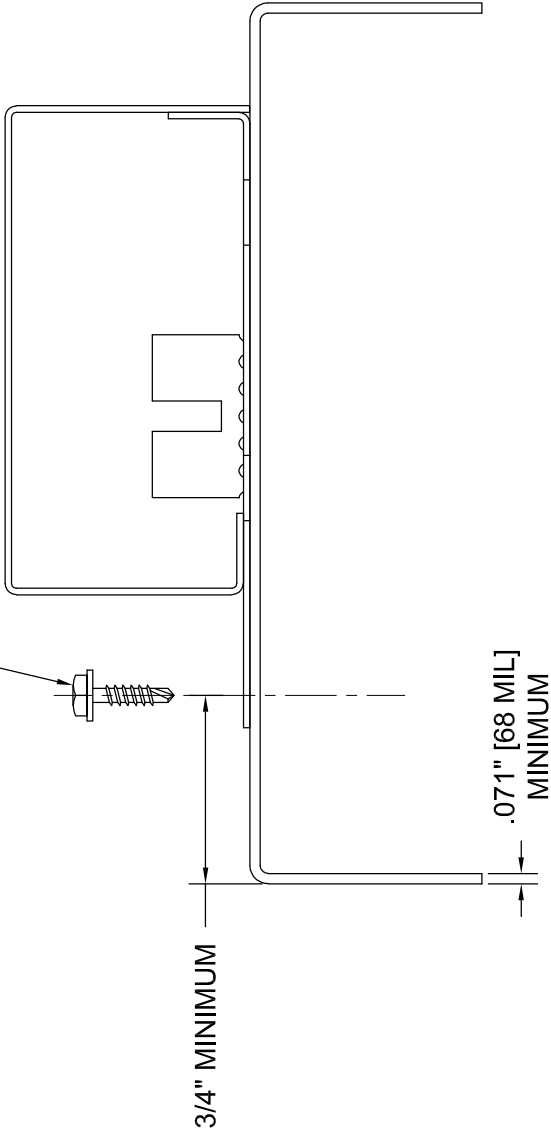

	E.F.BAVIS & ASSOC. INC. 201 GRANDIN RD. P.O.BOX 337 MAINEVILLE, OH. 45039 0337 PH 513-677-0500 FAX 513-677-0552		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES DECIMALS: XX +-.01; .XXX +-.005 FRACTIONS: + - 1/32; ANGLES: + - 30' REMOVE ALL BURRS AND SHARP EDGES TO R.02 OR .02 X .02 CHAMFER MAX.		8' FIXED WINDOW		MODEL 12103993		PAGE 15 OF 15	
			THIS DOCUMENTATION AND INFORMATION CONTAINED ARE THE SOLE PROPERTY OF E.F.BAVIS & ASSOC. INC. IT SHALL BE RETURNED UPON REQUEST AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE ELSE, OR USED, WITHOUT WRITTEN CONSENT OF E.F.BAVIS & ASSOC. INC.				DWG. 8' WT-HUR		DATE CREATED: 12/16/04 BAP	
							REV. 06/27/08		COPYRIGHT 1986,2002 E.F.Bavis & Assoc. Inc.	

FINISH CAULKING, FIELD VERIFIED

