

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

Product Evaluation Report
CAROLINA CARPORTS, INC.

Dutch Lap Wall Panel over Open Framing

Florida Product Approval # 6702.4 R8

Florida Building Code 2023

Per Rule 61G20-3

Method: 2 –B

Category: Structural Components

Subcategory: Structural Wall

Compliance Method: 61G20-3.005(2)(b)

NON HVHZ

Product Manufacturer:

Carolina Carports, Inc.

187 Cardinal Ridge Trail

Dobson, NC 27017

Engineer Evaluator:


Johnathan Green, P.E. #88223

Florida Evaluation ANE ID: 12901

Contents:

Evaluation Report: Page 1 - 3

Installation Detail: Page 4

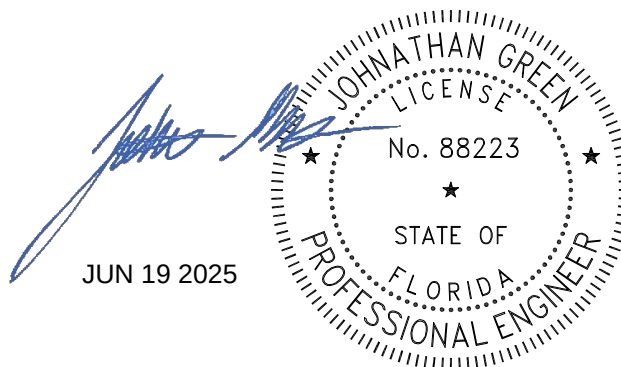

THIS DOCUMENT HAS
BEEN DIGITALLY SIGNED
AND SEALED BY
JOHNATHAN GREEN ON
THE DATE ADJACENT TO
THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED
AND SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.



Compliance Statement: The product as described in this report has demonstrated compliance with the Florida Building Code 2023, Section 1709.2.

Product Description: Dutch Lap Wall Panel, 29 Ga. or 26 Ga. Steel, 36" Coverage, through fastened structural wall panel. Structural Application.

Panel Material/Standards: Material: 29 Ga. or 26 Ga. Steel, panel material shall comply with Florida Building Code 2023 Section 1405.2.
 Yield Strength: Min. 80.0 ksi

Panel Dimension(s): Thickness: 29 Ga. 0.0140" min.
 26 Ga. 0.0185" min.
 Width: 36" maximum coverage
 Height: 0.648" tall

Panel Fastener: #12-14 x ¾" HWH SD with sealing washing or approved equal.
 Corrosion Resistance: Per Florida Building Code 2023.

Substrate Description: Min. 14 Ga. Steel Framing. Framing must be designed in accordance w/ Florida Building Code 2023.

Allowable Wall Design Pressures:

29 Ga. Dutch Lap Design Pressures

Maximum Wall Design Pressure:	-35.5 psf	+35.1 psf
Panel Fastener Pattern:	6"-6"-6"-6"-6"-6"	6"-6"-6"-6"-6"-6"
Panel Fastener (Post) Spacing:	4'-0" O.C.	4'-0" O.C.

*Design Pressure includes a Safety Factor = 1.5.


26 Ga. Dutch Lap Design Pressures

Maximum Wall Design Pressure:	-26.0 psf	+24.4 psf	-37.0 psf	+36.8 psf
Panel Fastener Pattern:	6"-6"-6"-6"-6"-6"	6"-6"-6"-6"-6"-6"	6"-6"-6"-6"-6"-6"	6"-6"-6"-6"-6"-6"
Panel Fastener (Post) Spacing:	5'-0" O.C.	5'-0" O.C.	4'-0" O.C.	4'-0" O.C.

*Design Pressure includes a Safety Factor = 1.5.



Code Compliance:	The product described herein has demonstrated compliance with The Florida Building Code 2023, Section 1709.2.
Evaluation Report Scope:	The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2023, as relates to Rule 61G20-3.
Performance Standards:	The product described herein has demonstrated compliance with: ▪ ASTM E 330-14 Test method for structural performance of Exterior Windows, Curtain Walls and Doors by Uniform Static Air Pressure difference.
Reference Data:	1. ASTM E 330-02 Test American Test Lab, Inc (FBC Organization # TST-1555) Report No. ATLNC 0315.01-17 2. Certificate of Independence By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing (FBC Organization # ANE ID: 12901)
Test Standard Equivalency:	The ASTM E 330-02 test standard is equivalent to the ASTM E 330-14 test standard.
Quality Assurance Entity:	The manufacturer has established compliance of wall panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
Installation:	Install per manufacturer's recommended details.
Insulation:	Manufacturer's approved product (Optional)
Panel Fire Classification:	Fire classification is not part of this acceptance.
Shear Diaphragm:	Shear diaphragm values are outside the scope of this report.
Design Procedure:	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2023 for wall cladding wind loads. These component wind loads for wall cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2023 Chapter 22 for steel, and Chapter 16 for structural loading.

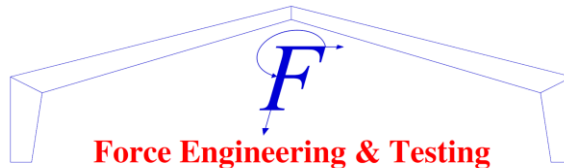

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

DUTCH LAP WALL PANEL

