

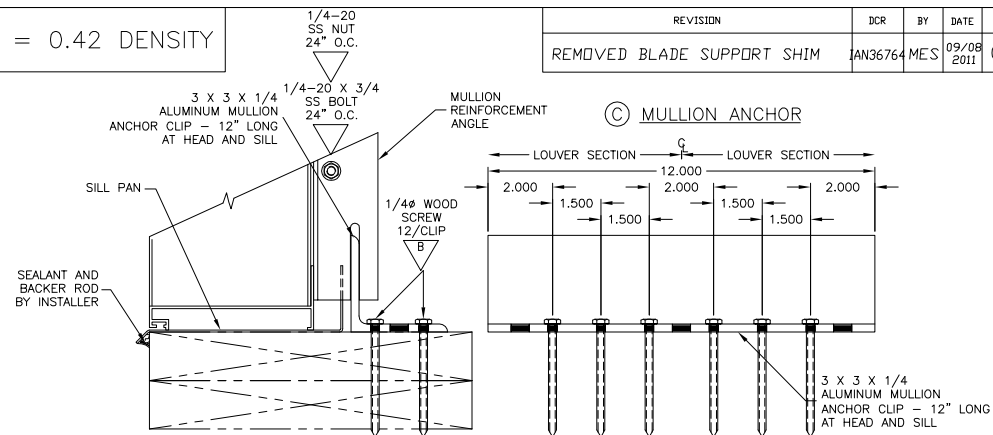

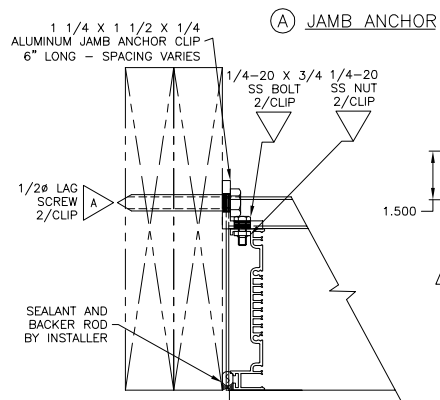
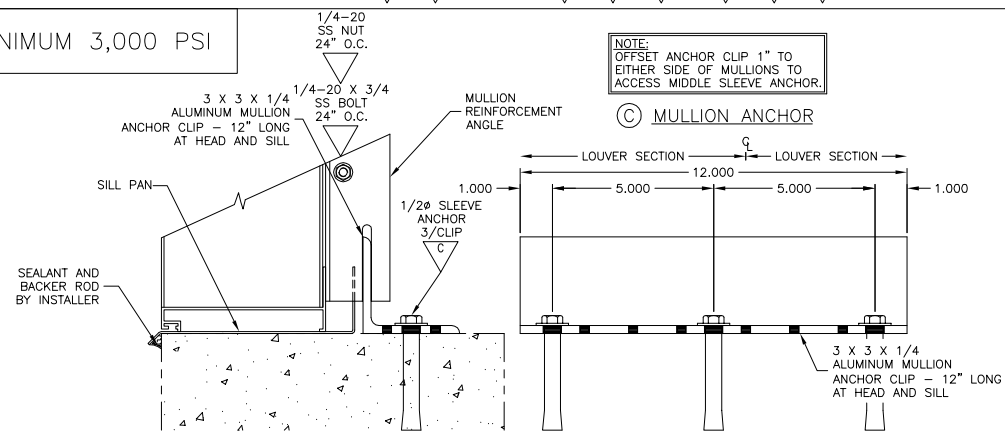




WOOD OPENING MINIMUM $G = 0.42$ DENSITY




MASONRY OPENING MINIMUM 3,000 PSI

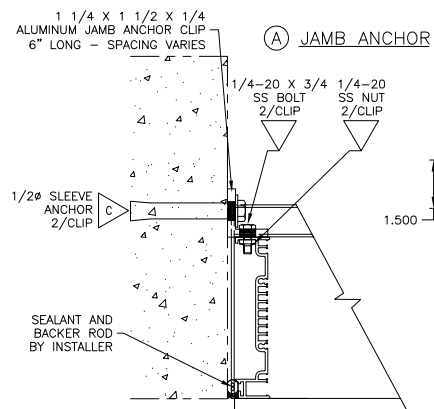


W/O SUPPORT ANGLE

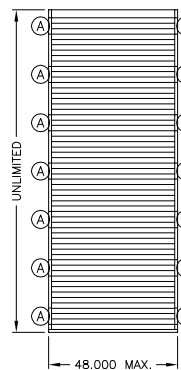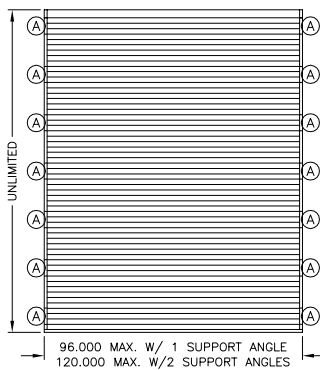W/ SUPPORT ANGLE

MULTIPLE SECTION W/ MULLION

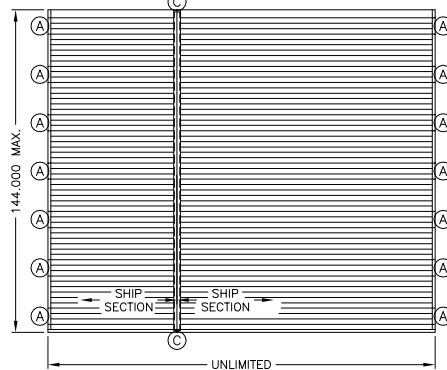

AVAILABLE SHAPES

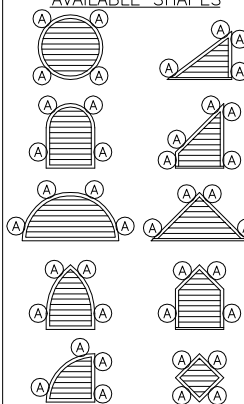

FIELD FASTENER SCHEDULE (BY INSTALLER)

TYPE	DESCRIPTION	MIN. EMBED.	MIN. EDGE DIST.	MIN. SPACING
A	1/2" LAG SCREW	3"	2 1/2"	3"
B	1/4" WOOD SCREW	3"	1/2"	1 1/2"
C	1/2" SLEEVE ANCHOR	3"-CONCRETE	3"	5"
C	1/2" SLEEVE ANCHOR	1 1/2"-BLOCK	3"	5"
D	1/4" SLEEVE ANCHOR	1 1/2"	1 1/2"	2 1/2"

INSTALLER TO PROVIDE SEPARATION OF DISSIMILAR MATERIALS AS REQUIRED

FIELD INSTRUCTIONS

PAINT	PART NO.	MAT'L	GAUGE	DESCRIPTION	
 GREENHECK P.O. BOX 410 SCHOFIELD, WISCONSIN 54476-0410				DRAWN BY STEEL	ECD IAN16098
TITLE IOM, EHH-501X FIELD INSTRUCTIONS, 1 OF 2				DATE 09/08/2011	ENG. REF. EHH-501X
				SUPERSEDES	
				SCALE 1/4	
				CAD DRAWING NO.	D141484

