



## DOOR MOUNTING BRACKET TO MASONRY DETAIL

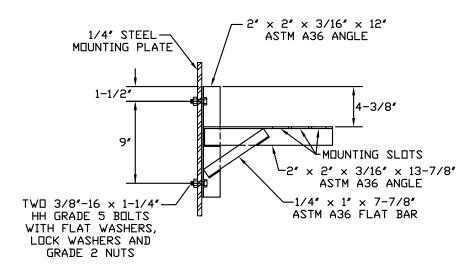

DOOR MOUNTING BRACKET TO STEEL DETAIL

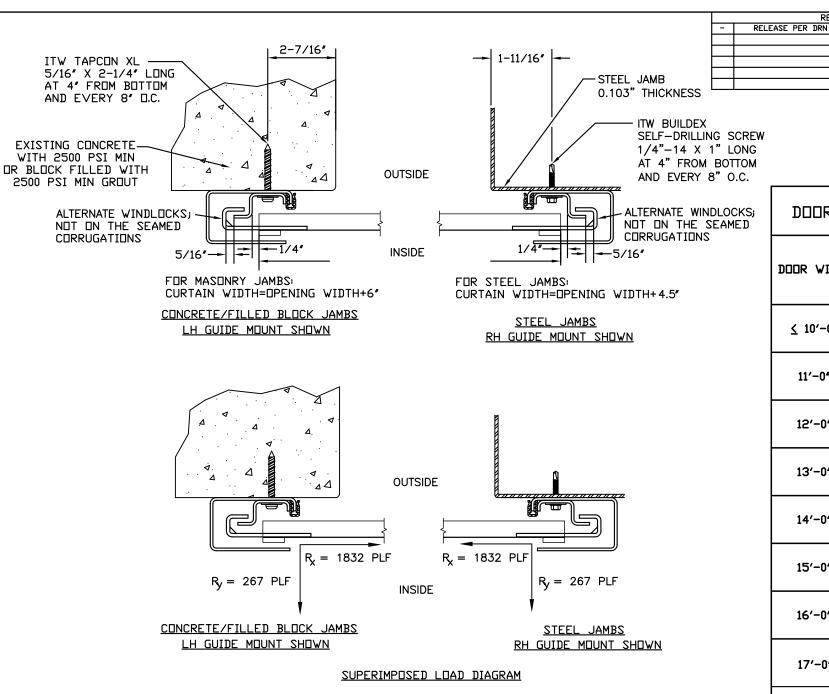


## GENERAL NOTES:

- 1. THIS DOOR EVALUATED IN ACCORDANCE WITH TEST METHODS ASTM E330-02 AND ANSI/DASMA 108-05.
- 2. THIS PRODUCT EVALUATION IS GENERIC. IT DOES NOT INCLUDE INFORMATION PREPARED FOR A SPECIFIC SITE.
- 3. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE STRUCTURAL CAPACITY OF THE SUBSTRATE (JAMB) TO RESIST THE LOADS IMPOSED BY THE ROLL-UP DOOR.
- 4. ALL DOOR JAMBS (MASONRY OR STEEL) MUST BE DESIGNED TO RESIST THE FORCES SHOWN IN SUPERIMPOSED LOAD DIAGRAM.

TX PE 56308/F-2203

5, THE DOOR ASSEMBLY SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

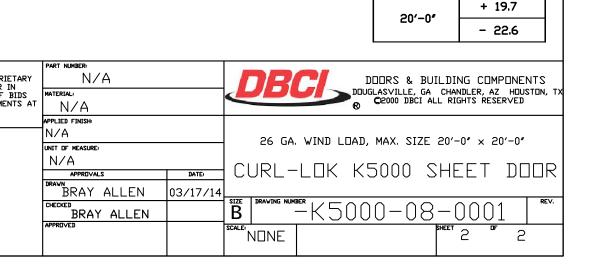

REVISIONS

DOOR SCHEDULE

DOOR WIDTH

≤ 10′-0″

11'-0"

12'-0"

13'-0"

14'-0"

15'-0"

16'-0"

17'-0"

18'-0"

19'-0"

DESIGN

**PRESSURE** 

(PSF)

+ 43.7

- 50.0

+ 39.9

- 45.7 + 36.8

- 42.1 + 34.1

- 39.0

+ 31.7

- 36.3

+ 29.7

- 34.0

+ 28.0

- 32.0

+ 25.4

- 29.1

+ 23.2

- 26.6

+ 21.3

- 24.4

DATE APPROVAL

THESE CONFIDENTIAL DOCUMENTS SUBMITTED BY DBCI CONTAIN INFORMATION OF A PROPRIETARY NATURE AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING IN PART OR IN WHOLE FOR ANY PURPOSE OTHER THAN THAT WHICH IS NECESSARY FOR PREPARATION OF BIDS OR ENGINEERING WITHOUT THE EXPRESS PERMISSION OF DBCI WHICH MAY RECALL DOCUMENTS AT ANY TIME.

JOHN E. SCATES PE 3121 FAIRGATE CARROLTON, TX 75007 FL PE 51737