

INSTALLATION NOTES:

- 7/31/2026 1:51 PM

c:\users\sebastianhereros\desktop\ykk.res.2026.cc\17533\ykk.260.dwg
- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
 - THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
 - INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
 - SHIM AS REQUIRED FOR FIN INSTALLATION AND AT EVERY ANCHOR LOCATION FOR THROUGH FRAME INSTALLATION IN ORDER TO ACHIEVE SQUARE AND PLUMB WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
 - FINLESS INSTALLATION:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
 - FINLESS INSTALLATION:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH ITW TAPCON OF SUFFICIENT LENGTH TO ACHIEVE 1-1/4 INCH MINIMUM EMBEDMENT.
 - FINLESS INSTALLATION:** FOR INSTALLATION THROUGH STEEL STUD USE #10 SELF-DRILLING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND STEEL STRUCTURE.
 - FIN INSTALLATION:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
 - FIN INSTALLATION:** FOR INSTALLATION THROUGH STEEL STUD USE #10 SELF-DRILLING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND STEEL STRUCTURE.
 - FOR MASONRY OR CONCRETE OPENINGS, 1X WOOD BUCK MAY BE USED (OPTIONAL AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
 - MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
 - INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
 - FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
 - INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

YKK AP AMERICA RESIDENTIAL

STYLEVIEW / PRECEDENCE TWIN/TRIPLE

DOUBLE HUNG WINDOW (NON-HVHZ) (NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

AAMA/WDMA/CSA 101/I.S.2/A440-22
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:


X: OPERABLE SASH

O: FIXED SASH
- GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 1 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, INSTALLATION NOTES & GLAZING DETAIL
2	ELEVATION & ANCHOR LAYOUTS
3	VERTICAL SECTIONS & ANCHOR SCHEDULE
4	HORIZONTAL SECTIONS & REINF SCHEDULE

DESIGN PRESSURE TABLE								
UNIT	MAX. FRAME SIZE		MAX. D.L.O.		DESIGN PRESSURE	CONFIGURATION	INSTALLATION METHOD	IMPACT RATING
	WIDTH	HEIGHT	WIDTH	HEIGHT				
1	107 1/2"	71 1/2"	29-11/32"	32-1/16"	+35/-35 PSF	"X/X"-"X/X"-"X/X"	THROUGH FRAME	NOT RATED
2	119 1/2"	73 1/2"	33 11/32"	TOP 33 17/64"	+35/-35 PSF	"X/X"-"X/X"-"X/X"	NAIL FIN	NOT RATED
3	119 1/2"	73 1/2"		BOTTOM 33 9/32"	+50/-50 PSF	"X/X"-"X/X"-"X/X"	NAIL FIN	NOT RATED

NOTE: THE TABLE ABOVE MAY ALSO BE USED TO QUALIFY TWIN UNITS INSTEAD OF TRIPLE UNITS, SUCH THAT THE LISTED D.L.O. DIMENSIONS ARE NOT EXCEEDED.

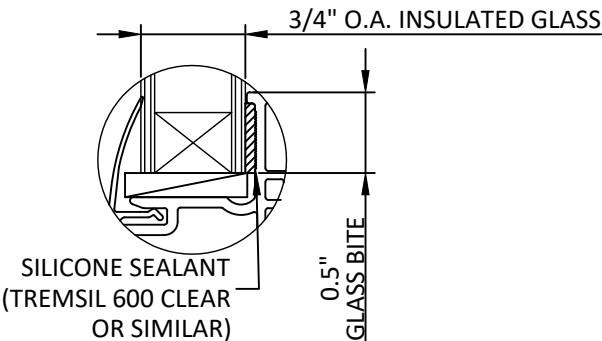

GLAZING DETAIL

GLAZING NOTES:

- GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCK TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" PER FBC CHAPTER 24.
- ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

INTERCEPT STAINLESS STEEL OR TIN PLATED SPACER: AROUND THE PERIMETER OF THE GLASS

PRIMARY SEALANT: POLYISOBUTYLENE (PIB)

SECONDARY SEALANT: STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEVIEW/PRECEDENCE TRIPLE DOUBLE HUNG WINDOW (NON-HVHZ) (NON-IMPACT)
GENERAL NOTES, INSTALLATION NOTES & GLAZING DETAIL


PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	05.01.24
REINFORCEMENT REV.	LS	05.27.26
2026 CODE CHANGE	SH	07.31.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.09 15:49:00 -0400

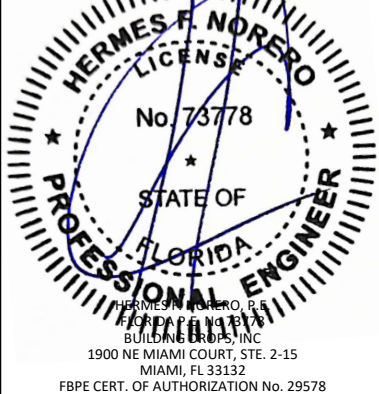

FL #: FL7533

DATE: 03.09.18

DWG. BY: HR

CHK. BY: HFN

SCALE: NTS

DWG. #: YKK260

SHEET:


1

REV. D


OF 4

7/31/2026 1:51 PM


c:\users\sebastianherrerros\desktop\ykk\res 2026 cc\7533\ykk260.dwg

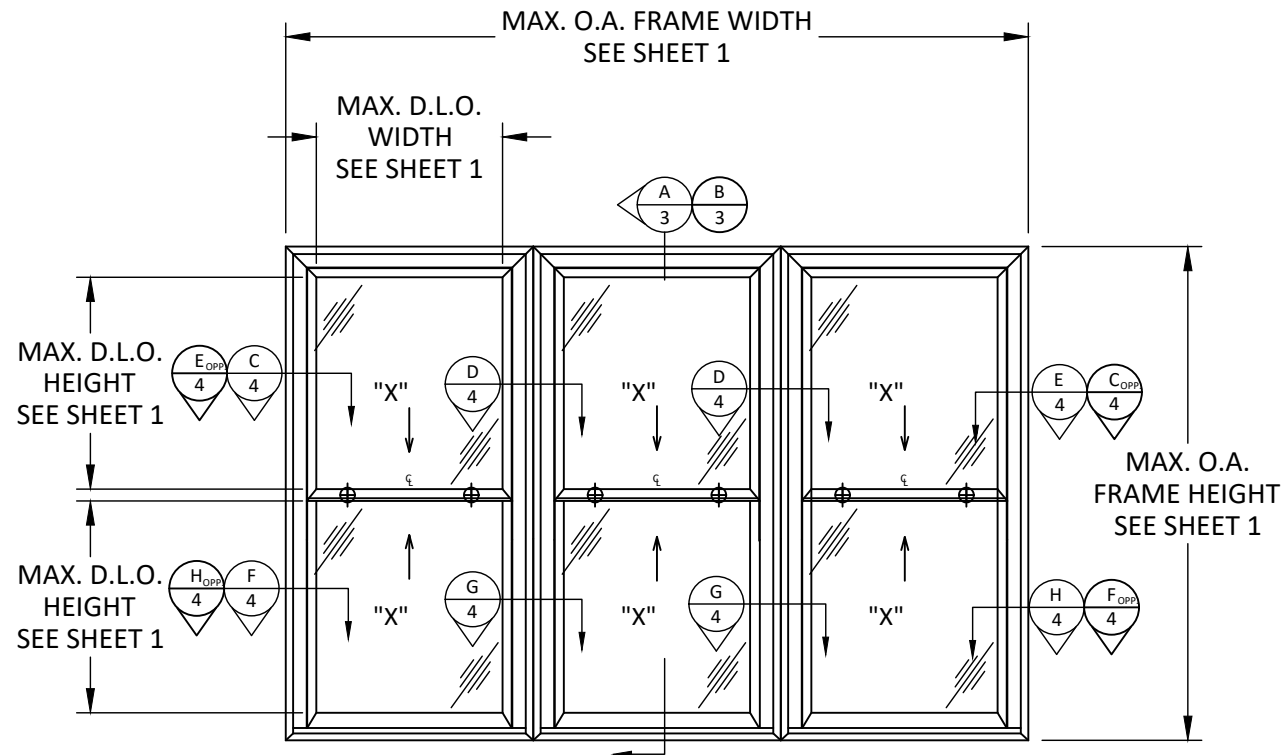

ELEVATION
DOUBLE HUNG WINDOW

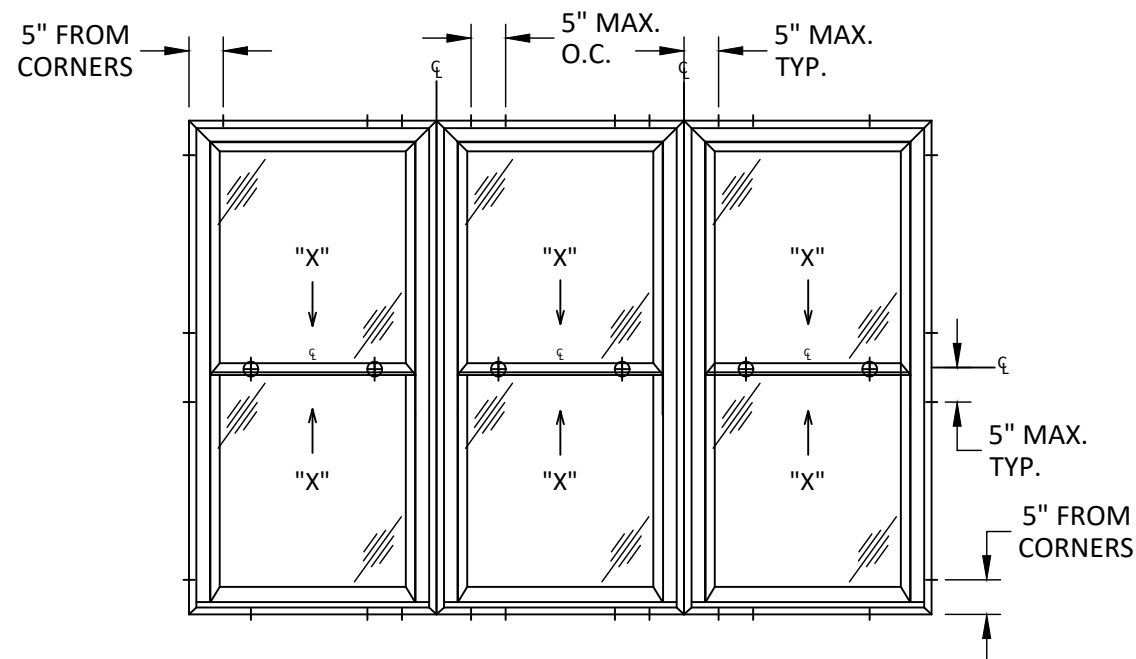

ANCHOR LAYOUT
THROUGH FRAME - DOUBLE HUNG
WINDOW

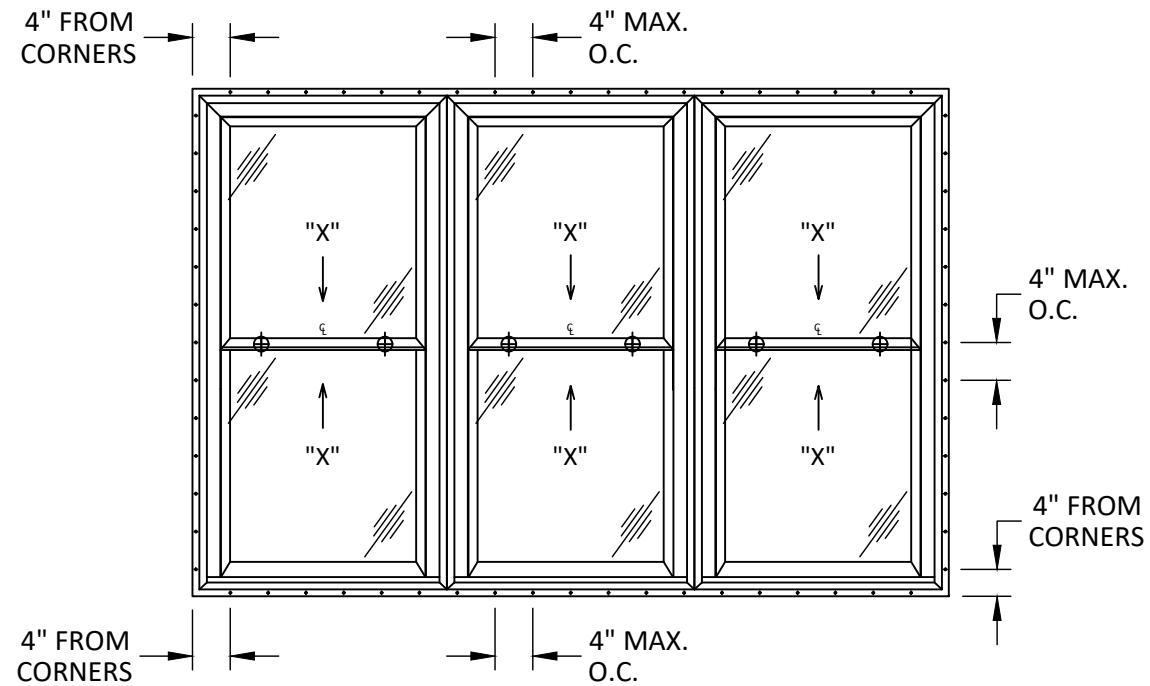

ANCHOR LAYOUT
NAIL FIN - DOUBLE HUNG WINDOW



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
STYLEVIEW/PRECEDENCE TRIPLE
DOUBLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
ELEVATION & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	05.01.24
REINFORCEMENT REV.	LS	05.27.26
2026 CODE CHANGE	SH	07.31.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

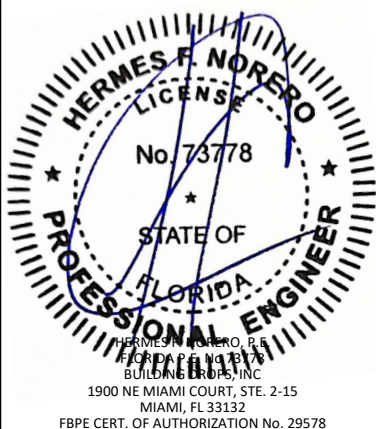

FL #:	FL7533
DATE:	03.09.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK260
SHEET:	2
REV.	D

7/31/2026 1:51 PM

c:\users\sebastianherrerero\desktop\ykk\res 2026 cc\17533\ykk260.dwg

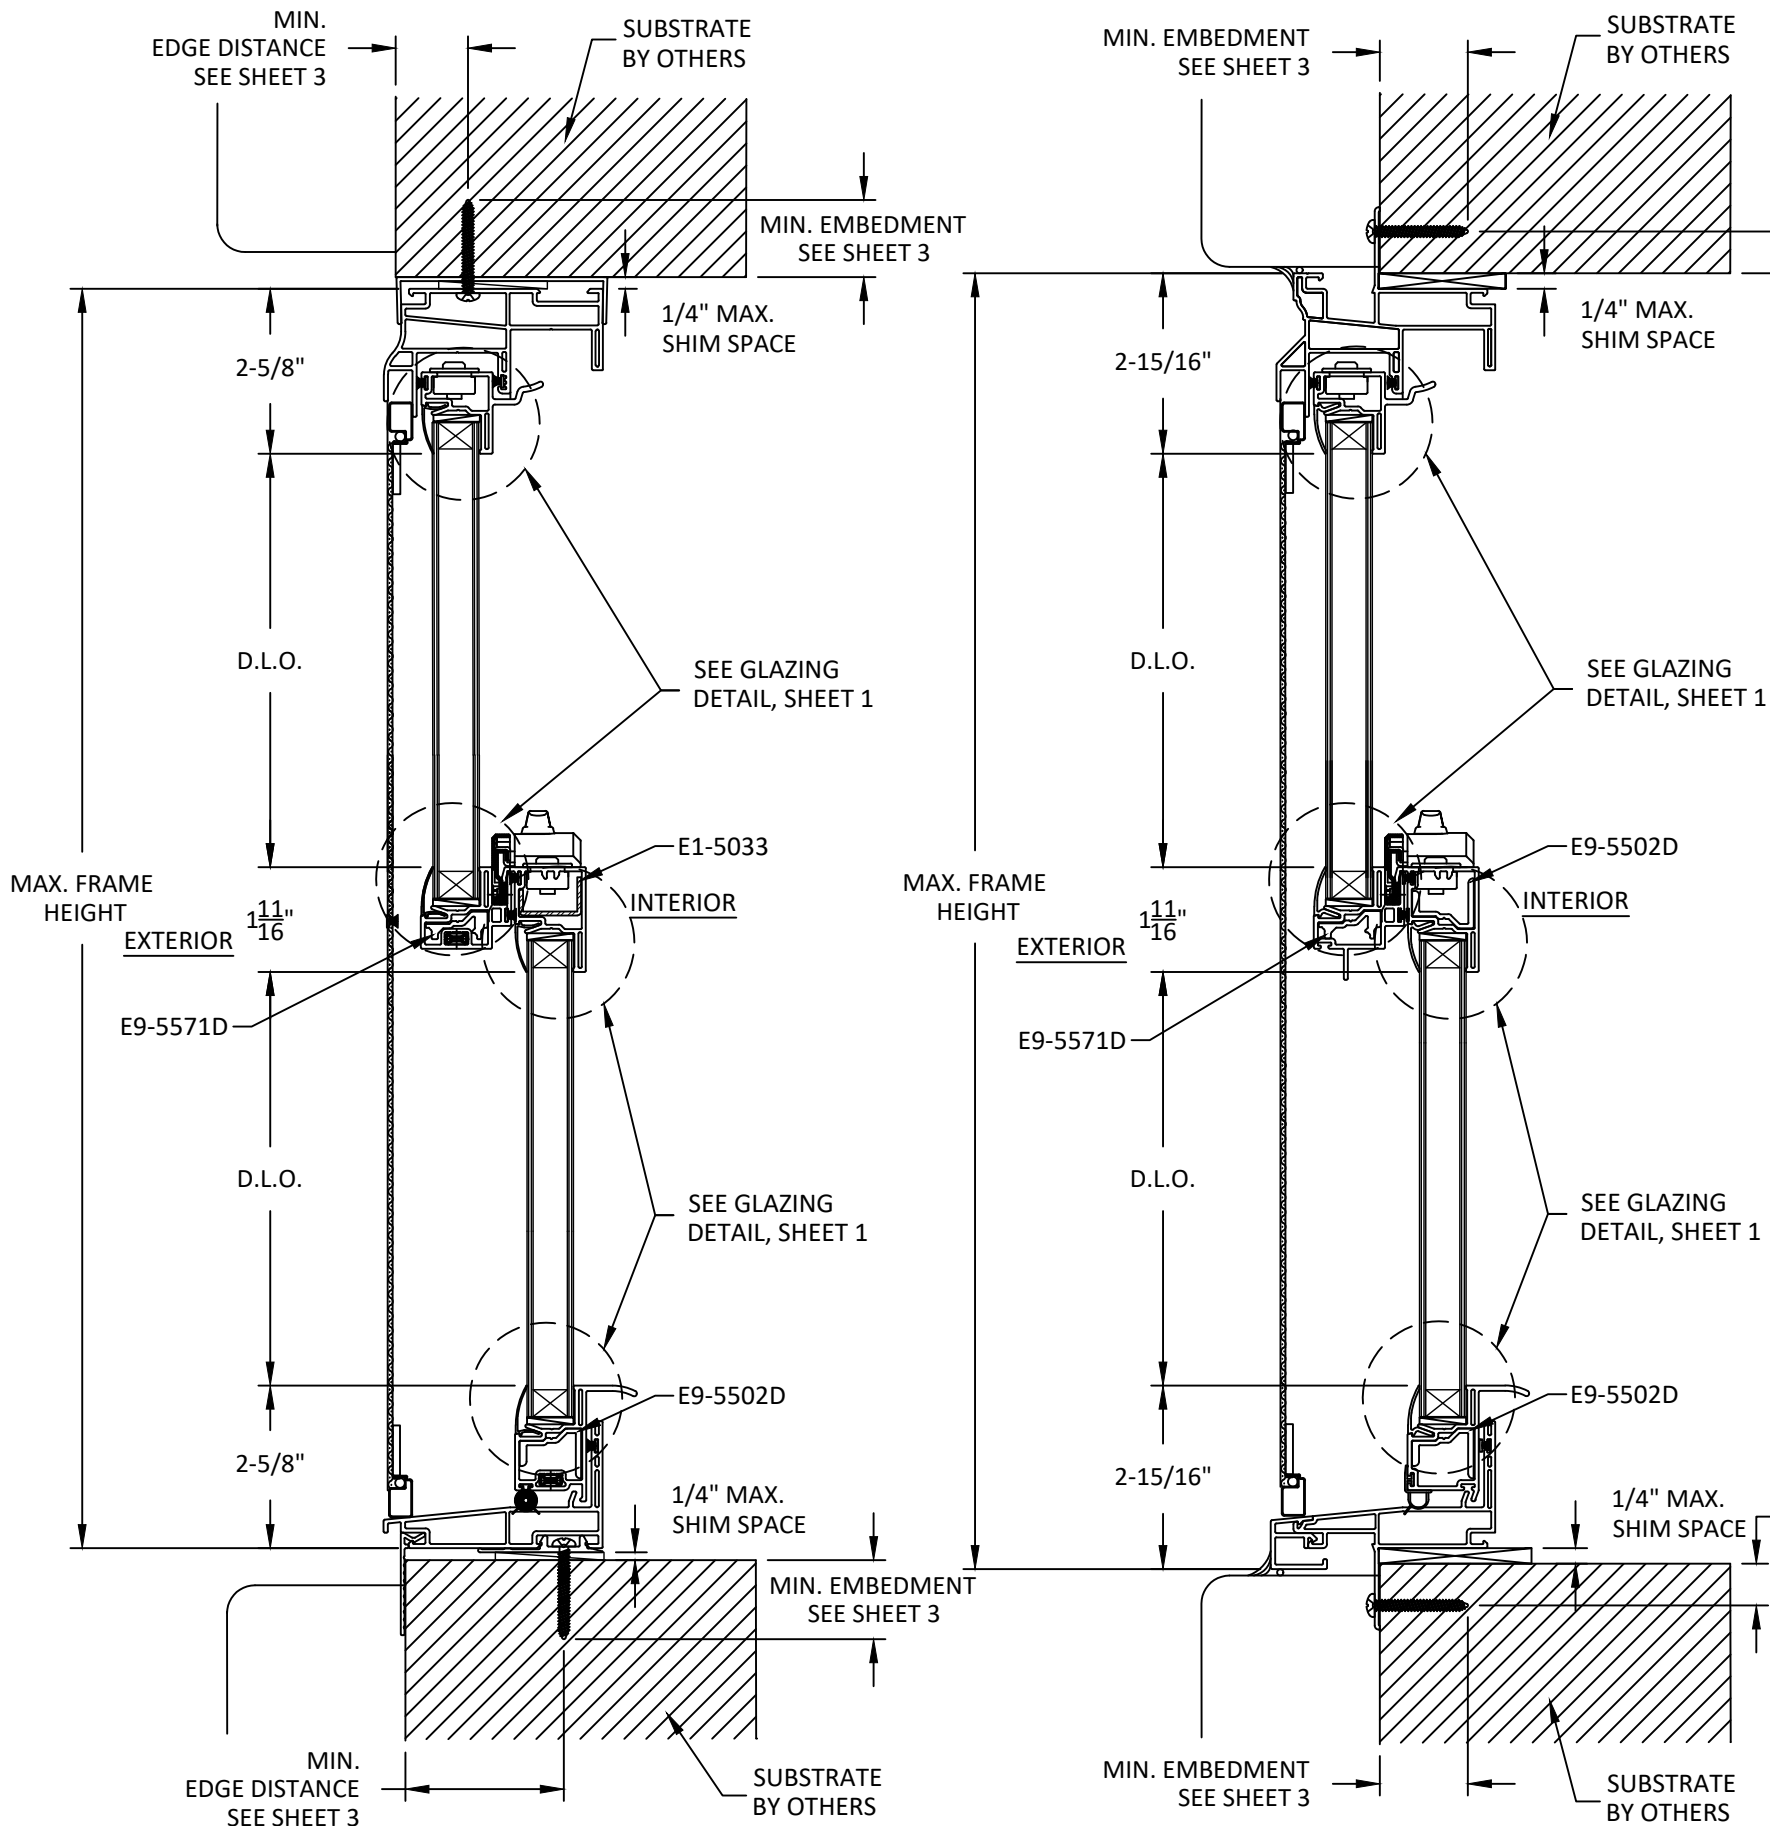

A
3

VERTICAL SECTION THROUGH FRAME

B
3

VERTICAL SECTION NAIL FIN

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#10 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"
	CONCRETE: fc= 3000 PSI	3/16" ITW TAPCON	1.25"	1.75"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.25"	1.75"
NAIL FIN	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#10 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE: STYLEVIEW/PRECEDENCE TRIPLE
DOUBLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
VERTICAL SECTIONS & ANCHOR SCHEDULE

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	05.01.24
REINFORCEMENT REV.	LS	05.27.26
2026 CODE CHANGE	SH	07.31.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

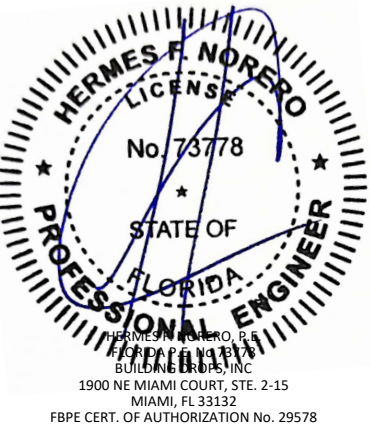

FL #:	FL7533
DATE:	03.09.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK260
SHEET:	3
REV.	D
OF 4	

7/31/2026 1:51 PM

c:\users\sebastianherrerero\desktop\ykk_res 2026 cc\47533\ykk260.dwg

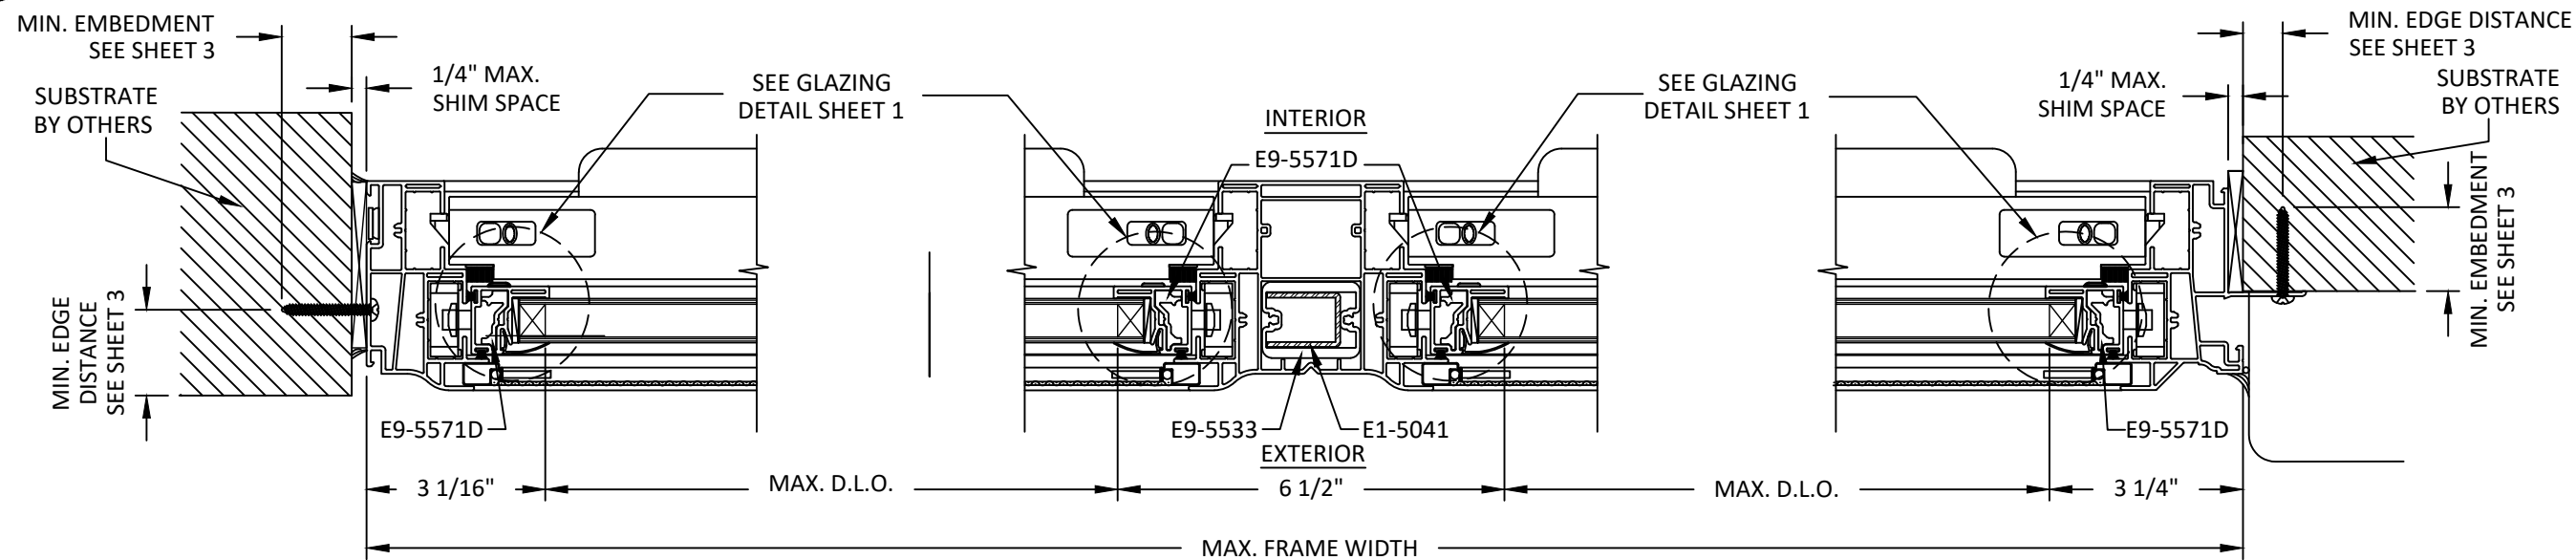

C
4

HORIZONTAL SECTION

UPPER VENT JAMB - THROUGH FRAME

D
4


HORIZONTAL SECTION

UPPER VENT MULLION

E
4

HORIZONTAL SECTION

UPPER VENT JAMB - NAIL FIN

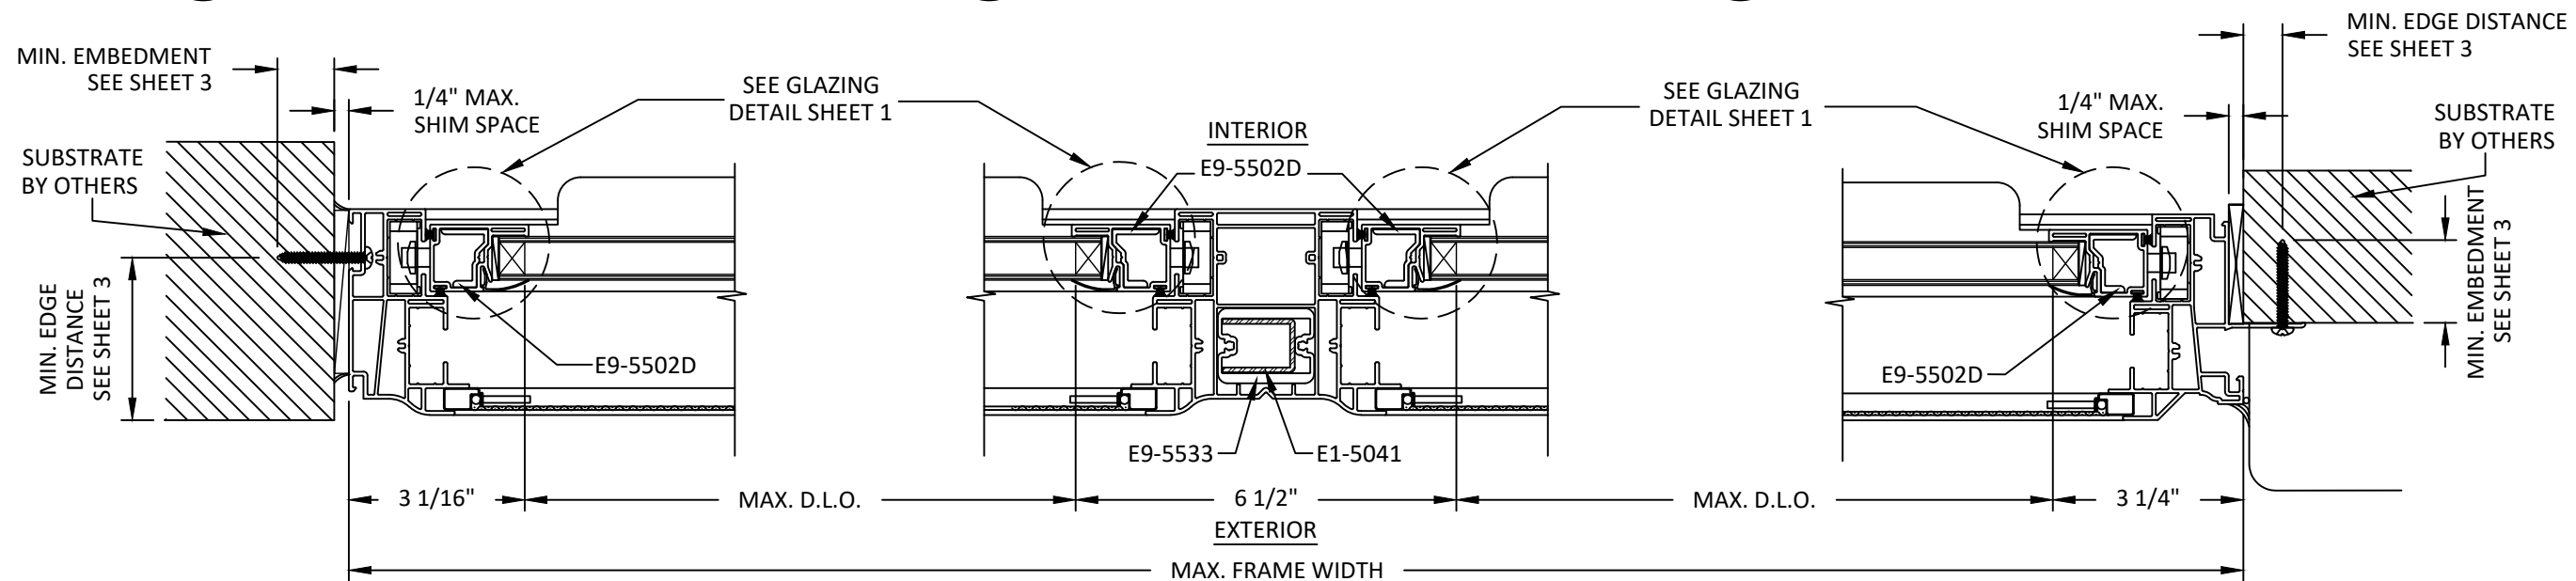

F
4

HORIZONTAL SECTION

LOWER VENT JAMB - THROUGH FRAME

G
4

HORIZONTAL SECTION

LOWER VENT MULLION

H
4

HORIZONTAL SECTION

LOWER VENT JAMB - NAIL FIN

REINFORCEMENT SCHEDULE		
UNIT	LOCATION	REINFORCEMENT PART#
1	MEETING RAIL (TOP SASH)	E9-5571D
	STILE (TOP SASH)	E9-5571D
	STILE (BOTTOM SASH)	E9-5502D
	MEETING RAIL (BOTTOM SASH)	E1-5033
2	MEETING RAIL (TOP SASH)	E9-5571D
	STILE (TOP SASH)	E9-5571D
	STILE (BOTTOM SASH)	E9-5502D
3	MEETING RAIL (TOP SASH)	E9-5571D
	MEETING RAIL (BOTTOM SASH)	E9-5502D
	STILE (TOP SASH)	E9-5571D
	STILE (BOTTOM SASH)	E9-5502D

MULLION REINFORCEMENT SCHEDULE		
UNIT SIZE	DESIGN PRESSURE	REINFORCEMENT PART#
107 1/2" X 71 1/2"	+/- 35 PSF	E9-5533
	+/- 35 PSF	E9-5533
119 1/2" X 73 1/2"	+/- 50 PSF	E9-5533
		E1-5041



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
STYLEVIEW/PRECEDENCE TRIPLE
DOUBLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)

HORIZONTAL SECTIONS & REINF. SCHEDULE


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	05.01.24
REINFORCEMENT REV.	LS	05.27.26
2026 CODE CHANGE	SH	07.31.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

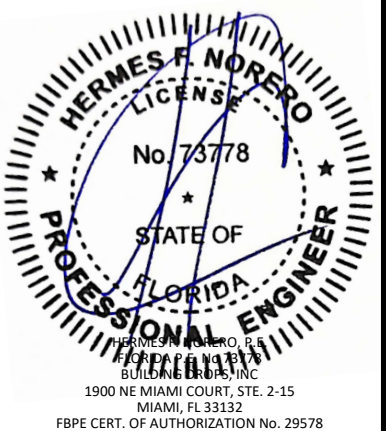

FL #:	FL7533
DATE:	03.09.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK260
SHEET:	4
REV.	D
OF 4	