

YKK AP AMERICA RESIDENTIAL

STYLEVIEW CLASSIC GEOMETRIC FIXED WINDOW


(NON-HVHZ) (NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-22
- ADEQUACY OF THE EXISTING STRUCTURAL 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 1 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATIONS & ANCHOR LAYOUTS
3	VERTICAL SECTION
4	HORIZONTAL SECTION
5	INSTALLATION NOTES & ANCHOR DETAILS

DESIGN PRESSURE RATING							
UNIT	MAX. FRAME SIZE		MAX. D.L.O. SIZE		DESIGN PRESSURE	CONFIGURATION	IMPACT RATING
	WIDTH	HEIGHT	WIDTH	HEIGHT			
1	71.5"	95.5"	67.5"	91.5"	+35/-35 PSF	"O"	NON-IMPACT
2	53.5"	83.5"	49.5"	79.5"	+50/-50 PSF	"O"	
3	79.5"	79.5"	75.5"	75.5"	+50/-50 PSF	"O"	

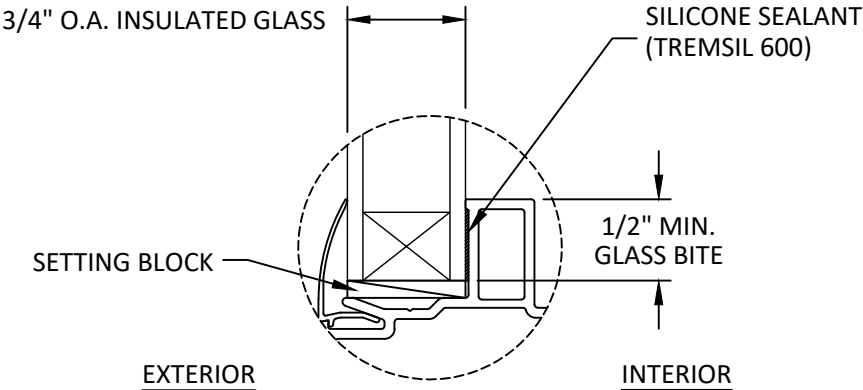

GLAZING DETAIL

GLAZING NOTES:

- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.



Quality
inspires™

YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
STYLEVIEW CLASSIC
GEOMETRIC FIXED WINDOW
(NON-HVHZ) (NON-IMPACT)

GENERAL NOTES &
GLAZING DETAIL


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
REVISED FRAME SIZES	DB	07/25
2026 CODE UPDATE	SH	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.08 11:01:11 -0400

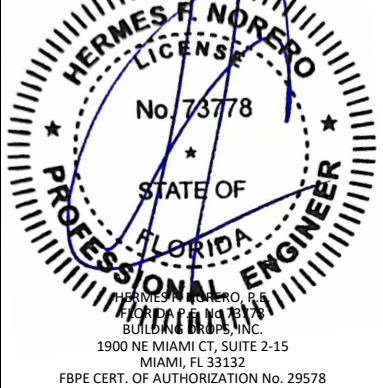

HERMES F. NORERO, P.E.
YKK AP AMERICA RESIDENTIAL
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL7829

DATE: **11.27.2023**

DWG. BY:
SH

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **YKK293**

SHEET:
1


REV.
B

OF 5


8/4/2026 8:44 AM
c:\users\sebastianherrerros\desktop\ykk_res_2026 cc\17829\ykk_293.dwg

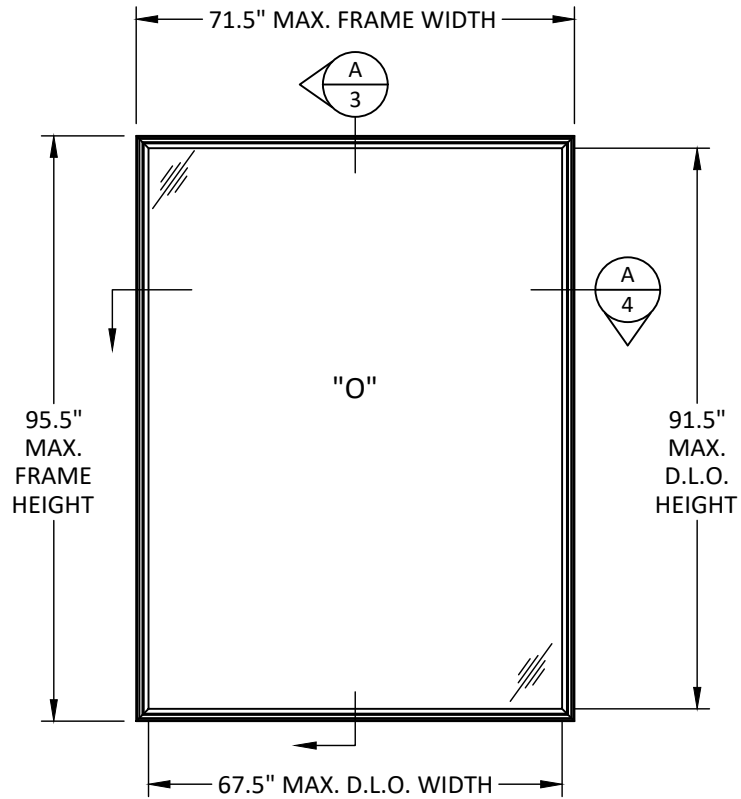


ELEVATION
UNIT 1

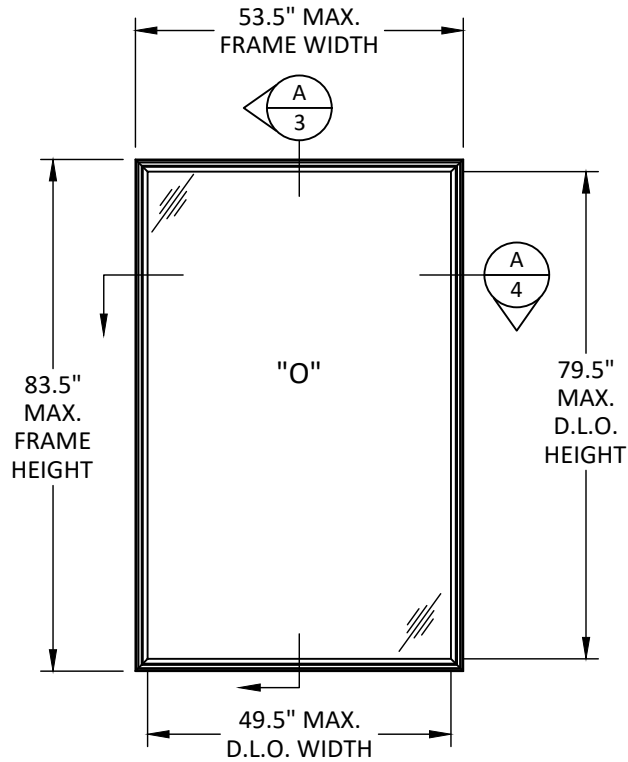


ELEVATION
UNIT 2

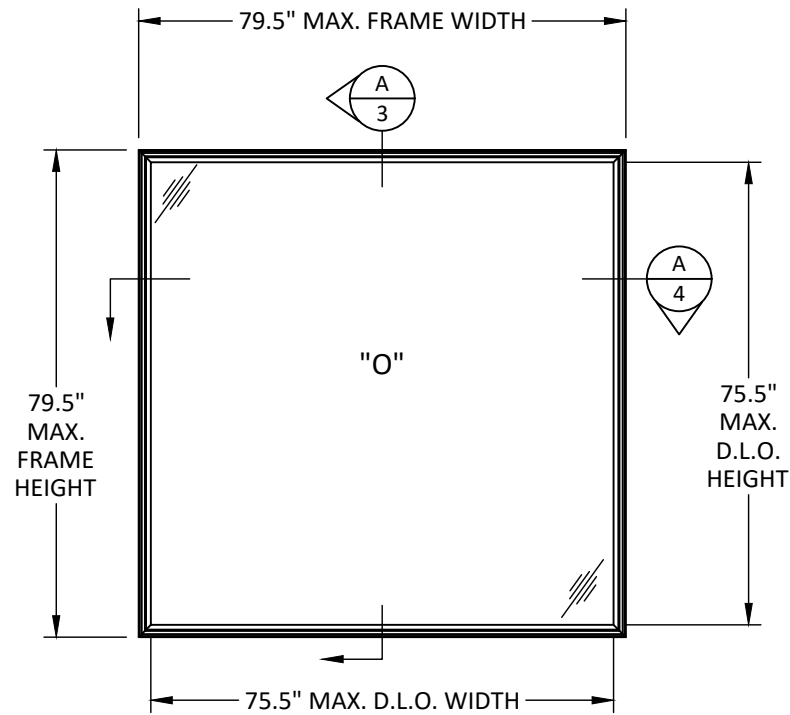


ELEVATION
UNIT 3

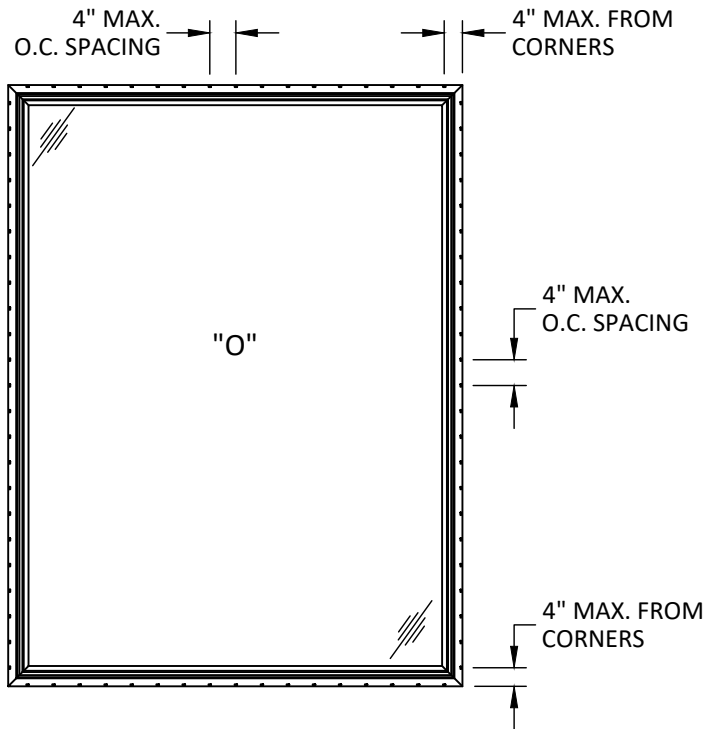

ANCHOR LAYOUT
NAIL FIN INSTALLATION
UNIT 1

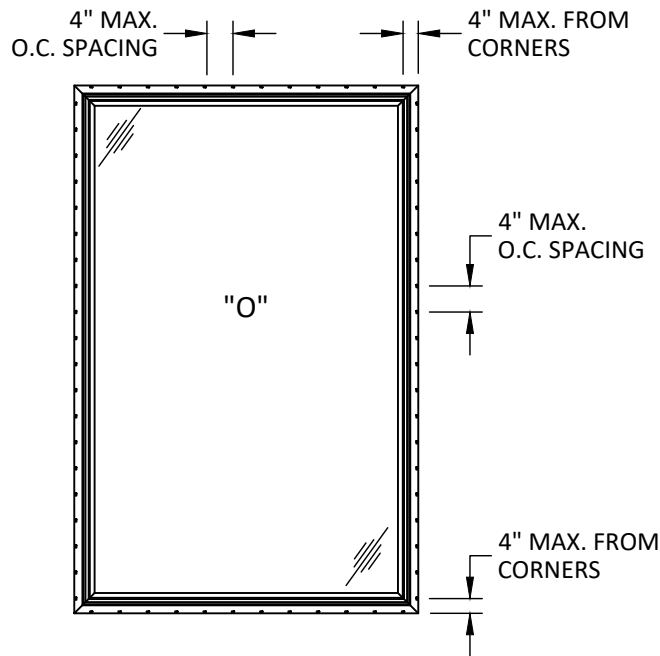

ANCHOR LAYOUT
NAIL FIN INSTALLATION
UNIT 2

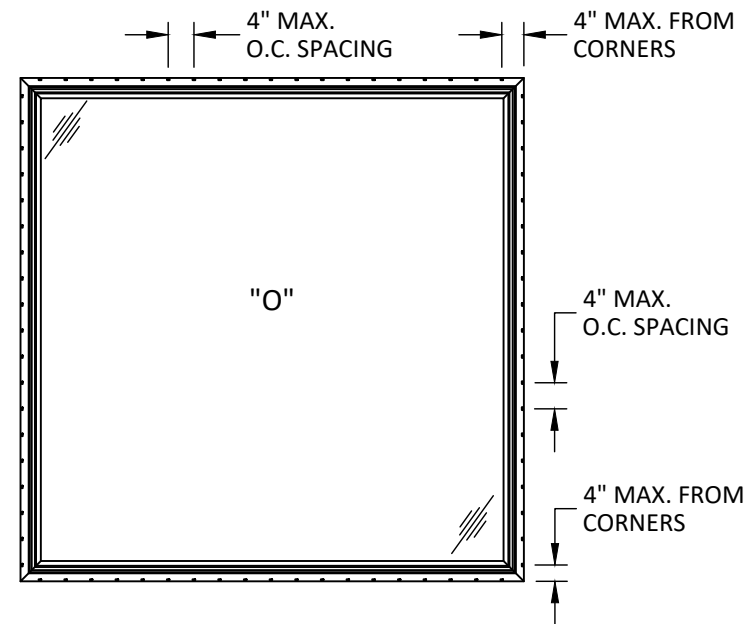

ANCHOR LAYOUT
NAIL FIN INSTALLATION
UNIT 3



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
STYLEVIEW CLASSIC
GEOMETRIC FIXED WINDOW
(NON-HVHZ) (NON-IMPACT)

**ELEVATIONS &
ANCHOR LAYOUTS**


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
REVISED FRAME SIZES	DB	07/25
2026 CODE UPDATE	SH	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

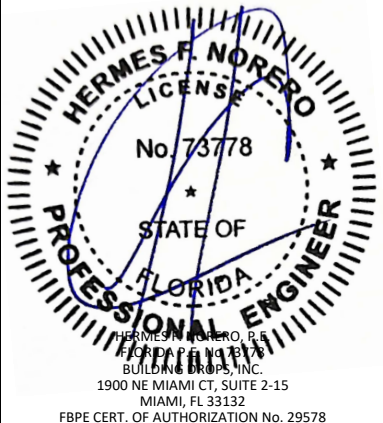

FL #:	FL7829
DATE:	11.27.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK293
SHEET:	2
REV.	B
OF 5	

c:\users\sebastianherrerros\desktop\ykk_res_2026 cc\17829\ykk_293.dwg 8/4/2026 8:44 AM

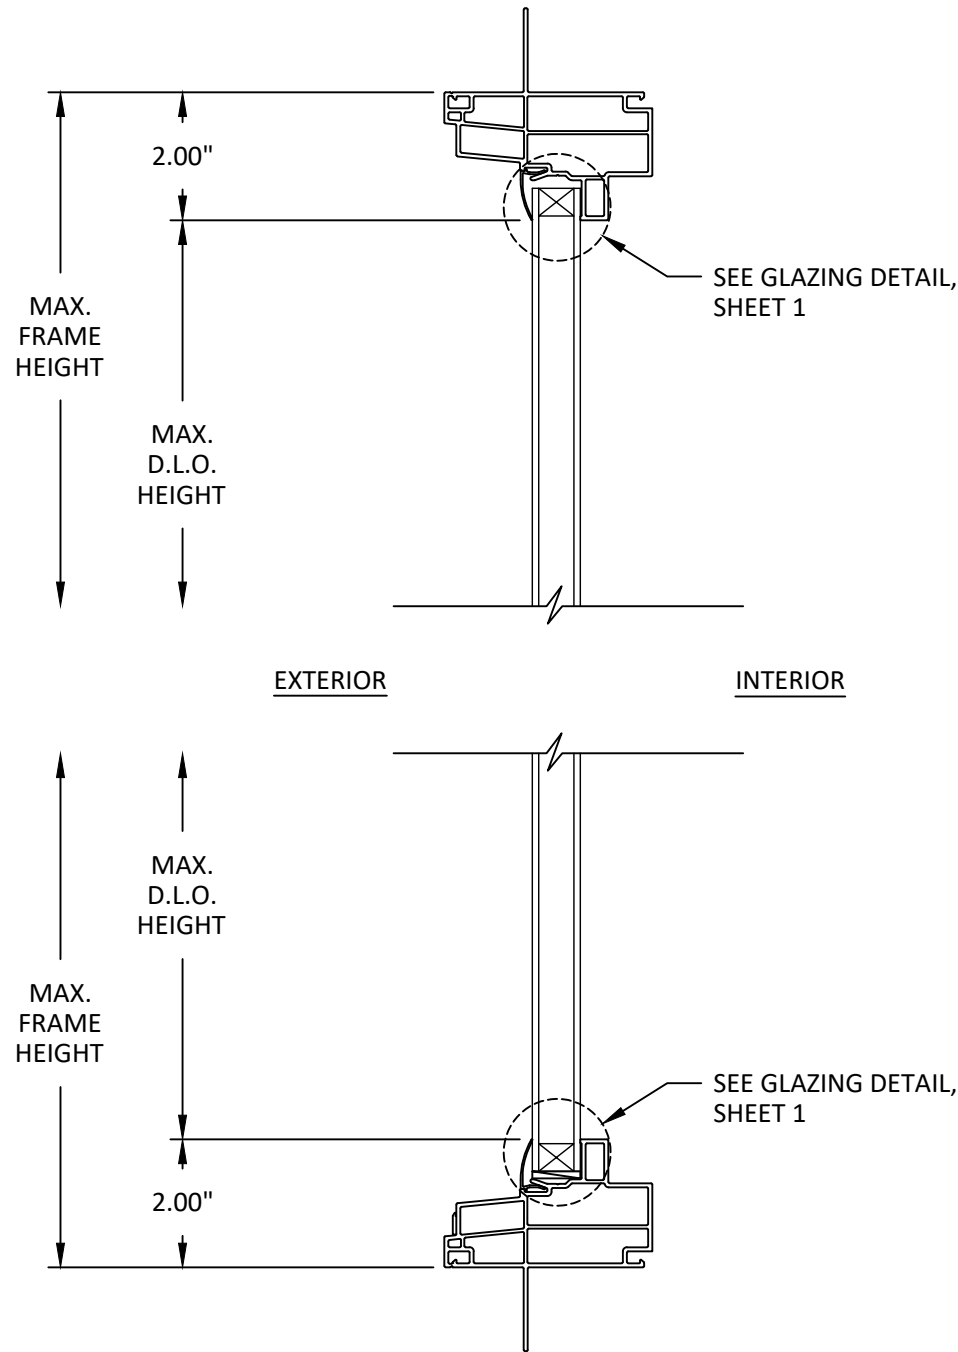

**A
3** VERTICAL SECTION



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEVIEW CLASSIC
GEOMETRIC FIXED WINDOW
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTION

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
REVISED FRAME SIZES	DB	07/25
2026 CODE UPDATE	SH	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:		FL7829	
DATE: 11.27.2023			
DWG. BY: SH		CHK. BY: HFN	
SCALE:		NTS	
DWG. #:		YKK293	
SHEET:		REV. B	
3			

c:\users\sebastianherrerros\desktop\ykk res 2026 cc\17829\ykk293.dwg 8/4/2026 8:44 AM

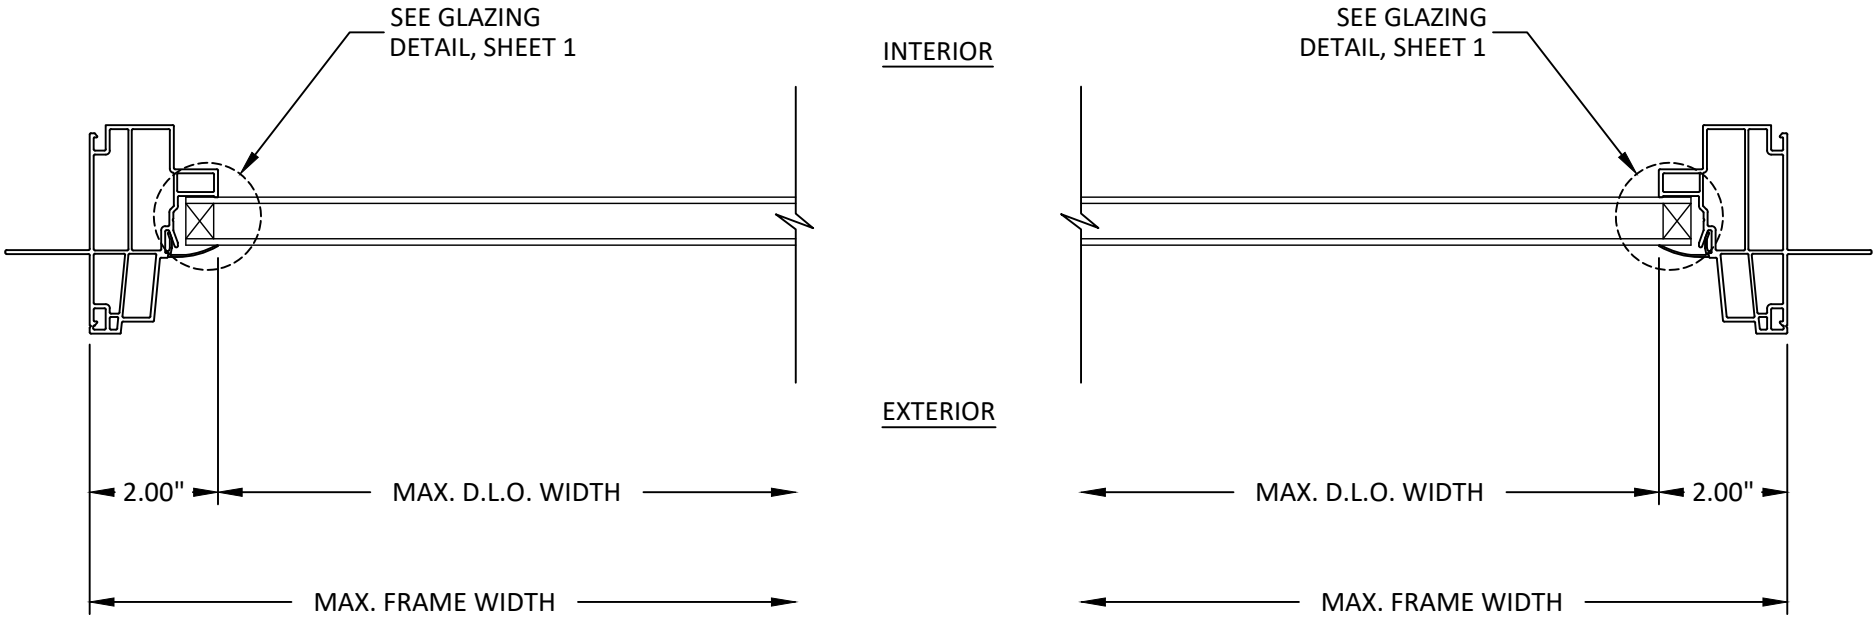

A
4 **HORIZONTAL SECTION**



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEVIEW CLASSIC
GEOMETRIC FIXED WINDOW
(NON-HVHZ) (NON-IMPACT)


HORIZONTAL SECTION

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
REVISED FRAME SIZES	DB	07/25
2026 CODE UPDATE	SH	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

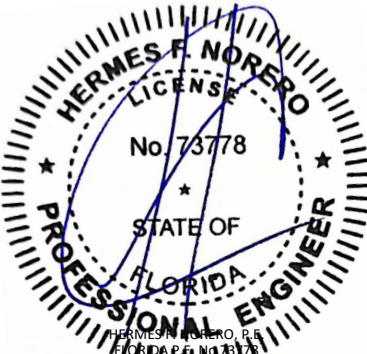

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL7829

DATE: **11.27.2023**

DWG. BY:

SH

CHK. BY:

HFN

SCALE: **NTS**

DWG. #: **YKK293**

SHEET:


4

REV.


B

OF 5


c:\users\sebastianhereros\desktop\ykk res 2026 cc\17829\ykk 293.dwg 8/4/2026 8:44 AM

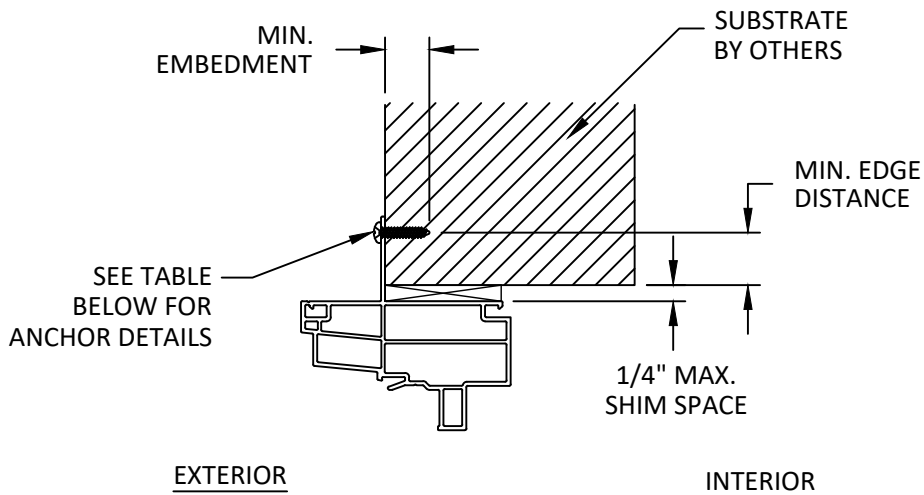

A
5 **ANCHOR DETAIL**
HEAD INSTALLATION

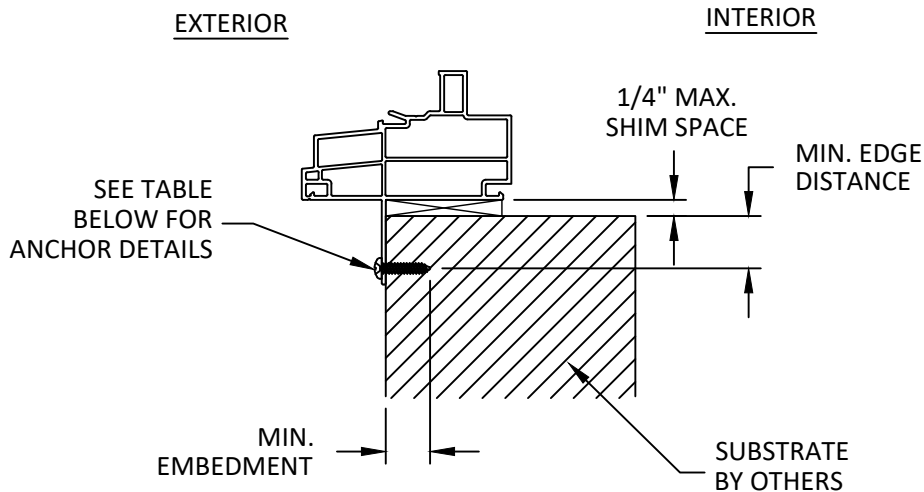

B
5 **ANCHOR DETAIL**
SILL INSTALLATION

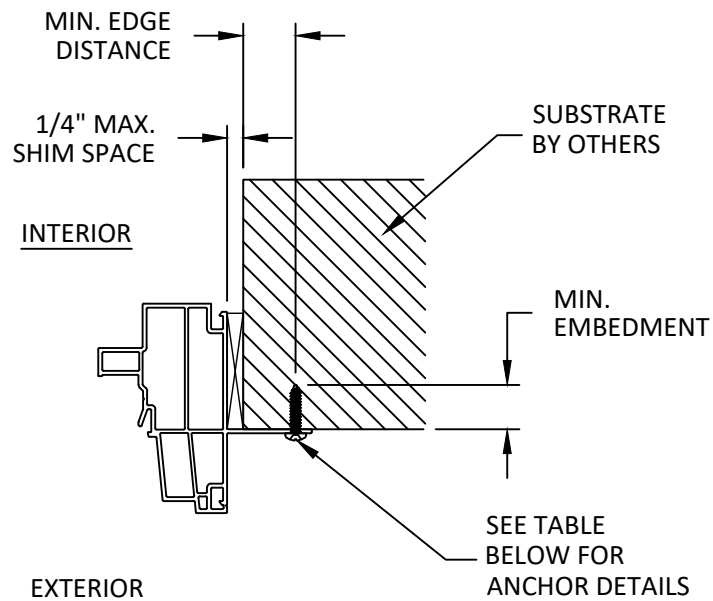

C
5 **ANCHOR DETAIL**
JAMB INSTALLATION

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 2.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED IN ORDER TO ACHIEVE SQUARE AND PLUMB INSTALLATION WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEVIEW CLASSIC
GEOMETRIC FIXED WINDOW
(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES
& ANCHOR DETAILS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
REVISED FRAME SIZES	DB	07/25
2026 CODE UPDATE	SH	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:		FL7829
DATE:		11.27.2023
DWG. BY:	CHK. BY:	
SH	HFN	
SCALE:		NTS
DWG. #:		YKK293
SHEET:		5
REV.		B
		OF 5