

DOOR HEIGHT	SECTION QUANTITY	STRUT QUANTITY	TRACK BRACKETS PER SIDE
6'-0" to 7'-0"	4	5	2
7'-6" to 8'-9"	5	6	3
9'-0" to 9'-3"	6	7	3
9'-6" to 10'-6"	6	7	4
10'-9" to 11'-6"	7	8	4
11'-9" to 12'-3"	7	8	5
12'-6" to 14'-0"	8	9	5

NOTE: MAXIMUM DOOR HEIGHT IS 14'. DETAIL VIEWS SHOWN ON SHEET 2. CONSULT SHEET 3 FOR STRUT PLACEMENT.


MODEL NUMBERS AVAILABLE
3600 SERIES
3700 SERIES

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED




Digitally signed by John E Scates
Date: 2026.02.13 10:50:58 -08'00'

JOHN E. SCATES, PE
8811 TEEL PARKWAY STE 100-5175
FRISCO, TX 75036-4428
FL PE 51737
TX PE 56308 / F-2203

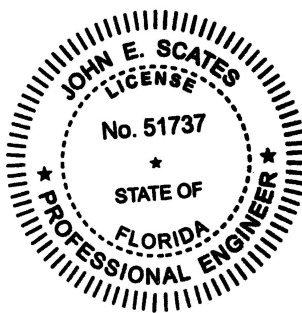


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

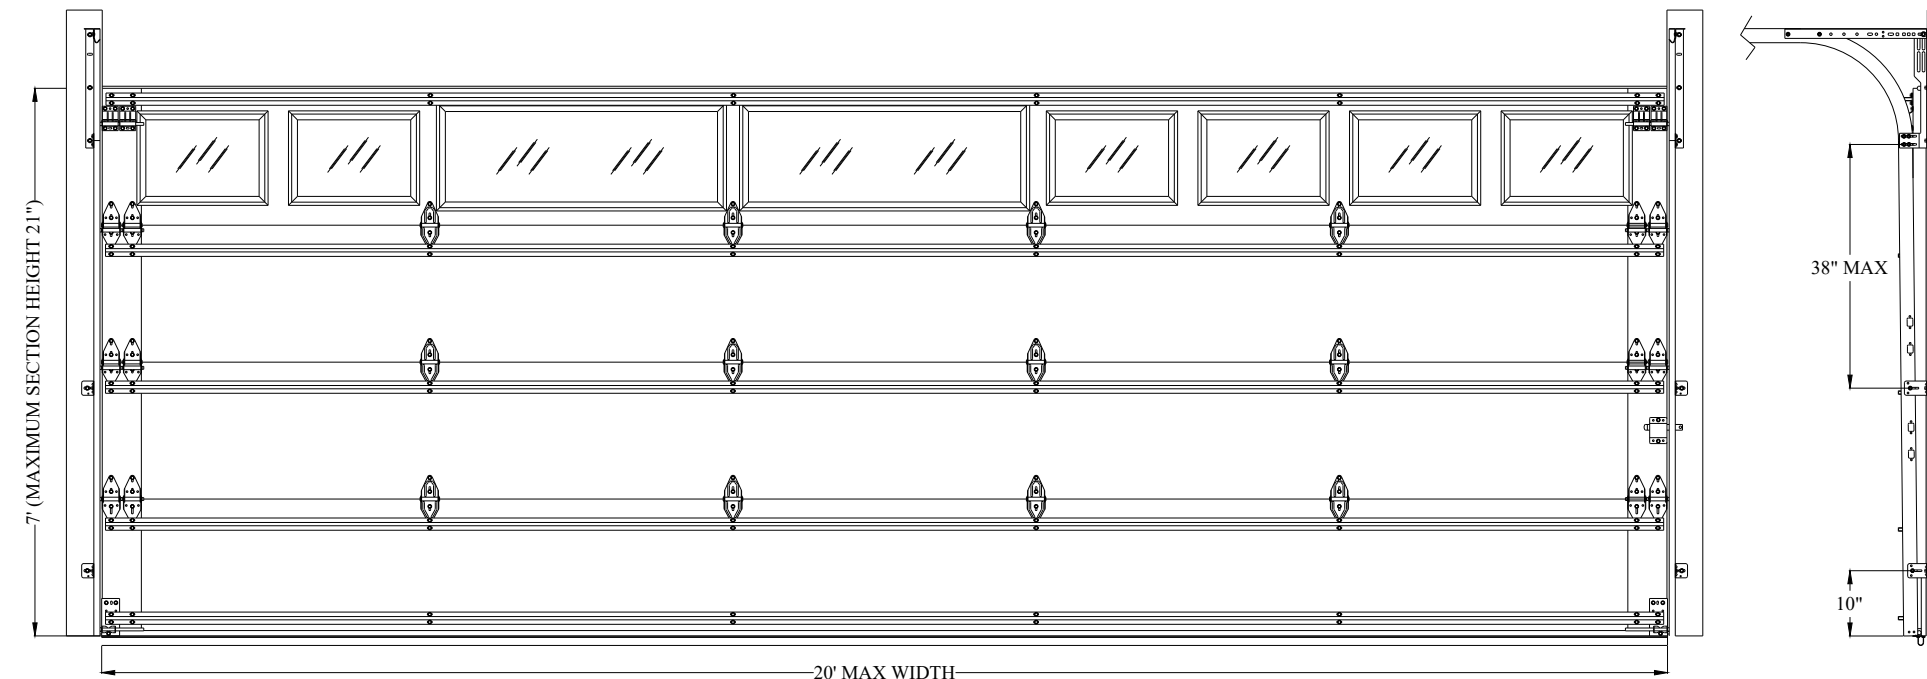

GENERAL NOTES:


- THIS PRODUCT HAS BEEN EVALUATED PER ANSI/DASMA 108.
- THIS DRAWING PROVIDES WIND LOAD ASSEMBLY DETAILS FOR THE CLAIMED SIZE AND PRESSURES.

MAX SIZE: 20' X 14' DESIGN PRESSURE: +12.7/-14.1 PSF	doorLink MANUFACTURING, INC.*	DESCRIPTION: WIND LOAD RATED RESIDENTIAL SANDWICH SECTIONAL GARAGE DOOR 20' WIDE 3600/3700 SERIES DOORS			
	5700 NW 39TH STREET RIVERSIDE, MO 64150	DRAWING NUMBER: RS20A_12.7_14.1		REV: 00	
		DRAWN BY: DMK		DATE DRAWN: 2/2/2026	REV DATE: 2/2/2026
		SIZE: ANSI A		SCALE: NTS	SHEET: 1 of 3




END HINGE
14 GAUGE GALVANIZED STEEL DOUBLE END HINGE ATTACHED WITH FOUR 1/4" X 5/8" SELF-TAPPING SCREWS.


ROLLER
MINIMUM NYLON NON-BALL BEARING ROLLER OR 7 BALL STEEL ROLLER WITH 4" STEM.



CENTER HINGE
18 GAUGE GALVANIZED HINGE ATTACHED WITH FOUR 1/4" X 5/8" SELF-TAPPING SCREWS.




TOP FIXTURE
16 GAUGE GALVANIZED STEEL TOP FIXTURE WITH TWO BOLT ROLLER CARRIER AND ATTACHED TO DOOR WITH FOUR 1/4" X 5/8" SELF-TAPPING SCREWS.

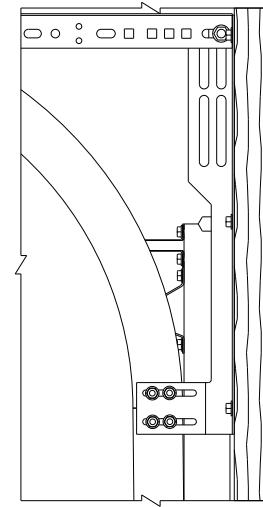

FLAG BRACKET
12 GAUGE GALVANIZED STEEL FLAG BRACKET ATTACHED TO WOOD JAMB WITH THREE 5/16" X 1-5/8" WOOD LAG SCREWS AND TO THE HORIZONTAL AND VERTICAL TRACKS WITH TWO 1/4" X 3/4" TRACK BOLTS AND NUTS EACH.

HORIZONTAL TRACK AND ANGLE
HORIZONTAL TRACK AND ANGLE TO SUIT WITH SUITABLE BACK HANG.


VERTICAL TRACK
2" GALVANIZED STEEL TRACK WITH A MINIMUM THICKNESS OF .045".

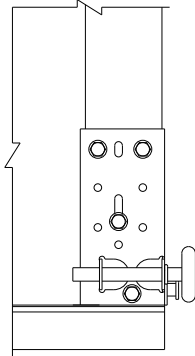

END CAP
20 GAUGE GALVANIZED STEEL END CAP ATTACHED WITH ONE SHEET METAL SCREW.

BOTTOM BRACKET
13 GAUGE GALVANIZED STEEL BOTTOM BRACKET ATTACHED WITH FOUR 1/4" X 5/8" SELF-TAPPING SCREWS.


BOTTOM WEATHERSTRIP
ALUMINUM EXTRUSION WITH VINYL INSERT.



LOCKING MECHANISM
DOOR MUST HAVE A LOCKING DEVICES INSTALLED THAT ENGAGES THE VERTICAL TRACK (INSIDE SLIDE LOCK SHOWN, OTHER LOCKBAR TYPES PERMITTED).

STOP MOLDING

STOP MOLDING (ATTACHED WITH MINIMUM 6D HEADED NAILS OR SCREWS) IS REQUIRED, OR DOOR MUST OVERLAP JAMBS BY 5/16". MAXIMUM 12" NAIL SPACING.






TRACK BRACKETS
2 1/4" WIDE X 12 GAUGE GALVANIZED STEEL TRACK BRACKET ATTACHED TO WOOD JAMB WITH ONE 5/16" X 1 5/8" WOOD LAG SCREW AND TO VERTICAL TRACK WITH ONE 1/4" X 3/4" TRACK BOLT AND NUT .
NOTE: CENTER DISTANCE BETWEEN TRACK BRACKETS NOT TO EXCEED 38".

WOOD JAMBS


VERTICAL JAMBS ARE TO BE 2X6 #2 SPF OR BETTER. REFER TO DASMA TDS 161 OR A LICENSED DESIGN PROFESSIONAL FOR JAMB CONFIGURATIONS.
NOTE: PREPARATION OF JAMBS BY OTHERS, AND SUPPORTING STRUCTURAL ELEMENTS MUST BE CAPABLE OF WITHSTANDING THE RATED WIND LOAD.

DRYWALL PRESENT

IF INTERIOR DRYWALL IS PRESENT AT THE OPENING, THREE OPTIONS EXIST:
(1) DRYWALL CAN BE CUT AWAY FROM THE DOOR OPENING TO ACCOMMODATE DIRECT TO STRUCTURE MOUNTING.
(2) IF DRYWALL IS NOT CUT AWAY, A 2X6 #2 SPF OR BETTER WOOD BUCK SHALL BE INSTALLED OVER THE DRYWALL. HOWEVER, THE FASTENERS FOR THE WOOD BUCK SHOULD BE OF INCREASED LENGTH TO ACCOUNT FOR THE THICKNESS OF THE DRYWALL TO ENSURE CORRECT EMBEDMENT INTO THE STRUCTURAL FRAMING MEMBER. IF MOUNTING TO WOOD, 3/8" X (3"+ DW THICKNESS) LAG SCREWS ON 24" CENTERS W/ 1-1/8" OD WASHER. LAG SCREWS MAY BE COUNTERSUNK (NOT REQUIRED) TO PROVIDE A FLUSH MOUNTING SERVICE. PLEASE REFERENCE DASMA TDS #164.
(3) IF MOUNTING DIRECT TO WALLBOARD, THE TRACK FASTENER MUST BE OF INCREASED LENGTH TO ACCOUNT FOR THE THICKNESS OF THE WALLBOARD, AND CARE SHOULD BE TAKEN TO NOT CRUSH THE WALLBOARD DURING INSTALLATION.

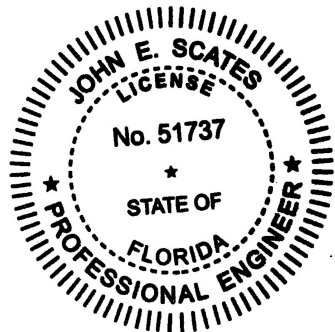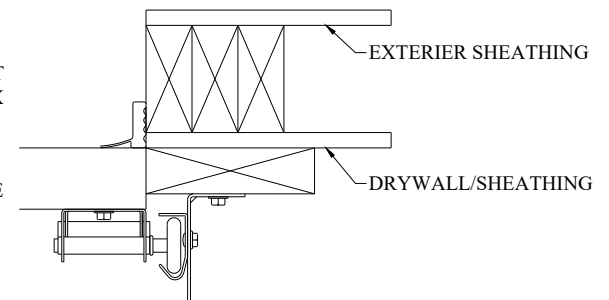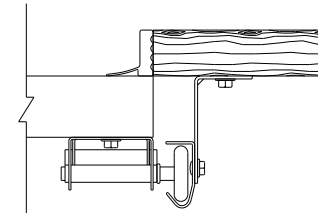


MAX SIZE: 20' X 14' DESIGN PRESSURE: +12.7/-14.1 PSF	 MANUFACTURING, INC.	DESCRIPTION: WIND LOAD RATED RESIDENTIAL SANDWICH SECTIONAL GARAGE DOOR 20' WIDE 3600/3700 SERIES DOORS		
		DRAWING NUMBER: RS20A_12.7_14.1		REV: 00
		DRAWN BY: DMK	DATE DRAWN: 2/2/2026	REV DATE: 2/2/2026
		SIZE: ANSI A	SCALE: NTS	SHEET: 2 of 3





WINDOWS (OPTIONAL)
WINDOWS AVAILABLE IN SIZES LISTED
BELOW. FRAMES ARE MOLDED PLASTIC.


FRAME	MAX DAYLIGHT OPENING	FASTENER PATTERN	GLAZING TYPES
SHORT	17-3/16" X 11-9/16"	#8-5/8" (14) TOTAL, (4) ALONG EACH HORIZONTAL EDGE & (3) ALONG EACH VERTICAL EDGE	1/8" DSB ANNEALED, 1/8" DSB TEMPERED, 0.100" POLYCARBONATE, OR 1/2" IG CONSISTING OF TWO PIECES OF ANNEALED OR TEMPERED GLASS WITH 1/4" SPACER
RANCH	36-13/16" X 10-1/4"	#8-5/8" (18) TOTAL, (6) ALONG EACH HORIZONTAL EDGE & (3) ALONG EACH VERTICAL EDGE	1/8" DSB ANNEALED, 1/8" DSB TEMPERED, 0.100" POLYCARBONATE, OR 1/2" IG CONSISTING OF TWO PIECES OF ANNEALED OR TEMPERED GLASS WITH 1/4" SPACER
4216/ 4416	41-3/4" X 13-7/8"	#8-5/8" (20) TOTAL, (7) ALONG EACH HORIZONTAL EDGE & (3) ALONG EACH VERTICAL EDGE	1/8" DSB ANNEALED, 1/8" DSB TEMPERED, OR 0.100" POLYCARBONATE
0741	38" X 4"	#8-1-3/4" (14) TOTAL, (5) ALONG EACH HORIZONTAL EDGE & (2) ALONG EACH VERTICAL EDGE	1/8" DSB ANNEALED, 1/8" DSB TEMPERED, 0.100" POLYCARBONATE, OR 1/2" IG CONSISTING OF TWO PIECES OF ANNEALED OR TEMPERED GLASS WITH 1/4" SPACER

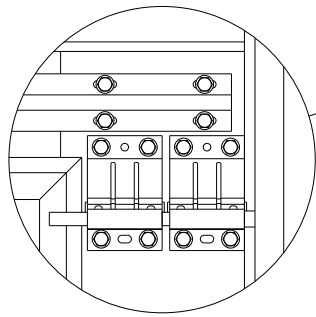


STRUT INSTALLED ABOVE
TOP FIXTURE

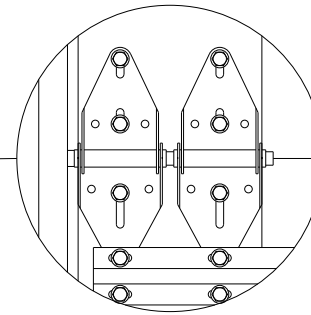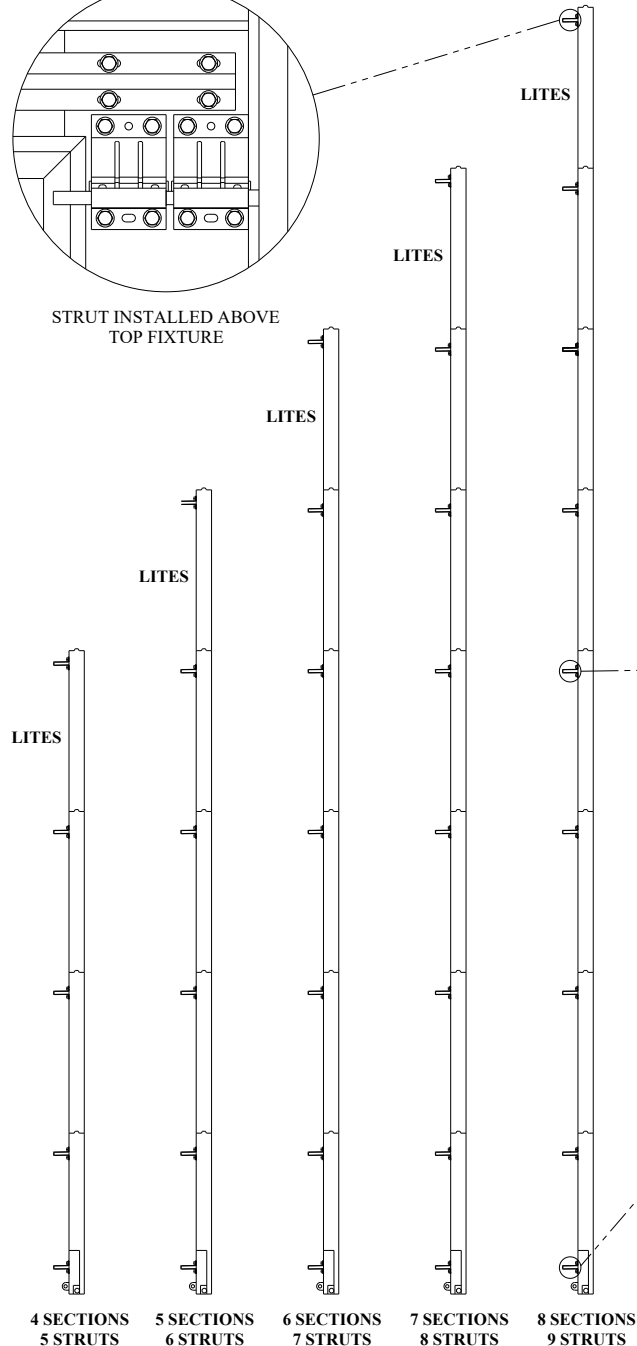


STRUT INSTALLED OVER
BOTTOM HALF OF HINGE

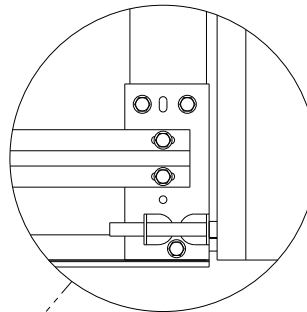

STRUT INSTALLED OVER
BOTTOM FIXTURE.



STRUTS
3" X 1 7/8" 20 GAUGE
50 KSI HAT STRUT ATTACHED
WITH TWO 1/4" X 5/8"
SELF-TAPPING SCREWS PER
STILE.

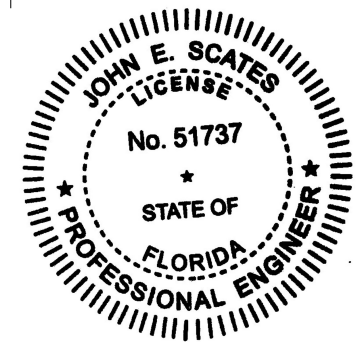

MAX SIZE: 20' X 14' DESIGN PRESSURE: +12.7/-14.1 PSF	 MANUFACTURING, INC.	DESCRIPTION: WIND LOAD RATED RESIDENTIAL SANDWICH SECTIONAL GARAGE DOOR 20' WIDE 3600/3700 SERIES DOORS		
		DRAWING NUMBER: RS20A_12.7_14.1		REV: 00
		DRAWN BY: DMK	DATE DRAWN: 2/2/2026	REV DATE: 2/2/2026
		SIZE: ANSI A	SCALE: NTS	SHEET: 3 of 3